


Warning: PDF designed for A4 colour print only with no page scaling

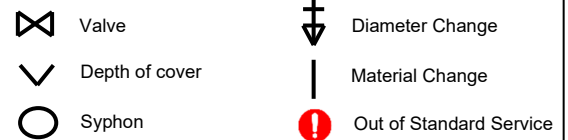

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:6662 (When plotted at A4)

1

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS


View extent: 100m, 100m

IMPORTANT NOTICES


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.





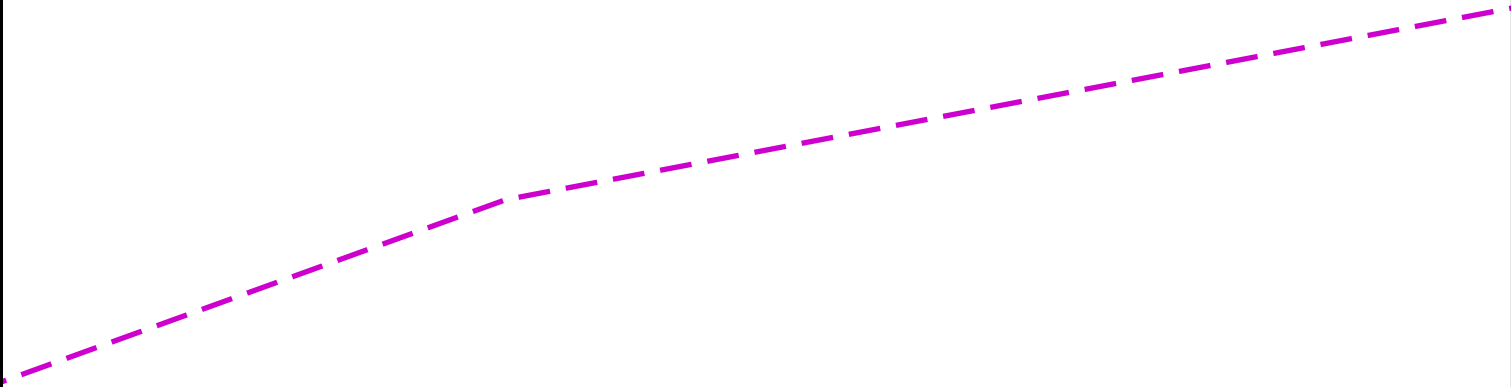

In case of emergency call - 0800 111 999

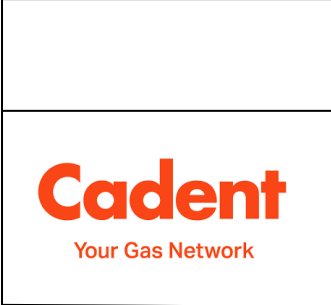





Scale: 1:500 (When plotted at A4)



Warning: PDF designed for A4 colour print only with no page scaling



- Dig Sites Area:  Line: 
-  LP Mains
 -  MP Mains
 -  IP Mains
 -  LHP Mains


-  Valve
-  Depth of cover
-  Syphon
-  Diameter Change
-  Material Change
-  Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

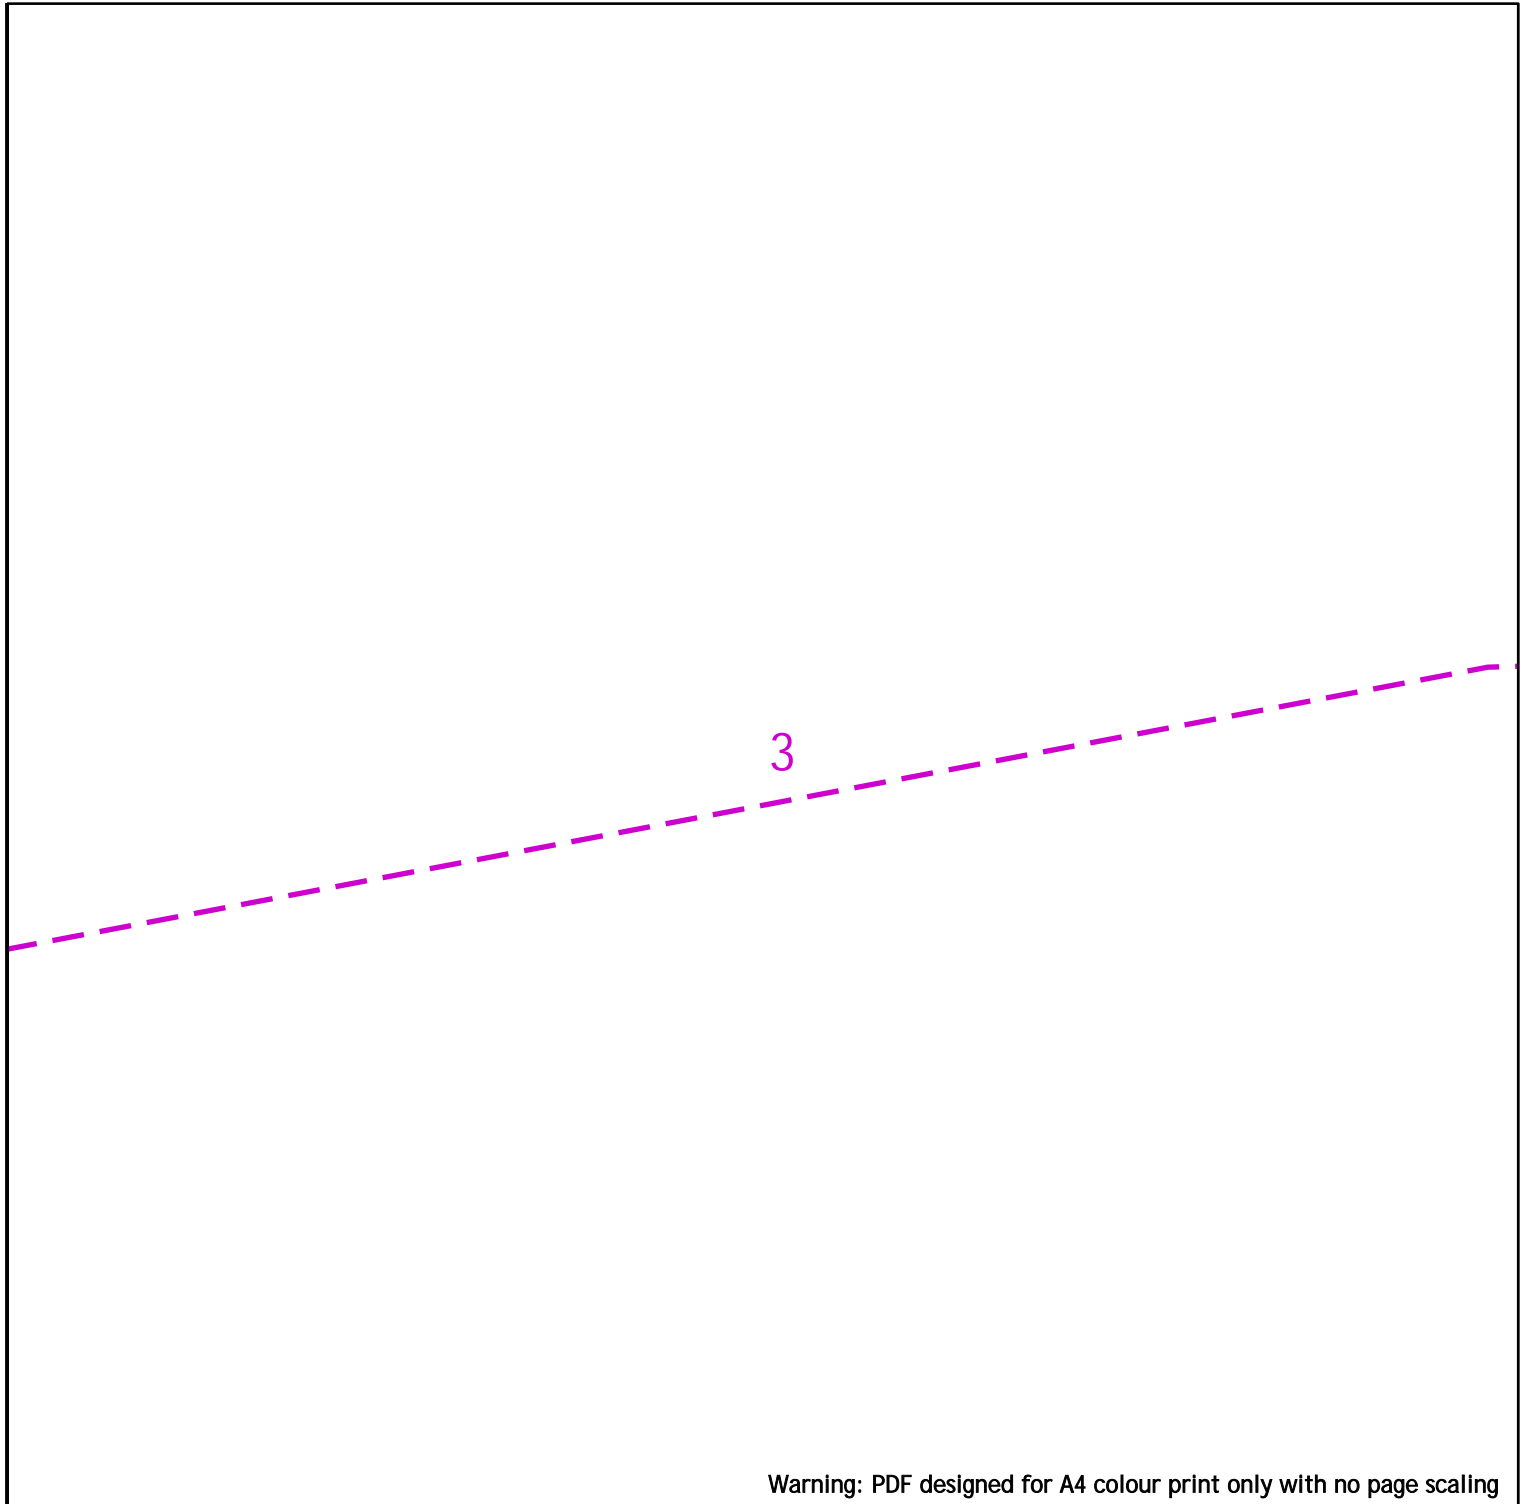

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

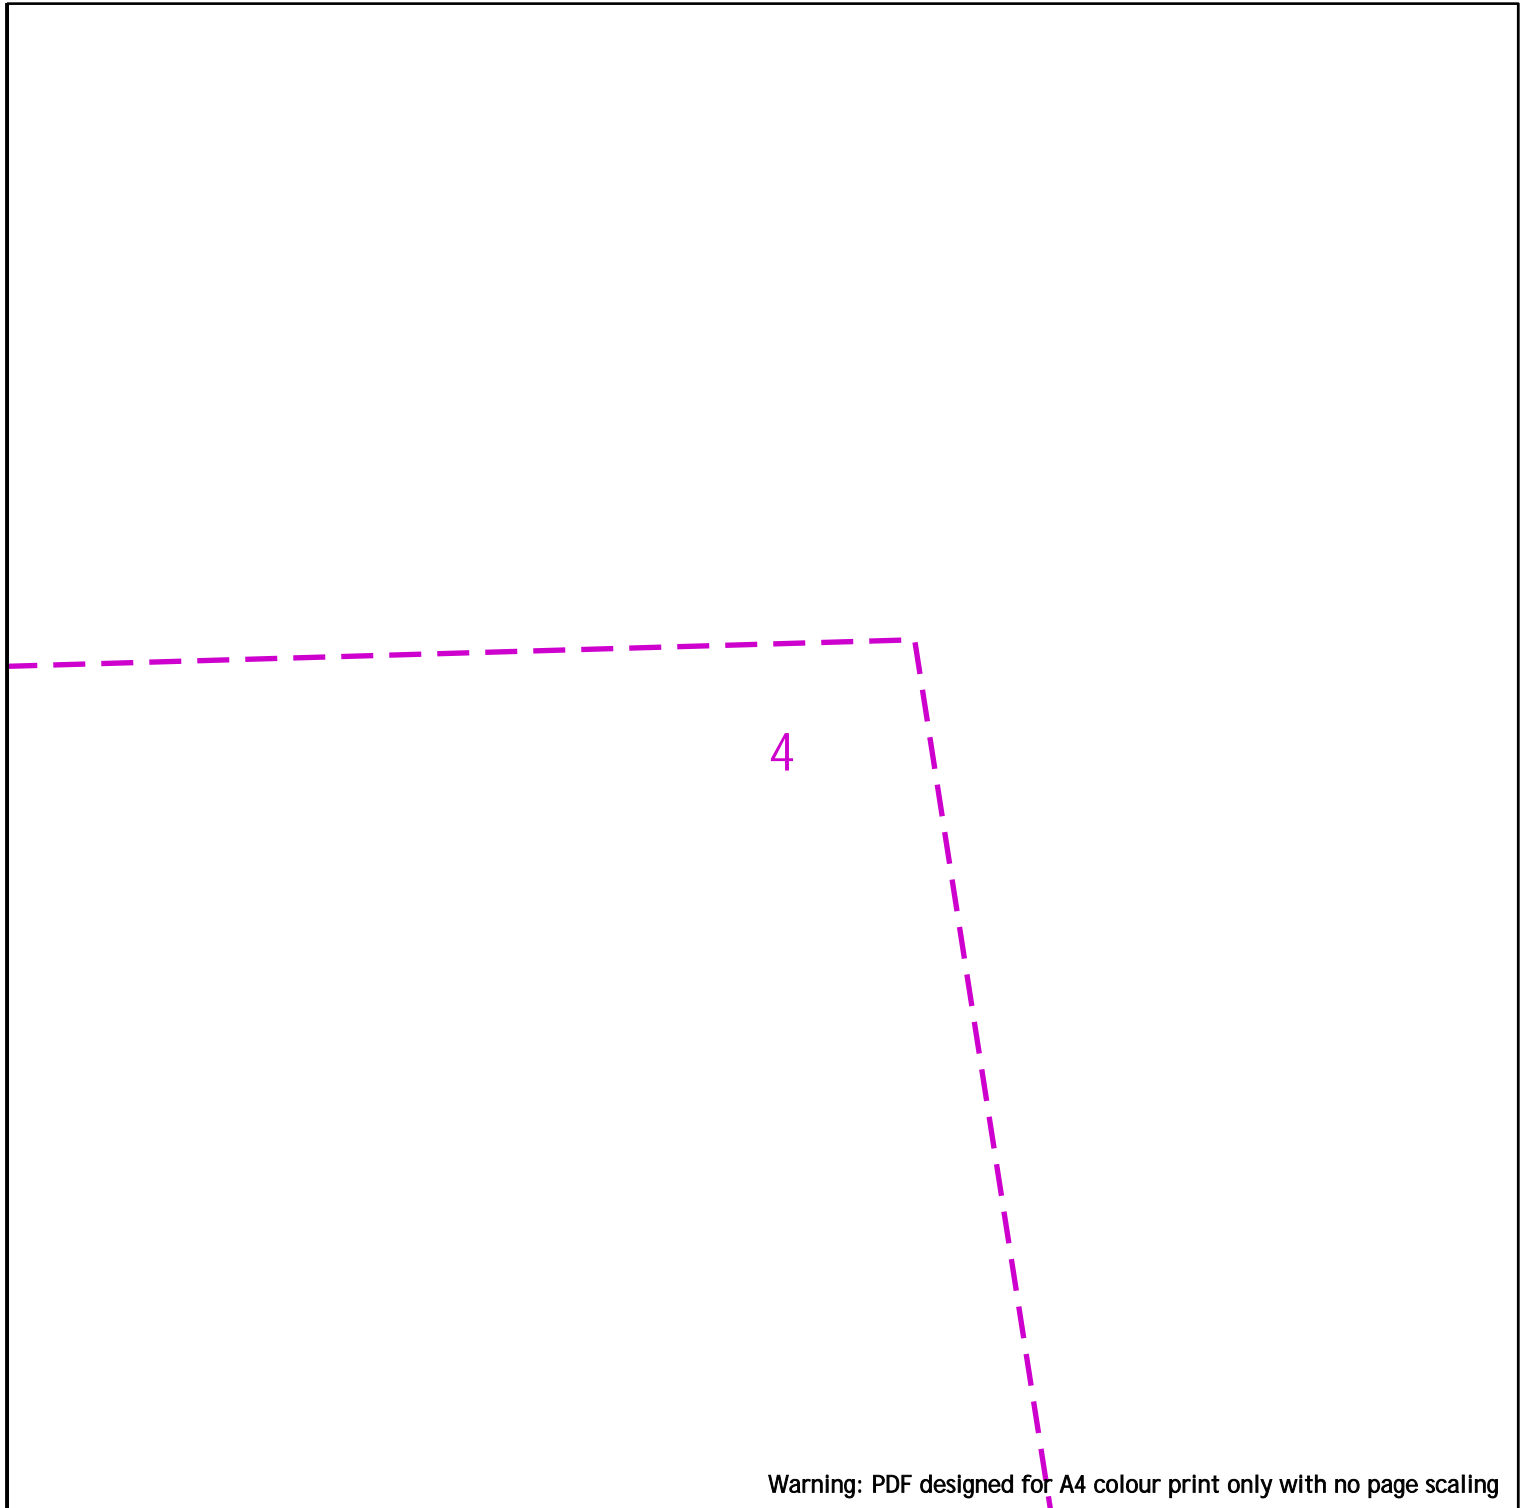











Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

6

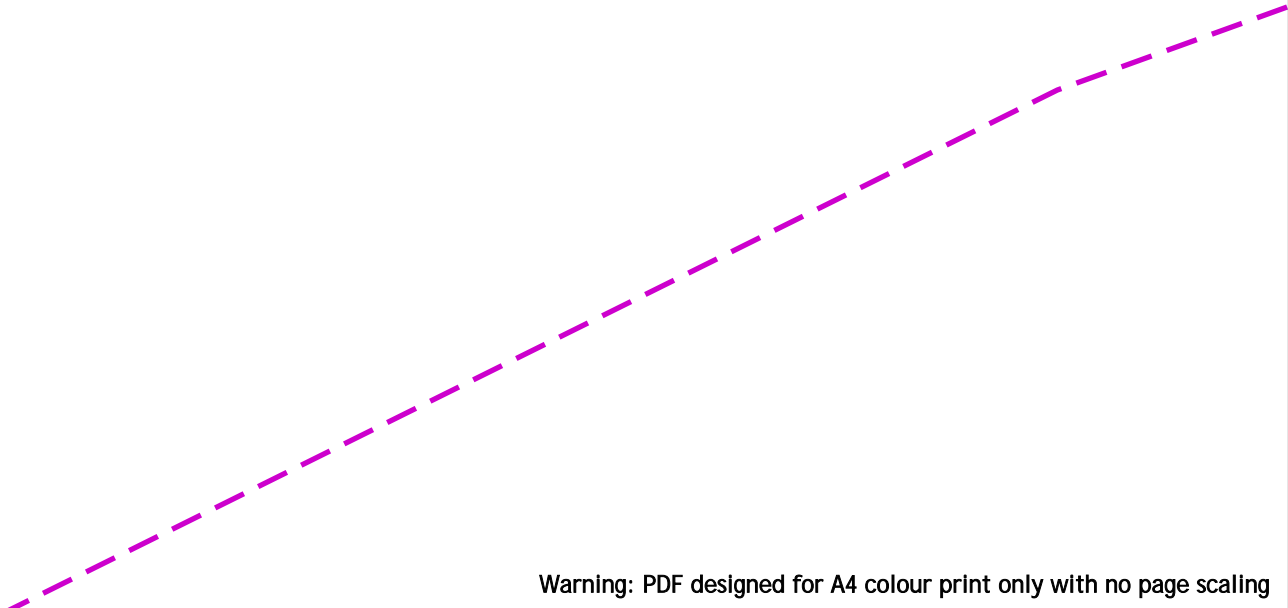

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS


View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

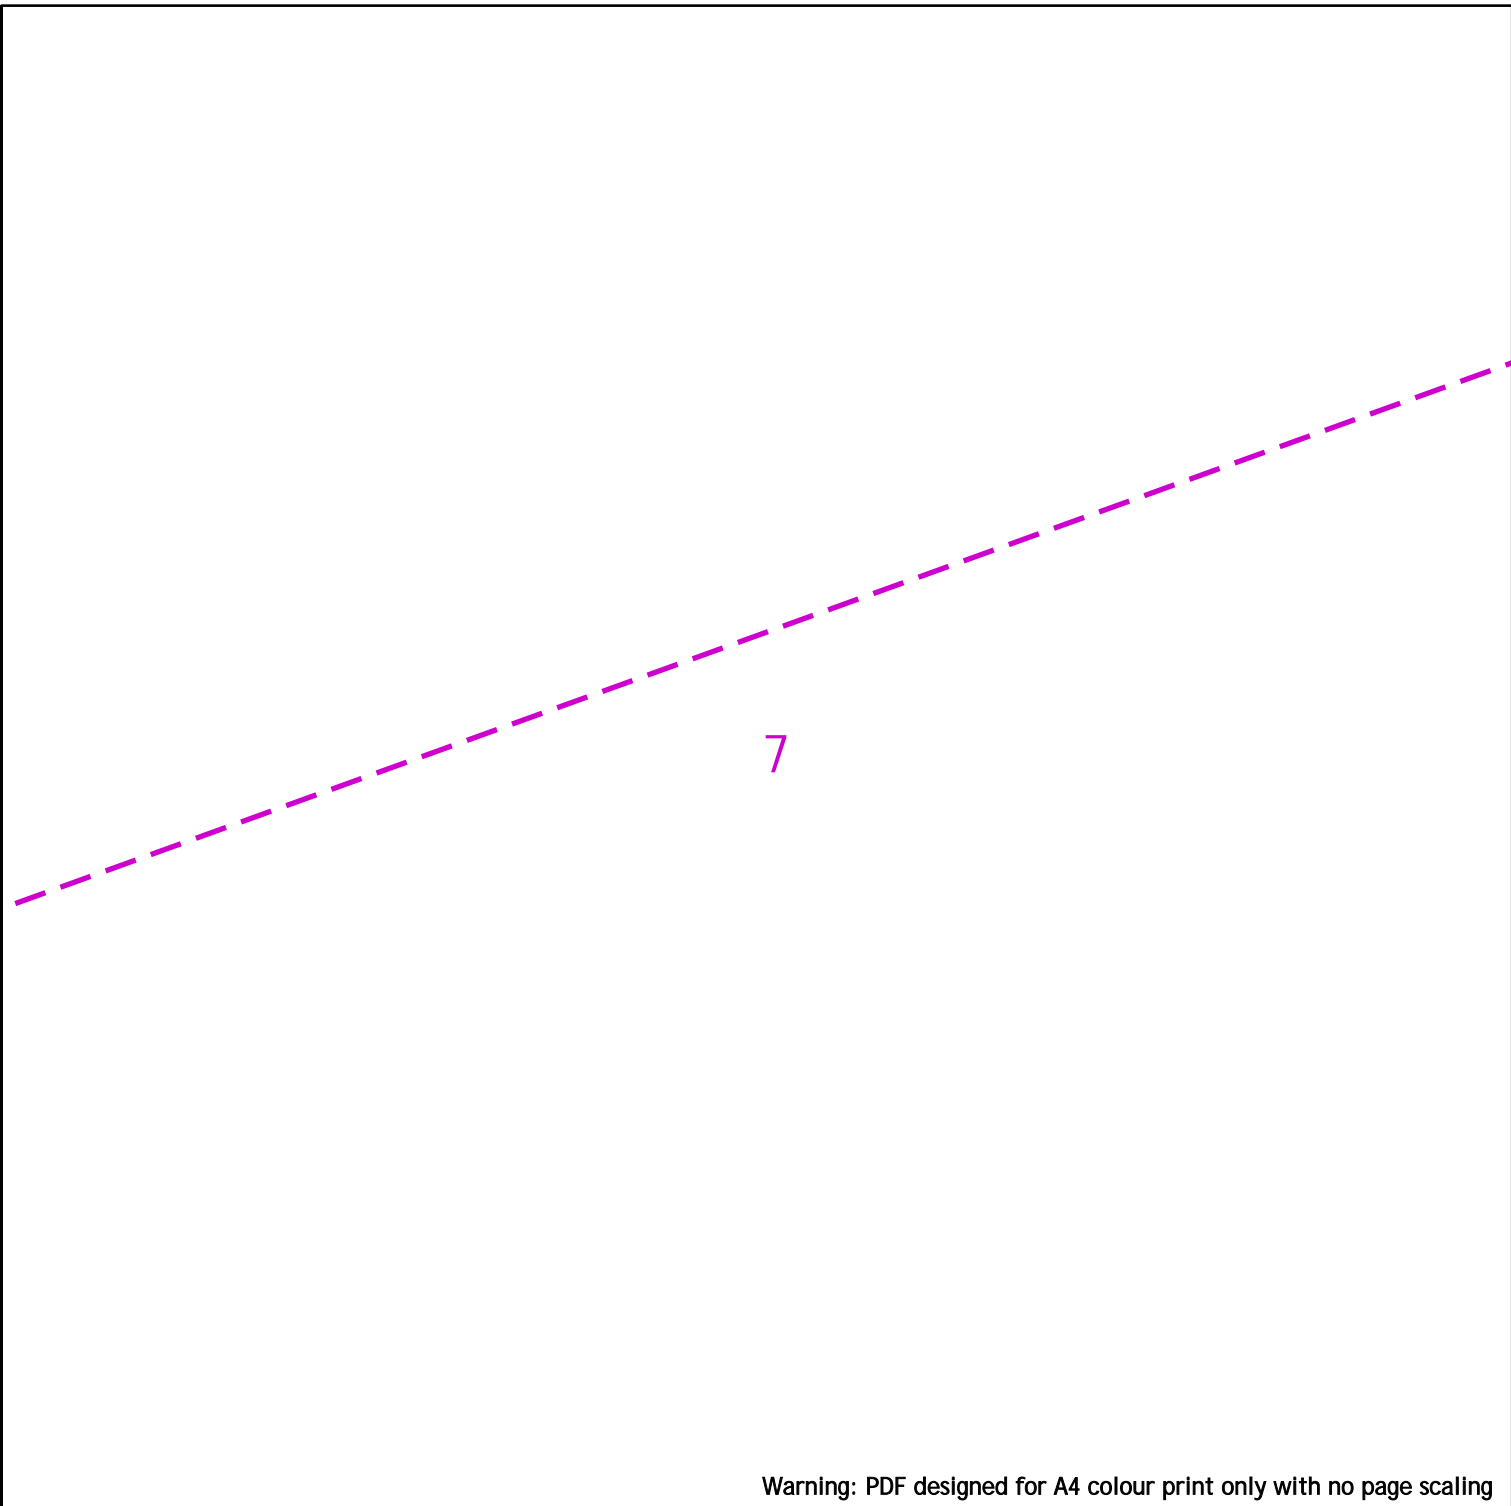

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS


View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

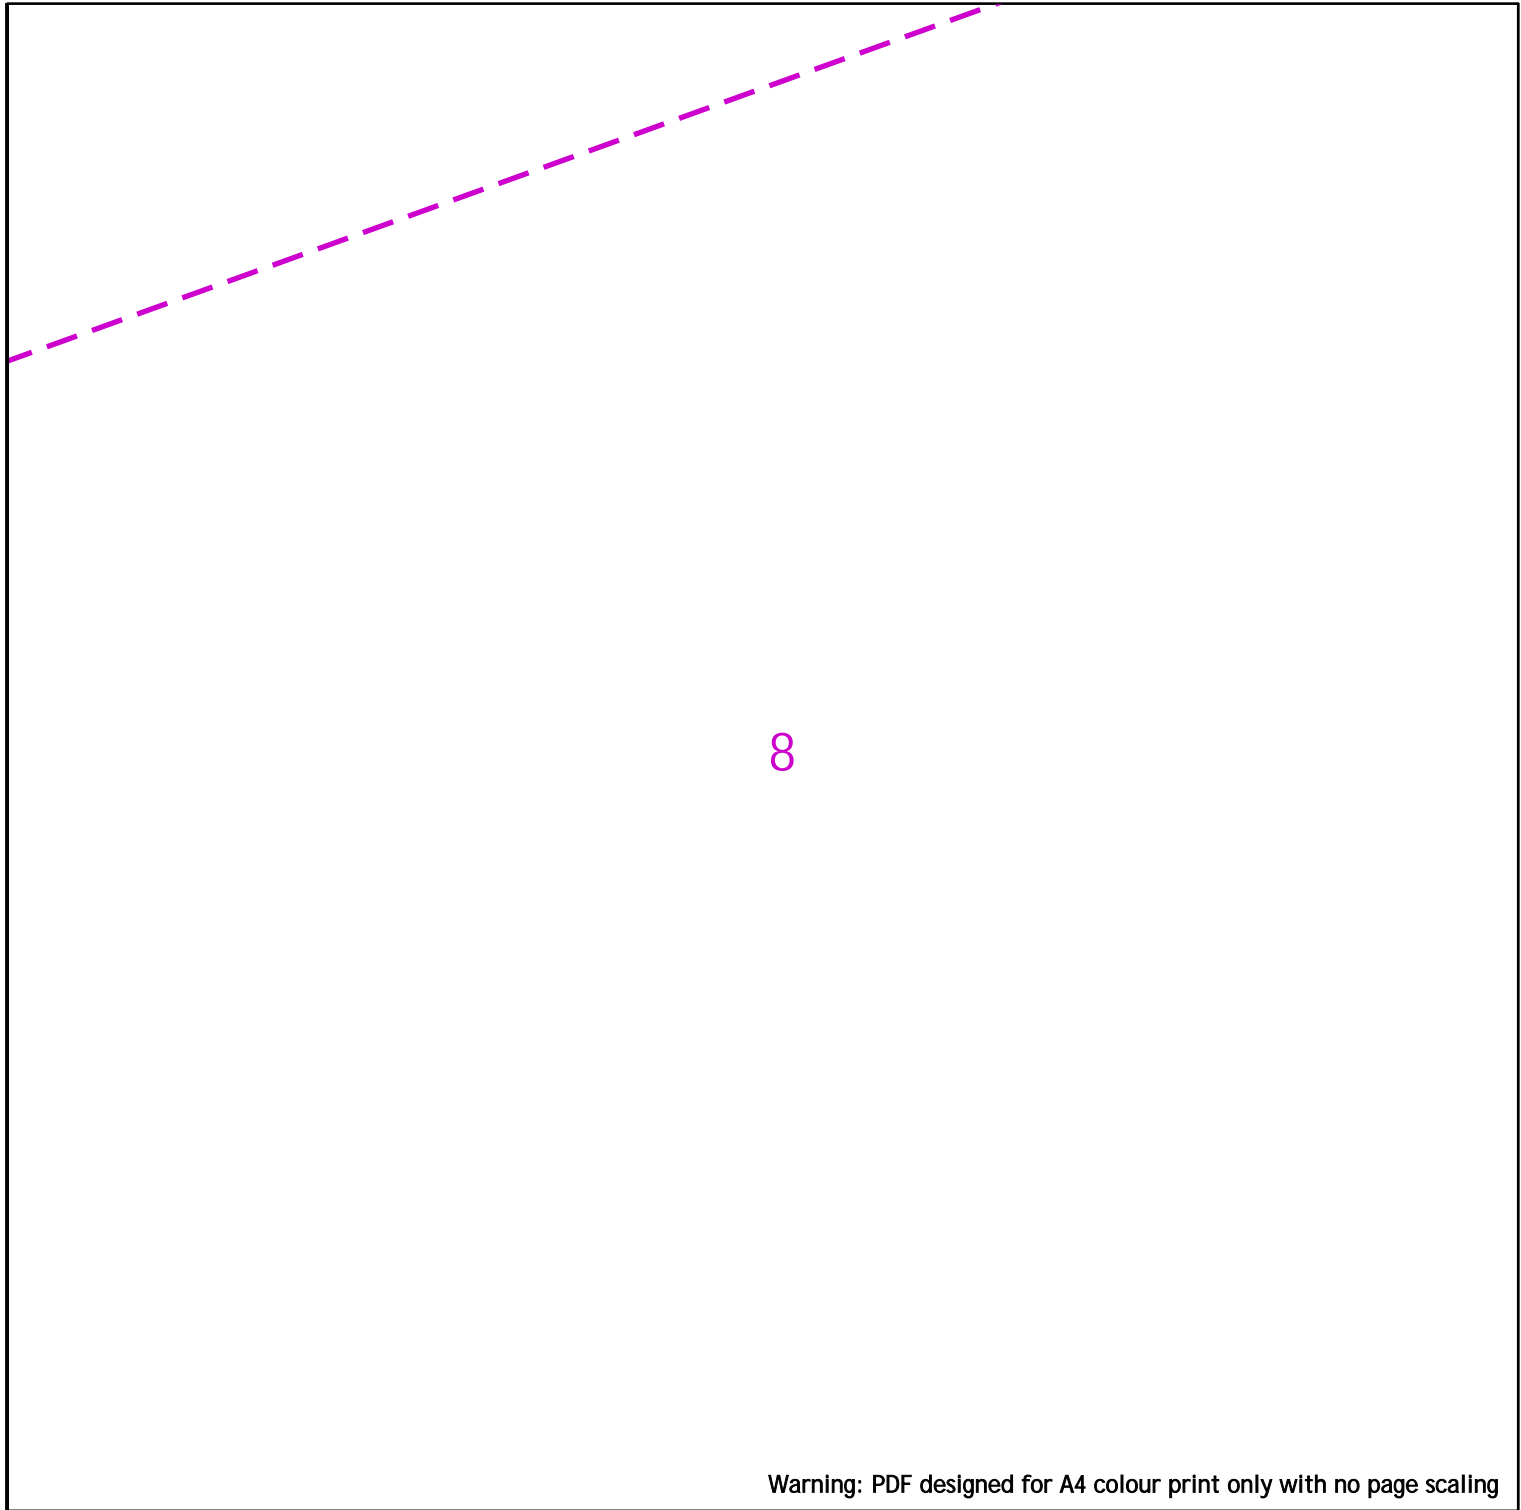

Warning: PDF designed for A4 colour print only with no page scaling

25m



- Dig Sites Area: Line:
- LP Mains
 - MP Mains
 - IP Mains
 - LHP Mains

- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999











Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999





11

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains
	MP Mains
	IP Mains
	LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

12

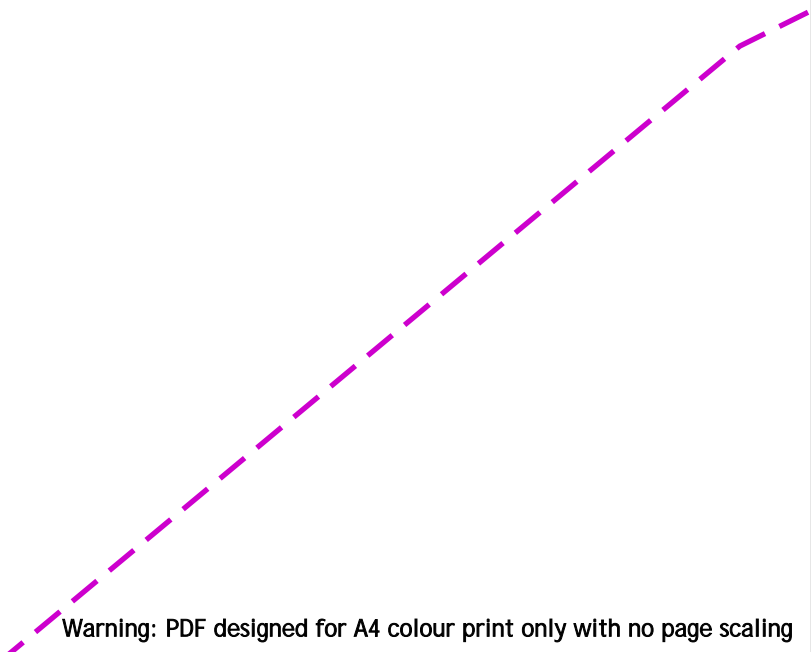






Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS


View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

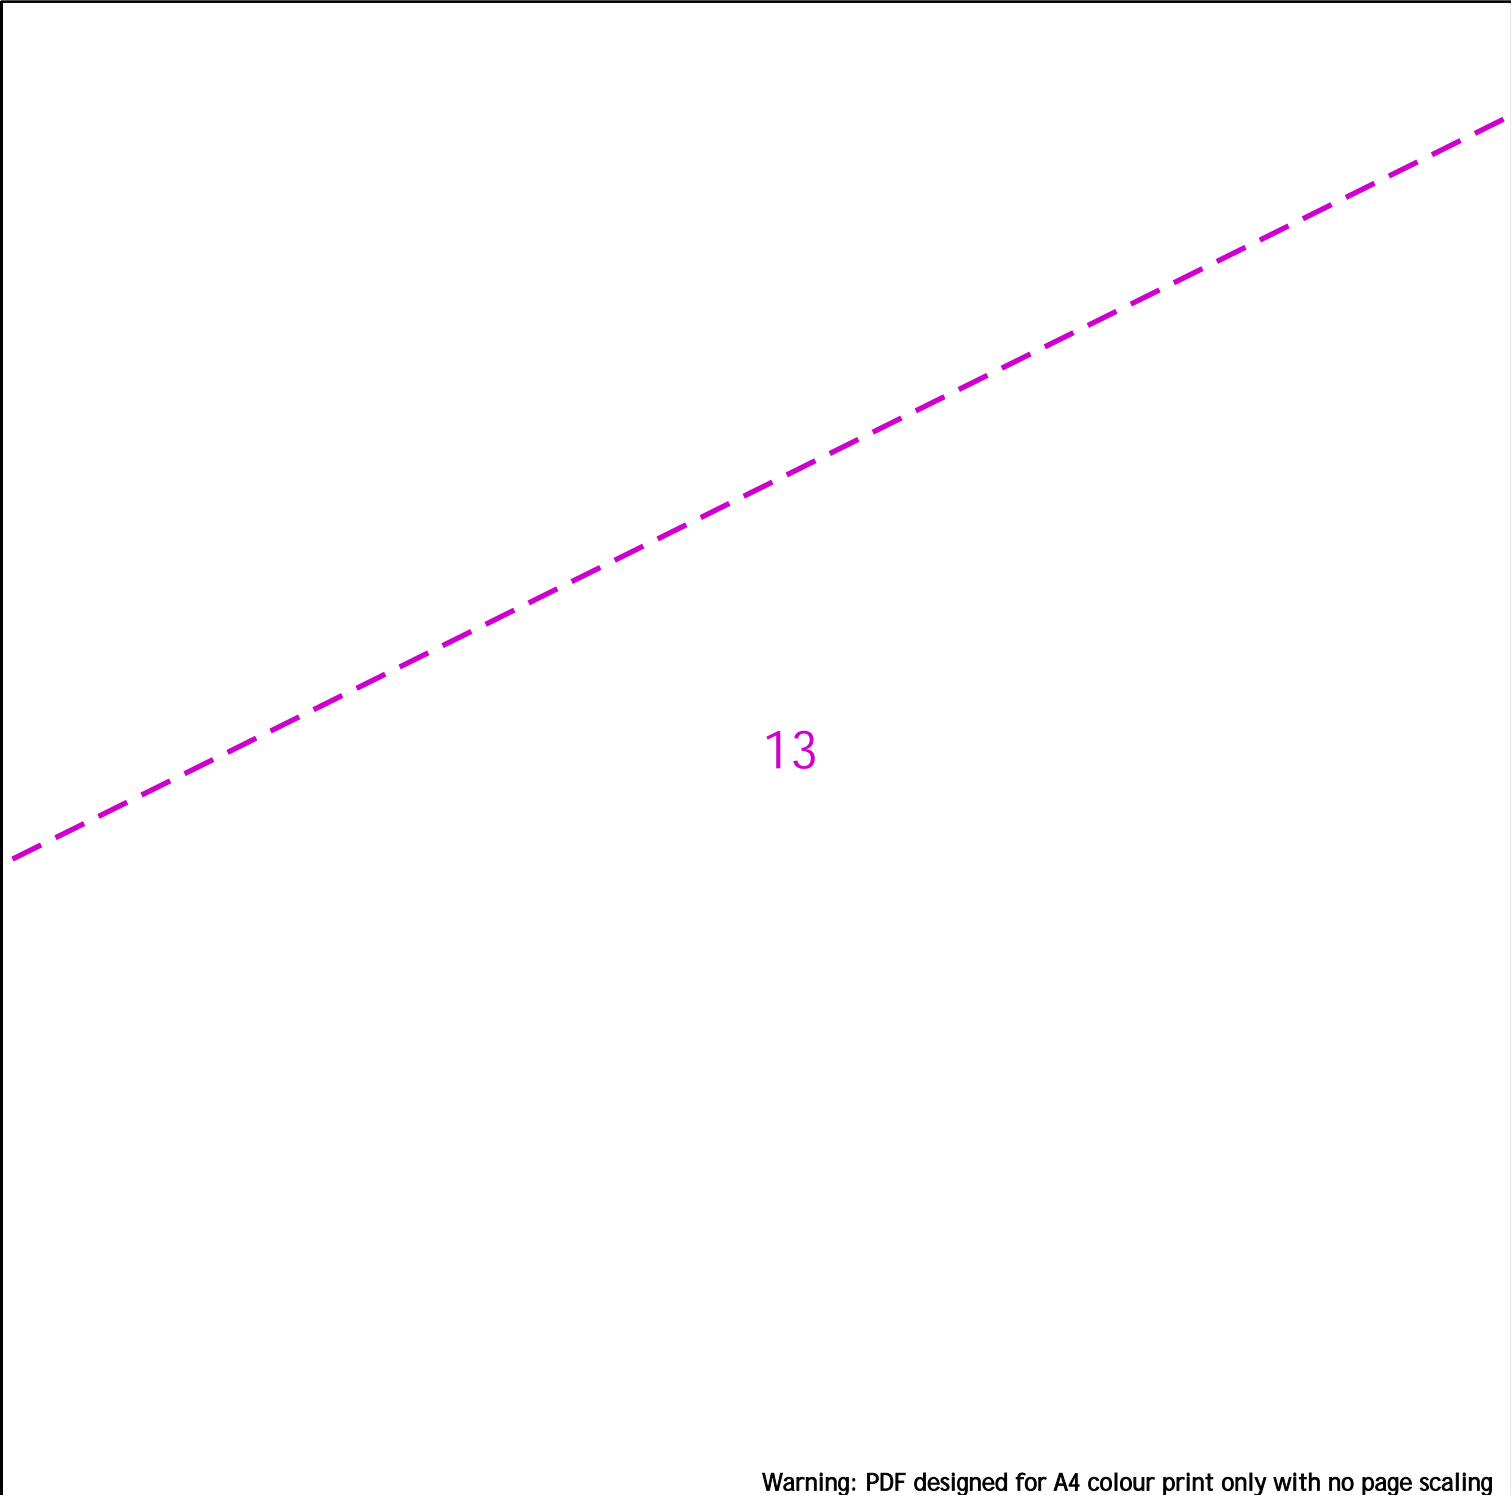

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites	Area:	Line:		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

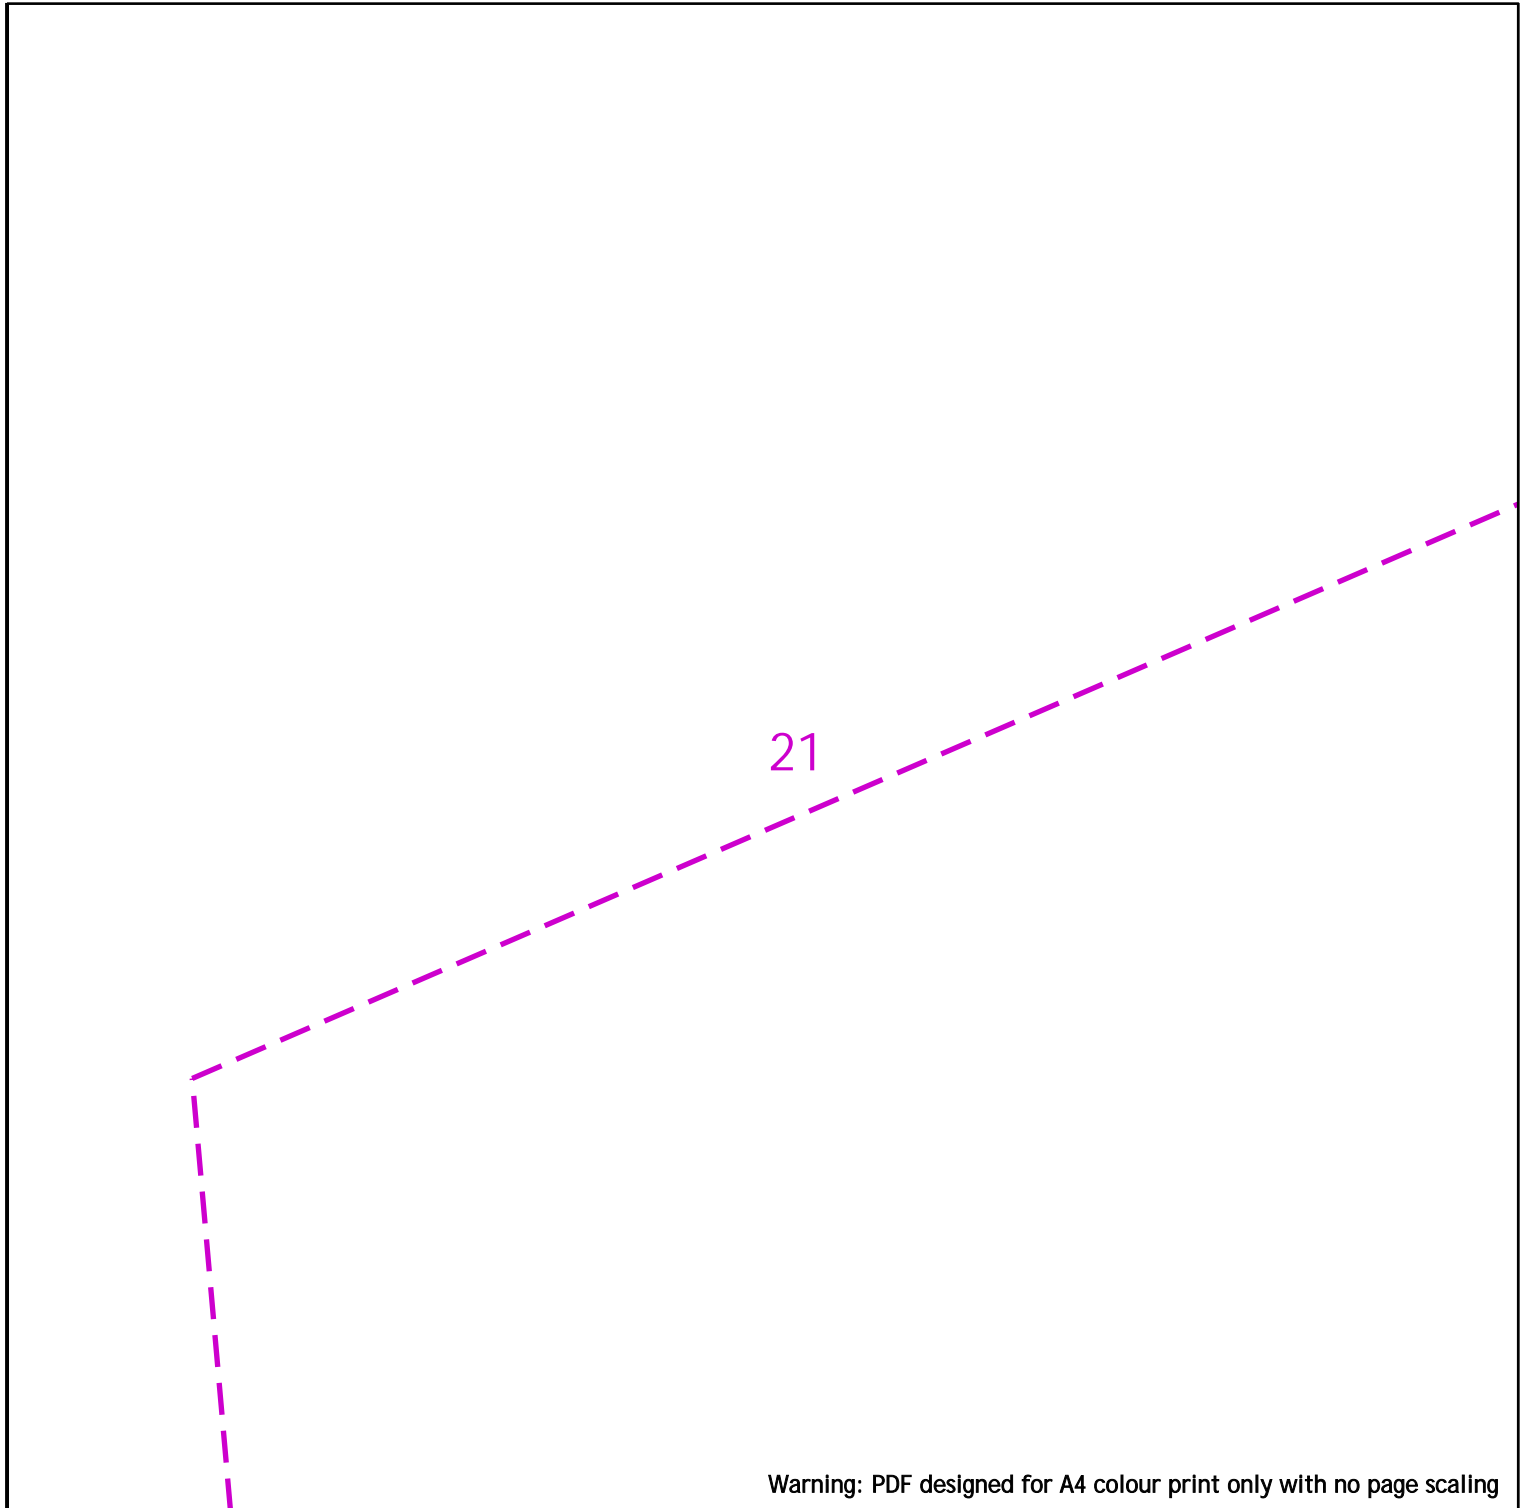

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





30

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



 LP Mains
 MP Mains
 IP Mains
 LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

Scale: 1:500 (When plotted at A4)

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999





31




Warning: PDF designed for A4 colour print only with no page scaling




 25m

Dig Sites Area:  Line: 



	LP Mains
	MP Mains
	IP Mains
	LHP Mains

	Valve
	Depth of cover
	Syphon

	Diameter Change
	Material Change
	Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





39

Warning: PDF designed for A4 colour print only with no page scaling

 25m


Dig Sites Area:  Line: 




	LP Mains
	MP Mains
	IP Mains
	LHP Mains

 Valve

 Depth of cover

 Syphon

 Diameter Change

 Material Change

 Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

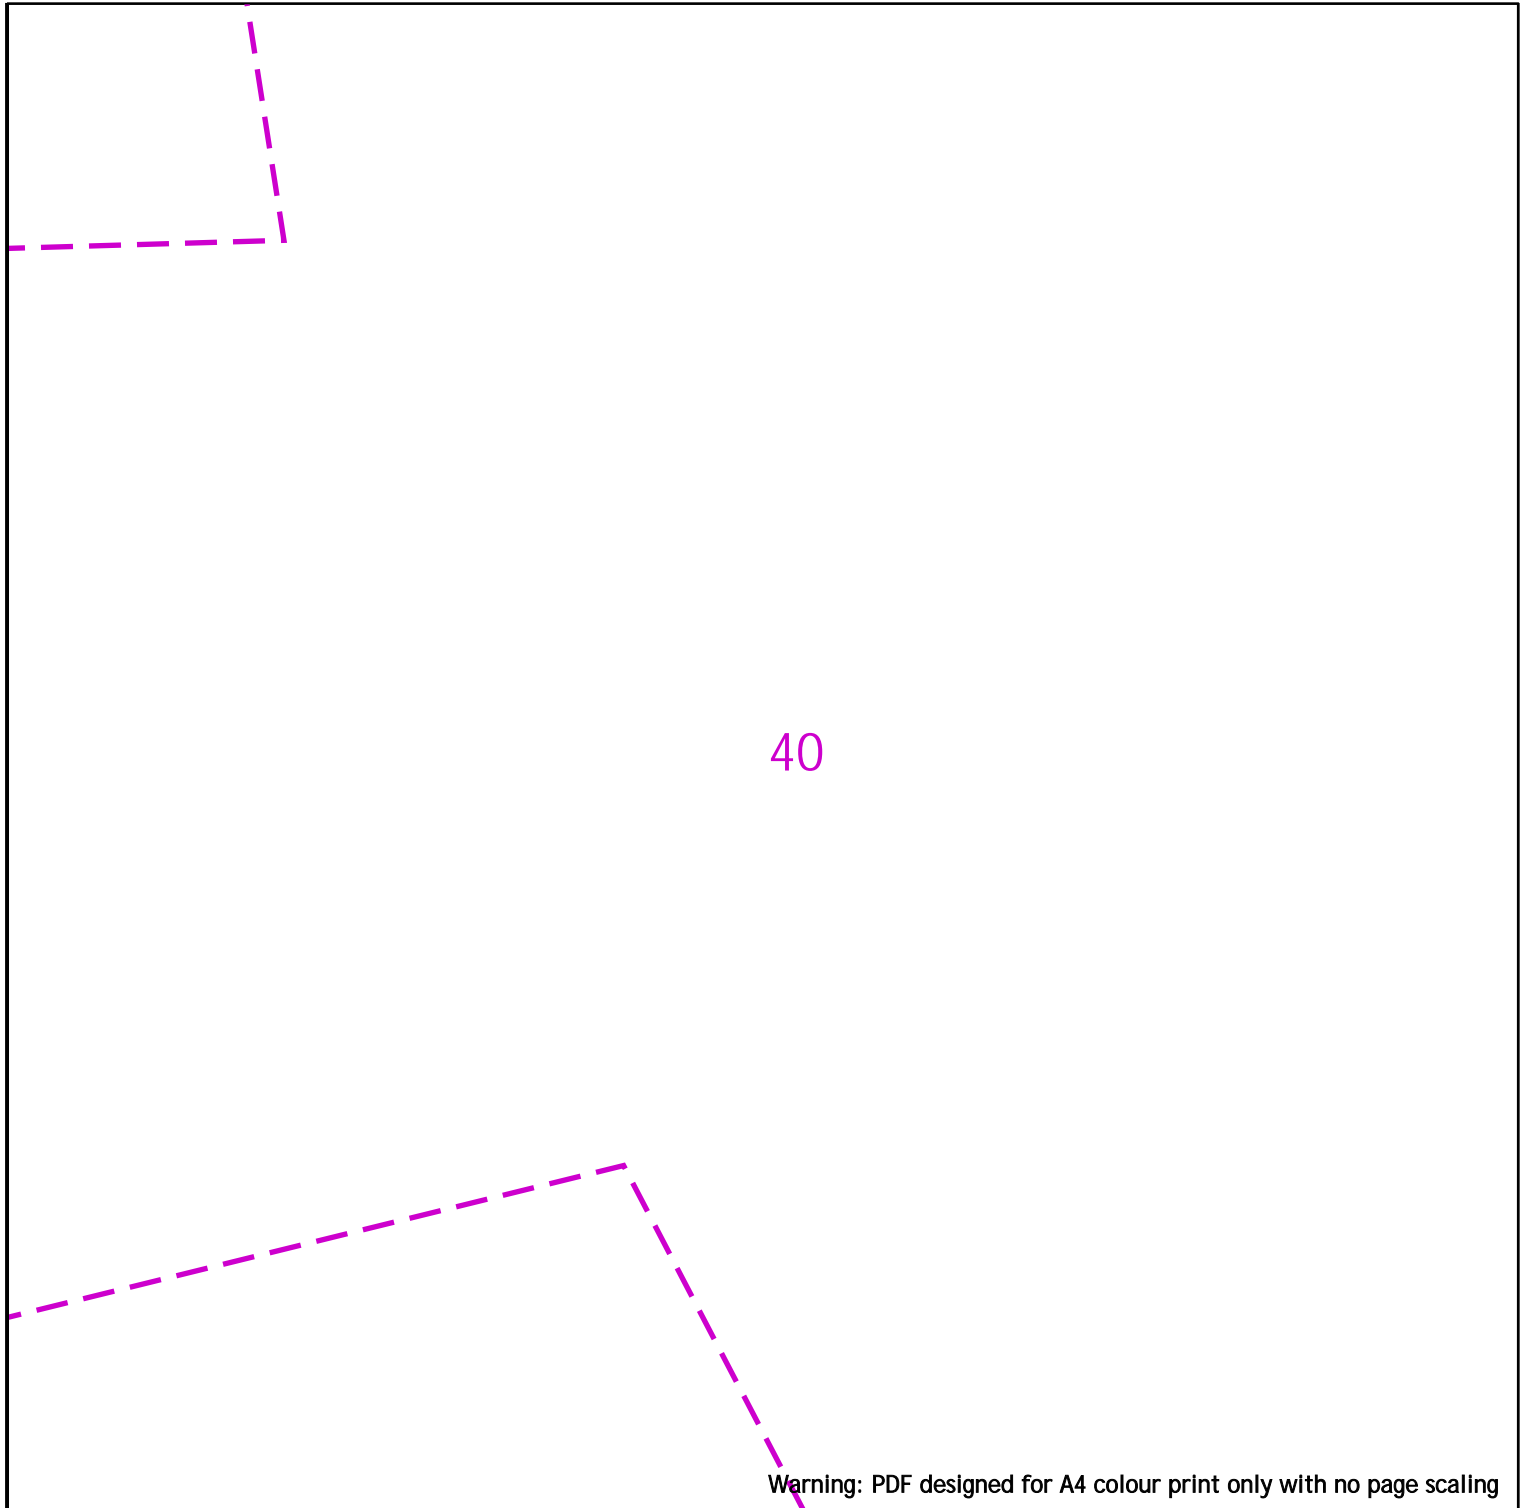











Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.


In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

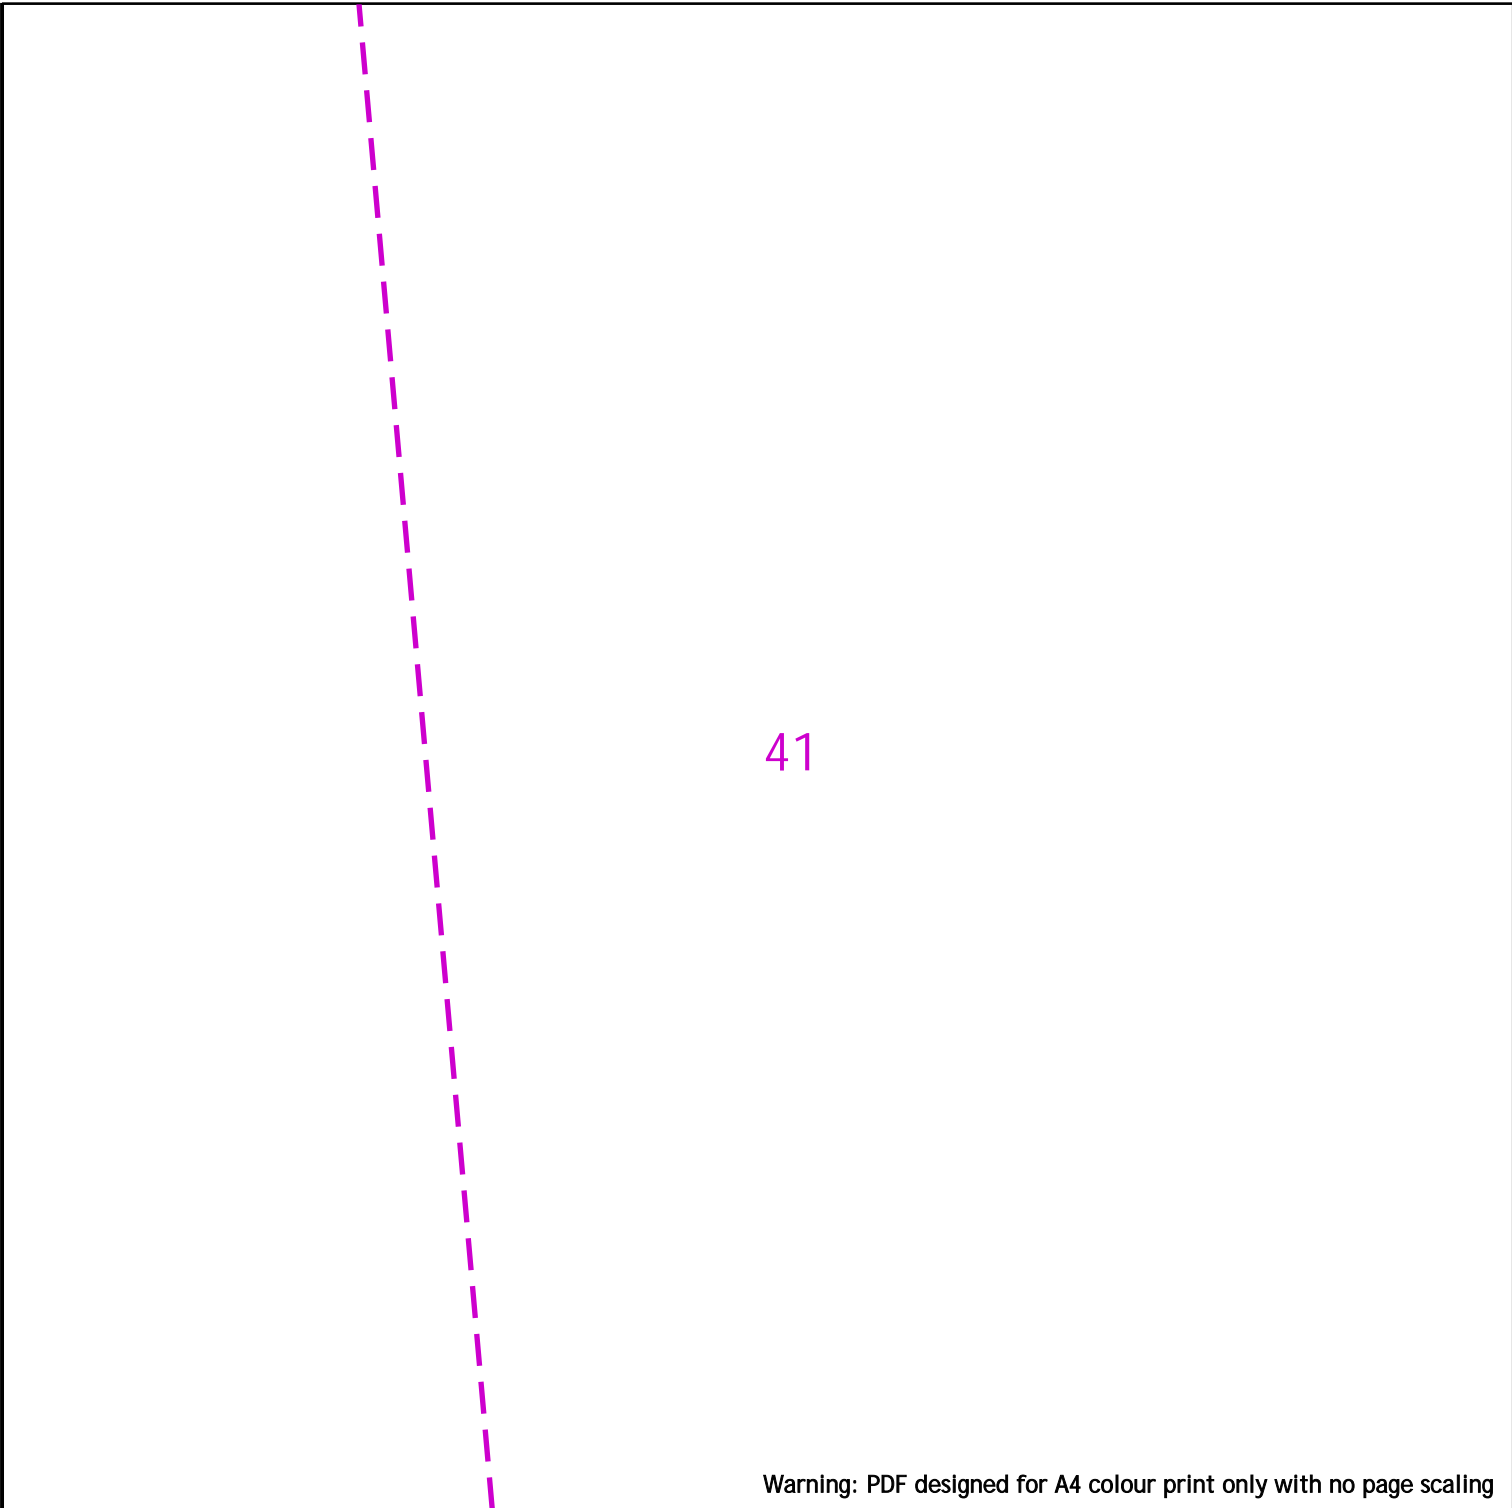

Warning: PDF designed for A4 colour print only with no page scaling

25m
Dig Sites Area: Line:

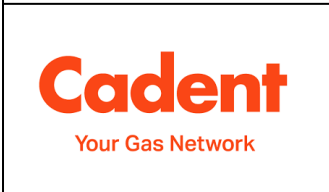

	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





50

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



 LP Mains
 MP Mains
 IP Mains
 LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

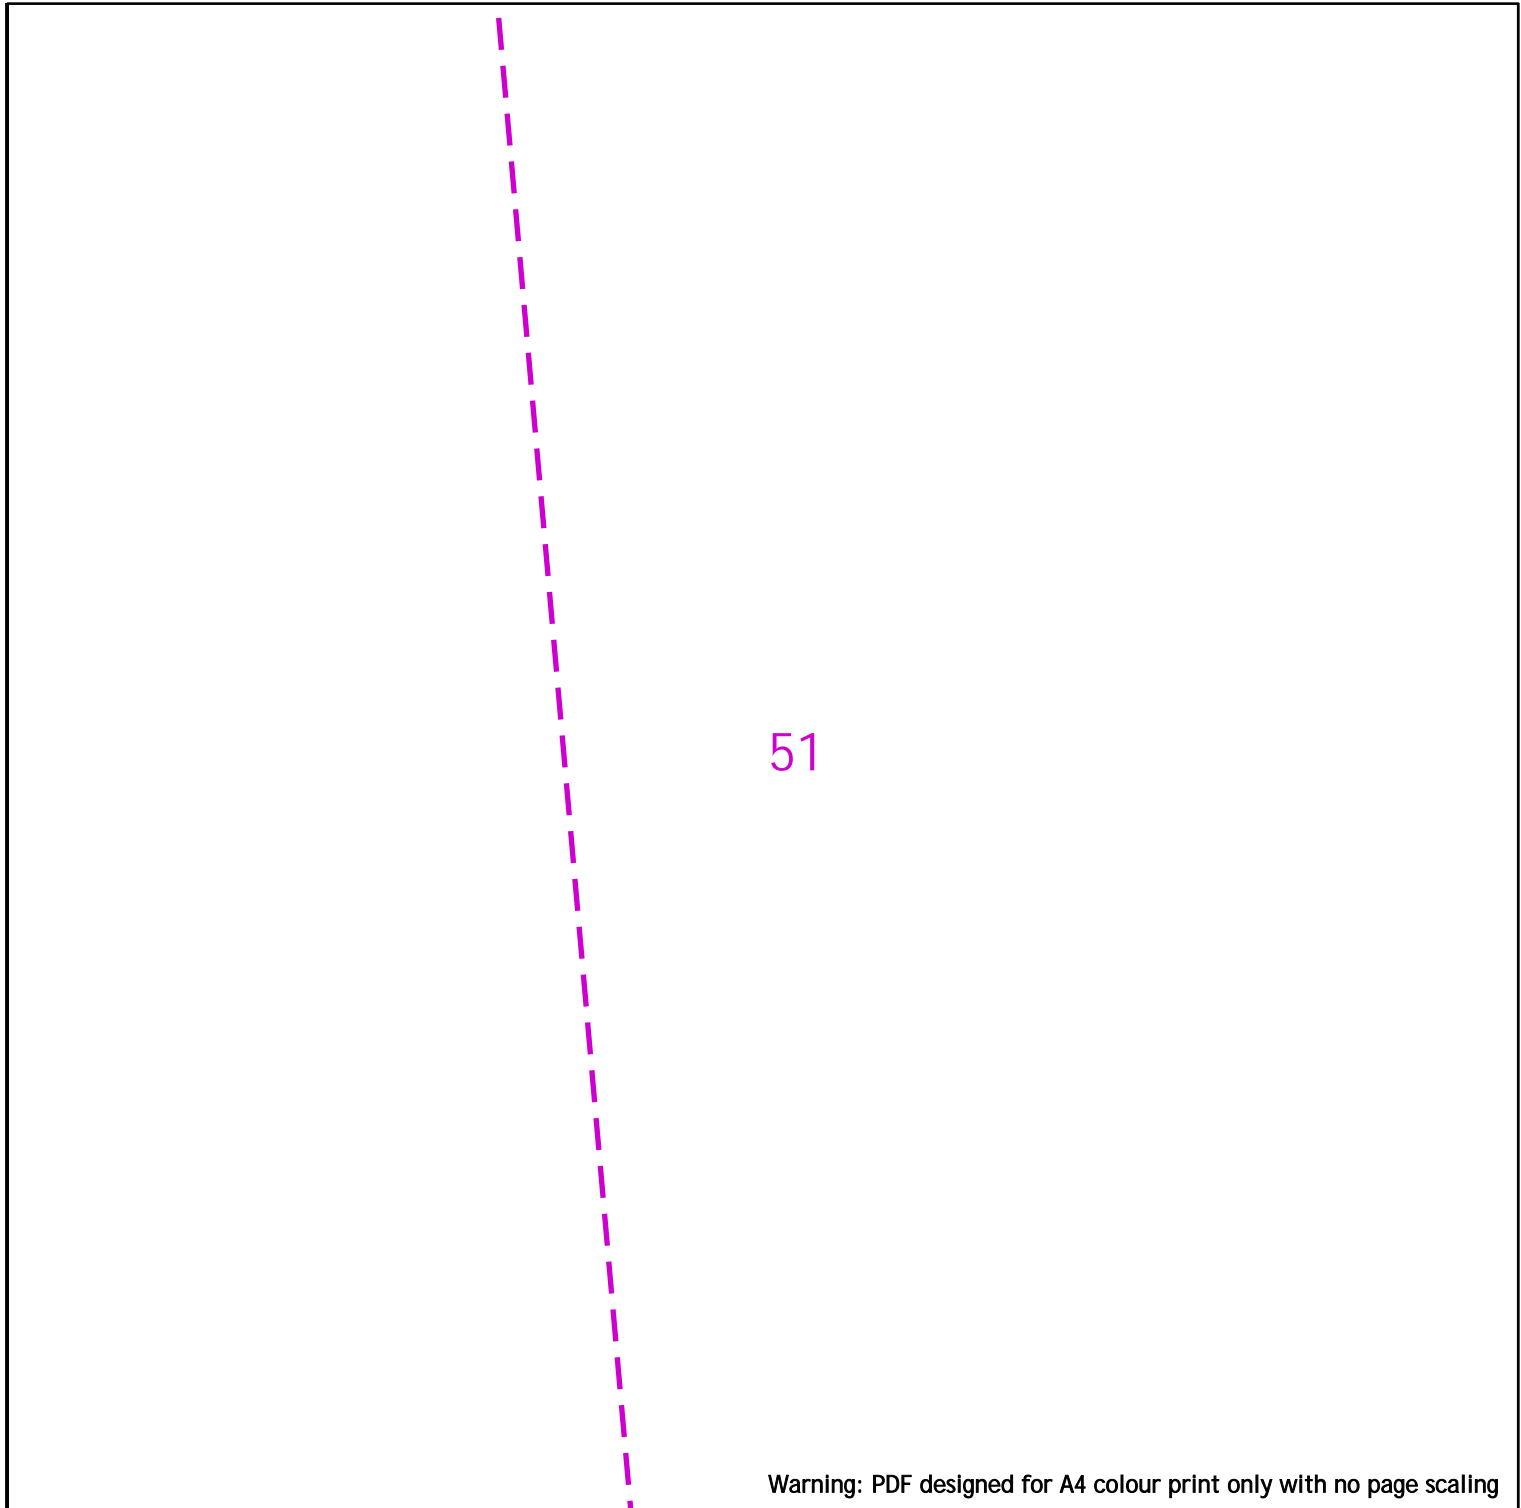











Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

60



Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)













Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

67













Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains
-  Valve
-  Depth of cover
-  Syphon
-  Diameter Change
-  Material Change
-  Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

68

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)











70

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.


In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

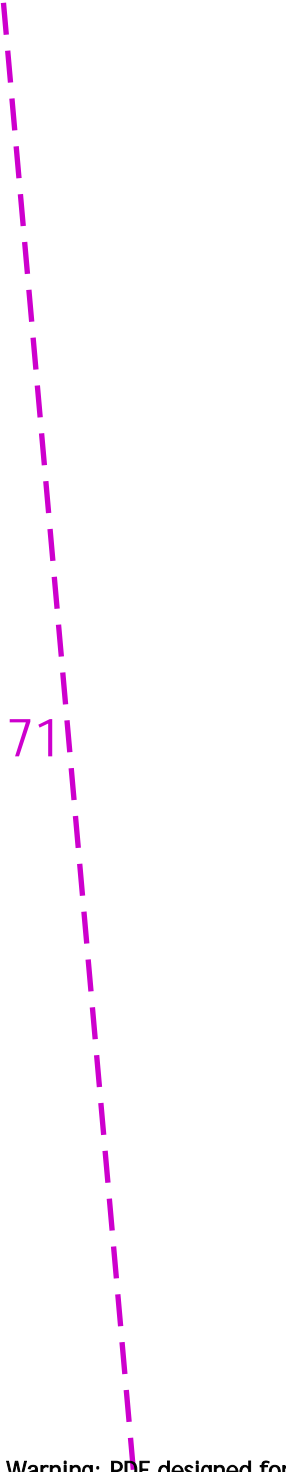

Warning: PDF designed for A4 colour print only with no page scaling

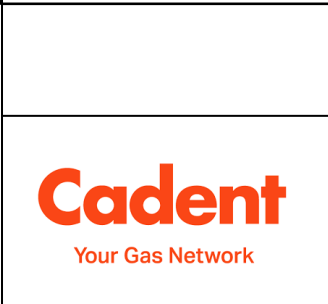

Dig Sites	Area:	Line:		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999











Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains
-  Valve
-  Depth of cover
-  Syphon
-  Diameter Change
-  Material Change
-  Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)











75

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

79


Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites

Area: 

Line: 



LP Mains
MP Mains
IP Mains
LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

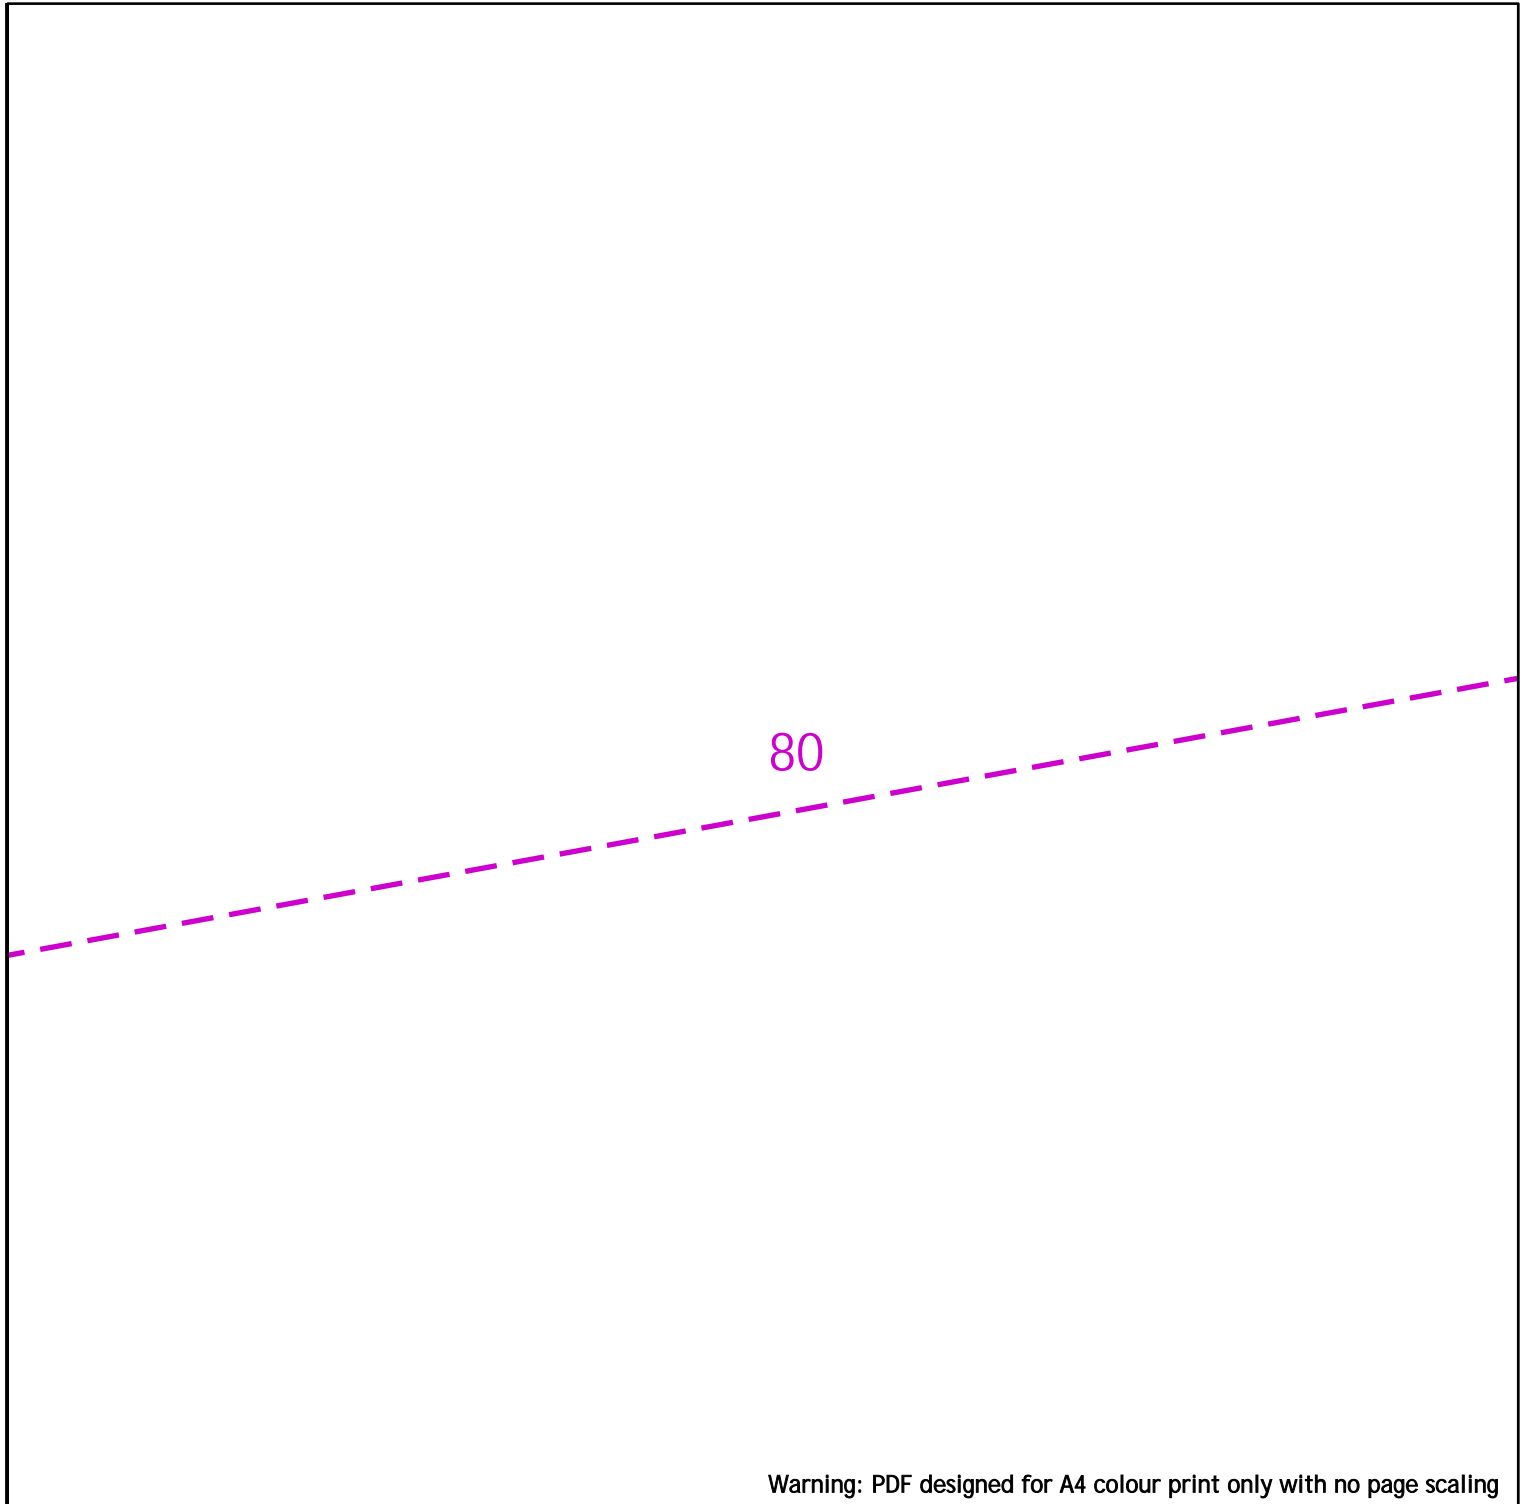

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains

- Valve
- Depth of cover
- Syphon

- Diameter Change
- Material Change
- Out of Standard Service

- Diameter Change
- Material Change
- Out of Standard Service


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.


In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

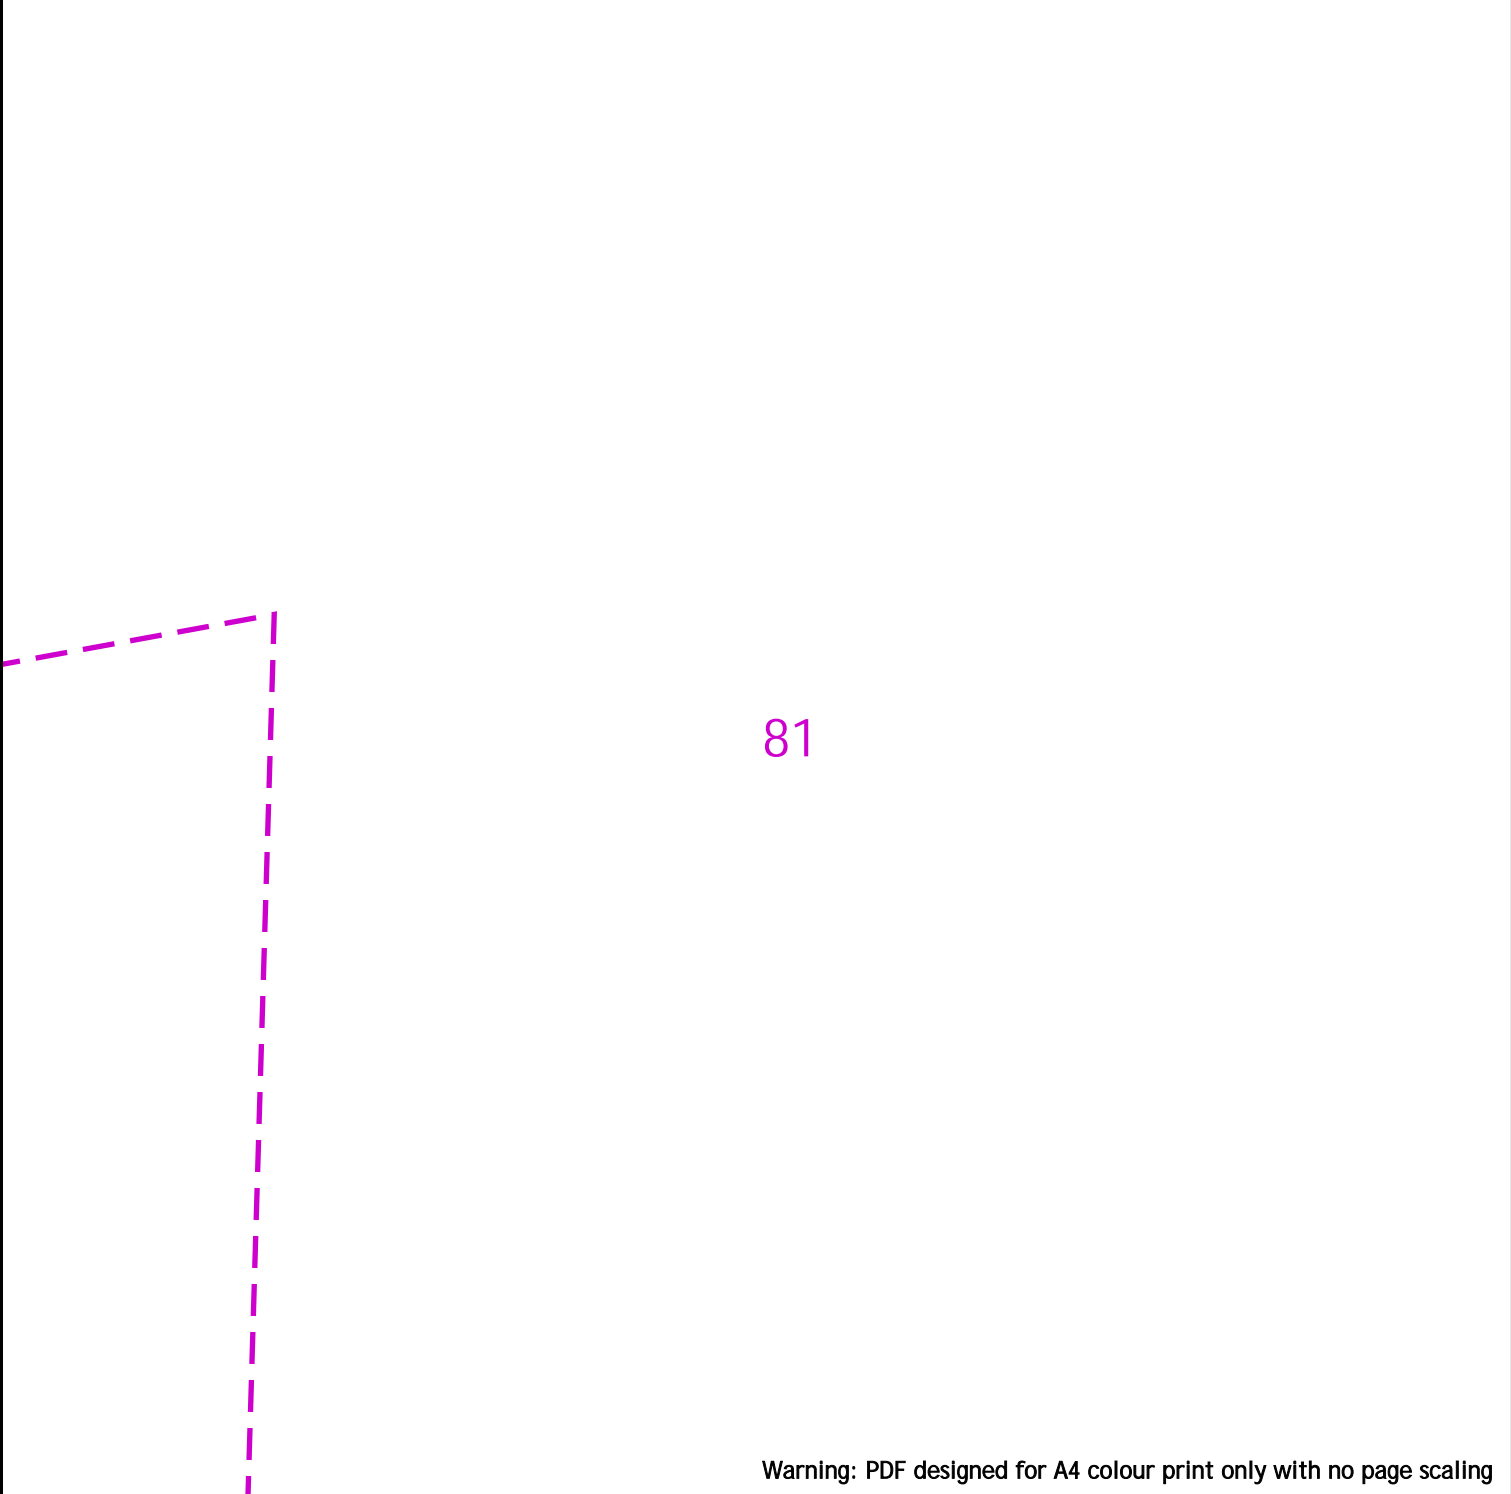

81

Warning: PDF designed for A4 colour print only with no page scaling

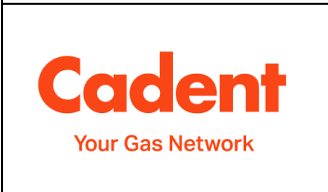

Dig Sites	Area:	Line:		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

85



Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





86




Warning: PDF designed for A4 colour print only with no page scaling




 25m

Dig Sites Area:  Line: 



	LP Mains
	MP Mains
	IP Mains
	LHP Mains

	Valve
	Depth of cover
	Syphon

	Diameter Change
	Material Change
	Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





88

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



 LP Mains
 MP Mains
 IP Mains
 LHP Mains



Valve



Depth of cover



Syphon



Diameter Change



Material Change



Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

90



Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- LP Mains
- MP Mains
- IP Mains
- LHP Mains
- Valve
- Depth of cover
- Syphon
- Diameter Change
- Material Change
- Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

91

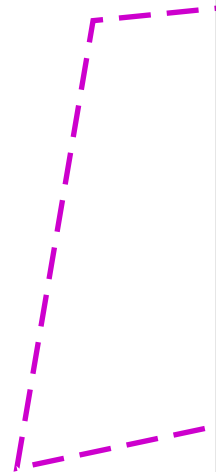











Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 




-  LP Mains
-  MP Mains
-  IP Mains
-  LHP Mains
-  Valve
-  Depth of cover
-  Syphon
-  Diameter Change
-  Material Change
-  Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

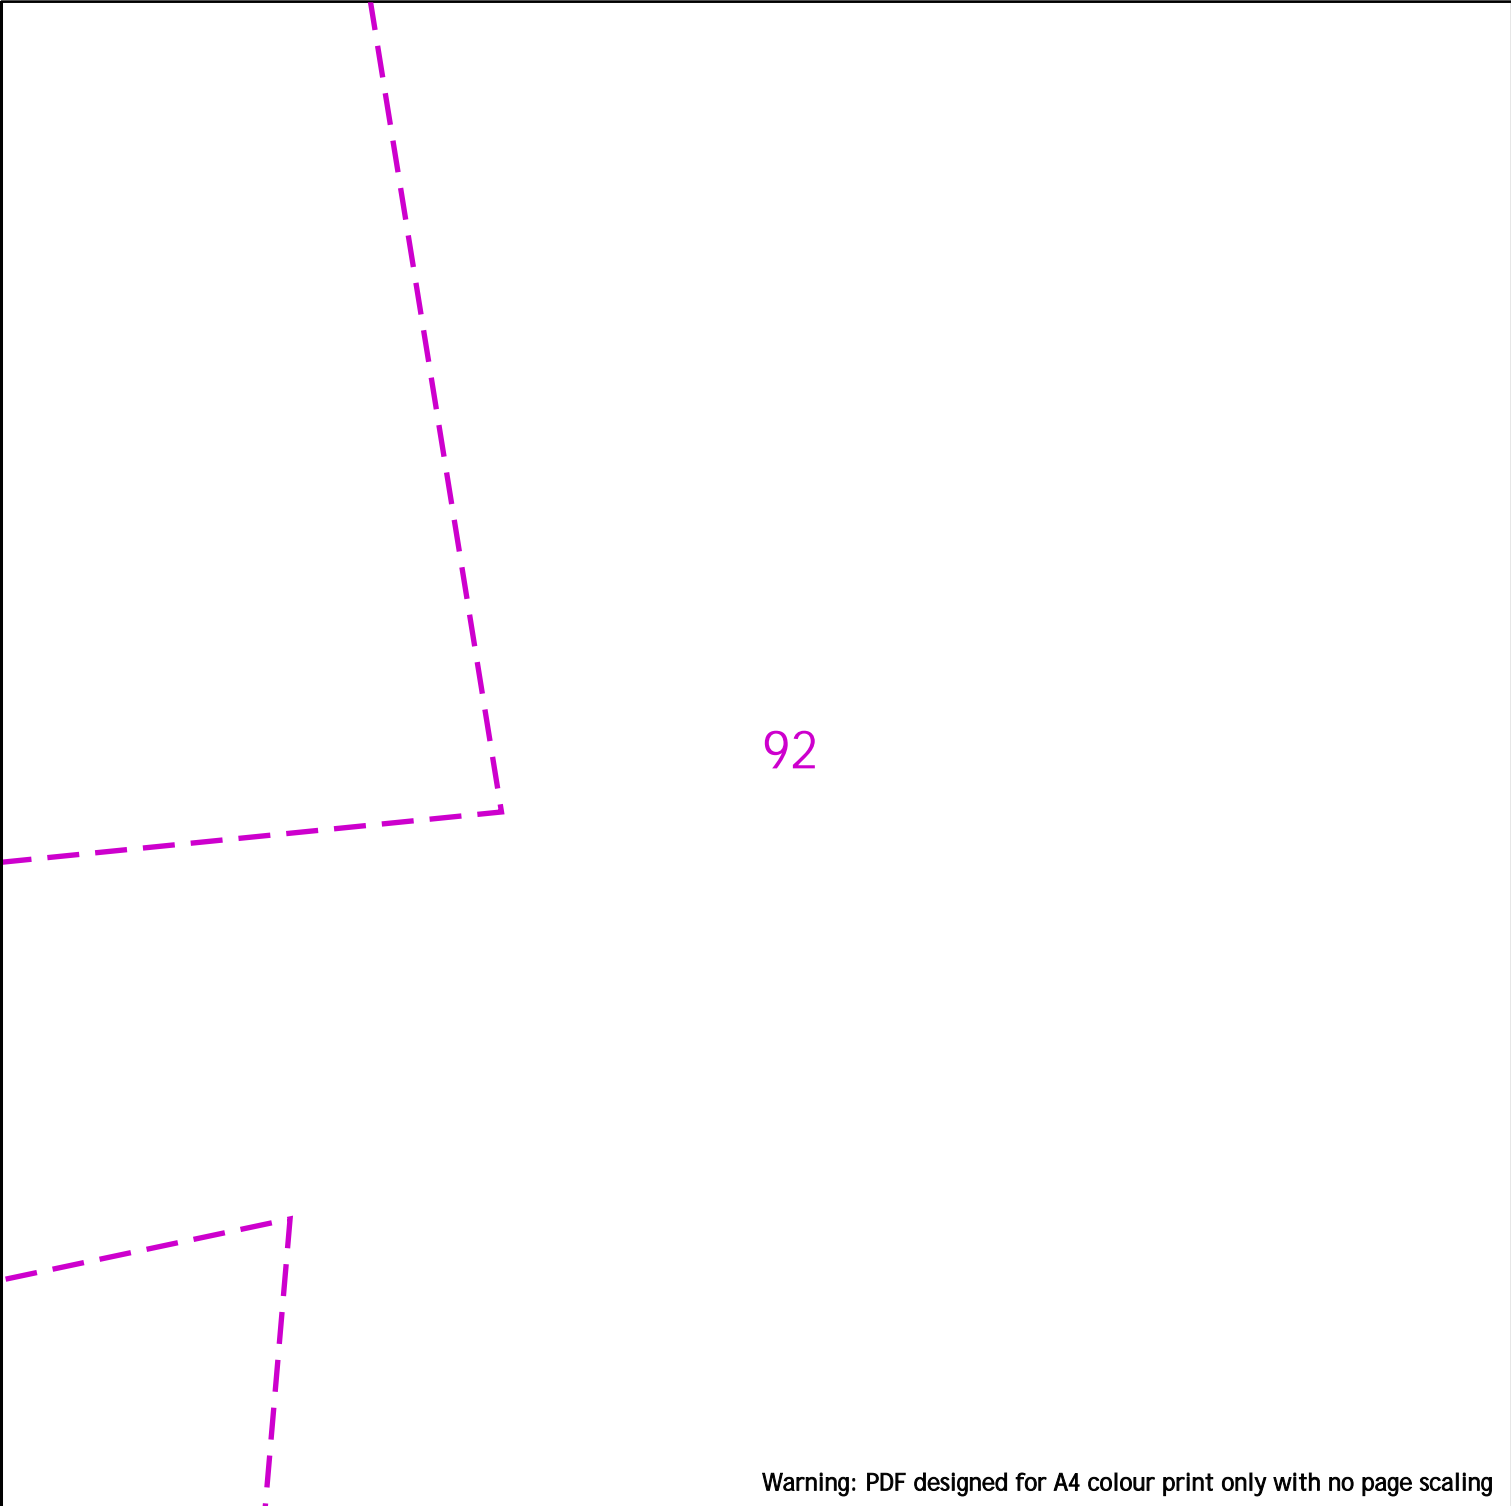

Warning: PDF designed for A4 colour print only with no page scaling

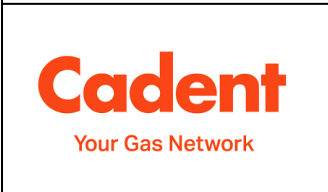

Dig Sites	Area:	Line:		
	LP Mains			Valve
	MP Mains			Depth of cover
	IP Mains			Syphon
	LHP Mains			Diameter Change
				Material Change
				Out of Standard Service

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.











In case of emergency call - 0800 111 999

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling

IMPORTANT NOTICES


This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

Your Scheme/Reference:
 UTT/22/2046/PINS

View extent: 100m, 100m

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

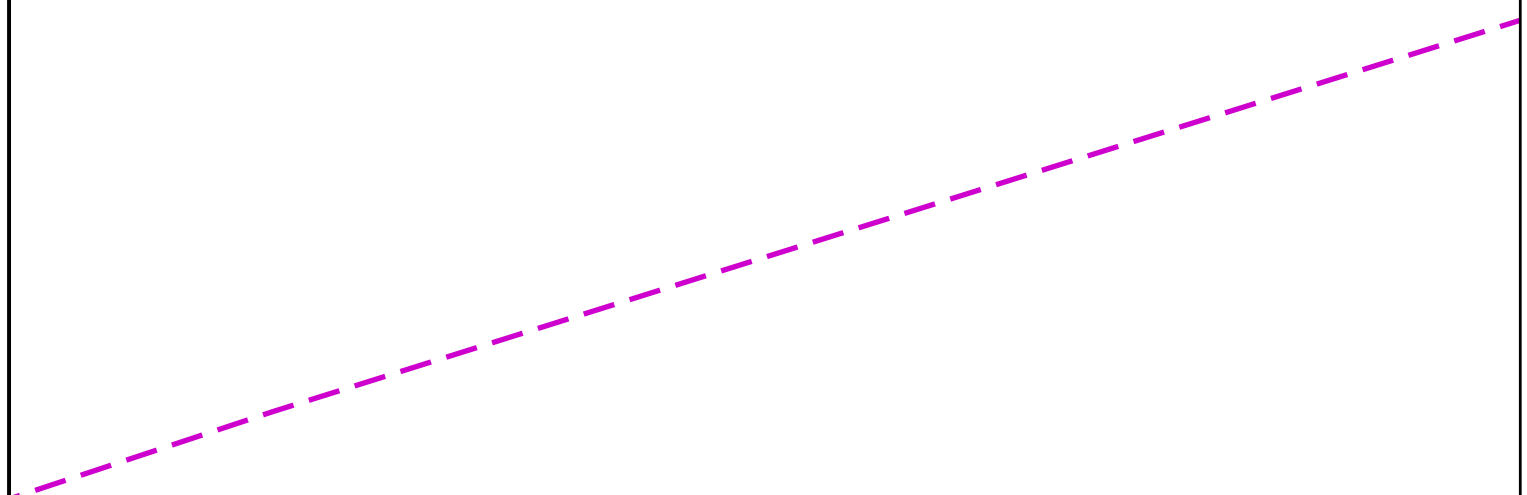

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |


Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

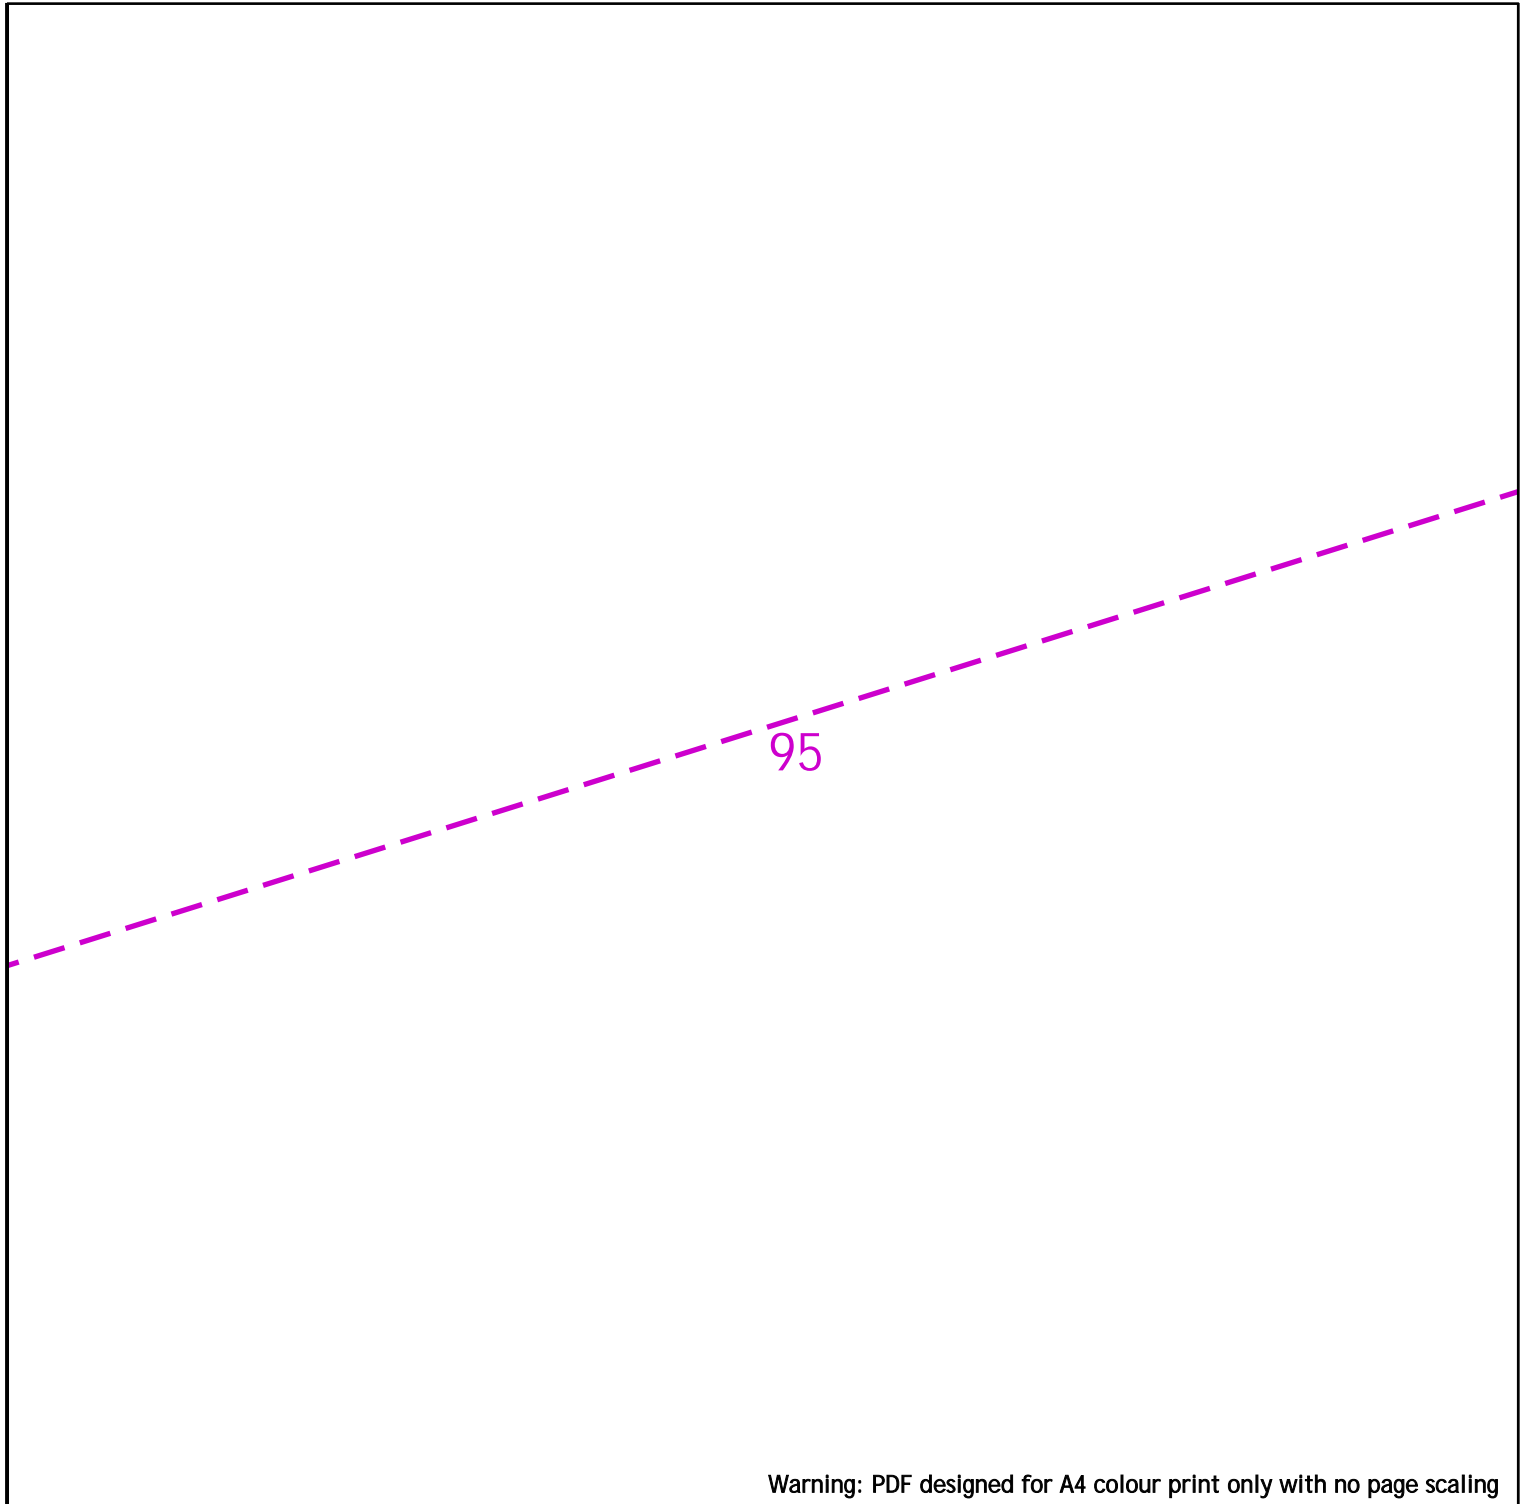











Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area:  Line: 



- | | | | | | |
|---|-----------|---|----------------|---|-------------------------|
|  | LP Mains |  | Valve |  | Diameter Change |
|  | MP Mains |  | Depth of cover |  | Material Change |
|  | IP Mains |  | Syphon |  | Out of Standard Service |
|  | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)





96

Warning: PDF designed for A4 colour print only with no page scaling

 25m


Dig Sites Area:  Line: 




	LP Mains
	MP Mains
	IP Mains
	LHP Mains

 Valve

 Depth of cover

 Syphon

 Diameter Change

 Material Change

 Out of Standard Service

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m


IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

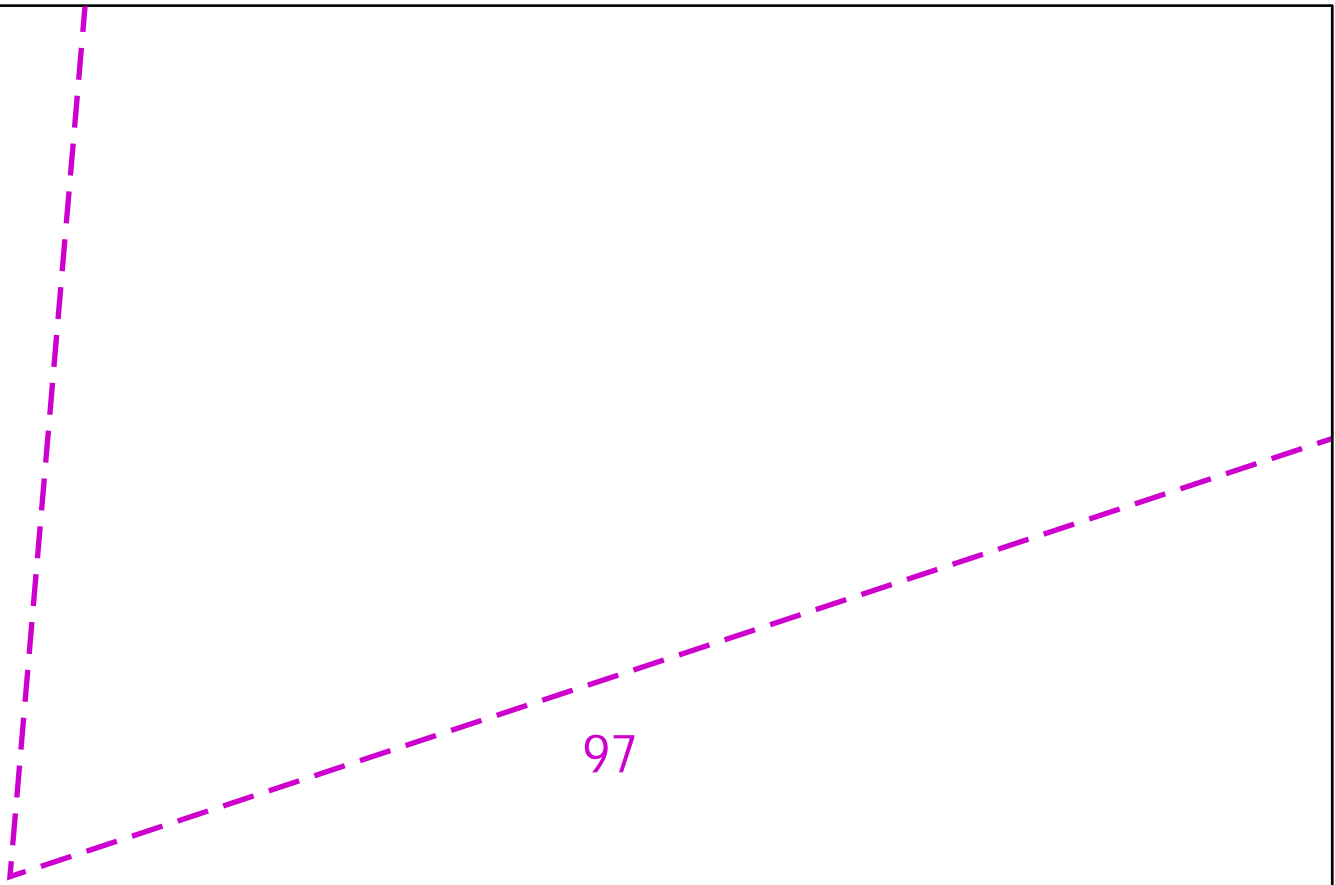

Warning: PDF designed for A4 colour print only with no page scaling

25m

Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)











98

Warning: PDF designed for A4 colour print only with no page scaling

 25m

Dig Sites Area:  Line: 



	LP Mains		Valve		Diameter Change
	MP Mains		Depth of cover		Material Change
	IP Mains		Syphon		Out of Standard Service
	LHP Mains				

Date Requested: 26/08/2022
Job Reference: 26730192
Site Location: 546199 229143
Requested by: Mrs Lynn Rusling

Your Scheme/Reference:
UTT/22/2046/PINS

View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999

Scale: 1:500 (When plotted at A4)

Crown Copyright © - This plan is reproduced from or based on the OS map by Cadent Gas Limited, with the sanction of the controller of HM Stationary Office. Crown Copyright Reserved. Ordnance Survey Licence number 100024886

Warning: PDF designed for A4 colour print only with no page scaling



Dig Sites Area: Line:



- | | | | | | |
|--|-----------|--|----------------|--|-------------------------|
| | LP Mains | | Valve | | Diameter Change |
| | MP Mains | | Depth of cover | | Material Change |
| | IP Mains | | Syphon | | Out of Standard Service |
| | LHP Mains | | | | |

Date Requested: 26/08/2022
 Job Reference: 26730192
 Site Location: 546199 229143
 Requested by: Mrs Lynn Rusling
 Your Scheme/Reference:
 UTT/22/2046/PINS
 View extent: 100m, 100m

IMPORTANT NOTICES

This plan shows these pipes owned by Cadent Gas Limited in its role as a Licensed Gas Transporter (GT). Gas pipes owned by other GT's or otherwise privately owned may be present in this area. Information with regards to such pipes should be obtained from the relevant owners. The information shown on this plan is given without warranty, the accuracy thereof cannot be guaranteed. Service pipes, valves, syphons, stub connections etc. are not shown but their presence should be anticipated. No liability of any kind whatsoever is accepted by Cadent Gas Limited or their agents, servants or contractors for any errors or omission. Safe digging practices, in accordance with HS(G)47, must be used to verify and establish the actual position of mains, pipes, services and other apparatus on site before any mechanical plant is used. It is your responsibility to ensure that this information is provided to all persons (either direct labour or contractors) working for you on or near gas apparatus. The information included on this plan should not be referred to beyond a period of 28 days from the date of issue.

In case of emergency call - 0800 111 999