

EC Type Examination Certificate Number: 0120/SGS0219

Sifam Tinsley Instrumentation Ltd

Unit 1 Warner Drive,
Springwood Industrial Estate
Braintree
Essex
CM7 2YW
United Kingdom

Instrument Identification: AP25-1DO

Instrument Traceable Number 0120/SGS0219

Single Phase, Active Import/ Export (kWh), Indoor, Electricity Meter

has been assessed and certified as meeting the requirements of

EC Directive 2004/22/EC

Measuring Instruments Annex B

It is certified that the manufacturer's technical design and specimen for the above instrument has been examined and, based on the evidence submitted, it is considered that the instrument conforms to the requirements of MI-003 of EC Directive 2004/22/EC

This certificate must be used in conjunction with a certificate covering the product verification as required in Annex D or Annex F

This certificate is valid until 29th September 2025 Issue 1

Certification is based on report number(s) SHES141200649301 issued 16th April 2015, EMA207767 issued 9th October 2015 EMA219419 issued 28th January 2016

Authorised Signature

SGS United Kingdom Limited, Notified Body 0120 Unit 202B Worle Parkway, Weston-super-Mare, BS22 6WA□UK t +44 (0)1934 522917 f +44 (0)1934 522137 www.sgs.com

Contact Address SGS United Kingdom Ltd, Units 12A & 12B, South Industrial Estate, Bowburn, Durham, DH6 5AD□UK t +44 (0)191 377 2000 f +44 (0)191 377 2020 www.sgs.com



0120/SGS0219

Issue Number: 1 Dated: 28th January 2016

1. Technical Data


Manufacturer	Sifam Tinsley Instrumentation Ltd.	
Meter Type(s)	AP25-1DO	
Voltage Rating (Un)	230V	
Current Rating (Imin – Iref (Imax))	0.5-10(100)A	
Frequency (Fn)	50Hz	
Active Accuracy Class (kWh)	A or B (kWh)	
Type of circuit	1p2w	
Temperature Range	-25°C to +55°C	
Software Version No.	V1.2	
Identification Location	Nameplate	
Bill Of Materials No.'s	SDM230MODBUS-20150929	
IP Rating	IP51	
Insulation Protective Class	Class II	
LED Pulse Constant	1000imp/ kWh	
Impulse Voltage Rating	6kV	
AC Voltage Rating	4kV	
Terminal Cover Sealing Type	4 x Wire & Crimp	
Integrity of meter	Inaccessible without breaking seals	
Intended Location of the Meter	Indoor	
Type of Register	LCD	



0120/ SGS0219

Issue Number: 1 Dated: 28th January 2016

2. Photograph of Meter and Sealing Plan

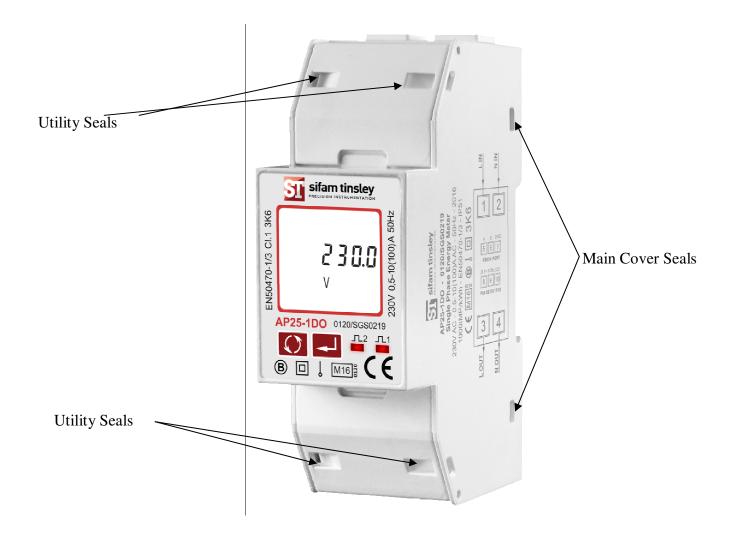



0120/SGS0219

Issue Number: 1 Dated: 28th January 2016

3. Influence factors for temperature, frequency and voltage

Current	PF Cos	-25℃	-10℃	5℃	30℃	40℃	55℃
lmin	1.0	0.45	0.33	0.23	0.15	0.17	0.23
Itr	1.0	0.44	0.31	0.19	0.07	0.10	0.18
10ltr	1.0	0.42	0.29	0.18	0.03	0.08	0.16
Imax	1.0	0.27	0.19	0.12	0.03	0.06	0.12
ltr	0.5ind	0.48	0.36	0.27	0.17	0.18	0.22
10ltr	0.5ind	0.41	0.28	0.17	0.03	0.08	0.17
Imax	0.5ind	0.27	0.18	0.12	0.04	0.07	0.13
ltr	0.8cap	0.45	0.31	0.20	0.09	0.12	0.18
10ltr	0.8cap	0.40	0.27	0.16	0.04	0.10	0.19
Imax	0.8cap	0.26	0.19	0.11	0.05	0.08	0.15

During the type approval examination the influence factors for temperature, frequency and voltage are determined per load point. The table above represents the sum of the square values per load, determined via the following formula:-

$$\delta \; e \; (\textit{T}, \; \textit{U}, \; \textit{f}) = \sqrt{\; (\delta \; e^2 \; (\textit{T}, \; \textit{I} \; , \text{cos} \phi) \; , \; \delta \; e^2 \; (\textit{U}, \; \textit{I} \; , \text{cos} \phi) \; , \; \delta \; e^2 \; (\; \textit{f} \; , \; \textit{I} \; , \text{cos} \phi))}$$

where

 $\delta e(T, I, \cos \varphi) =$ Additional error due to variation of the temperature at the same load $\delta e(U, I, \cos \varphi) =$ Additional error due to variation of the voltage at the same load Additional error due to variation of the frequency at the same load



0120/SGS0219

Issue Number: 1 Dated: 28th January 2016

4. Annex of Variants

Product Variant Identification Details:

Type Designation Description of meter

AP25-1DO: Single tariff, total active energy, resettable active energy, import active energy,

export active energy, total reactive energy, import reactive energy,

export reactive energy, active power, reactive power, voltage, current, frequency,

power factor, power demand, RS485 Modbus.

Modifications to the meter(s) described according to approval No.0120/SGS0219 must be notified to the issuing body to confirm the meter(s) continuing compliance to the relevant pattern approval standard(s).

5. Document Revision History

Issue	Date	Comments
1	28/01/2016	Initial Issue