EU Type Examination Certificate Number: **0120/SGS0259**

Bemko sp. z.o.o.

Bocznicowa 13 str,
05-850 Jawczyce,
Poland

Instrument Identification:
BL03A-MID

Polyphase, Active Import/Export (kWh), Electricity Meter

Instrument Traceable Number
0120/SGS0259

has been assessed and certified as meeting the requirements of

EU Directive 2014/32/EU

on Measuring Instruments Annex II, Module B

It is certified that the manufacturer's technical design and specimen for the above instrument has been examined and, based on the evidence submitted, it is considered that the instrument conforms to the requirements of Annex V of EU Directive 2014/32/EU

This certificate must be used in conjunction with a certificate covering the product verification as required in Annex II, Module D or Annex II, Module F
.

This certificate is valid until 14th March 2027
Issue 1

Certification is based on report number(s) SHES151200818401 Dated 17th March 2017
EMA234429/1
EMA229767

Authorised Signature

SGS United Kingdom Limited, Notified Body 0120
Unit 202B Worle Parkway, Weston-super-Mare, BS22 6WA, UK
t +44 (0)1934 522917 f +44 (0)1934 522137 www.sgs.com

Contact Address
SGS United Kingdom Limited, Units 12A & 12B, South Industrial Estate, Bowburn, Durham, DH6 5AD, UK
t +44 (0)191 377 2000 f +44 (0)191 377 2020 www.sgs.com

1. Technical Data

Manufacturer	Bemko sp. z.o.o.
Meter Type	BL03A-MID
Voltage Rating *(Un)*	3x230/400V
Current Rating *(Imin – Iref (Imax))*	0.25-5(30)A, 0.25-5(32)A, 0.25-5(40)A, 0.25-5(45)A, 0.25-5(50)A, 0.25-5(80)A,
Frequency *(Fn)*	50Hz
Active Accuracy Class *(kWh)*	A or B (kWh)
Type of circuit	3P4W
Temperature Range	-25°C to +55°C
Software/ Firmware Version No **CRC Checksum** **Identification Location**	V1.01 91E4 LCD
Bill Of Materials Number	D519032
IP Rating	IP51
Insulation Protective Class	Class II
LED Pulse Constant	1000imp/kWh
Impulse Voltage Rating	6kV
AC Voltage Rating	4kV
Main Cover Sealing Type	Wire & Crimp
Integrity of meter	Inaccessible without breaking seals
Intended Location of the Meter	Indoor
Type of Register	LCD
Terminal Arrangement(s)	DIN
Location of Manufacturers Address	Associated documents and side of meter

2. Photographs of Meter and Sealing Plan

Terminal Cover Seals

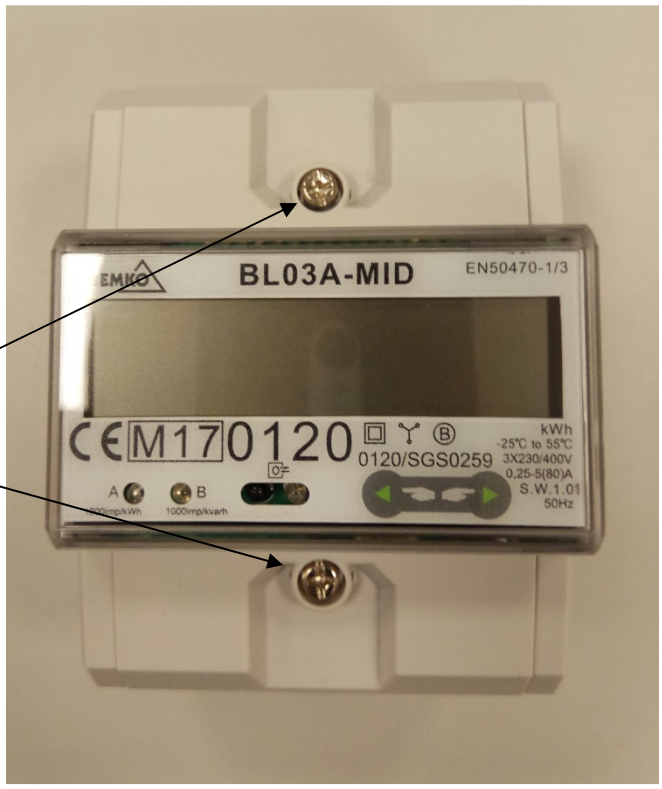

Main Cover Seal

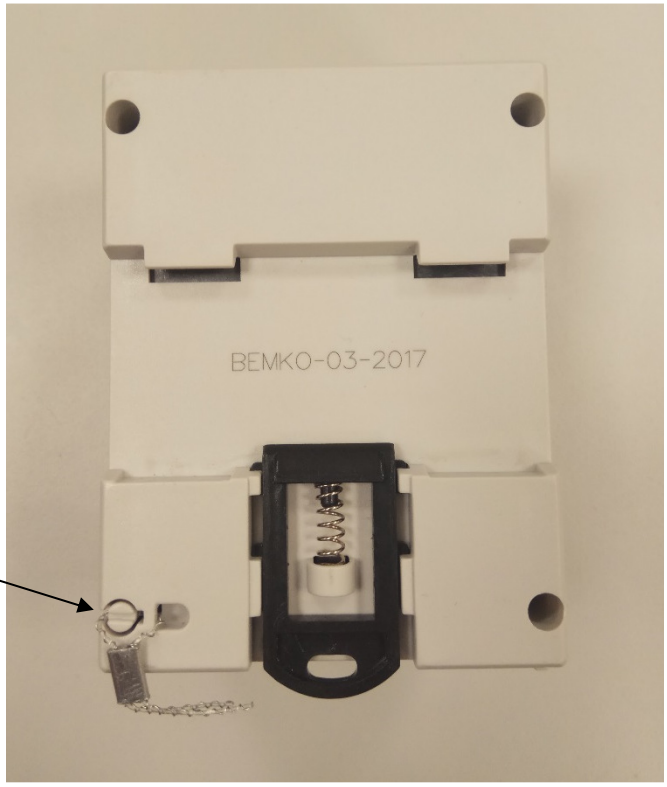

3. Examples of Nameplates

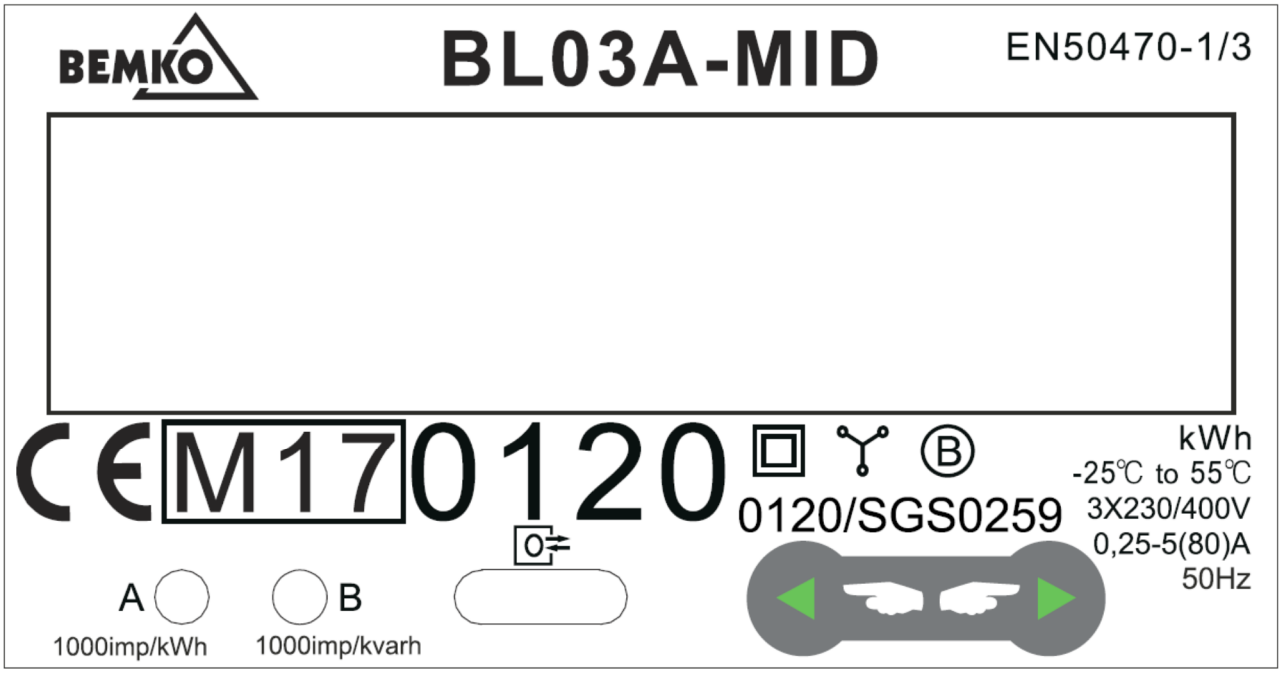

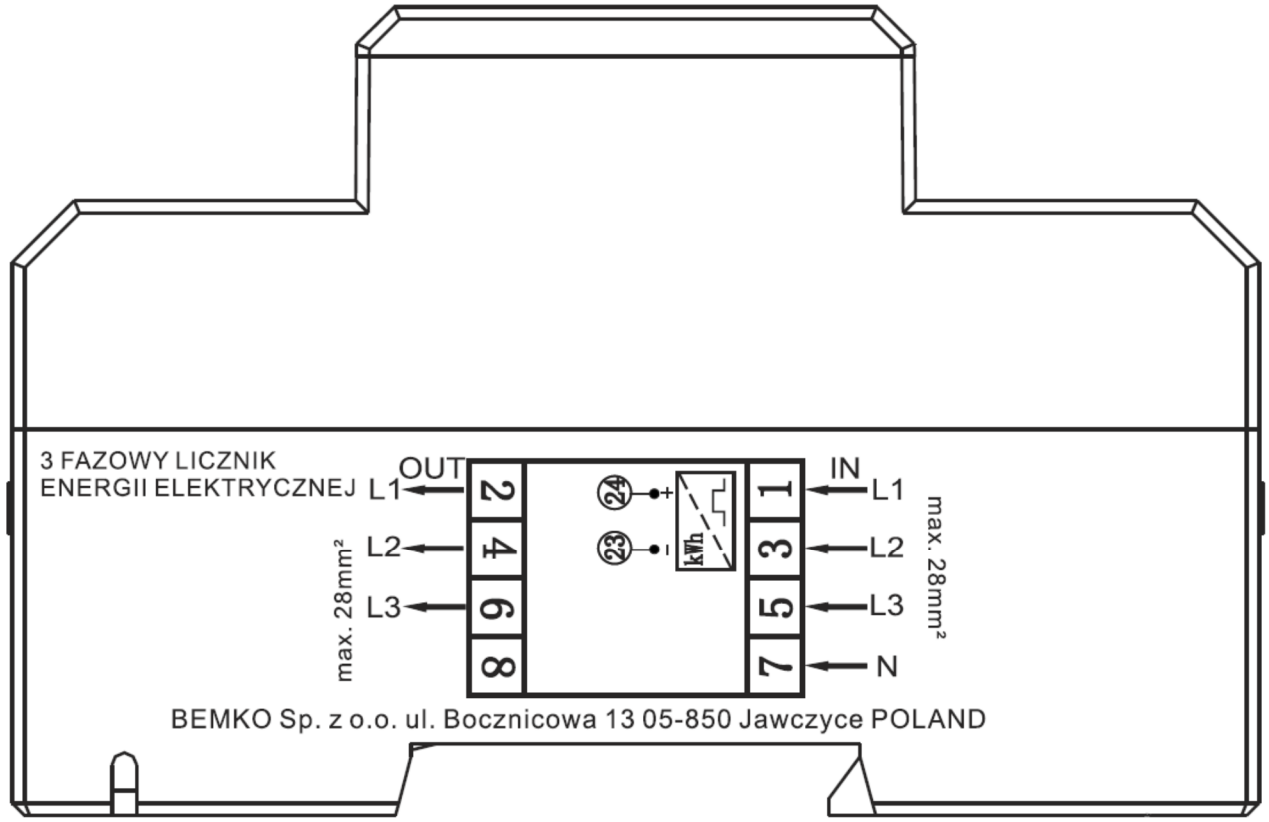

4. Calculation of the composite error/ MPE

During the type approval examination the influence factors for temperature, frequency and voltage are determined per load point. The table below represents the sum of the square values per load, determined via the following formula:-

$$\delta e\,(T, U, f) = \sqrt{(\delta e^2\,(T, I, \cos\varphi)\,,\ \delta e^2\,(U, I, \cos\varphi)\,,\ \delta e^2\,(f, I, \cos\varphi))}$$

where

$\delta e(T, I, \cos\varphi)$	=	Additional error due to variation of the temperature at the same load
$\delta e(U, I, \cos\varphi)$	=	Additional error due to variation of the voltage at the same load
$\delta e(f, I, \cos\varphi)$	=	Additional error due to variation of the frequency at the same load

		Influence Factors for Temperature. Frequency & Voltage					
Current	**PF Cos**	-25℃	-10℃	5℃	30℃	40℃	55℃
Imin	1.0	0.38	0.25	0.13	0.08	0.17	0.29
Itr	1.0	0.38	0.27	0.14	0.07	0.16	0.31
10Itr	1.0	0.37	0.25	0.13	0.08	0.18	0.33
Imax	1.0	0.32	0.22	0.16	0.06	0.15	0.28
Itr	0.5ind	0.38	0.27	0.13	0.06	0.14	0.31
10Itr	0.5ind	0.36	0.24	0.11	0.09	0.19	0.35
Imax	0.5ind	0.30	0.21	0.14	0.05	0.15	0.31
Itr	0.8cap	0.37	0.26	0.14	0.07	0.17	0.33
10Itr	0.8cap	0.35	0.23	0.11	0.11	0.20	0.36
Imax	0.8cap	0.30	0.21	0.13	0.07	0.16	0.31
					0.00	0.00	0.00
L1							
Itr	1.0	0.39	0.26	0.12	0.07	0.17	0.26
10Itr	1.0	0.39	0.25	0.11	0.09	0.18	0.29
Imax	1.0	0.30	0.21	0.13	0.06	0.15	0.26
Itr	0.5ind	0.39	0.26	0.12	0.09	0.15	0.30
10Itr	0.5ind	0.38	0.25	0.11	0.10	0.19	0.33
Imax	0.5ind	0.30	0.21	0.13	0.06	0.15	0.28
L2							
Itr	1.0	0.52	0.37	0.20	0.10	0.24	0.46
10Itr	1.0	0.51	0.35	0.17	0.12	0.26	0.49
Imax	1.0	0.45	0.33	0.21	0.08	0.21	0.42
Itr	0.5ind	0.54	0.36	0.20	0.08	0.22	0.44
10Itr	0.5ind	0.51	0.35	0.17	0.11	0.25	0.47
Imax	0.5ind	0.47	0.34	0.22	0.08	0.20	0.41
L3							
Itr	1.0	0.17	0.12	0.08	0.07	0.12	0.28
10Itr	1.0	0.15	0.12	0.06	0.05	0.13	0.27
Imax	1.0	0.09	0.09	0.07	0.04	0.10	0.23
Itr	0.5ind	0.16	0.12	0.06	0.05	0.09	0.26
10Itr	0.5ind	0.12	0.11	0.06	0.08	0.13	0.28
Imax	0.5ind	0.06	0.08	0.02	0.05	0.11	0.24

5. Annex of Variants

Product Variant Identification Details:

Type Designation	Description of meter
BL03A-MID	3x230/400V, 0.25-5(x), energy measurement (kWh & kVarh), IR

Modifications to the meter(s) described according to approval No.**0120/SGS0259** must be notified to the issuing body to confirm the meter(s) continuing compliance to the relevant pattern approval standard(s).

6. Document Revision History

Issue	Date	Comments
1	13/04/2018	Initial Issue

END OF CERTIFICATE