

EU Type Examination Certificate Number: 0120/SGS0225

# **Janitza Electronics GmbH**

Vor dem Polstűck 6 35633 Lahnau Germany

Instrument Identification:

MPA-3-669 & MPA-3-669DI

Poly Phase, Active Import/Export, Indoor, Multi-Function, Transformer Operated, Electricity
Meter

Instrument Traceable Number 0120/SGS0225

has been assessed and certified as meeting the requirements of

# EU Directive 2014/32/EU

on Measuring Instruments Annex II, Module B

It is certified that the manufacturer's technical design and specimen for the above instrument has been examined and, based on the evidence submitted, it is considered that the instrument conforms to the requirements of Annex V of EU Directive 2014/32/EU

This certificate must be used in conjunction with a certificate covering the product verification as required in Annex II, Module D or Annex II, Module F

This certificate is valid until 9<sup>th</sup> March 2024 Issue 4

Certification is based on report number(s) EMA174647/1/MID dated 30<sup>th</sup> January 2014 EMA221862/1 dated 24<sup>th</sup> March 2016

**Authorised Signature** 

KC.

SGS United Kingdom Limited, Notified Body 0120 Unit 202B Worle Parkway, Weston-super-Mare, BS22 6WA, UK t +44 (0)1934 522917 f +44 (0)1934 522137 www.sgs.com

Contact Address

SGS United Kingdom Limited, Units 12A & 12B, South Industrial Estate, Bowburn, Durham, DH6 5AD, UK t +44 (0)191 377 2000 f +44 (0)191 377 2020 <a href="https://www.sgs.com">www.sgs.com</a>

DU\_CST-ME-002 Rev 2 EU Type Examination Cert.



# 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

#### 1. Technical Data


Manufacturar	lavitus Flactuspies Cook!!
Manufacturer	Janitza Electronics GmbH
Meter Type	MPA-3-669 & MPA-3-669DI
Voltage Rating (Un)	3x230/400V
Current Rating (Imin – Iref (Imax))	0.25-5(6)A
Frequency (Fn)	50Hz
Active Accuracy Class (kWh)	A or B or C (kWh)
Type of circuit	3p4w, 3p3w, 1p2w
Temperature Range	-25°C to +55°C
Software/ Firmware Version No	MPA-3-669: V1.3 MPA-3-669DI: V1.8
CRC Checksum	MPA-3-669: 0x0000D5C8 MPA-3-669DI: 0x005D2CB2
Identification Location	Nameplate
Bill Of Materials Number	MPA-3-669: SDM630-1 V1.5 OR DH-JS-150046-1.4 MPA-3-669DI: DH-JS-190005-1.0
IP Rating	IP51
Insulation Protective Class	Class II
LED Pulse Constant	3200imp/kWh
Impulse Voltage Rating	6kV
AC Voltage Rating	4kV
Main Cover Sealing Type	2 x Wire & Crimp
Integrity of meter	Inaccessible without breaking seals
Intended Location of the Meter	Indoor
Type of Register	LCD
Terminal Arrangement(s)	DIN
Location of Manufacturers Address	Side of meter




# 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

#### 2. Photograph of Meter and Sealing Plan

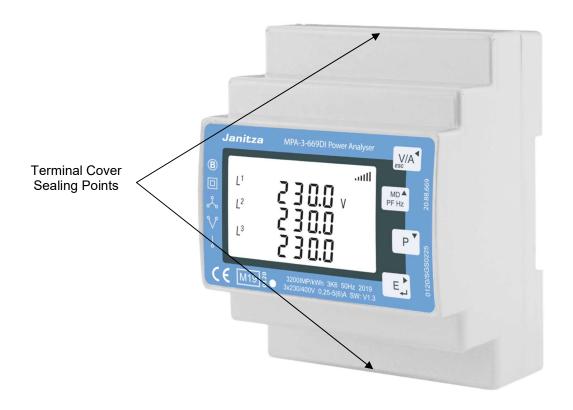

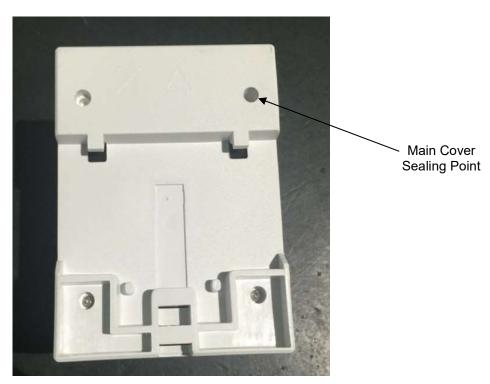



## 0120/SGS0225


Dated: 5th December 2019 Issue Number: 4

#### 3. **Examples of Nameplates**



Vor dem Polstück 6 • 35633 Lahnau • Germany Janitza electronics GmbH www.janitza.com

Vor dem Polstück 6 • 35633 Lahnau • Germany Janitza electronics GmbH www.janitza.com

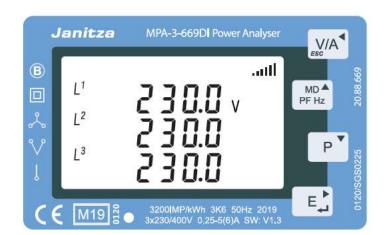



### 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

#### 4. Calculation of the composite error/ MPE

During the type approval examination the influence factors for temperature, frequency and voltage are determined per load point. The table below represents the sum of the square values per load, determined via the following formula:-

$$\delta e(T, U, f) = \sqrt{(\delta e^2(T, I, \cos\varphi), \delta e^2(U, I, \cos\varphi), \delta e^2(f, I, \cos\varphi))}$$

#### where

 $\begin{array}{lll} \delta \mathrm{e}(T,I,\cos \varphi) & = & \quad \text{Additional error due to variation of the temperature at the same load} \\ \delta \mathrm{e}(U,I,\cos \varphi) & = & \quad \text{Additional error due to variation of the voltage at the same load} \\ \delta \mathrm{e}(f,I,\cos \varphi) & = & \quad \text{Additional error due to variation of the frequency at the same load} \\ \end{array}$ 



# 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

	Influence Factors for Temperature. Frequency & Voltage				Voltage		
Current	PF Cos	-25	-10	5	30	40	55
Imin	1.0	0.39	0.30	0.71	0.16	0.25	0.39
Itr	1.0	0.33	0.27	0.28	0.18	0.25	0.47
10ltr	1.0	0.35	0.31	0.24	0.22	0.29	0.49
Imax	1.0	0.36	0.31	0.25	0.21	0.28	0.47
Itr	0.5ind	0.26	0.25	0.36	0.16	0.23	0.44
10ltr	0.5ind	0.38	0.34	0.29	0.27	0.34	0.52
lmax	0.5ind	0.42	0.38	0.32	0.30	0.36	0.52
Itr	0.8cap	0.31	0.42	0.43	0.32	0.37	0.50
10ltr	0.8cap	0.32	0.27	0.21	0.17	0.26	0.45
Imax	0.8cap	0.34	0.28	0.21	0.15	0.24	0.43
L1							
Itr	1.0	0.37	0.39	0.44	0.14	0.28	0.35
10ltr	1.0	0.34	0.30	0.24	0.20	0.27	0.47
Imax	1.0	0.33	0.30	0.23	0.21	0.28	0.47
Itr	0.5ind	0.41	0.56	0.96	0.14	0.15	0.16
10ltr	0.5ind	0.49	0.46	0.42	0.38	0.43	0.62
Imax	0.5ind	0.49	0.46	0.42	0.39	0.44	0.60
L2							
Itr	1.0	0.25	0.20	0.12	0.18	0.31	0.51
10ltr	1.0	0.38	0.32	0.23	0.19	0.28	0.45
Imax	1.0	0.38	0.32	0.23	0.21	0.28	0.47
Itr	0.5ind	0.12	0.12	0.13	0.25	0.38	0.59
10ltr	0.5ind	0.36	0.33	0.25	0.25	0.32	0.49
Imax	0.5ind	0.39	0.35	0.28	0.27	0.34	0.49
L3							
Itr	1.0	0.32	0.27	0.21	0.19	0.27	0.46
10ltr	1.0	0.32	0.28	0.22	0.21	0.30	0.50
Imax	1.0	0.33	0.30	0.23	0.22	0.30	0.50
Itr	0.5ind	0.32	0.32	0.24	0.20	0.29	0.53
10ltr	0.5ind	0.34	0.29	0.23	0.23	0.33	0.54
Imax	0.5ind	0.35	0.31	0.25	0.13	0.33	0.53



## 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

#### 5. Annex of Variants

**Product Variant Identification Details:** 

Type Designation	Description of meter
MPA-3-669:	0.25-5(6)A – Polyphase, Active Import/Export kWh, Multifunction, Transformer Operated (Terminal 7 and 8 used as power output for next meter in daisy connection)
MPA-3-669DI:	0.25-5(6) A-Polyphase, Active Import/Export kWh, Multifunction, Transformer Operated. Digital inputs

Modifications to the meter(s) described according to approval No.0120/SGS0225 must be notified to the issuing body to confirm the meter(s) continuing compliance to the relevant pattern approval standard(s).



### 0120/SGS0225

Issue Number: 4 Dated: 5<sup>th</sup> December 2019

#### 6. Document Revision History

Issue	Date	Comments
1	07/04/2016	Initial Issue
2	28/10/2016	Change of meter type number from ECS3-669MID to MPA-3-669
3	01/10/2019	Addition of MPA-3-669DI variant and change of manufacturer name & address
4	05/12/2019	Active accuracy class 'C' added to approval

This document is issued by the Company subject to its General Conditions for Certification Services, available on request or accessible at <a href="http://www.sgs.com/en/Terms-and-Conditions.aspx">http://www.sgs.com/en/Terms-and-Conditions.aspx</a>.

Attention is drawn to the limitation of liability, indemnification and jurisdiction issues defined therein. Any holder of this document is advised that information contained hereon reflects the Company's findings at the time of its intervention only and within the limits of Client's instructions, if any. The Company's sole responsibility is to its Client and this document does not exonerate parties to a transaction from exercising all their rights and obligations under the transaction documents. This document cannot be reproduced except in full, without prior written approval of the Company. Any unauthorized alteration, forgery or falsification of the content or appearance of this document is unlawful and offenders may be prosecuted to the fullest extent of the law.

Unless otherwise stated the results shown in this test report refer only to the sample(s) tested and such sample(s) are retained for 28 days only.

END OF CERTIFICATE