

Construction noise and vibration Monthly Report – February 2021

London Borough of Hillingdon

Non-Technical Summary	1
Abbreviations and Descriptions	2
1 Introduction	3
1.2 Measurement Locations	4
2 Summary of Results	5
2.1 Summary of Measured Noise Levels	5
2.2 Exceedances of the LOAEL and SOAEL	7
2.3 Exceedances of Trigger Level	9
2.4 Complaints	9
Appendix A Site Locations	10
Appendix B Monitoring Locations	15
Appendix C Data	20

List of tables

Table 1: Table of Abbreviations	2
Table 2: Monitoring Locations	4
Table 3: Summary of Measured dB L _{Aeq} Data over the Monitoring Period	6
Table 4: Summary of Exceedances of LOAEL and SOAEL	8
Table 5: Summary of Exceedances of Trigger Levels	9
Table 6: Summary of Complaints	9

Non-Technical Summary

This Noise and Vibration Monitoring Report fulfils HS2 Limited's commitment detailed in the Environmental Minimum Requirements (EMRs), Annex 1, Code of Construction Practice, to present the results of noise monitoring carried out within the London Borough of Hillingdon during the month of February 2021.

Within this period noise monitoring was undertaken at the following worksites:

- Load Test Pile worksite (ref.: LPT #2), where works activities included:
 - at Dews Lane site, utility works, hardstanding works and civil works, excavations and compound operation were underway; and
 - at Moorhall Road site, utility works, hardstanding works and civil works, earthworks, drainage works and ground investigations were underway;
- West Ruislip Portal worksite (ref.: West Ruislip Portal), where site setup, site security, deliveries, pile trimming, bored stone column installations and power utility works were underway;
- South Ruislip Ventilation Shaft worksite (ref.: SRVS), where site setup activities, excavation works and surveys were underway.

Further works, where monitoring did not take place, were also undertaken at:

- Harvil Road, where sheet piling works took place;
- St Michael's Crescent, Meadow Way, Ruislip and The Uplands, Ruislip where power utility works were underway;

There were no exceedances of the HS2 threshold levels for significant noise impact during the reporting period at any monitoring position.

There were no exceedances of trigger levels as defined in Section 61 consents during the reporting period at any monitoring position.

Four complaints were received during the monitoring period. A description of the complaints, the results of investigations and any actions taken are detailed in Table 6 of this report.

Abbreviations and Descriptions

The abbreviations, descriptions and project terminology used within this report can be found in Table 1.

Table 1: Table of Abbreviations

Acronym/Term	Definition
$L_{Aeq,T}$	See equivalent continuous sound pressure level
Ambient sound	A description of the all-encompassing sound at a given location and time which will include sound from many sources near and far. Ambient sound can be quantified in terms of the equivalent continuous sound pressure level, $L_{pAeq,T}$
Decibel(s), or dB	Between the quietest audible sound and the loudest tolerable sound there is a million to one ratio in sound pressure (measured in Pascal (Pa)). Because of this wide range, a level scale called the decibel (dB) scale, based on a logarithmic ratio, is used in sound measurement. Audibility of sound covers a range of approximately 0-140dB.
Decibel(s) A-weighted, or dB(A)	The human ear system does not respond uniformly to sound across the detectable frequency range and consequently instrumentation used to measure sound is weighted to represent the performance of the ear. This is known as the 'A weighting' and is written as 'dB(A)'.
Equivalent continuous sound pressure level, or $L_{Aeq,T}$	An index used internationally for the assessment of environmental sound impacts. It is defined as the notional unchanging level that would, over a given period of time (T), deliver the same sound energy as the actual time-varying sound over the same period. Hence fluctuating sound levels can be described in terms of an equivalent single figure value, typically expressed as a decibel level.
Exclusion of data	Measurement of noise levels can be affected by weather conditions such as prolonged periods of rain, winds speeds higher than 5m/s and snow/ice ground cover. Noise levels measured during these periods are considered not representative of normal noise conditions at the site and, for the purposes of this report, are excluded from the assessment of exceedances and calculation of typical noise levels and are also greyed out in charts. Identifiable incongruous noise and vibration events not attributable to HS2 construction noise are also excluded.
Façade	A facade noise level is the noise level 1m in front of a large reflecting surface. The effect of reflection, is to produce a slightly higher (typically +2.5 to +3 dB) sound level than it would be if the reflecting surface was not there.
Free-field	A free-field noise level is the noise level measured at a location where no reflective surfaces, other than the ground, lies within 3.5 metres of the microphone position.
LOAEL	Lowest Observed Adverse Effect Level - the level above which adverse effects on health and quality of life can be detected.
Peak particle velocity, or PPV	Instantaneous maximum velocity reached by a vibrating element as it oscillates about its rest position. The PPV is a simple indicator of perceptibility and risk of damage to structures due to vibration. It is usually measured in mm/s.
SOAEL	Significant Observed Adverse Effect Level - the level above which significant adverse effects on health and quality of life occur.
Sound pressure level	The parameter by which sound levels are measured in air. It is measured in decibels. The threshold of hearing has been set at 0dB, while the threshold of pain is approximately 120dB. Normal speech is approximately 60dB at a distance of 1 metre and a change of 3dB in a time varying sound signal is commonly regarded as being just detectable. A change of 10dB is subjectively twice, or half, as loud.
Vibration dose value, or VDV	An index used to evaluate human exposure to vibration in buildings. While the PPV provides information regarding the magnitude of single vibration events, the VDV provides a measure of the total vibration experienced over a specified period of time (typically 16h daytime and 8h night-time). It takes into account the magnitude, the number and the duration of vibration events and can be used to quantify exposure to continuous, impulsive, occasional and intermittent vibration. The vibration dose value is measured in $m/s^{1.75}$.

1 Introduction

1.1.1 HS2 is required to undertake noise (and vibration) monitoring as necessary to comply with the requirements of the High Speed Rail (London-West Midlands) Environmental Minimum Requirements, including specifically Annex 1: Code of Construction Practice, in addition to any monitoring requirements arising from conditions imposed through consents under Section 61 of the Control of Pollution Act, 1974 or through Undertakings & Assurances given to third parties. Such monitoring may be undertaken for the following purposes:

- monitoring the impact of construction works;
- to investigate complaints, incidents and exceedance of trigger levels; or
- monitoring the effectiveness of noise and vibration control measures.

1.1.2 Monitoring data and interpretive reports are to be provided to each relevant local authority on a monthly basis and shall include a summary of the construction activities occurring, the data recorded over the monitoring period, any complaints received, any periods in exceedance of agreed trigger levels, the results of any investigations and any actions taken or mitigation measures implemented. This report provides noise data, and interpretation thereof, for monitoring carried out by HS2 within the London Borough of Hillingdon for the period 1st to 28st February 2021.

1.1.3 Active construction sites in the local authority area where monitoring was undertaken during this period include:

- Load Test Pile Worksite, ref.: LPT #2 (see plan 1 in Appendix A), where work activities included:
 - utility works, hardstanding works and civil works, excavations and compound operations along Dews Lane site; and
 - utility works, hardstanding and civil works, earthworks, drainage works and ground investigations were underway at Moorhall Road site.
- West Ruislip Portal Worksite, ref.: WRP (see plan 2 in Appendix A), where work activities included:
 - site setup, including hoarding and fencing installation, site security and aggregate deliveries via freight train, pile trimming bored stone column installation and power utility works,

- South Ruislip Ventilation Shaft worksite, ref.: SRVS (see plan 3 in Appendix A), where work activities included:
 - excavation of piling platforms, site clearance works, set up of site welfare and site preparation works (including removal of asbestos, construction of hardstanding, concrete ground slabs, dewatering works) and surveys.

1.1.4 Further works, where monitoring did not take place, were also undertaken at the following locations:

- Harvill Road, where sheet piling works and vegetation clearance were underway. Overhead line works were also underway in Harvill Road; and
- St Michael’s Crescent, Meadow Way, Ruislip and The Uplands, Ruislip (power utility works).

1.1.5 The applicable standards, guidance, and monitoring methodology is outlined in the construction noise and vibration monitoring methodology report which can be found at the following location <https://www.gov.uk/government/collections/monitoring-the-environmental-effects-of-hs2>. Noise and vibration monitoring reports for previous months can also be found at this location.

1.2 Measurement Locations

1.2.1 Six noise monitoring installations were active in February in the London Borough of Hillingdon area. Table 2 summarises the position of noise monitoring installations within the London Borough of Hillingdon area in February 2021.

1.2.2 Maps showing the position of noise monitoring installations are presented in Appendix B.

Table 2: Monitoring Locations

Worksite Reference	Measurement Reference	Address
Load Test Pile (LTP #2)	NMP1	Hillingdon Outdoor Activity Centre, Dews Lane, Harefield, Uxbridge
	NMP3	Dew's Farm Cottages, Dews Lane, Harefield, Uxbridge
West Ruislip Portal (WRP)	N048	West Ruislip Golf Club, Ickenham Rd, Ruislip
	N056	83 The Greenway, Ickenham, Ruislip
	N057	123 The Greenway, Ickenham, Ruislip
South Ruislip Ventilation Shaft (SRVS)	N061	Cineworld South Ruislip car park, Ruislip

2 Summary of Results

2.1 Summary of Measured Noise Levels

- 2.1.1 Table 3 presents a summary of the measured noise levels at each monitoring location over the reporting period. The $L_{Aeq,T}$ is presented for each of the relevant time periods averaged over the calendar month, along with the highest single period $L_{Aeq,T}$ that was found to occur within the month.

Table 3: Summary of Measured dB L_{Aeq} Data over the Monitoring Period

Worksite Reference	Measurement Reference	Site Address	Free-field or Façade Measurement	Weekly Average L _{Aeq,T} (highest Day L _{Aeq,T})					Saturday Average L _{Aeq,T} (highest day L _{Aeq,T})					Sunday / Public Holiday Average L _{Aeq,T} (highest day L _{Aeq,T})	
				0700 - 0800	0800 - 1800	1800 - 1900	1900 - 2200	2200 - 0700	0700 - 0800	0800 - 1300	1300 - 1400	1400 - 2200	2200 - 0700	0700 - 2200	2200 - 0700
LTP #2	NMP1	Hillingdon Outdoor Activity Centre, Dews Lane, Harefield, Uxbridge	Free-field	58.3 (63.2)	66.4 (69.6)	58.7 (68.9)	55.4 (61.2)	56.8 (64.0)	58.3 (62.5)	61.0 (67.8)	57.4 (60.1)	54.6 (62.6)	56.3 (61.5)	55.3 (60.4)	55.2 (60.9)
	NMP3	Dew's Farm Cottages, Dews Lane, Harefield, Uxbridge,	Free-field	52.9 (56.5)	68.2 (72.1)	57.7 (74.4)	50.5 (54.7)	49.7 (65.3)	50.0 (51.0)	57.5 (71.0)	55.4 (72.2)	51.5 (62.2)	49.6 (60.1)	50.6 (54.0)	48.3 (57.5)
WRP	N048	West Ruislip Golf Club, Ickenham Rd, Ruislip	Free-field	61.7 (63.4)	65.3 (69.1)	59.0 (62.4)	56.5 (61.4)	54.2 (60.8)	60.3 (61.2)	64.2 (65.4)	56.7 (57.3)	56.8 (58.6)	49.8 (57.6)	56.3 (58.8)	53.5 (59.5)
	N056	83 The Greenway, Ickenham, Ruislip	Free-field	60.7 (62.1)	60.4 (64.8)	59.4 (60.3)	58.0 (61.9)	56.0 (62.9)	61.2 (62.3)	59.6 (60.4)	59.4 (60.7)	59.1 (61.6)	50.8 (60.3)	59.7 (63.9)	56.0 (60.8)
	N057	123 The Greenway, Ickenham, Ruislip	Free-field	55.9 (57.4)	57.5 (58.9)	55.3 (57.8)	53.7 (60.9)	51.0 (58.1)	55.9 (56.5)	56.3 (56.8)	54.8 (55.4)	55.6 (62.7)	46.8 (55.1)	54.9 (57.5)	51.1 (56.0)
SRVS	N061	Cineworld South Ruislip car park, Ruislip	Free-field	58.6 (61.4)	62.6 (64.0)	63.2 (67.4)	62.2 (66.4)	54.6 (65.5)	58.8 (59.5)	61.8 (63.0)	63.1 (64.2)	63.7 (70.8)	54.1 (64.7)	61.5 (67.0)	54.2 (59.2)

2.1.2 Appendix C presents graphs of the noise monitoring data over the month for each of the measurement locations. Noise data presented consists of the hourly L_{Aeq} values and, where relevant, the $L_{Aeq,T}$ values (where the time period T has been taken to be the averaging period as specified in Table 1 of HS2 Information Paper E23). The full data set for the monitoring equipment can be found at the following location:
<https://data.gov.uk/dataset/24542ae7-dd44-444f-b259-871c4cc43b5e/environmental-monitoring-data>.

2.2 Exceedances of the LOAEL and SOAEL

- 2.2.1 The lowest observed adverse effect level (LOAEL) is defined in the Planning Practice Guidance – Noise (PPG) as the level above which "noise starts to cause small changes in behaviour and/or attitude, e.g. turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a perceived change in the quality of life".
- 2.2.2 The significant observed adverse effect level (SOAEL) is defined in the 'Planning Practice Guidance – Noise' as the level above which "noise causes a material change in behaviour and/or attitude, e.g. avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area."
- 2.2.3 HS2 Phase One Information Paper E23: Control of Construction Noise and Vibration sets out the LOAELs and SOAELs for construction noise.
- 2.2.4 Where reported construction noise levels exceed the LOAEL and SOAEL, relevant periods will be identified. Summary statistics to evaluate ongoing qualification for noise insulation and temporary rehousing are also presented where relevant.
- 2.2.5 Table 4 presents a summary of recorded exceedances of the LOAEL and SOAEL at each measurement location over the reporting period, including the number of exceedances during each time period.

Table 4: Summary of Exceedances of LOAEL and SOAEL

Worksite Reference	Measurement Reference	Site Address	Day (Weekday, Saturday, Sunday, Night)	Time period	Number of exceedances of LOAEL	Number of exceedances of SOAEL
LTP #2	NMP1	Hillingdon Outdoor Activity Centre, Dews Lane, Harefield, Uxbridge	Weekday	0800-1800	19	No exceedance
			Saturday	1800-1900 0800-1300	1 1	1* No exceedance
	NMP3	Dew's Farm Cottages, Dews Lane, Harefield, Uxbridge	Weekday	0800-1800	20	No exceedance
			Saturday	1800-1900 0800-1300 1300-1400	2 1 1	2* No exceedance 1*
WRP	N048	West Ruislip Golf Club, Ickenham Rd, Ruislip	Weekday	0800-1800	6	No exceedance
	N056	83 The Greenway, Ickenham, Ruislip	All day	All period	No exceedance	No exceedance
	N057	123 The Greenway, Ickenham, Ruislip	All days	All periods	No exceedance	No exceedance
SRVS	N061	Cineworld South Ruislip car park, Ruislip	All days	All period	Not applicable*	Not applicable**

* 4 no of exceedance of the SOAEL were due to activities being undertaken in close proximity to the monitor and not representative of noise levels experienced at nearby receptors.

** The defined LOAEL and SOAEL criteria are not applicable to non-residential receptors

2.2.6 No exceedances of the SOAEL were recorded due to HS2 construction works during February 2021. Exceedances of the LOAEL were recorded at monitoring locations NMP1, NMP3 and N048.

2.3 Exceedances of Trigger Level

2.3.1 Table 5 provides a summary of exceedances of the Section 61 trigger noise levels determined to be due to HS2 related construction noise measured during the reporting period, along with the findings of any investigation.

Table 5: Summary of Exceedances of Trigger Levels

Complaint Reference Number (if applicable)	Worksite Reference	Date and Time Period	Identified Source	Results of Investigation (including noise monitoring results)	Actions Taken
-	-	-	-	-	-

2.4 Complaints

2.4.1 Table 6 provides a summary of complaint information related to noise and vibration received during the reporting period, along with the findings of any investigation.


Table 6: Summary of Complaints


Complaint Reference Number	Worksite Reference	Description of Complaint	Results of Investigation	Actions Taken
HS2-21-41381-C HS2-21-41395-C	WRP	Complaints regarding loud noise from site before 8am.	Investigations shown that noise levels before 8am were similar to normal weekday levels and in line with the Section 61 application.	No actions considered to be required for works on site which were in line with the Section 61 application coverage.
HS2-21-41397-C	WRP	Complaint regarding noise from site during night-time.	Investigations shown that no works related to HS2 were underway at the time of the complaint.	No actions considered to be required.
HS2-21-41444-C	LTP#2	Complaint regarding noise due to piling works.	Investigation shown that the complaint was from a resident located to a significant distance from any of piling works undertaken at the time of the complaint and works were carried out in line with the Section 61 application.	The complainant has been contacted and information provided. No action considered to be required for works on site which were in line with Section 61 application coverage.


Appendix A Site Locations


HS2

Worksite identification plan - Overview

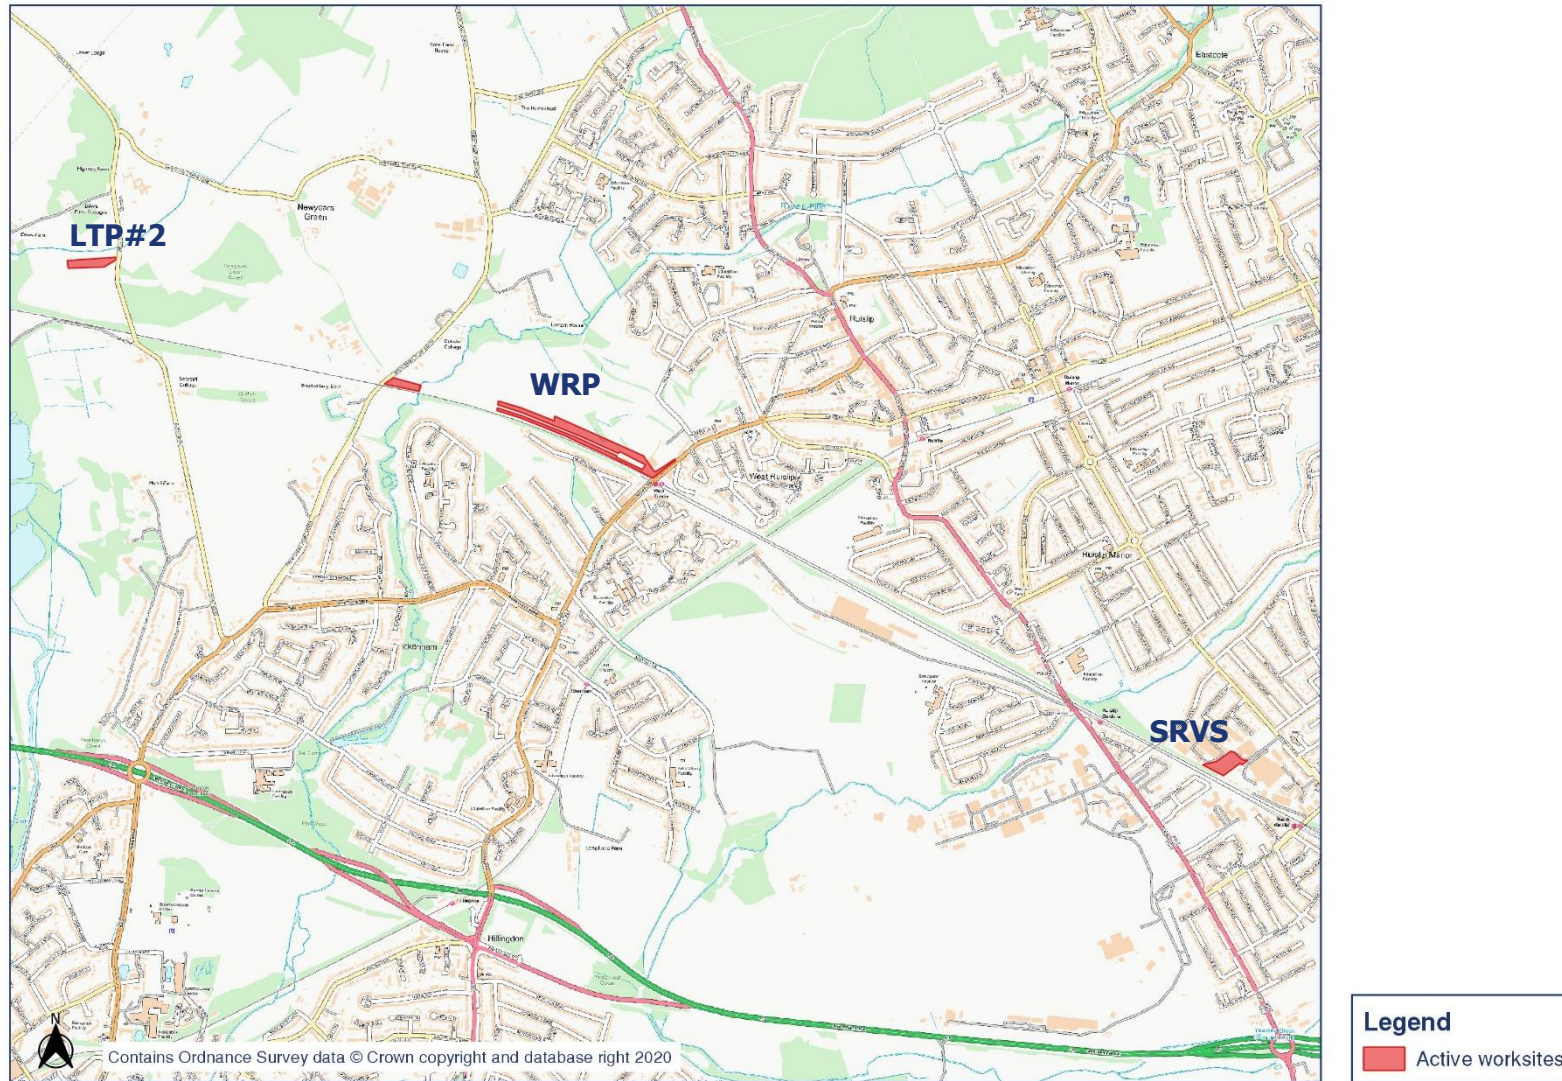


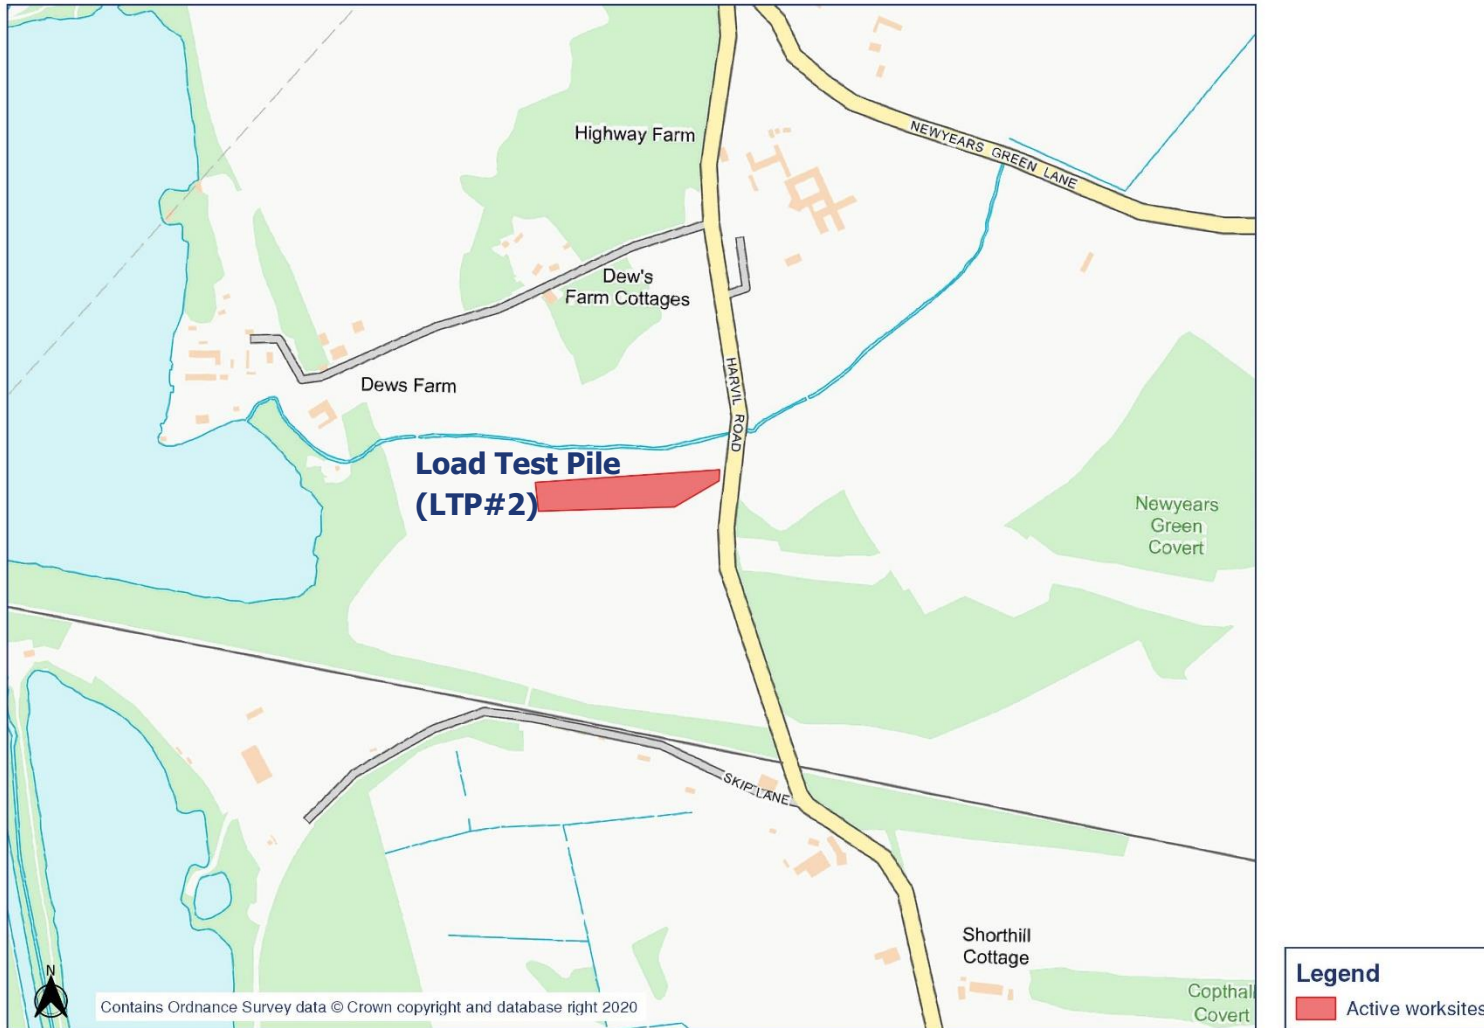

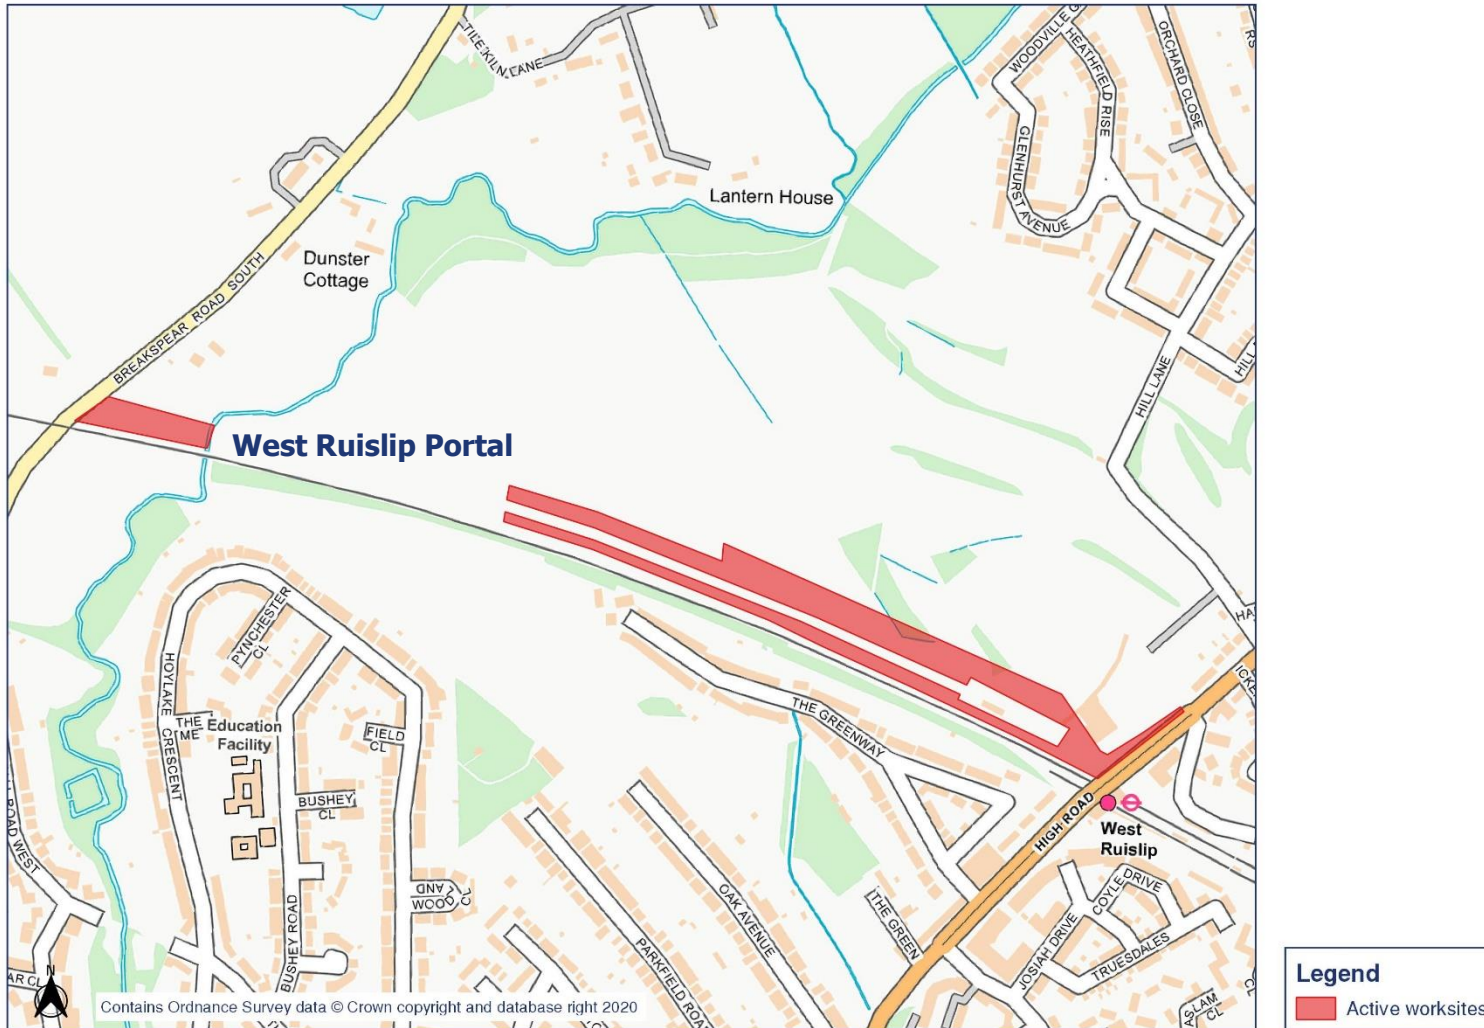

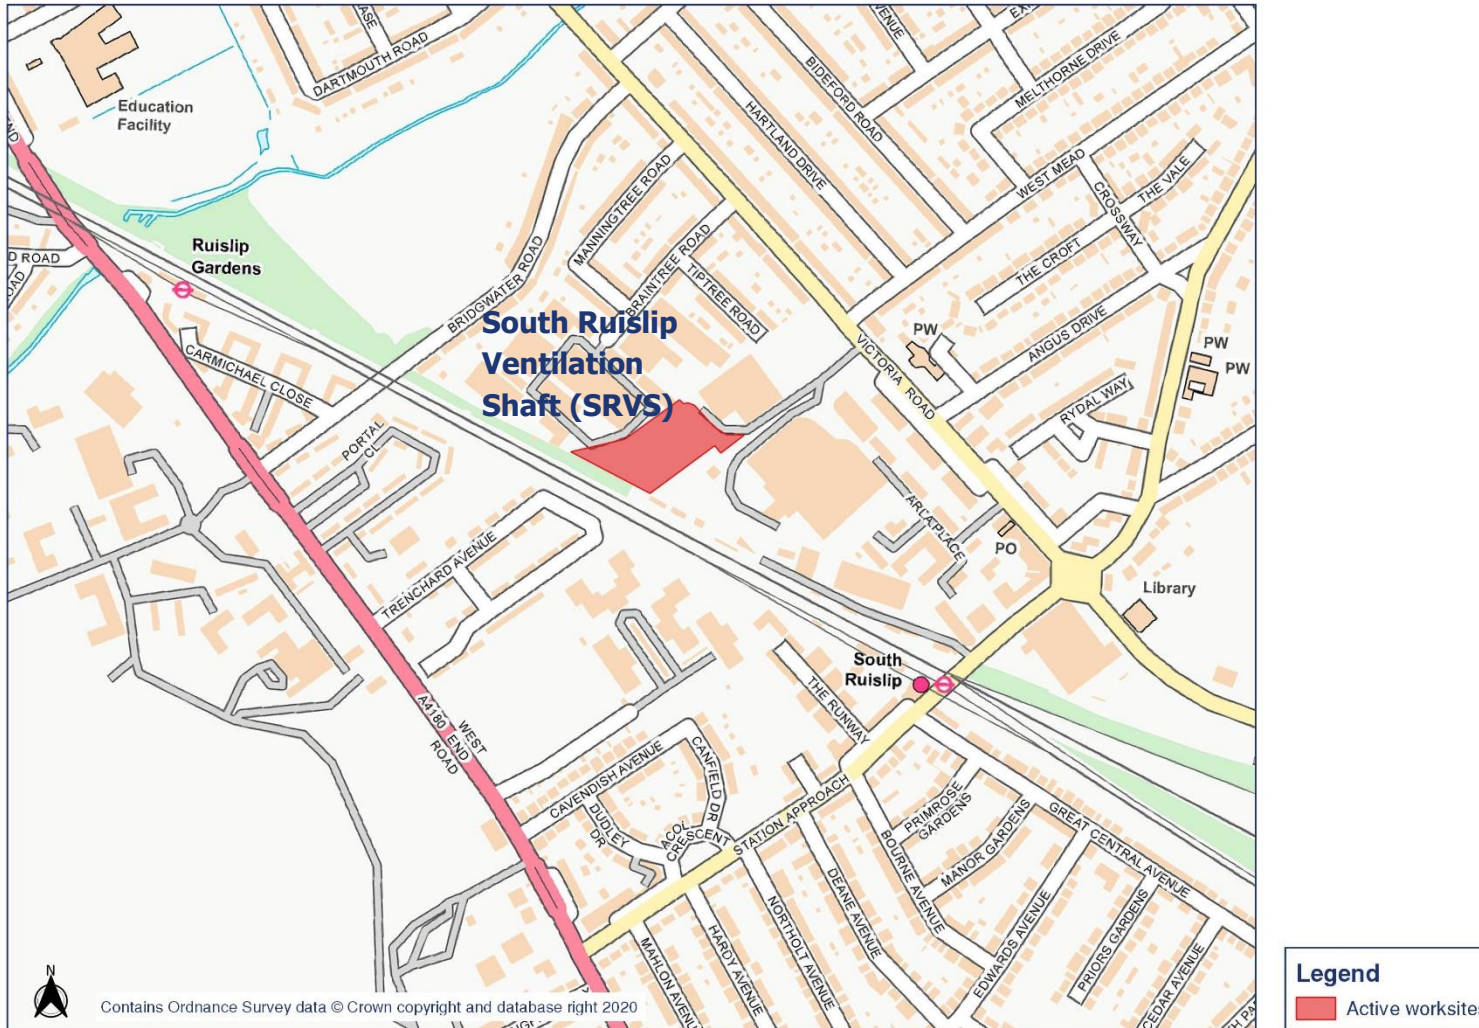


Appendix B Monitoring Locations

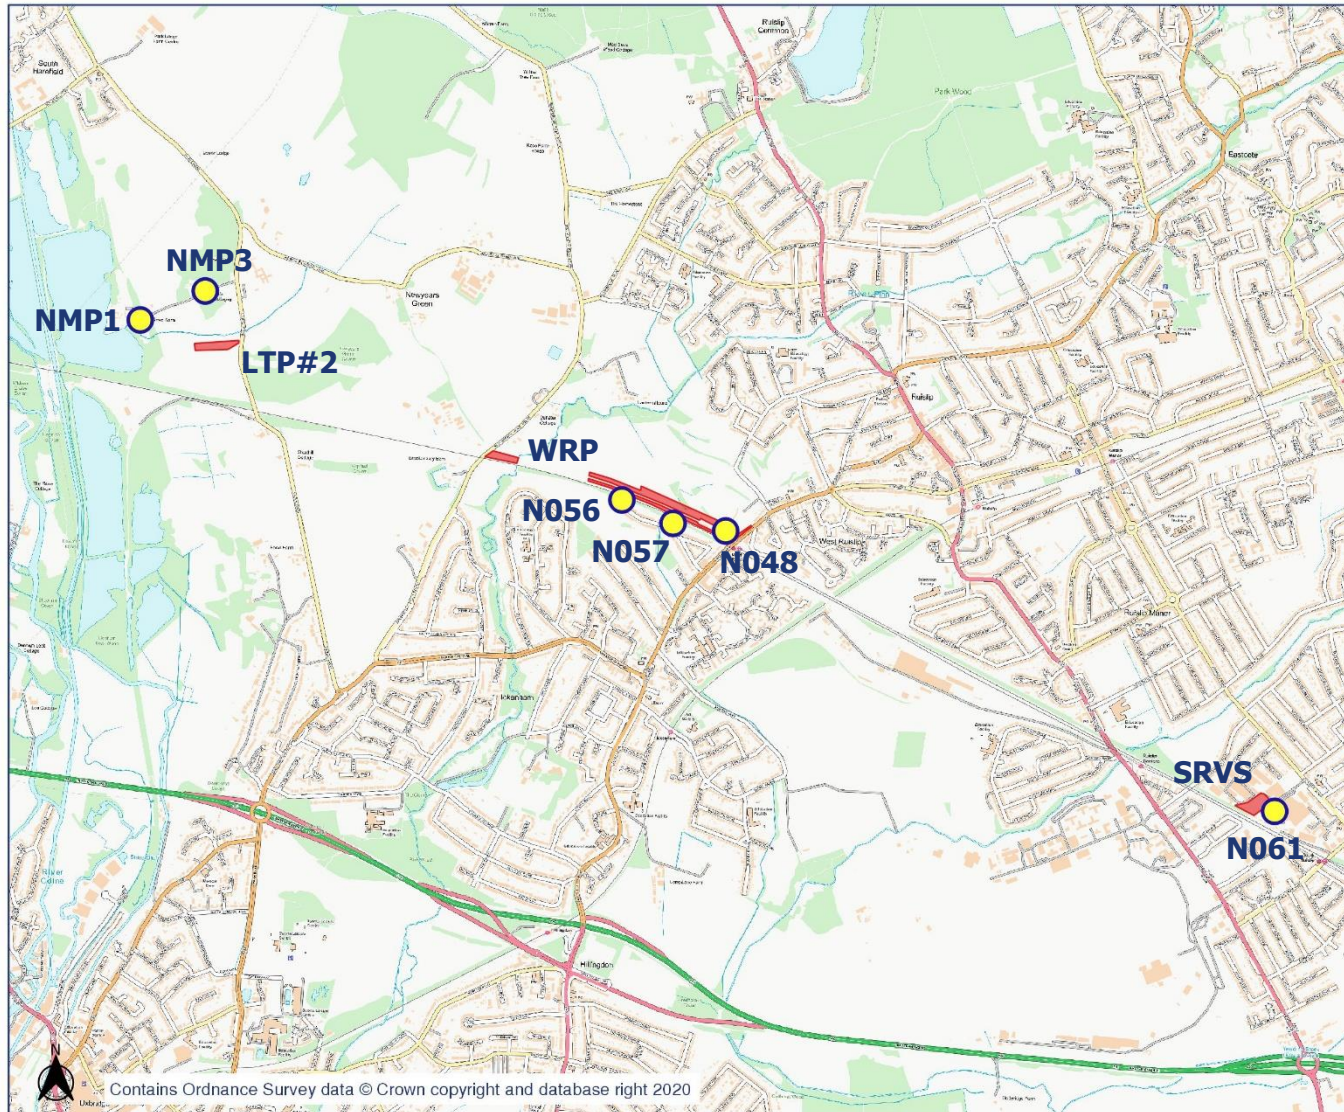


Legend

-  Noise monitor
-  Active worksites




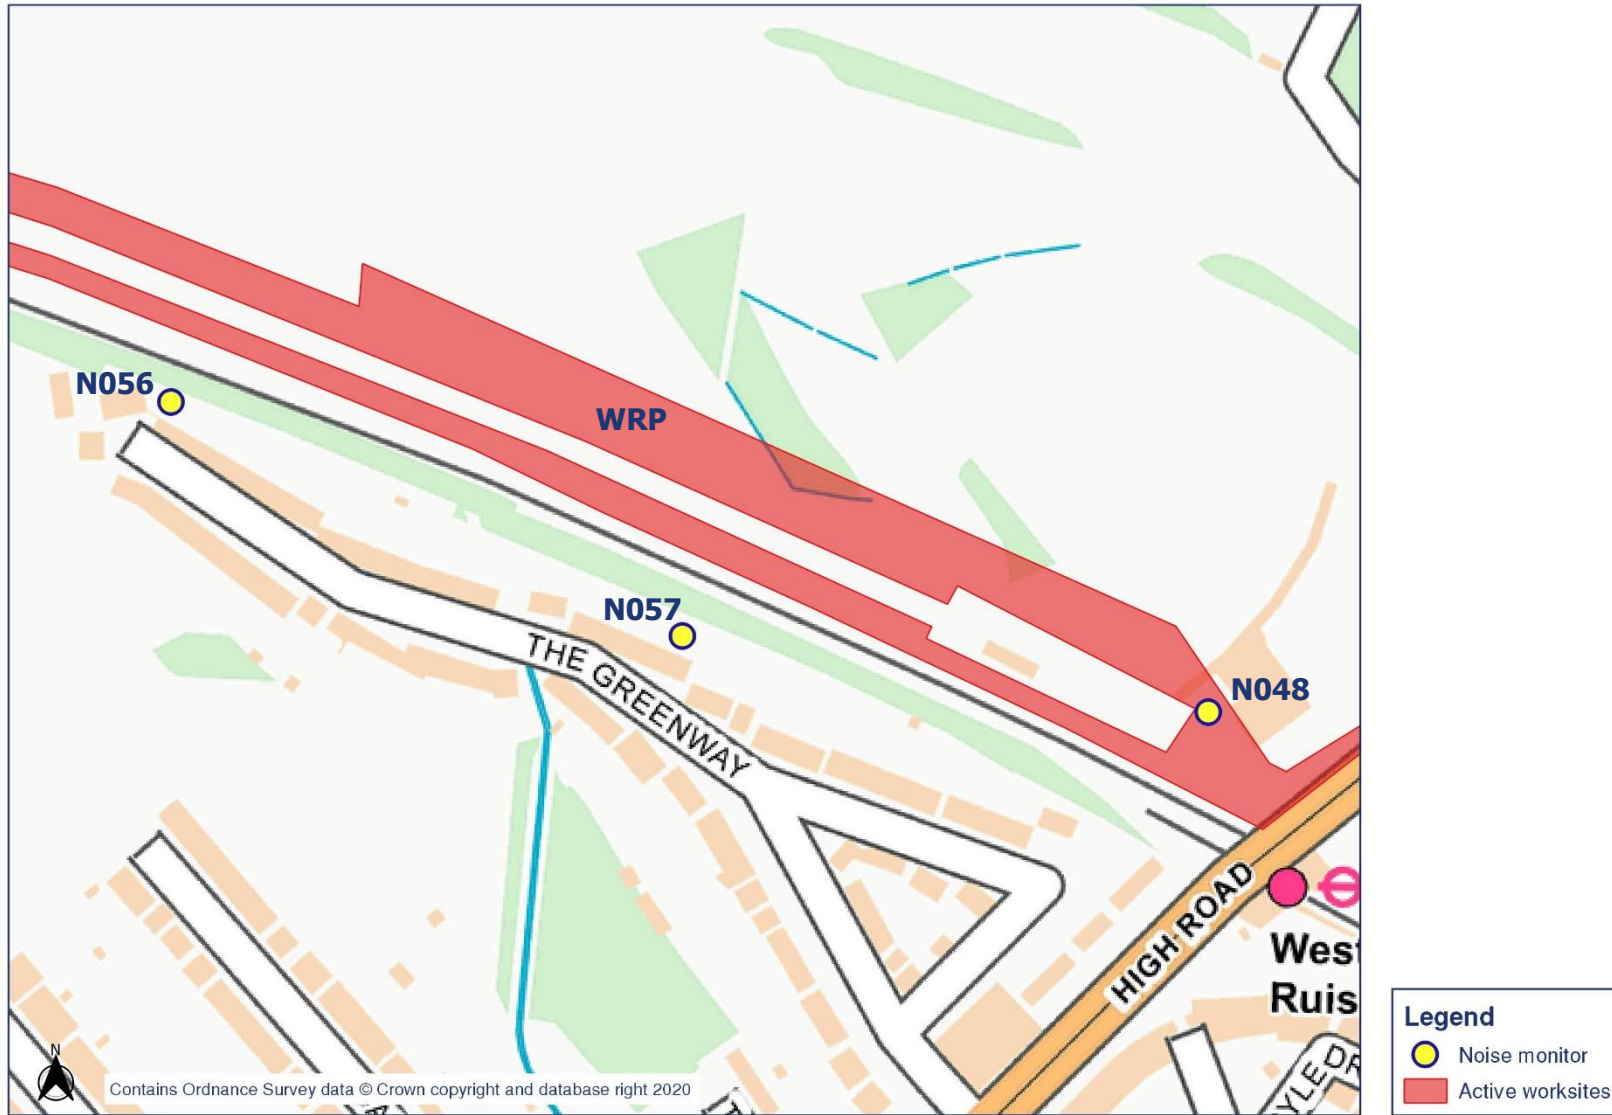


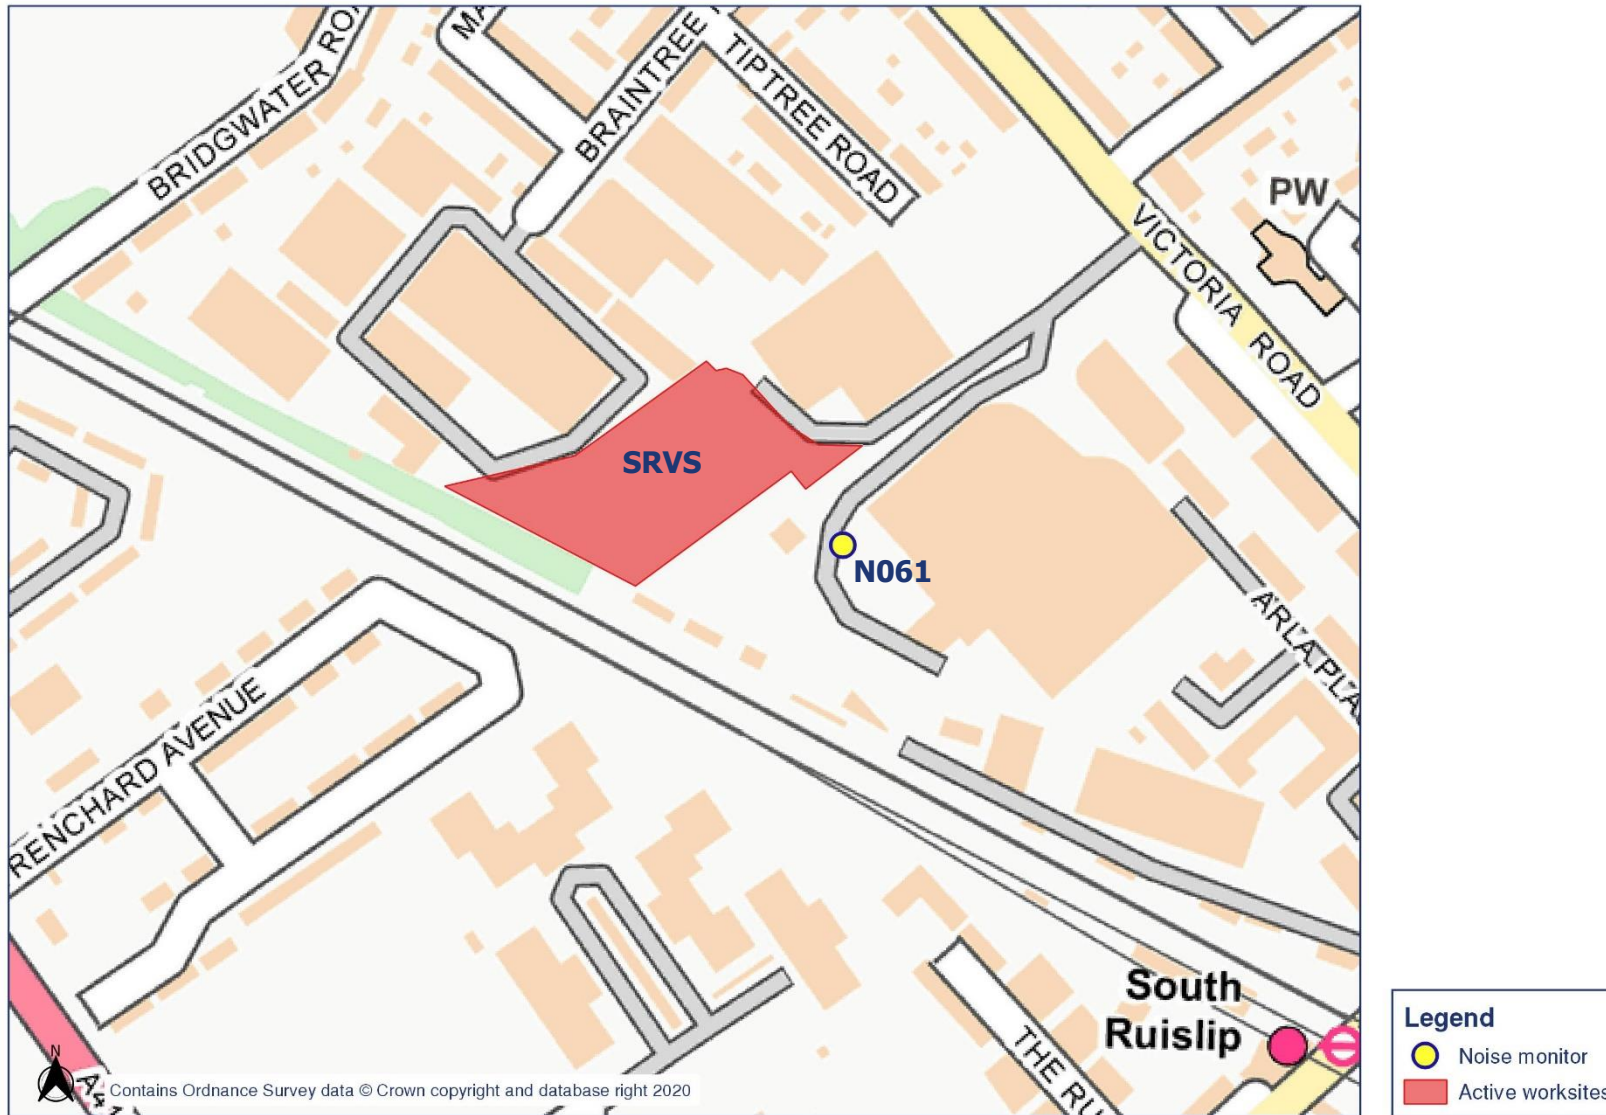



Appendix C Data

The following graphs show the hourly measured ambient noise level $L_{Aeq,1h}$ and, where relevant, the averaged noise level $L_{Aeq,T}$ values, where the time period T is as specified in Table 1 of HS2 Information Paper E23. Periods with adversely weather affected noise levels are greyed out and have been excluded from the calculation of the $L_{Aeq,T}$ values in Table 3 of the main report.


Worksite: Load Test Pile (LTP #2) – Monitoring Ref: NMP1

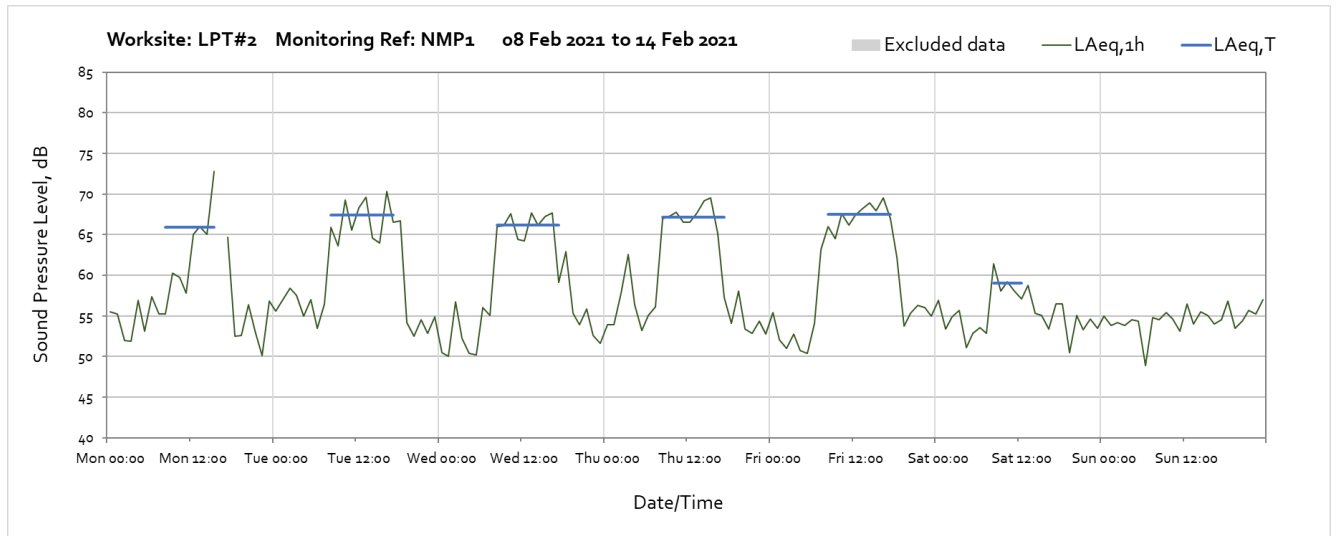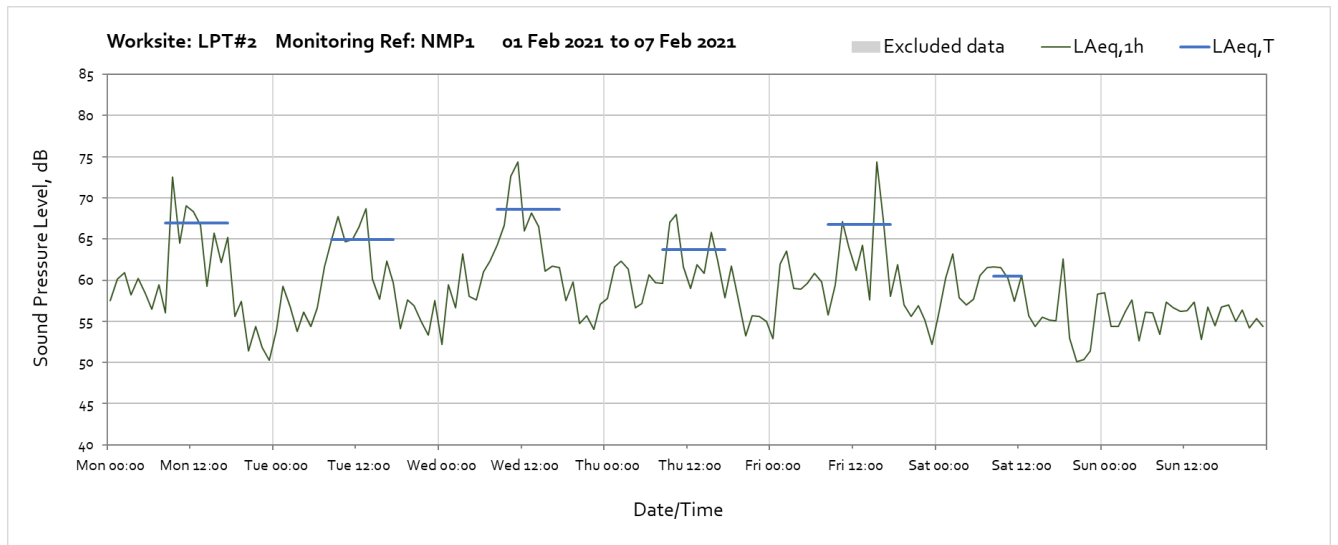


Note: Missing data between 16:00 and 17:00 on Monday 8th February 2021 was due to maintenance operations at the noise monitor.

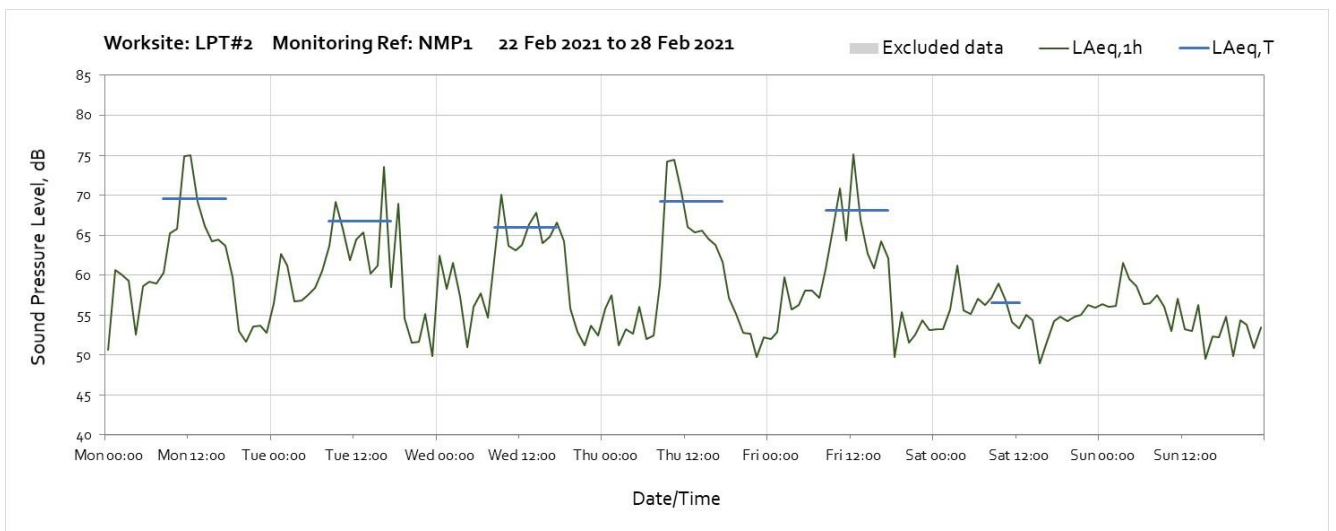
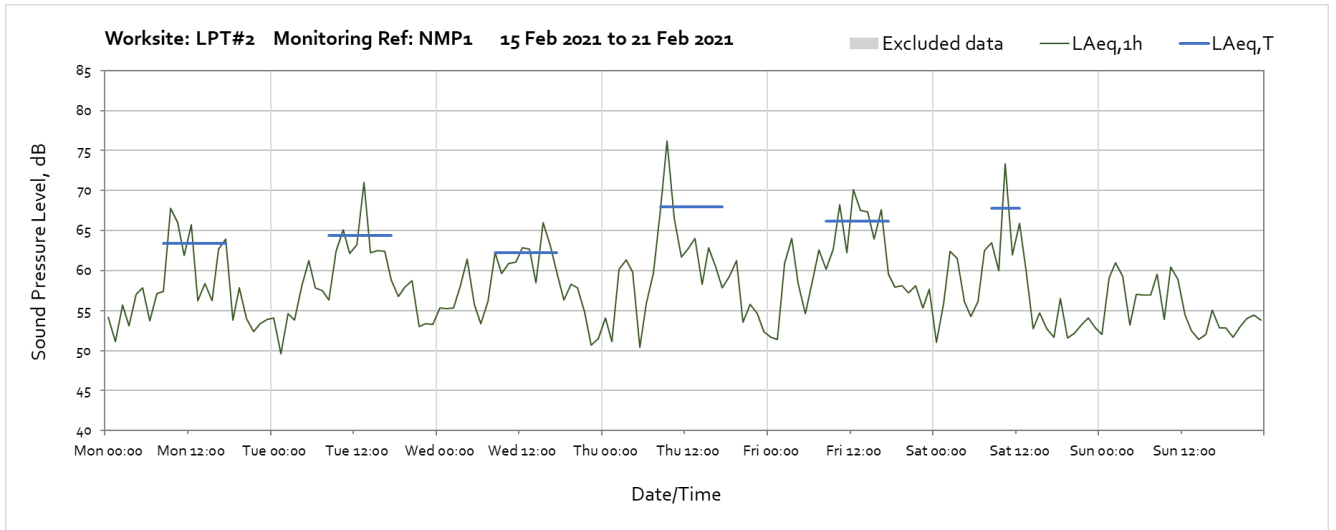


Worksite: Load Test Pile (LTP #2) – Monitoring Ref: NMP3



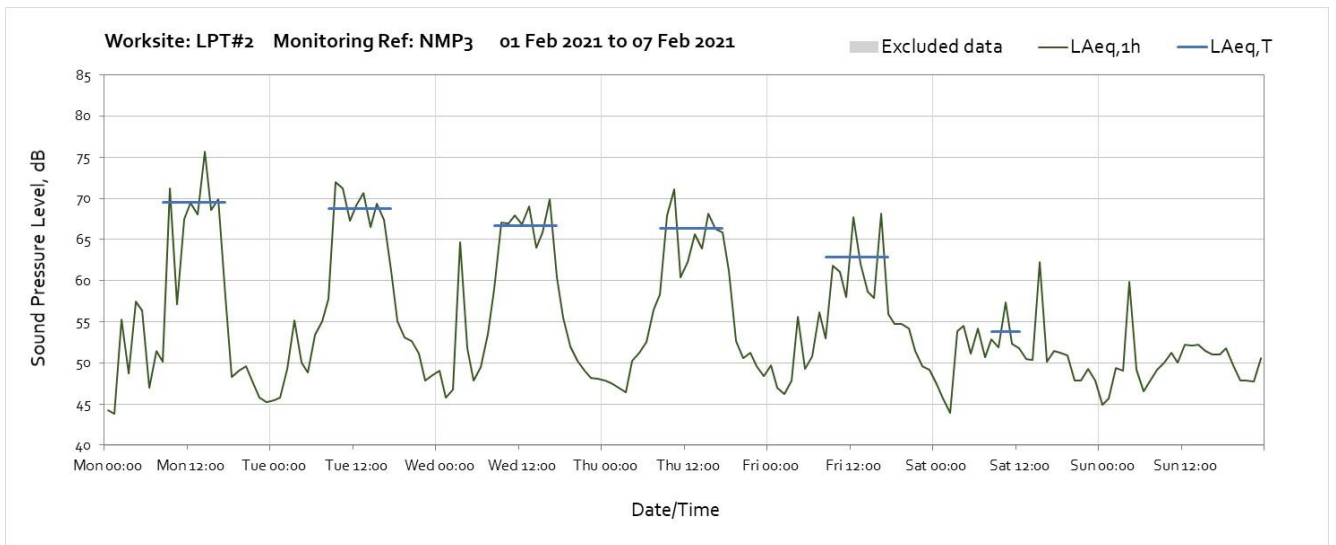


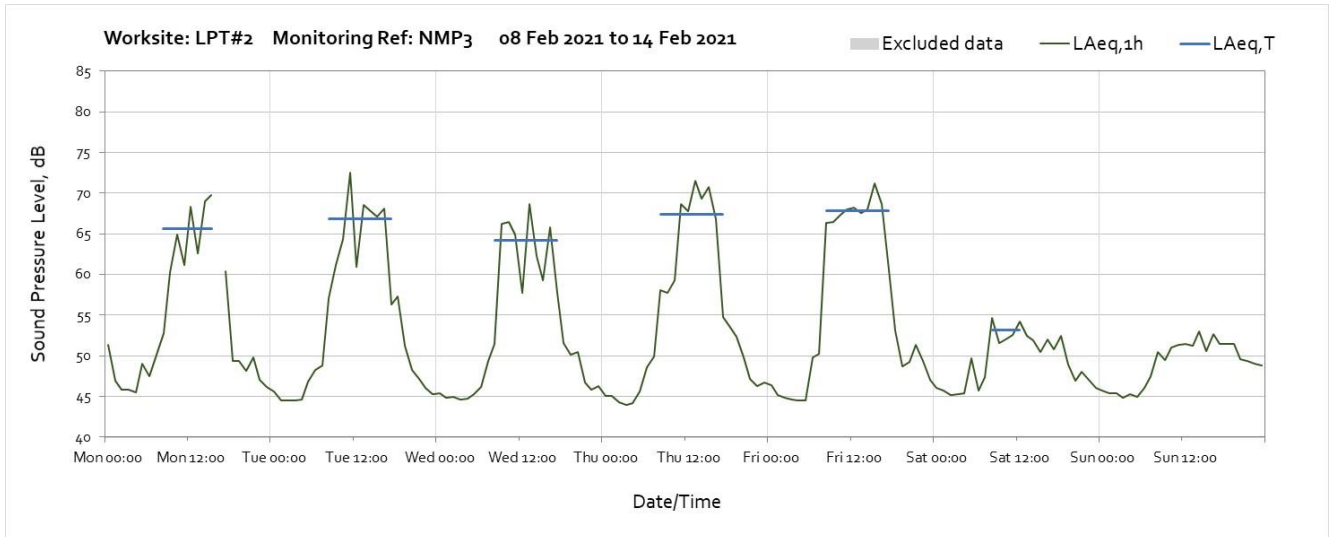


Note: Missing data between 16:00 and 17:00 on Monday 8th February 2021 was due to maintenance operations at the noise monitor.

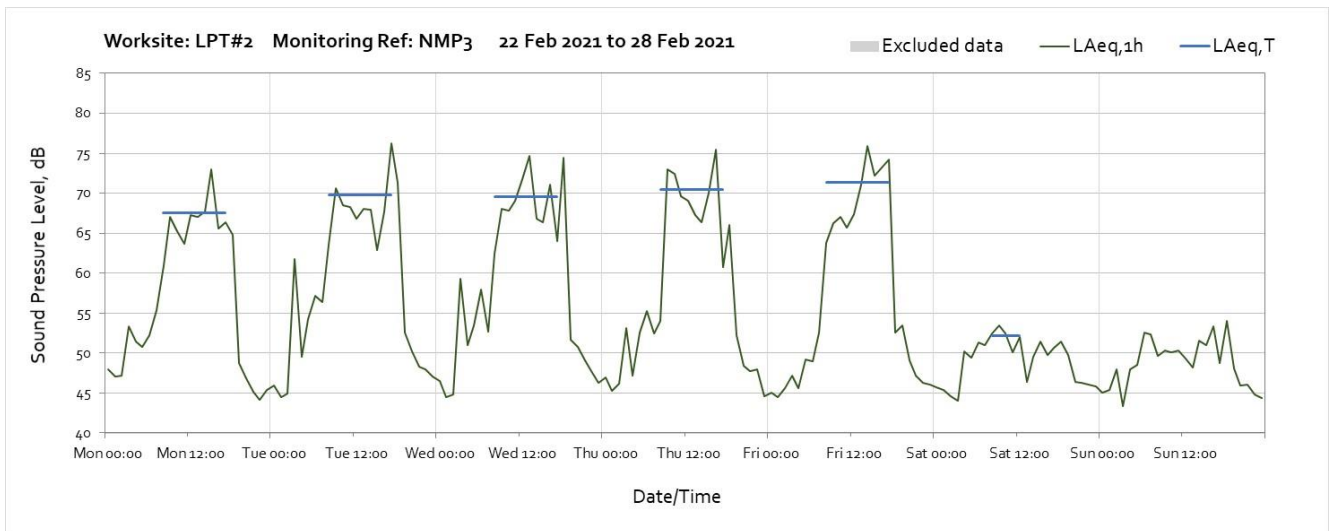
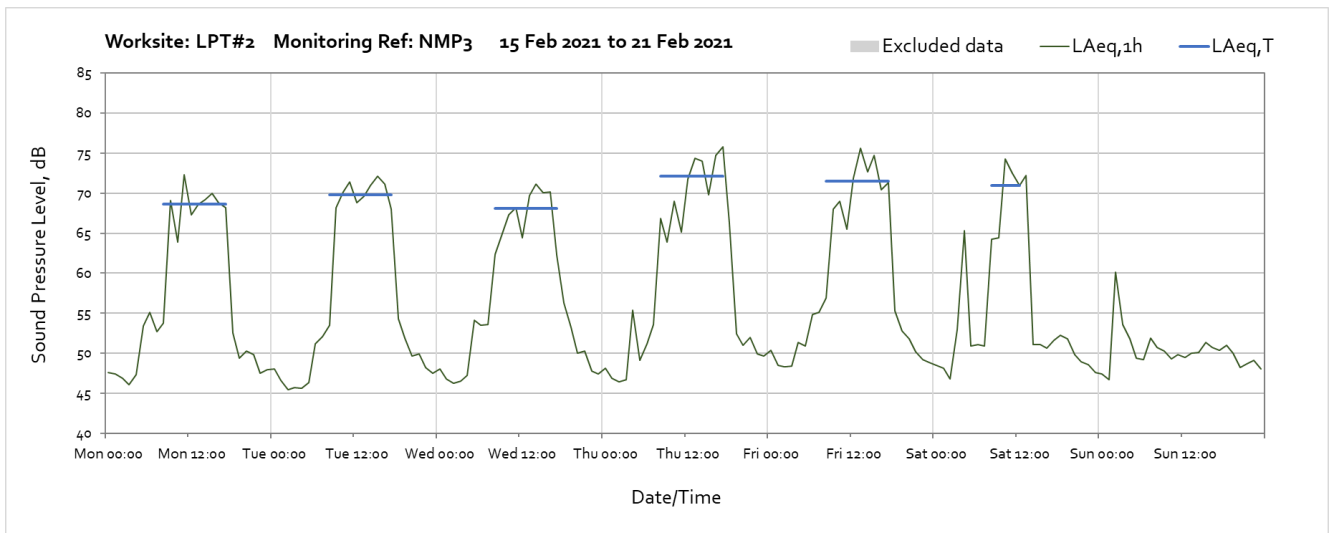




Worksite: West Ruislip Portal (WRP) – Monitoring Ref: N048

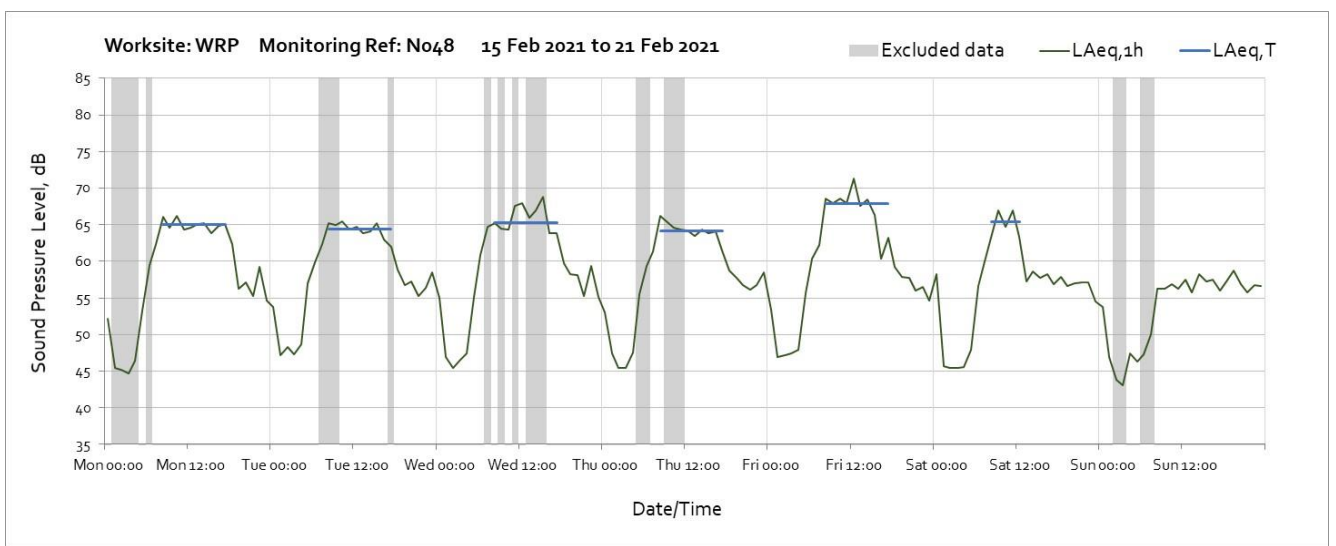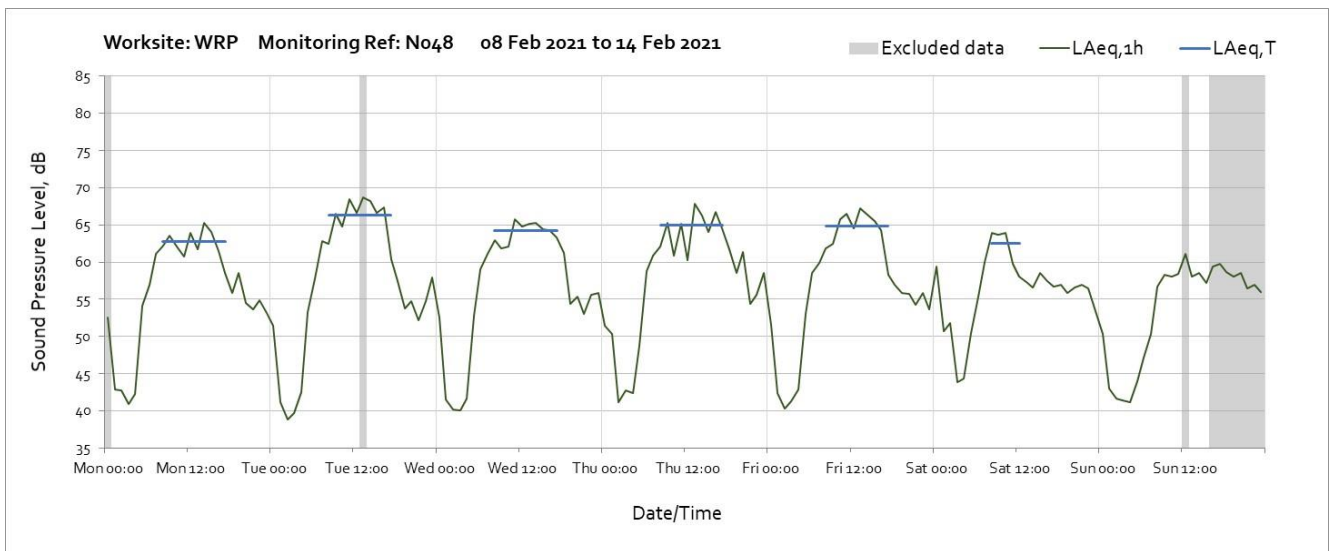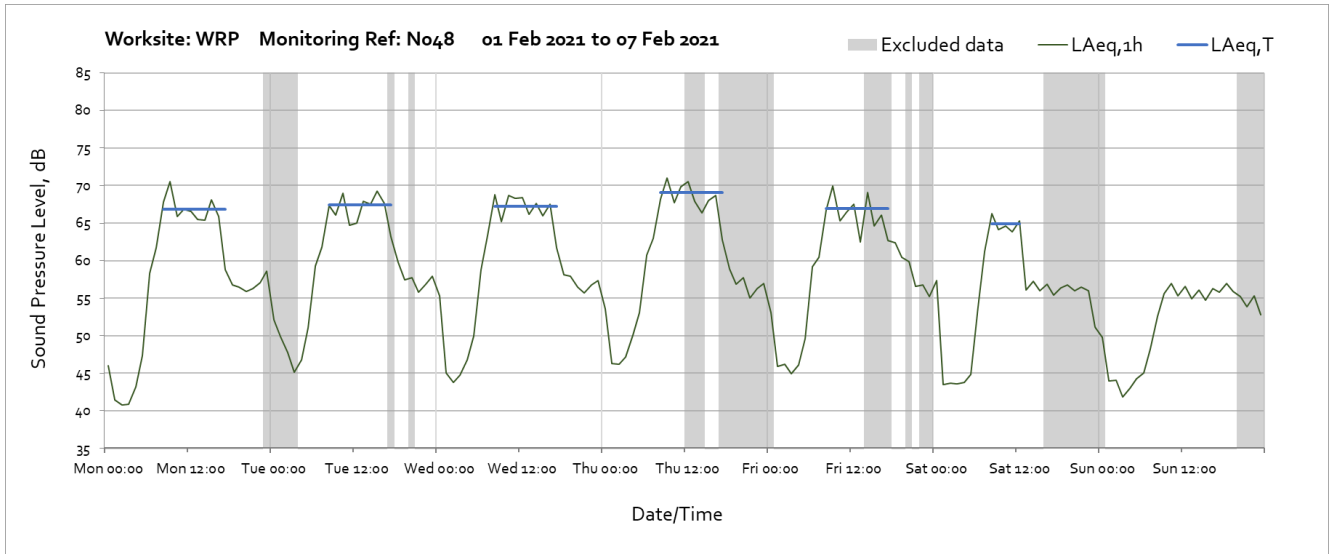

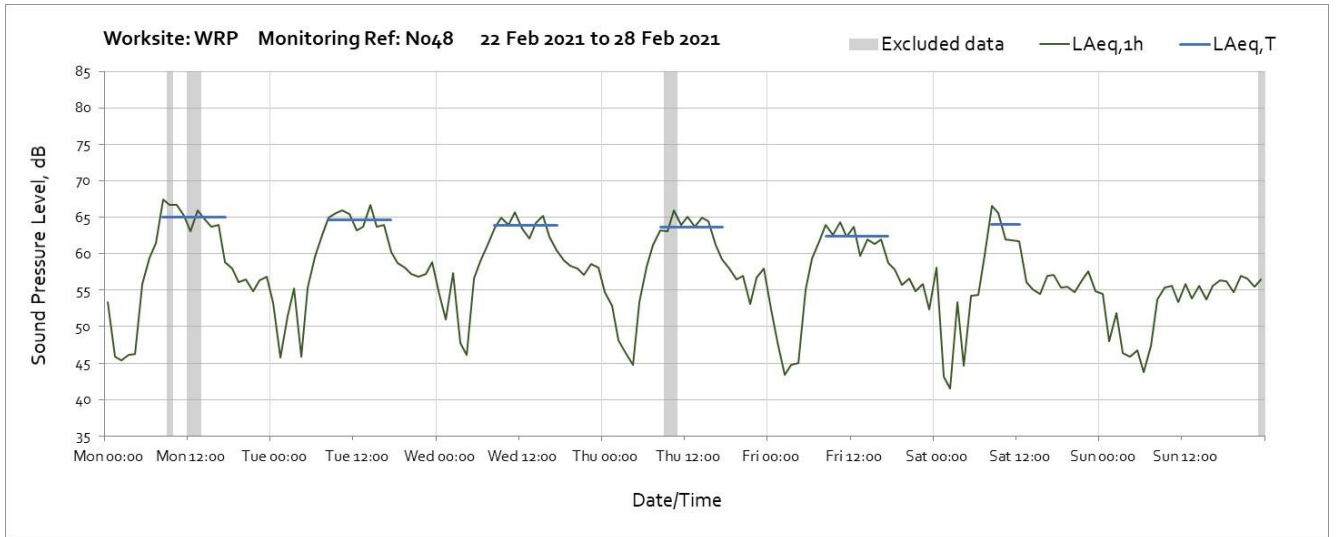





Worksite: West Ruislip Portal (WRP) – Monitoring Ref: N056

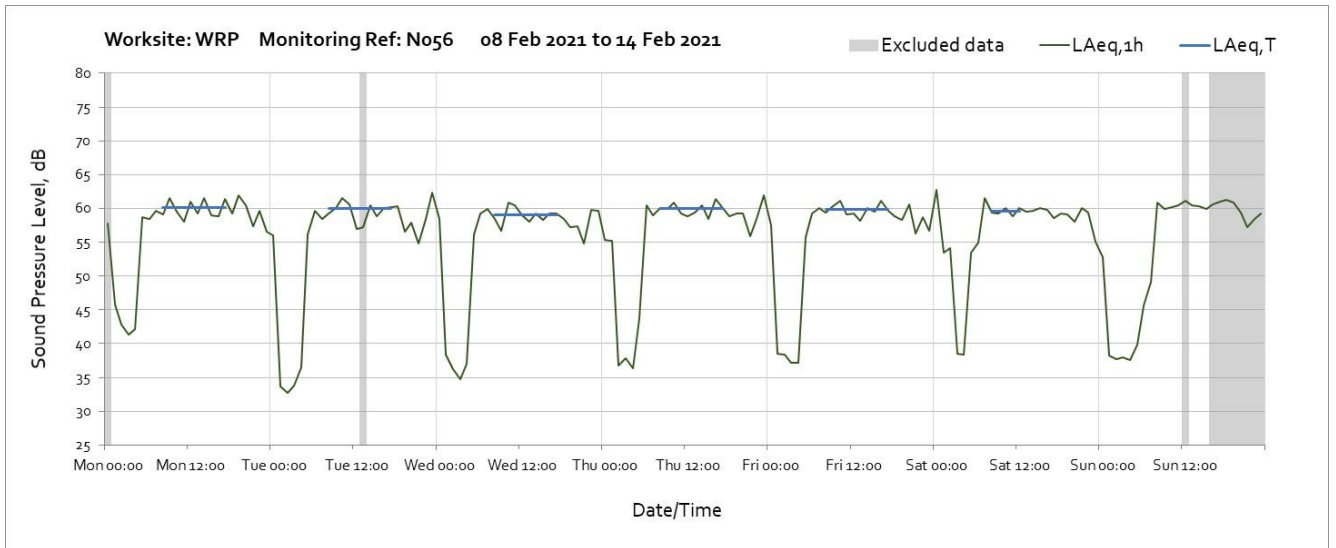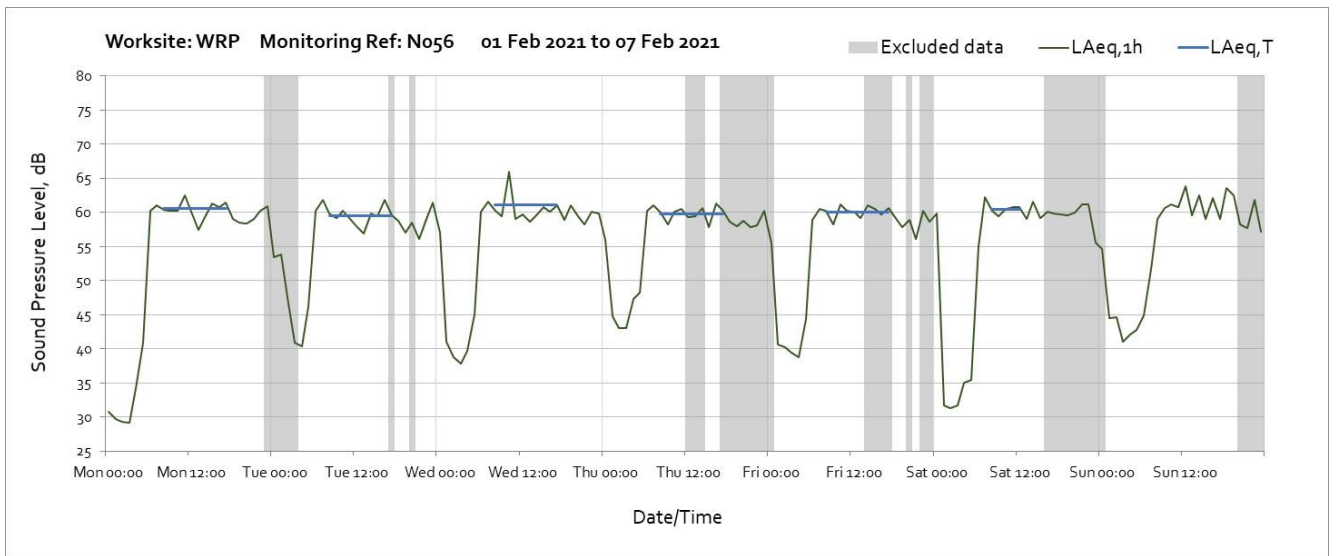


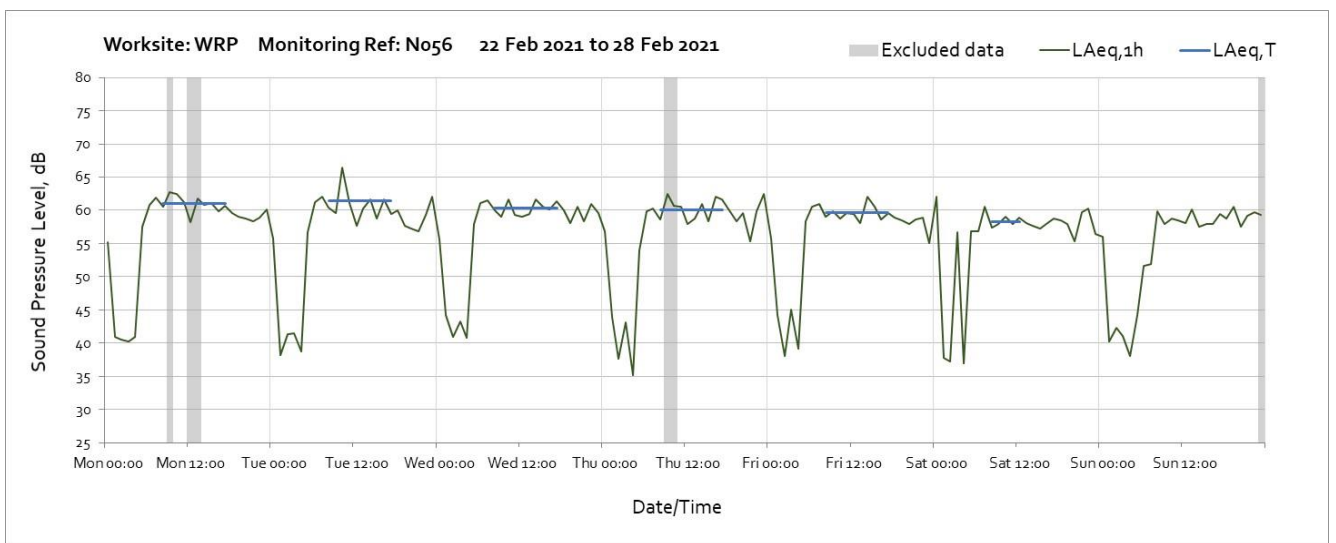
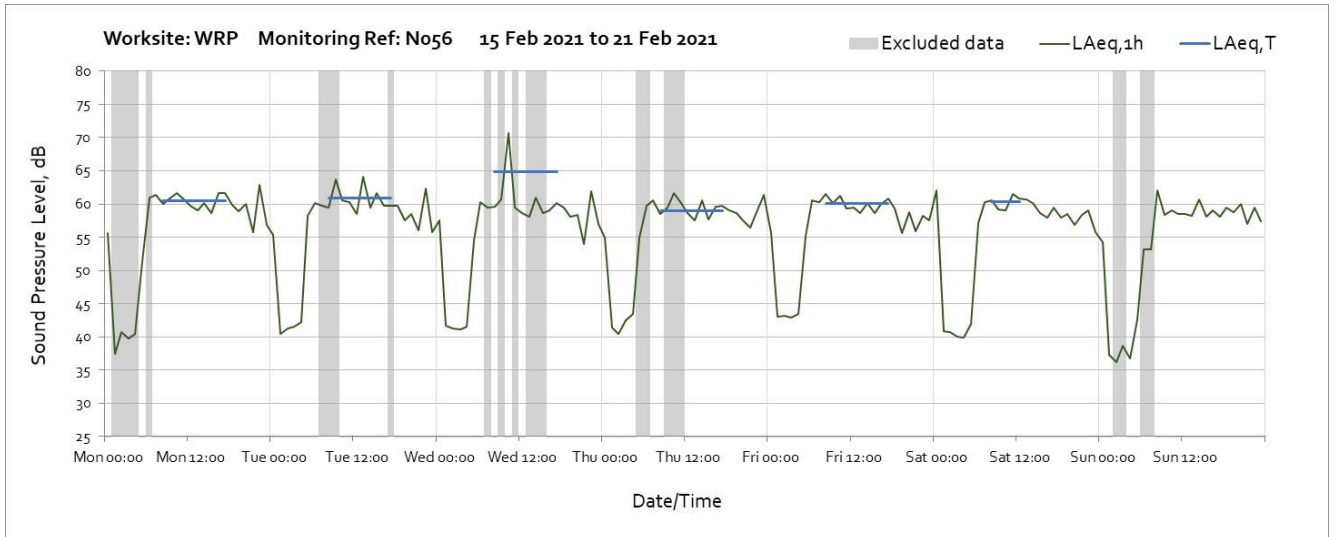


Worksite: West Ruislip Portal (WRP) – Monitoring Ref: N057

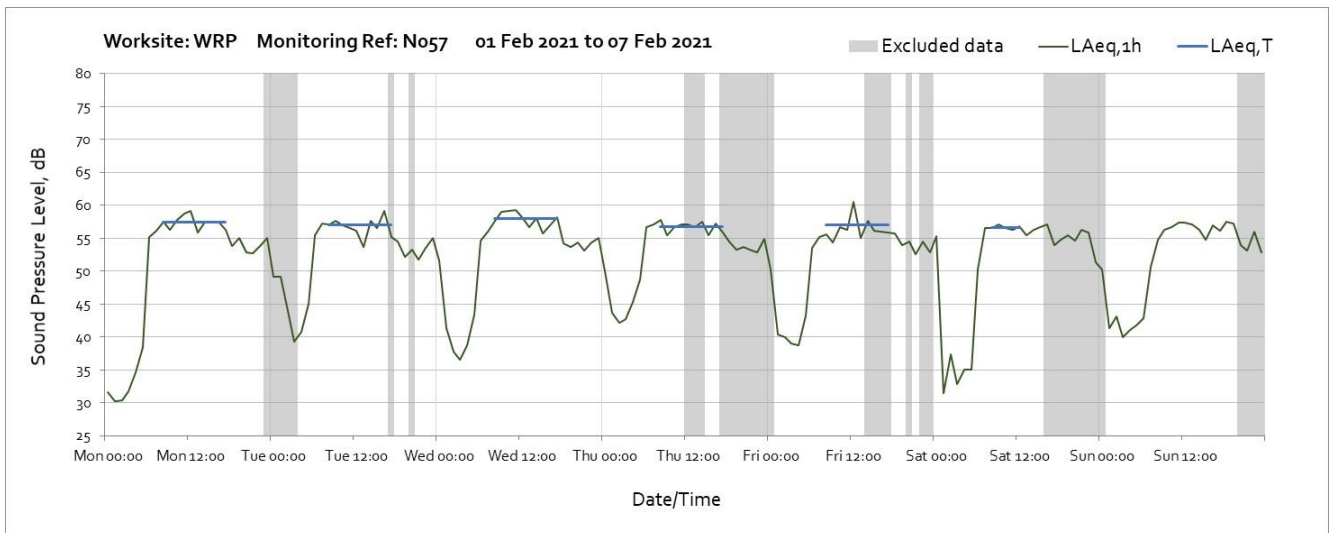

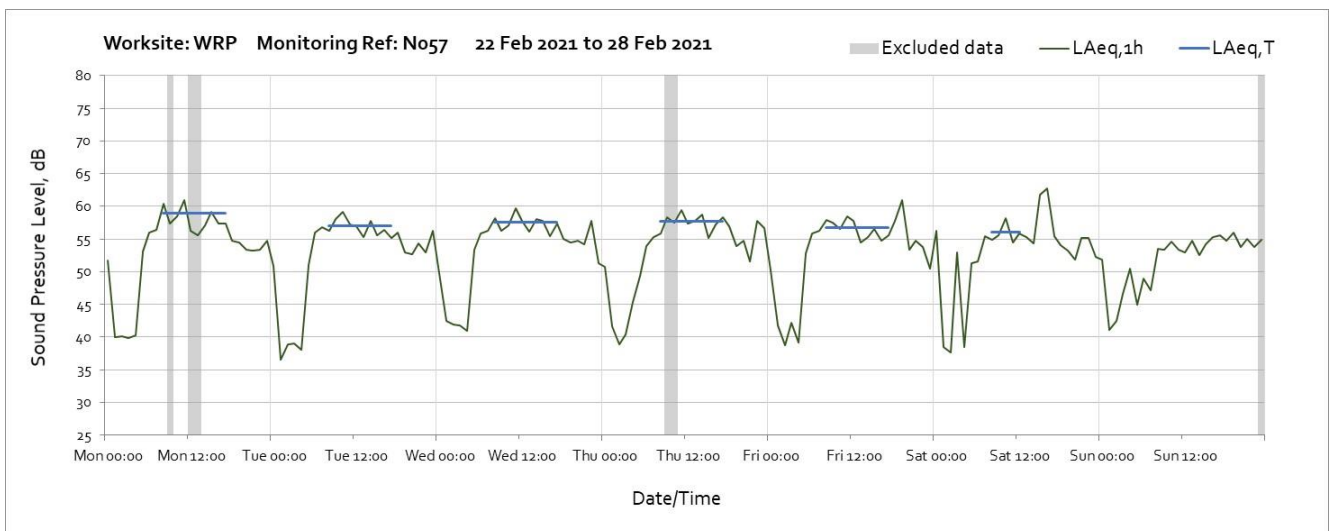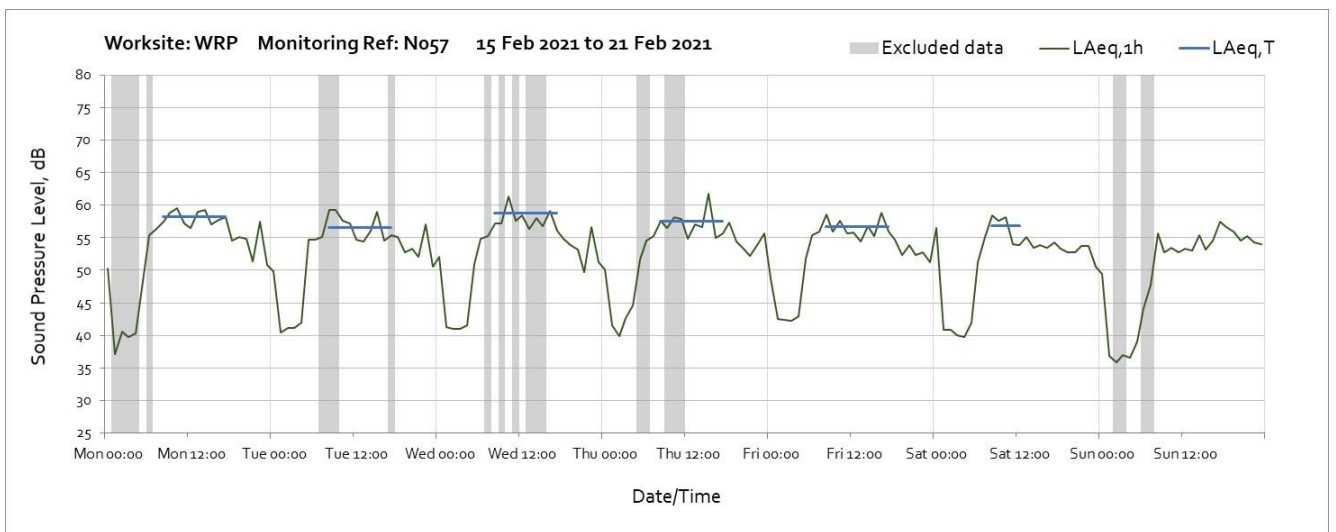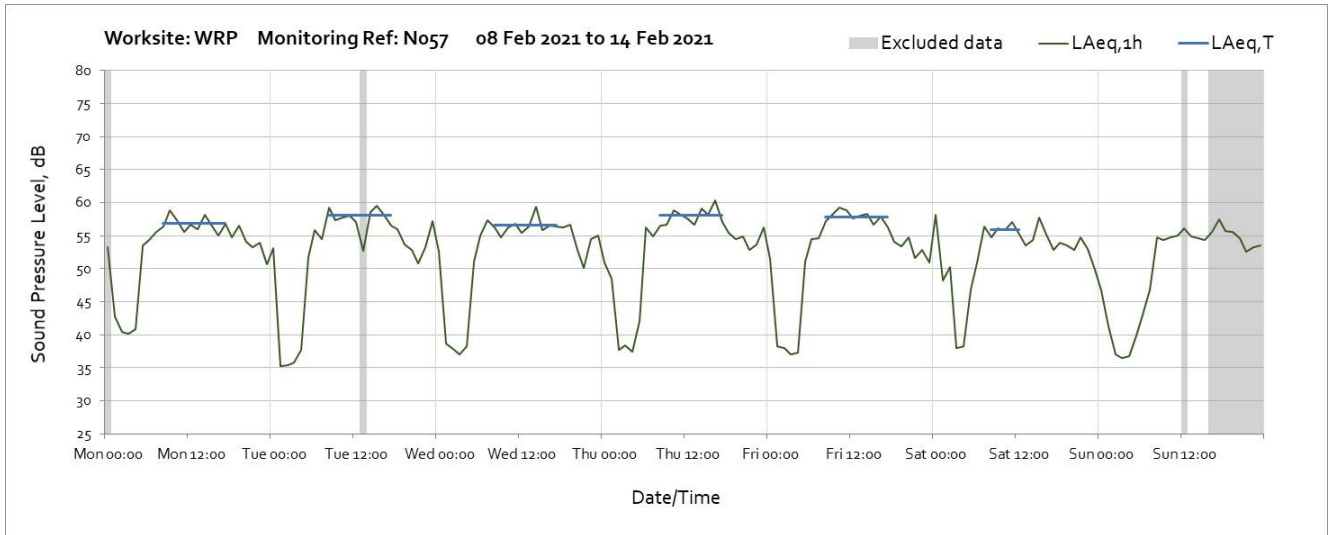

Worksite: South Ruislip Ventilation Shaft (SRVS) – Monitoring Ref: N061

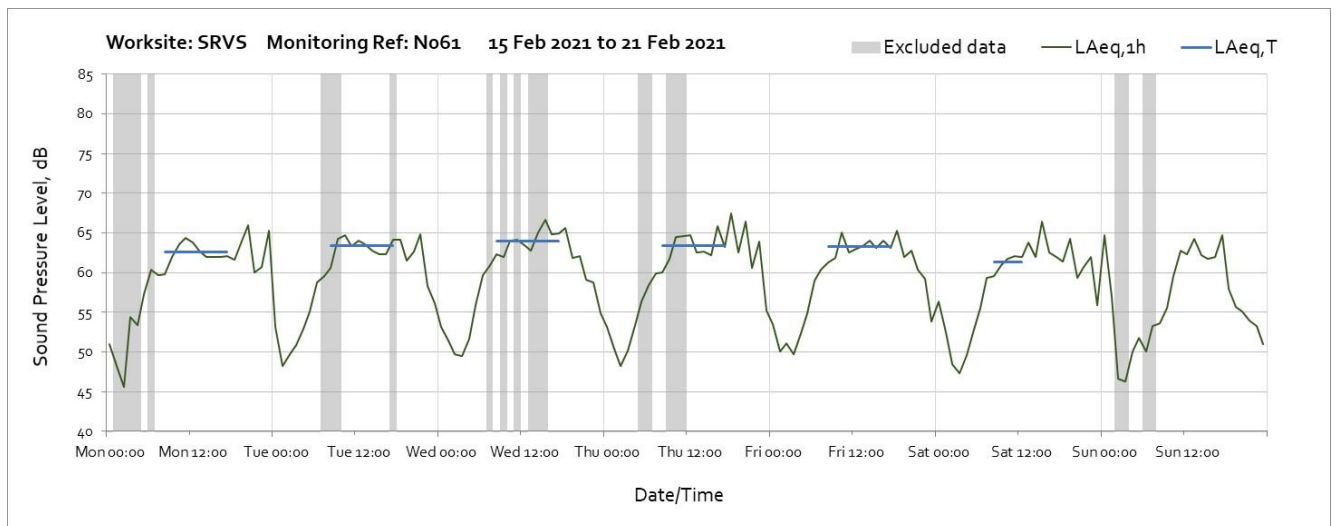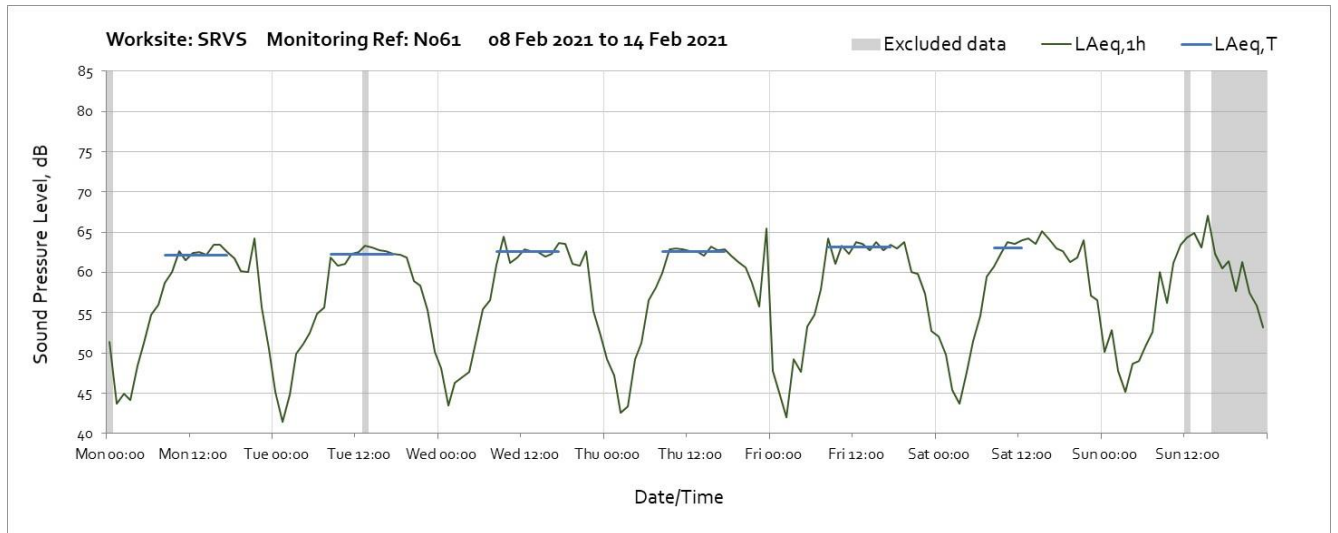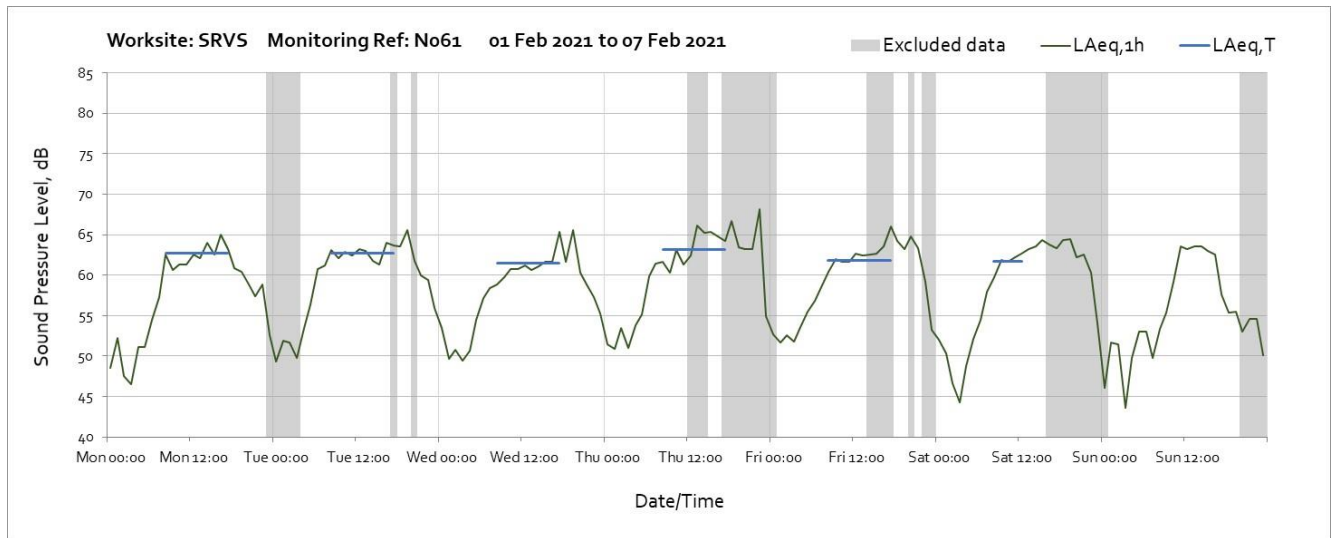

OFFICIAL

