

Construction Noise and Vibration Monthly Report – February 2022

Birmingham City

Non-Technical Summary	1
Abbreviations and Descriptions	2
1 Introduction	3
1.2 Measurement Locations	5
2 Summary of Results	6
2.1 Summary of Measured Noise and Vibration Levels	6
2.2 Exceedances of the LOAEL and SOAEL	8
2.3 Exceedances of Trigger Level	10
2.4 Complaints	10
Appendix A Site Locations	11
Appendix B Monitoring Locations	16
Appendix C Data	21

List of tables

Table 1: Table of Abbreviations	2
Table 2: Monitoring Locations	5
Table 3: Summary of Measured dB L_{Aeq} Data over the Monitoring Period	7
Table 4: Summary of Measured Component PPV Data over the Monitoring Period	8
Table 5: Summary of Exceedances of LOAEL and SOAEL	9
Table 6: Summary of Exceedances of Trigger Levels	10
Table 7: Summary of Complaints	10

Non-Technical Summary

This Noise and Vibration Monitoring Report fulfils HS2 Limited's commitment detailed in the Environmental Minimum Requirements (EMRs), Annex 1, Code of Construction Practice, to present the results of noise and vibration monitoring carried out within Birmingham City during the month of February 2022.

Within this period monitoring was undertaken at the following worksites:

- Noise monitoring was undertaken in the vicinity of the Curzon Street worksite (ref.: CS), where material deliveries and storage, general site operations including maintenance of working platforms and water treatment plant, piling works, excavation and backfilling works, stockpiling, water treatment plant operations, concrete pours, vegetation clearance, installation of barriers and concrete blocks, material movements, breakout works, stockpiling and removal of arising stockpiles off-site were underway.
- Noise and vibration monitoring was undertaken in the vicinity of the Twisted Oak Stables worksite (ref.: TOS), where concrete pours, deliveries and water treatment works were underway.
- Noise and vibration monitoring was undertaken in the vicinity of the Washwood Heath Depot worksite (ref.: WWHD), where obstruction removal and vegetation removal, stockpiling works, piling works, earthworks, brook diversion works, installation of acoustic fencing, wall works, concrete breakout and crushing works were underway.
- Noise monitoring was undertaken in the vicinity of the SAS13 Bridge Replacement worksite in Washwood Heath (ref.: SAS13), where abutment construction, including concrete pouring, laying aggregate, and installation of the bridge deck were underway.

Further works, where monitoring did not take place, were also undertaken at:

- Erskine Street (water utility works);
- Curzon Street (power utility works); and
- Duddlestone Mill (water utility works).

There were no exceedance of the HS2 threshold levels for significant noise impacts, which are defined in Information Paper E23 (<https://www.gov.uk/government/publications/hs2-information-papers-environment>) during the reporting period.

There were no exceedances of trigger levels as defined in Section 61 consents during the reporting period at any monitoring position.

No complaints were received during the monitoring period.

Abbreviations and Descriptions

The abbreviations, descriptions and project terminology used within this report can be found in Table 1.

Table 1: Table of Abbreviations

Acronym/Term	Definition
L _{Aeq,T}	See equivalent continuous sound pressure level
Ambient sound	A description of the all-encompassing sound at a given location and time which will include sound from many sources near and far. Ambient sound can be quantified in terms of the equivalent continuous sound pressure level, L _{pAeq,T}
Decibel(s), or dB	Between the quietest audible sound and the loudest tolerable sound there is a million to one ratio in sound pressure (measured in Pascal (Pa)). Because of this wide range, a level scale called the decibel (dB) scale, based on a logarithmic ratio, is used in sound measurement. Audibility of sound covers a range of approximately 0-140dB.
Decibel(s) A-weighted, or dB(A)	The human ear system does not respond uniformly to sound across the detectable frequency range and consequently instrumentation used to measure sound is weighted to represent the performance of the ear. This is known as the 'A weighting' and is written as 'dB(A)'.
Equivalent continuous sound pressure level, or L _{Aeq,T}	An index used internationally for the assessment of environmental sound impacts. It is defined as the notional unchanging level that would, over a given period of time (T), deliver the same sound energy as the actual time-varying sound over the same period. Hence fluctuating sound levels can be described in terms of an equivalent single figure value, typically expressed as a decibel level.
Exclusion of data	Measurement of noise levels can be affected by weather conditions such as prolonged periods of rain, winds speeds higher than 5m/s and snow/ice ground cover. Noise levels measured during these periods are considered not representative of normal noise conditions at the site and, for the purposes of this report, are excluded from the assessment of exceedances and calculation of typical noise levels and are also greyed out in charts. Identifiable incongruous noise and vibration events not attributable to HS2 construction noise are also excluded.
Façade	A facade noise level is the noise level 1m in front of a large reflecting surface. The effect of reflection, is to produce a slightly higher (typically +3 dB) sound level than it would be if the reflecting surface was not there.
Free-field	A free-field noise level is the noise level measured at a location where no reflective surfaces, other than the ground, lies within 3.5 metres of the microphone position.
LOAEL	Lowest Observed Adverse Effect Level - the level above which adverse effects on health and quality of life can be detected.
Peak particle velocity, or PPV	Instantaneous maximum velocity reached by a vibrating element as it oscillates about its rest position. The PPV is a simple indicator of perceptibility and risk of damage to structures due to vibration. It is usually measured in mm/s.
SOAEL	Significant Observed Adverse Effect Level - the level above which significant adverse effects on health and quality of life occur.
Sound pressure level	The parameter by which sound levels are measured in air. It is measured in decibels. The threshold of hearing has been set at 0dB, while the threshold of pain is approximately 120dB. Normal speech is approximately 60dB at a distance of 1 metre and a change of 3dB in a time varying sound signal is commonly regarded as being just detectable. A change of 10dB is subjectively twice, or half, as loud.
Vibration dose value, or VDV	An index used to evaluate human exposure to vibration in buildings. While the PPV provides information regarding the magnitude of single vibration events, the VDV provides a measure of the total vibration experienced over a specified period of time (typically 16h daytime and 8h night-time). It takes into account the magnitude, the number and the duration of vibration events and can be used to quantify exposure to continuous, impulsive, occasional and intermittent vibration. The vibration dose value is measured in m/s ^{1.75} .

1 Introduction

1.1.1 HS2 is required to undertake noise (and vibration) monitoring as necessary to comply with the requirements of the High Speed Rail (London-West Midlands) Environmental Minimum Requirements, including specifically Annex 1: Code of Construction Practice, in addition to any monitoring requirements arising from conditions imposed through consents under Section 61 of the Control of Pollution Act, 1974 or through Undertakings & Assurances given to third parties. Such monitoring may be undertaken for the following purposes:

- monitoring the impact of construction works;
- to investigate complaints, incidents and exceedance of trigger levels; or
- monitoring the effectiveness of noise and vibration control measures.

1.1.2 Monitoring data and interpretive reports are to be provided to each relevant local authority on a monthly basis and shall include a summary of the construction activities occurring, the data recorded over the monitoring period, any complaints received, any periods in exceedance of agreed trigger levels, the results of any investigations and any actions taken or mitigation measures implemented. This report provides vibration data, and interpretation thereof, for monitoring carried out by HS2 within Birmingham City for the period 1st to 28th February 2022.

1.1.3 Construction sites in the local authority area where monitoring was undertaken during this period include:

- Curzon Street worksite ref.: CS (see plan 1 in Appendix A) where work activities included:
 - material deliveries and storage;
 - movement of concrete barriers;
 - wheel wash operation and maintenance works;
 - piling works for ground investigations;
 - removal of piling equipment;
 - general maintenance works on the platform area (including excavations and backfilling) and stockpiling;
 - water treatment plant maintenance works;
 - concrete pours;
 - vegetation clearance;

- breakout works of student accommodation foundations;
- stockpiling and removal of arising stockpiles off-site.
- Twisted Oak Stables worksite, ref.: TOS (see plan 3 in Appendix A) where work activities included:
 - pouring of concrete slabs;
 - deliveries of tunnel boring machine components, sewage treatment plant components and water treatment plant;
 - water treatment works to ensure compliance with environmental water quality permit.
- Washwood Heath Depot worksite, ref.: WWHD (see plan 2 in Appendix A) where work activities included:
 - stockpiling;
 - removal of obstructions and piling works;
 - earthworks;
 - brook diversion works;
 - installation of acoustic fencing;
 - removing of invasive non-native species;
 - diaphragm wall works, including concrete pouring;
 - concrete breakout works and crushing.
- SAS13 Bridge Replacement worksite, ref.: SAS13 (see plan 3 in Appendix A) where work activities included:
 - ongoing construction of abutment, including steel fixing, construction of shuttering and concrete pouring;
 - laying aggregate; and
 - installation of the bridge deck, including steel fixing, installing glass reinforced plastic (GRP) panels and shuttering.

1.1.4 Further work where monitoring did not take place, were also undertaken at the following locations:

- Erskine Street (water utility works);
- Curzon Street (power utility works); and
- Duddlestone Mill (water utility works).

1.1.5 The applicable standards, guidance, and monitoring methodology is outlined in the construction noise and vibration monitoring methodology report which can be found at the following location <https://www.gov.uk/government/collections/monitoring-the-environmental-effects-of-hs2>. Noise and vibration monitoring reports for previous months can also be found at this location.

1.2 Measurement Locations

1.2.1 Six noise and three vibration monitoring installations were active in February in the Birmingham City area. Table 2 summarises the position of noise and vibration monitoring installations within the Birmingham City area in February 2022.

1.2.2 Maps showing the position of noise and vibration monitoring installations are presented in Appendix B.

Table 2: Monitoring Locations

Worksite Reference	Measurement Reference	Address
Curzon Street (CS)	CS-N1	Curzon Street, Birmingham
Twisted Oak Stables (TOS)	TOS-N1	B4118-Birmingham Road, Water Orton, Birmingham
	TOS-V1	B4118-Birmingham Road, Water Orton, Birmingham
Washwood Heath Depot (WWHD)	WWHD-N1	Drews Lane, Birmingham
	WWHD-V1	Drews Lane, Birmingham
	WWHD-N2	Common Lane, Birmingham
	WWHD-V2	Common Lane, Birmingham
SAS13 Bridge Replacement (SAS13)	SAS13-N1 (East)	Taroni Avenue, off Aston Church Road, Birmingham
	SAS13-N2 (West)	Heartlands Parkway, Nechells, Birmingham

2 Summary of Results

2.1 Summary of Measured Noise and Vibration Levels

2.1.1 Table 3 presents a summary of the measured noise levels at each monitoring location over the reporting period. The $L_{Aeq,T}$ is presented for each of the relevant time periods averaged over the calendar month, along with the highest single period $L_{Aeq,T}$ that was found to occur within the month.

Table 3: Summary of Measured dB L_{Aeq} Data over the Monitoring Period

Worksite Reference	Measurement Reference	Site Address	Free-field or Façade measurement	Weekday Average L _{Aeq,T} (highest day L _{Aeq,T})					Saturday Average L _{Aeq,T} (highest day L _{Aeq,T})					Sunday / Public Holiday Average L _{Aeq,T} (highest day L _{Aeq,T})	
				0700 - 0800	0800 - 1800	1800 - 1900	1900 - 2200	2200 - 0700	0700 - 0800	0800 - 1300	1300 - 1400	1400 - 2200	2200 - 0700	0700 - 2200	2200 - 0700
CS	CS-N1	Curzon Street	Free-field	66.3 (68.0)	67.7 (68.7)	65.7 (67.8)	64.0 (70.5)	61.0 (66.0)	61.8 (62.6)	64.2 (64.8)	66.0 (66.7)	65.2 (68.2)	62.0 (64.5)	64.2 (67.8)	60.9 (64.5)
TOS	TOS-N1	B4118-Birmingham Road	Free-field	67.4 (71.2)	70.1 (74.2)	65.7 (69.8)	65.6 (68.7)	64.4 (71.8)	67.4 (68.1)	69.0 (70.2)	68.6 (69.4)	68.2 (70.4)	64.7 (67.2)	68.0 (70.7)	64.3 (69.4)
WWHD	WWHD-N1	Drews Lane,	Free-field	58.5 (61.8)	63.2 (72.5)	55.5 (60.9)	55.3 (60.3)	53.5 (60.4)	53.7 (55.1)	53.8 (54.7)	51.1 (51.1)	53.8 (60.6)	49.9 (52.2)	54.0 (60.6)	52.9 (58.8)
	WWHD-N2	Common Lane,	Free-field	55.2 (58.6)	57.3 (61.3)	52.5 (58.6)	52.8 (58.1)	51.6 (59.3)	50.8 (52.0)	50.7 (51.0)	49.8 (49.8)	51.0 (57.9)	47.6 (53.5)	48.9 (54.5)	50.7 (55.5)
SAS13	SAS13-N1 (East)	Taroni Avenue	Free-field	57.3 (63.0)	62.3 (67.1)	61.5 (69.2)	60.0 (68.8)	56.2 (67.9)	55.3 (58.2)	59.2 (62.6)	61.4 (64.1)	61.9 (67.3)	57.6 (64.8)	60.5 (68.4)	57.7 (66.0)
	SAS13-N2 (West)	Heartlands Parkway, Nechells	Free-field	60.5 (63.7)	63.5 (65.5)	61.1 (64.0)	59.7 (65.0)	57.2 (63.2)	56.2 (56.8)	61.7 (65.6)	61.9 (63.7)	60.8 (62.7)	58.0 (62.5)	59.7 (63.6)	56.5 (60.8)

2.1.2 Table 4 presents a summary of the measured vibration levels at each monitoring location over the reporting period. The highest component PPV measured during periods of works along any axis is presented in the table.

Table 4: Summary of Measured Component PPV Data over the Monitoring Period

Worksite Reference	Measurement Reference	Monitor Address	Highest PPV measured in any axis, mm/s
TOS	TOS-V1	B4118-Birmingham Road, Water Orton, Birmingham	1.27 (X-axis)
WWHD	WWHD-V1	Drews Lane, Birmingham	3.65 (Z-axis)
WWHD	WWHD-V2	Common Lane, Birmingham	1.10 (Y-axis)

2.1.3 Appendix C presents graphs of the noise and vibration monitoring data over the month for each of the measurement locations. Noise data presented consists of the hourly L_{Aeq} values and, where relevant, the $L_{Aeq,T}$ values (where the time period T has been taken to be the averaging period as specified in Table 1 of HS2 Information Paper E23). Vibration data presented consist of hourly PPV values. The full data set for the monitoring equipment can be found at the following location:

<https://data.gov.uk/dataset/24542ae7-dd44-444f-b259-871c4cc43b5e/environmental-monitoring-data>.

2.2 Exceedances of the LOAEL and SOAEL

2.2.1 The lowest observed adverse effect level (LOAEL) is defined in the Planning Practice Guidance – Noise (PPG) as the level above which "noise starts to cause small changes in behaviour and/or attitude, e.g. turning up volume of television; speaking more loudly; where there is no alternative ventilation, having to close windows for some of the time because of the noise. Potential for some reported sleep disturbance. Affects the acoustic character of the area such that there is a perceived change in the quality of life".

2.2.2 The significant observed adverse effect level (SOAEL) is defined in the 'Planning Practice Guidance – Noise' as the level above which "noise causes a material change in behaviour and/or attitude, e.g. avoiding certain activities during periods of intrusion; where there is no alternative ventilation, having to keep windows closed most of the time because of the noise. Potential for sleep disturbance resulting in difficulty in getting to sleep, premature awakening and difficulty in getting back to sleep. Quality of life diminished due to change in acoustic character of the area."

2.2.3 HS2 Phase One Information Paper E23: Control of Construction Noise and Vibration sets out the LOAELs and SOAELs for construction noise.

2.2.4 Where reported construction noise levels exceed the LOAEL and SOAEL, relevant periods will be identified. Summary statistics to evaluate ongoing qualification for noise insulation and temporary rehousing are also presented where relevant.

2.2.5 Table 5 presents a summary of recorded exceedances of the LOAEL and SOAEL at each measurement location over the reporting period, including the number of exceedances during each time period.

Table 5: Summary of Exceedances of LOAEL and SOAEL

Worksite Reference	Measurement Reference	Site Address	Day (Weekday, Saturday, Sunday, Night)	Time period	Number of exceedances of LOAEL	Number of exceedances of SOAEL
CS	CS-N1*	Curzon Street, Birmingham	All days	All periods	No exceedance	No exceedance
TOS	TOS-N1*	B4118-Birmingham Road, Water Orton, Birmingham	Weekdays	0800-1800	4	No exceedance
WWHD	WWHD-N1*	Drews Lane, Birmingham	All days	All periods	No exceedance	No exceedance
WWHD	WWHD-N2*	Common Lane, Birmingham	All days	All periods	No exceedance	No exceedance
SAS13	SAS13-N1 (East)*	Taroni Avenue, off Aston Church Road, Birmingham	All days	All periods	No exceedance	No exceedance
SAS13	SAS13-N2 (West)*	Heartlands Parkway, Nechells, Birmingham	All days	All periods	No exceedance	No exceedance

* A distance correction has been applied when calculating exceedances of the LOAEL and SOAEL.

2.2.6 Four exceedances of the LOAEL were recorded across the Twisted Oak Stables worksite during working core hours. No exceedance of the SOAEL were reported due to HS2 works during February 2022.

2.3 Exceedances of Trigger Level

2.3.1 Table 6 provides a summary of exceedances of the S61 trigger vibration levels determined to be due to HS2 related construction vibration measured during the reporting period, along with the findings of any investigation.

Table 6: Summary of Exceedances of Trigger Levels

Complaint Reference Number (if applicable)	Worksite Reference	Date and Time Period	Identified Source	Results of Investigation (including noise monitoring results)	Actions Taken
-	-	-	-	-	-


2.4 Complaints


2.4.1 Table 7 provides a summary of complaint information related to noise and vibration received during the reporting period, along with the findings of any investigation.


Table 7: Summary of Complaints


Complaint Reference Number	Worksite Reference	Description of Complaint	Results of Investigation	Actions Taken
-	-	-	-	-

Appendix A Site Locations

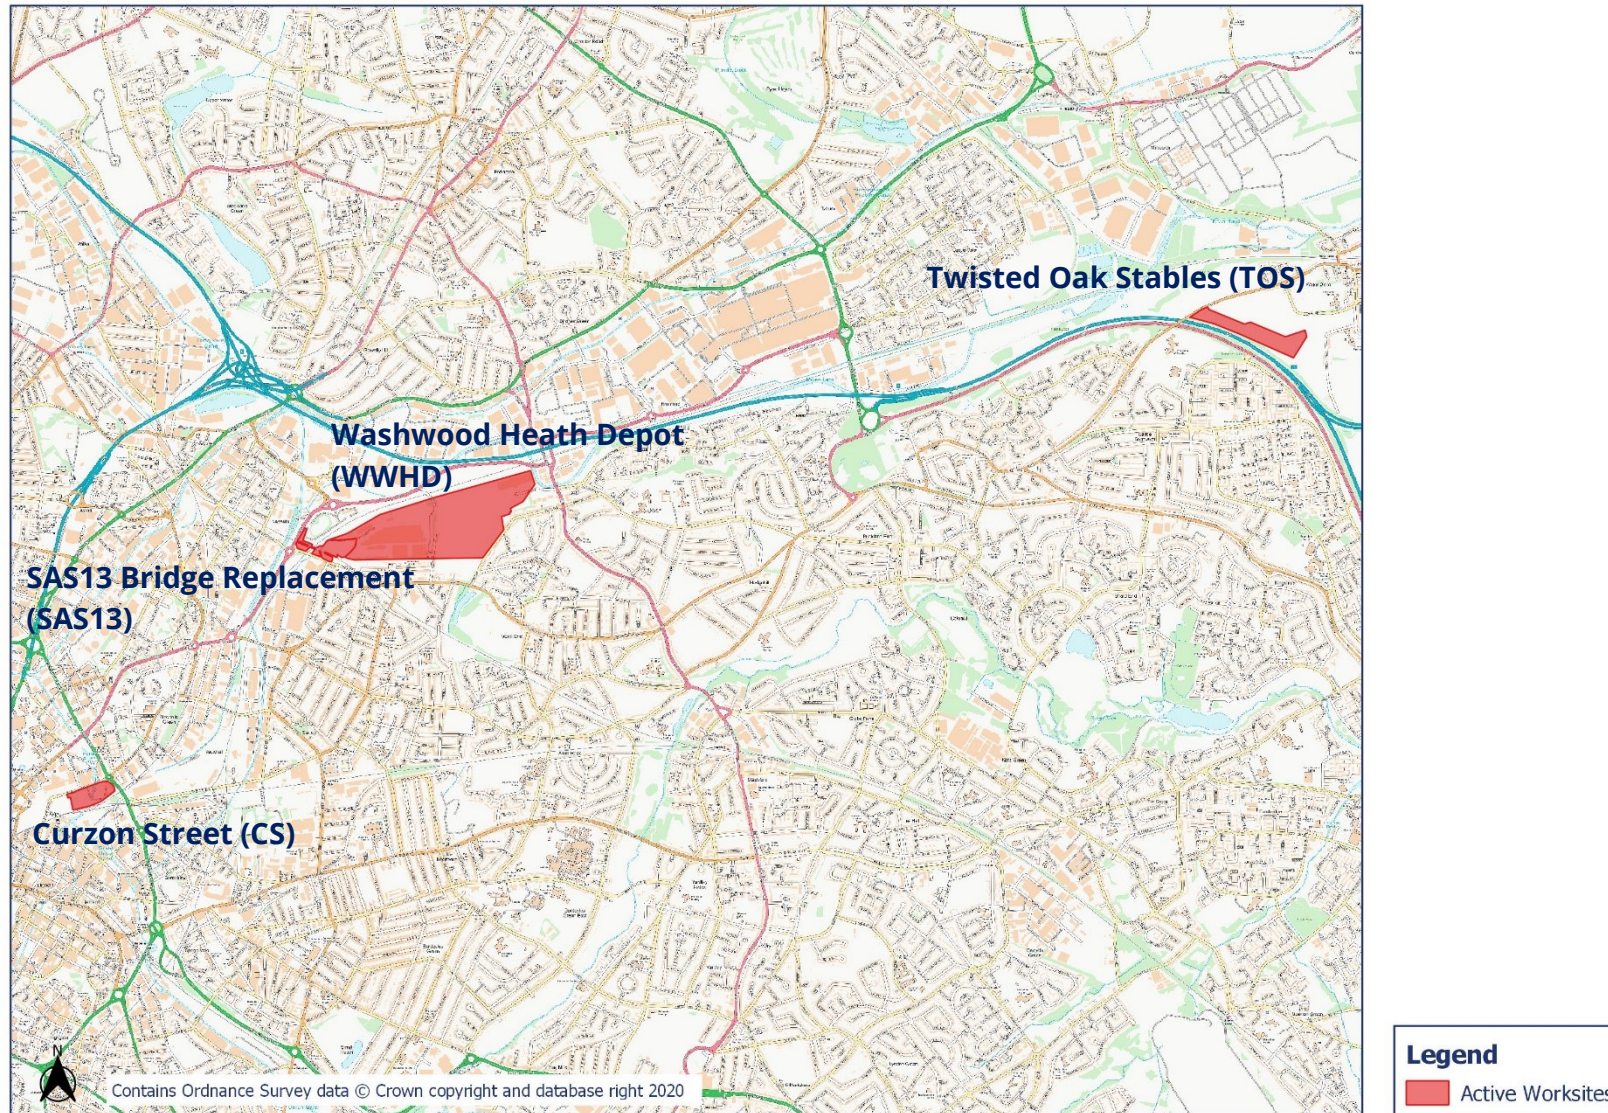


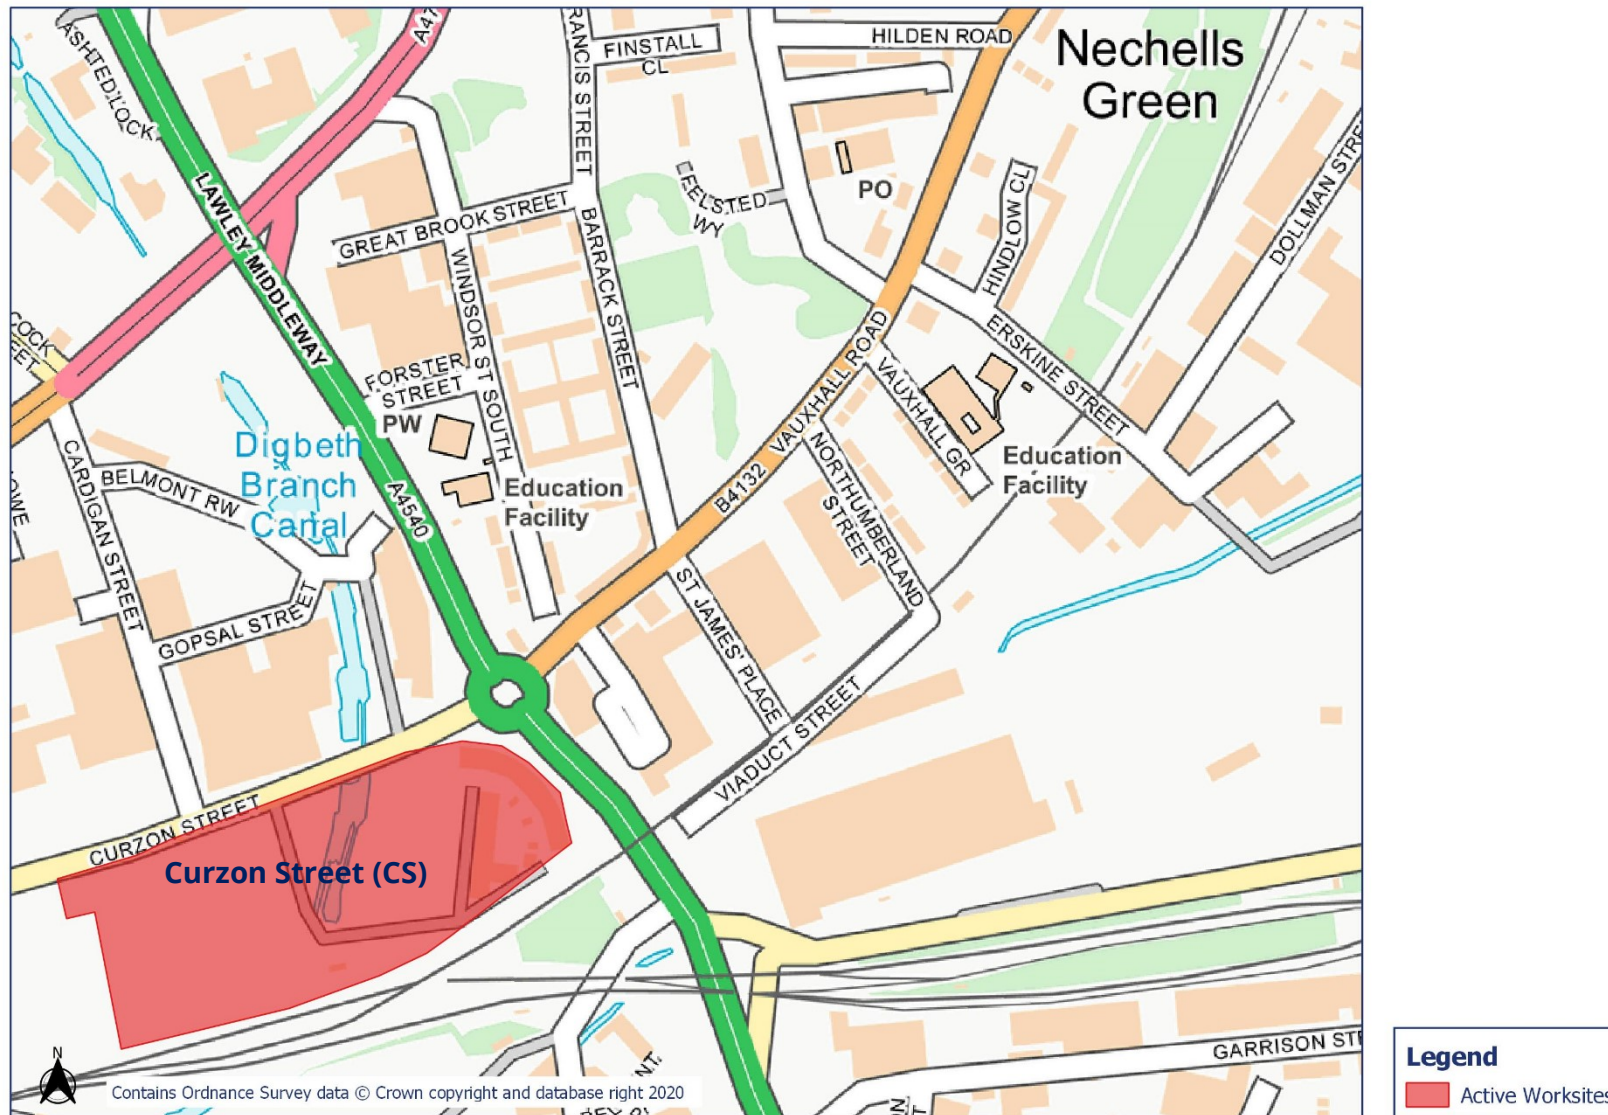


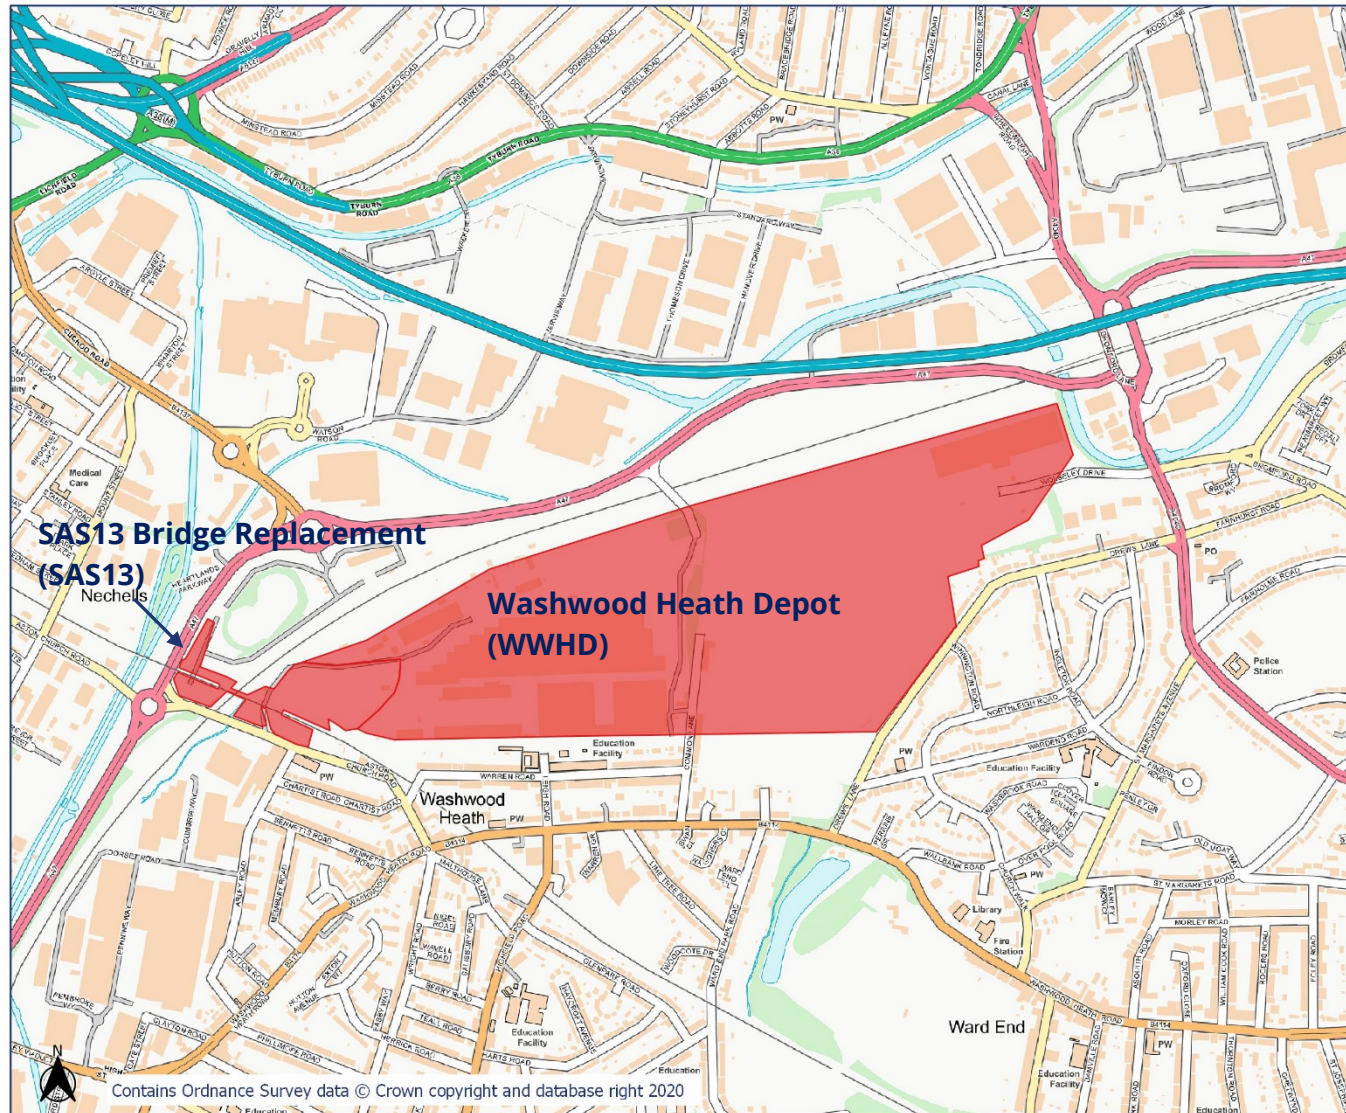


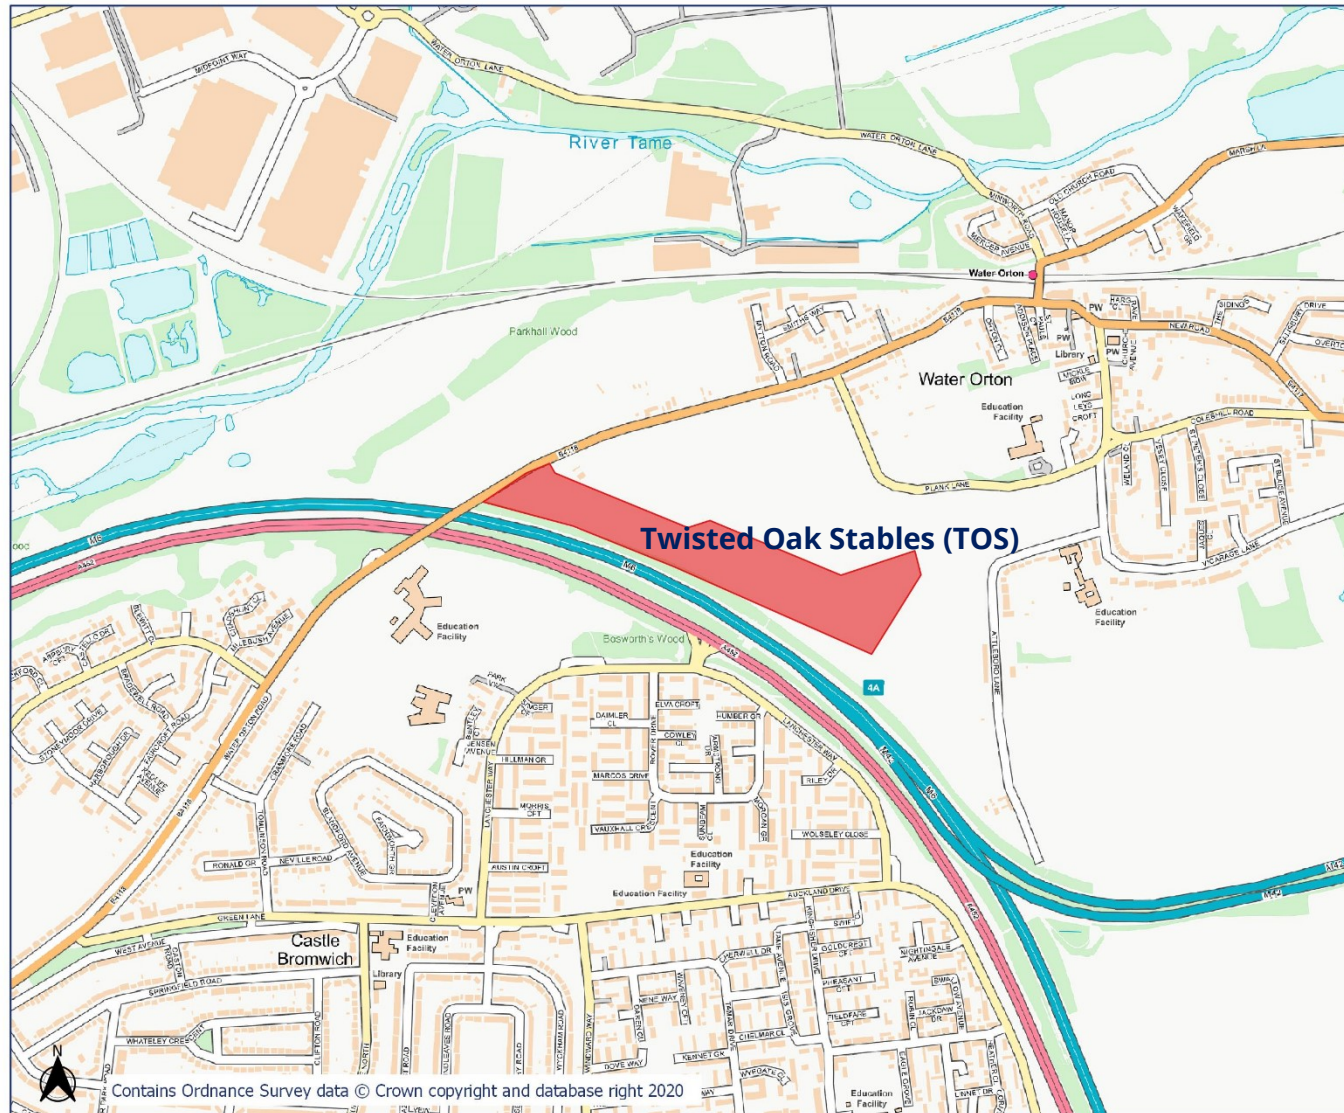


Appendix B Monitoring Locations

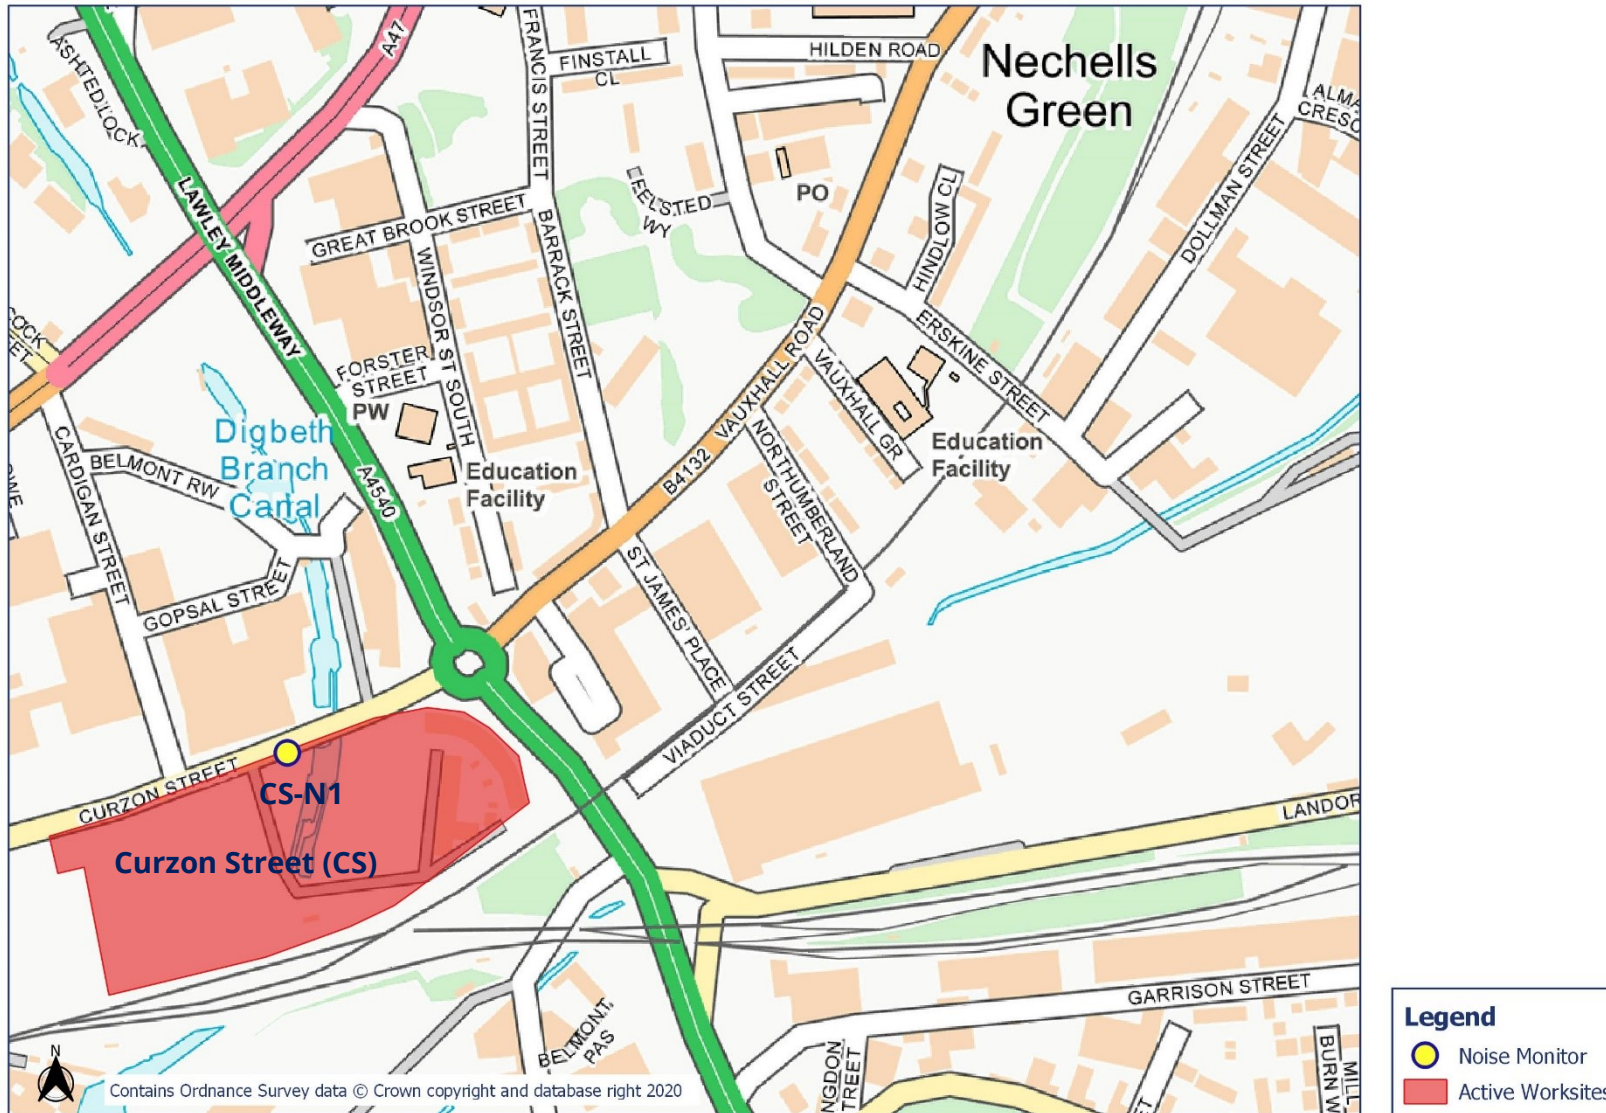

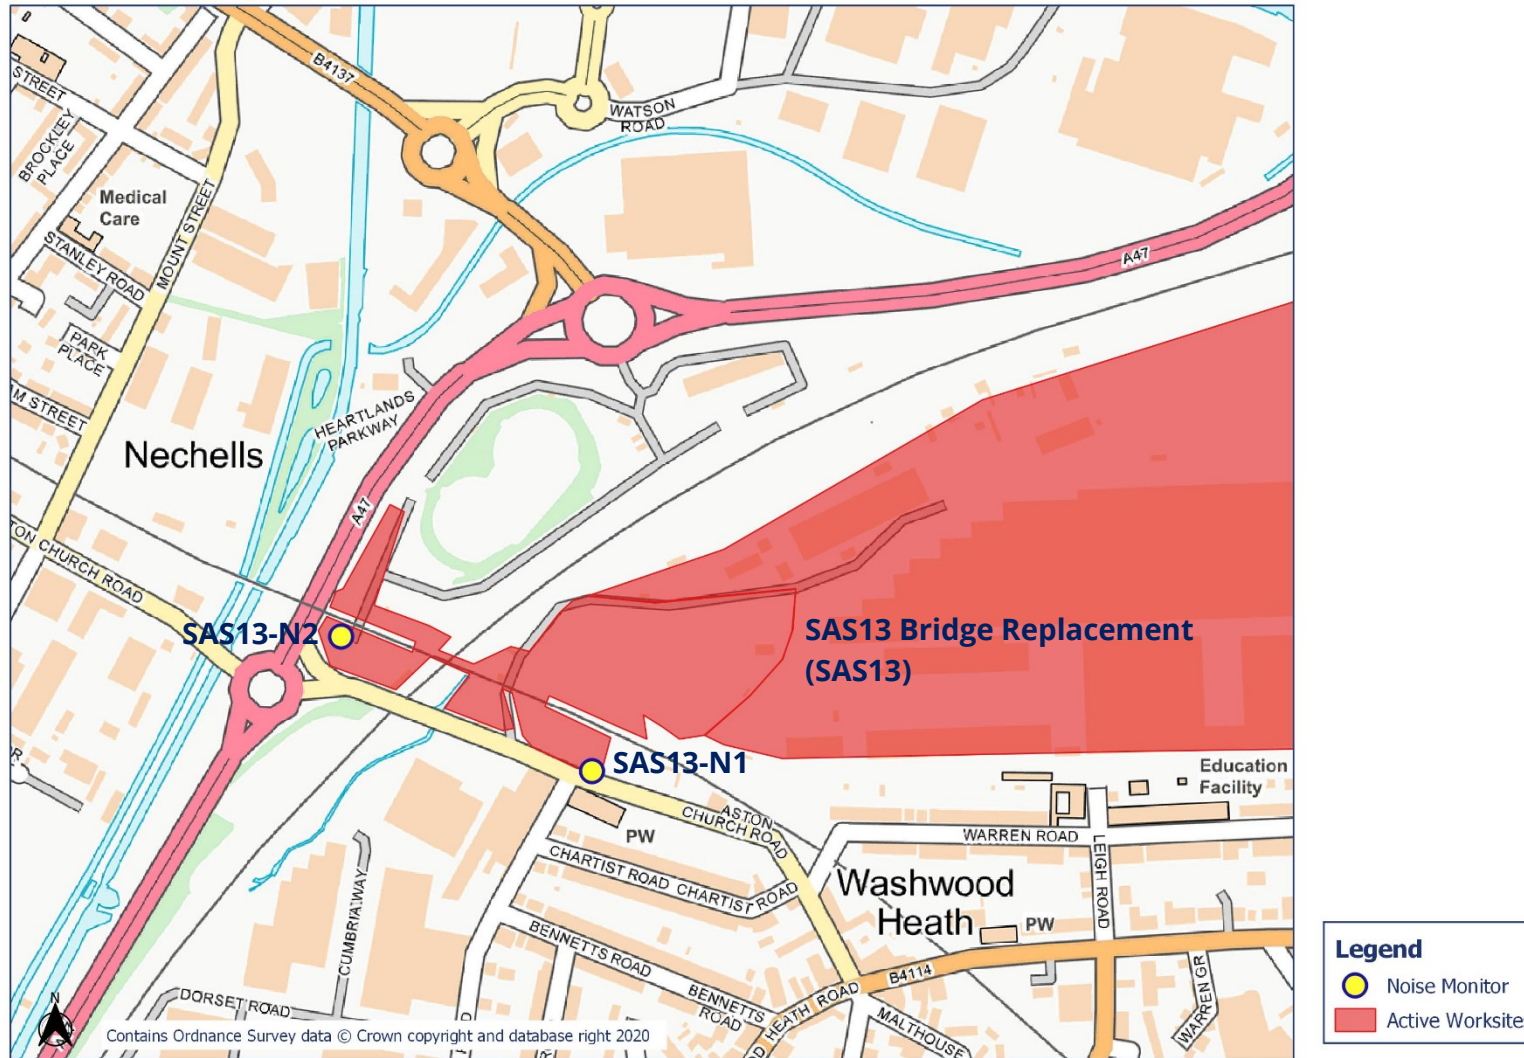

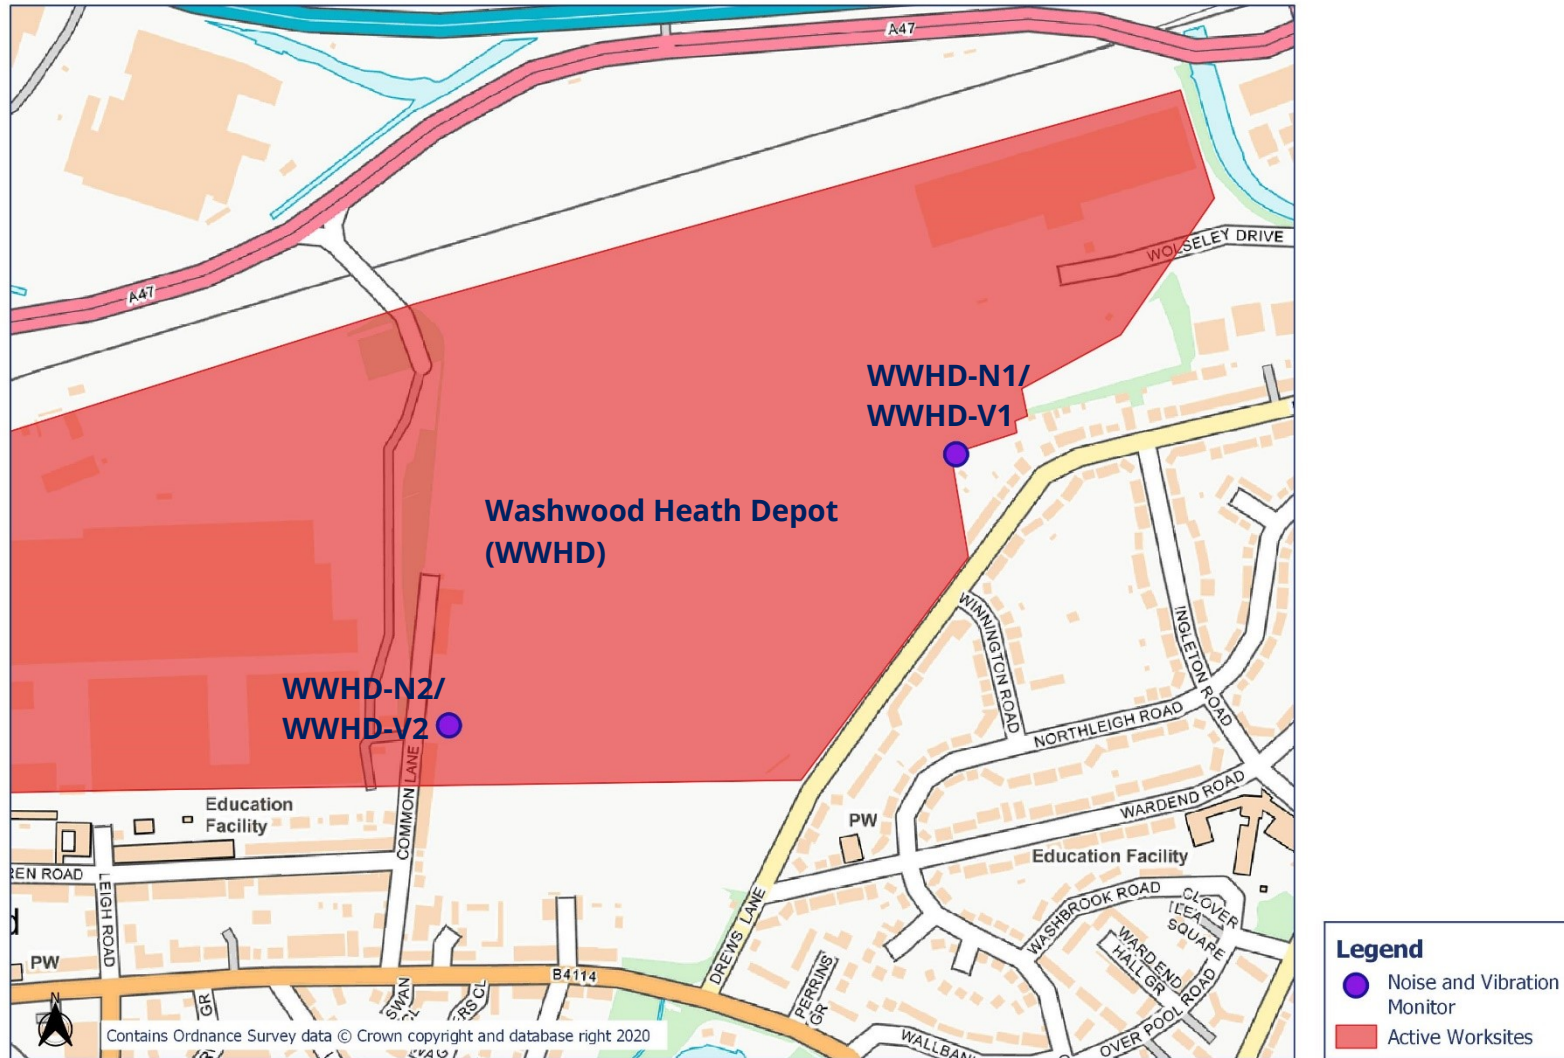


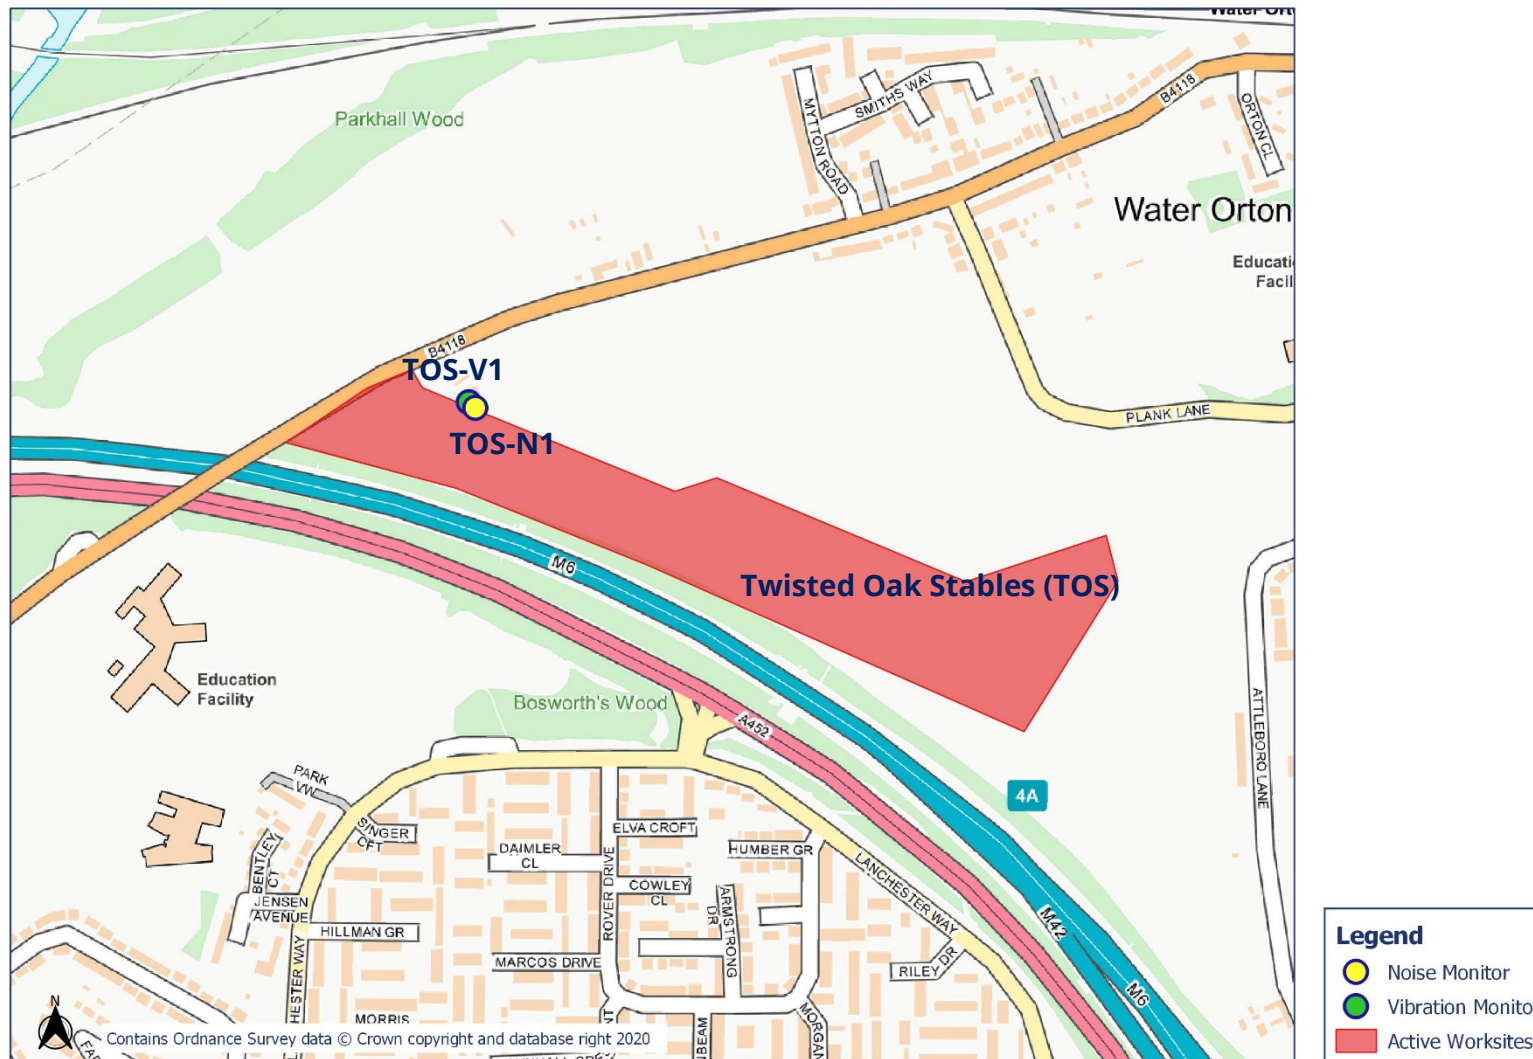





Appendix C Data

Noise




The following graphs show the hourly measured ambient noise level $L_{Aeq,1h}$ and, where relevant, the averaged noise level $L_{Aeq,T}$ values, where the time period T is as specified in Table 1 of HS2 Information Paper E23. Periods with adversely weather affected noise levels are greyed out and have been excluded from the calculation of the $L_{Aeq,T}$ values in Table 3 of the main report.



Worksite: Curzon Street (CS) – Monitoring Ref: CS-N1

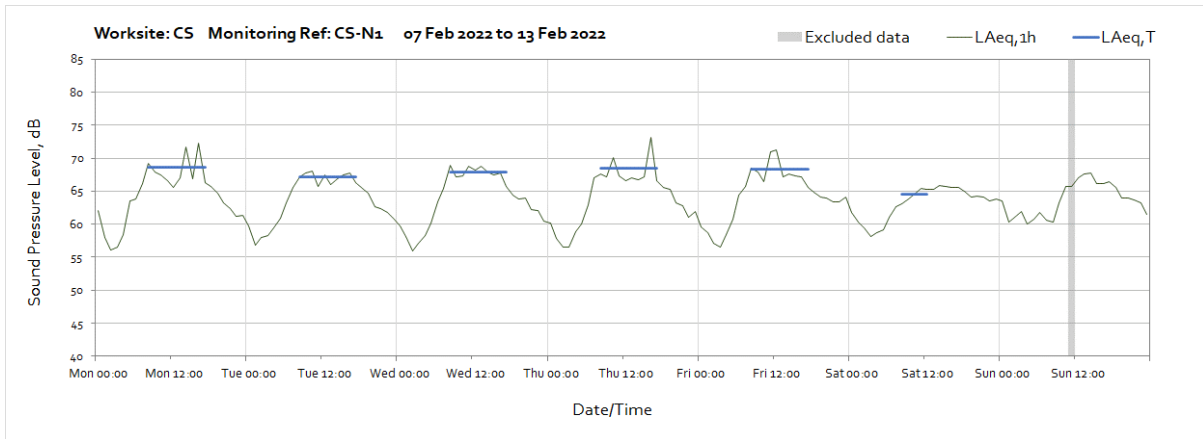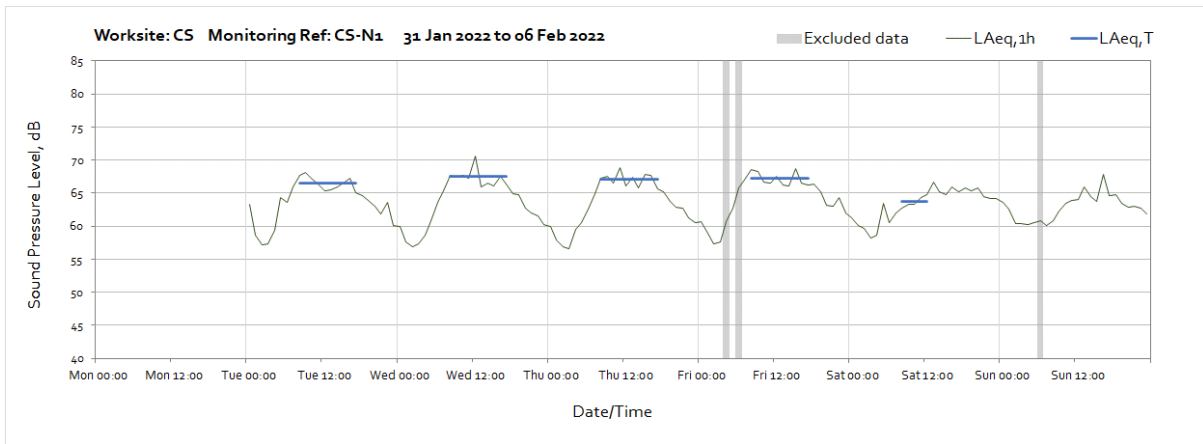

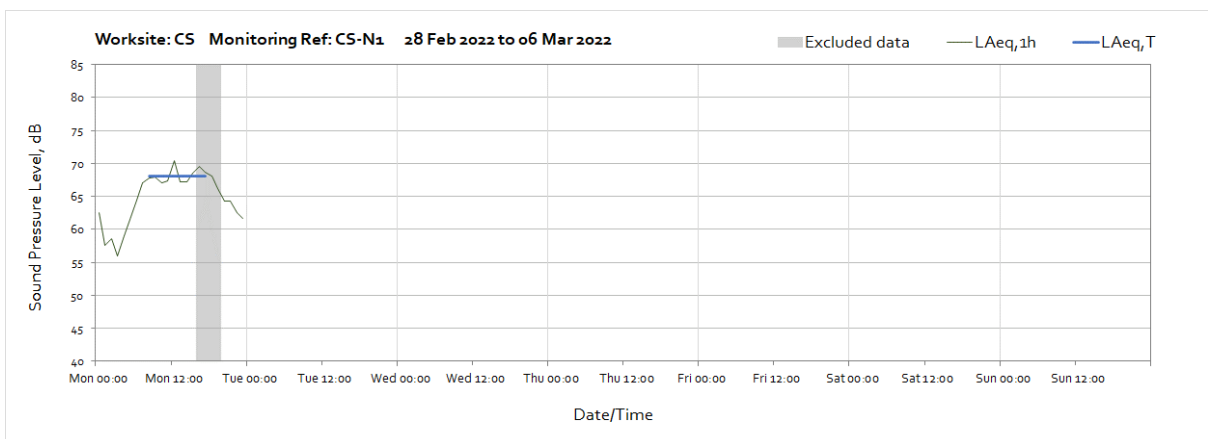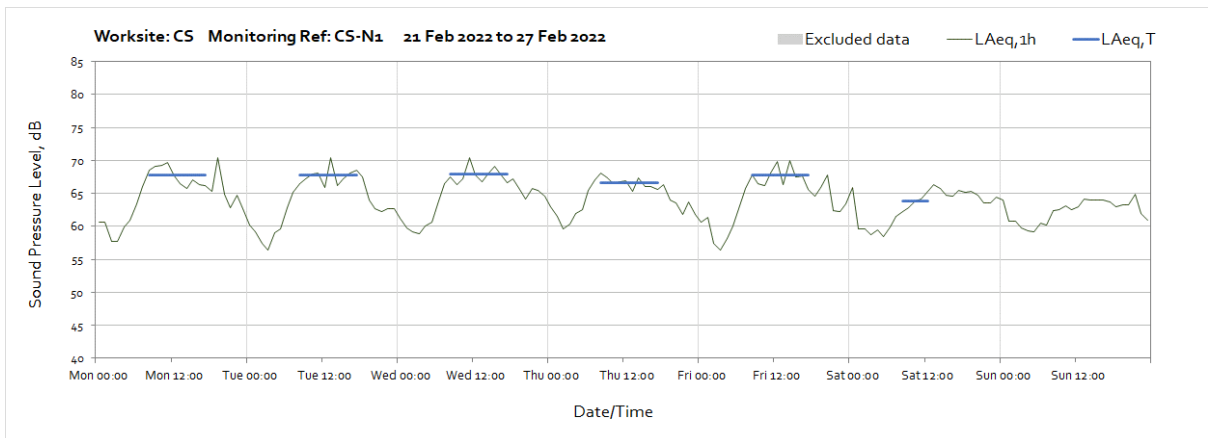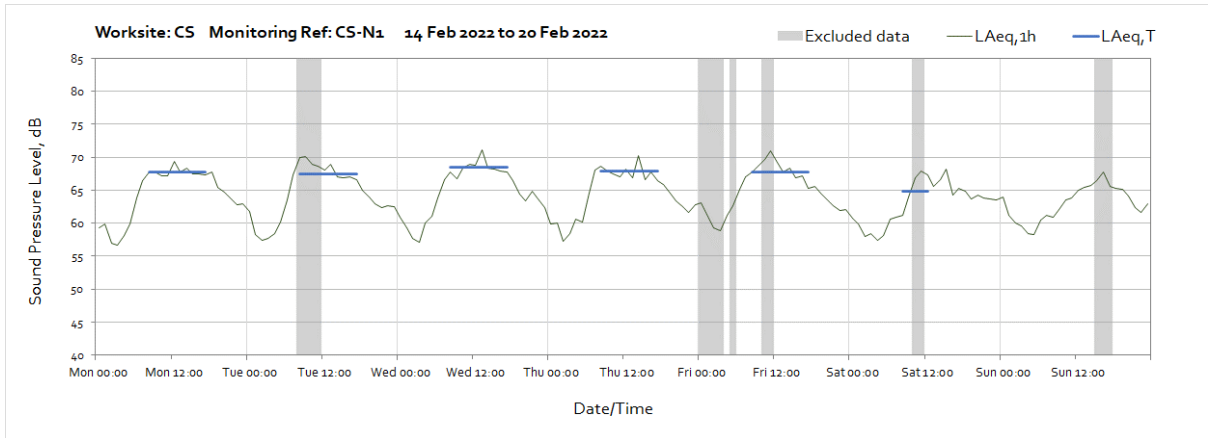


Worksite: Washwood Heath Depot (WWHD) – Monitoring Ref: WWHD-N1

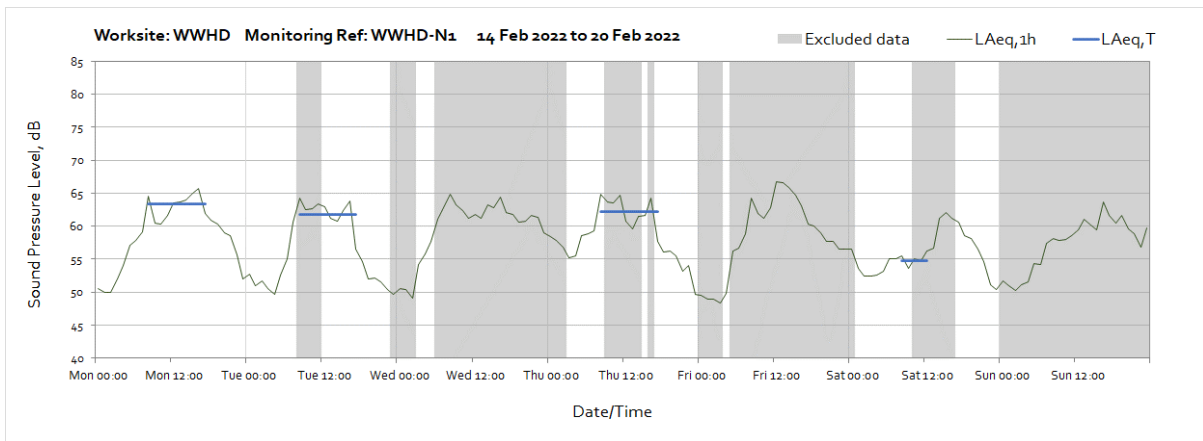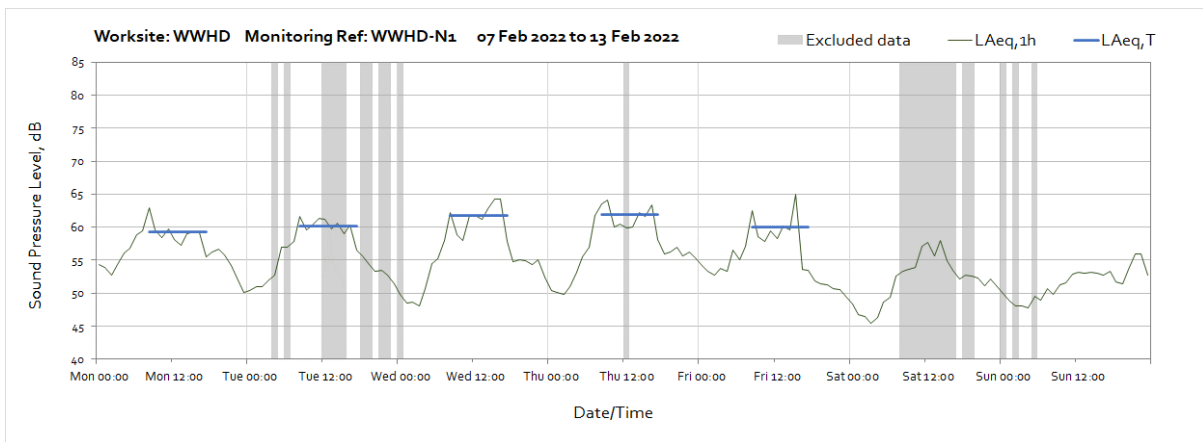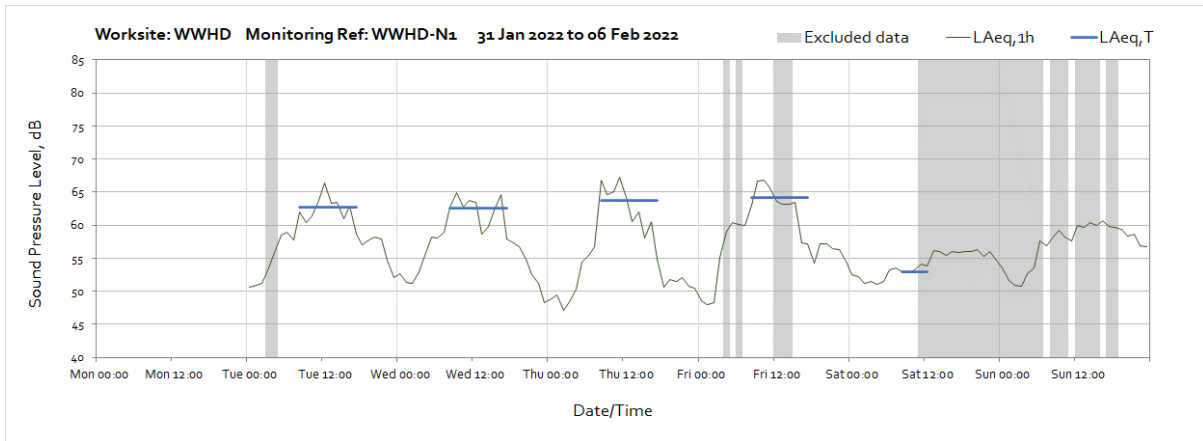


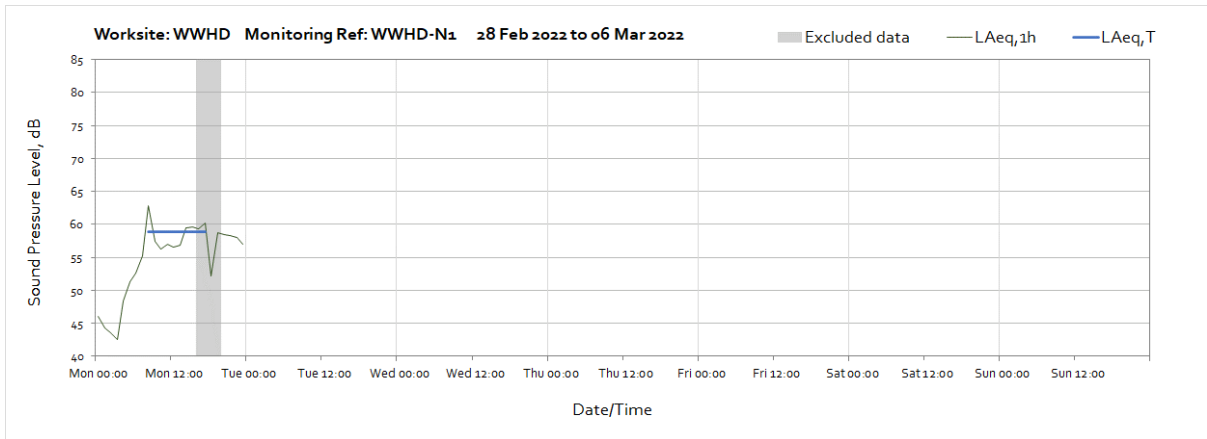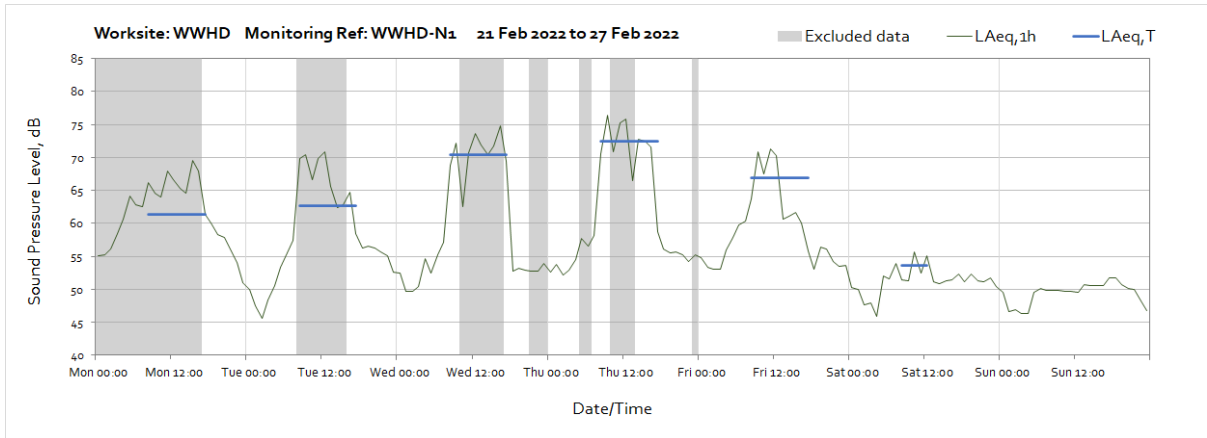



Worksite: Washwood Heath Depot (WWHD) – Monitoring Ref: WWHD-N2

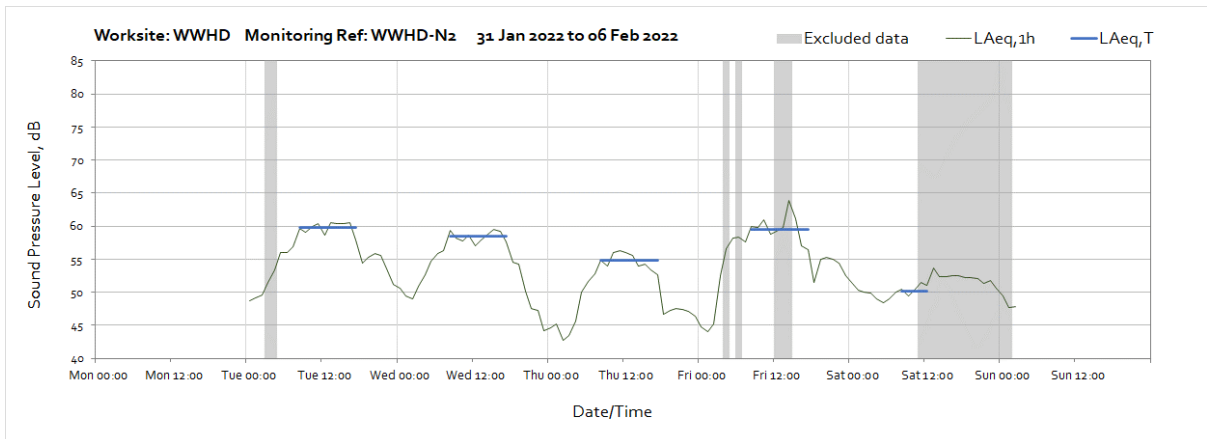


Note: Missing data from 03:00 on Sunday 6th February to 14:00 on Thursday 10th February 2022 were due to a monitor system glitch and it is currently under investigation.


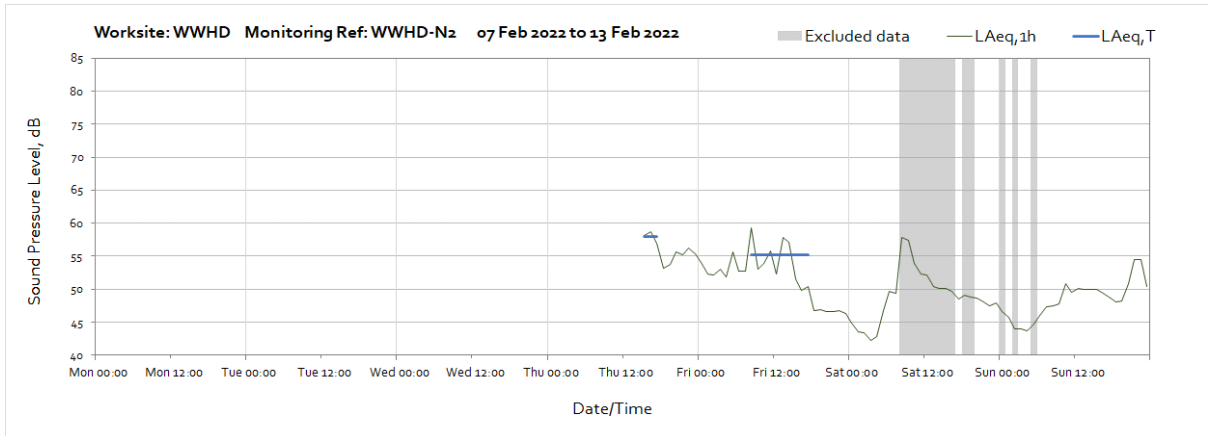





Note: Missing data from 03:00 on Sunday 6th February to 14:00 on Thursday 10th February 2022 were due to a monitor system glitch and it is currently under investigation.

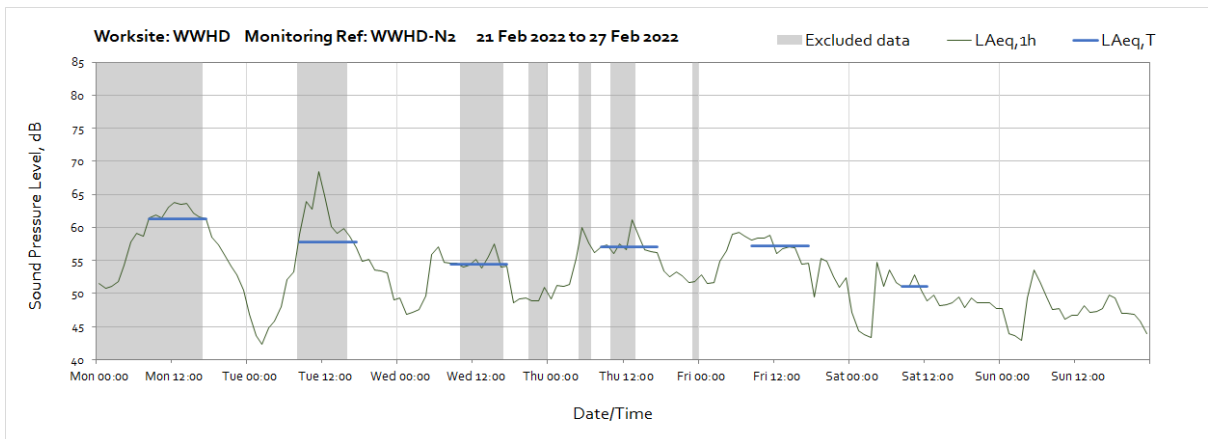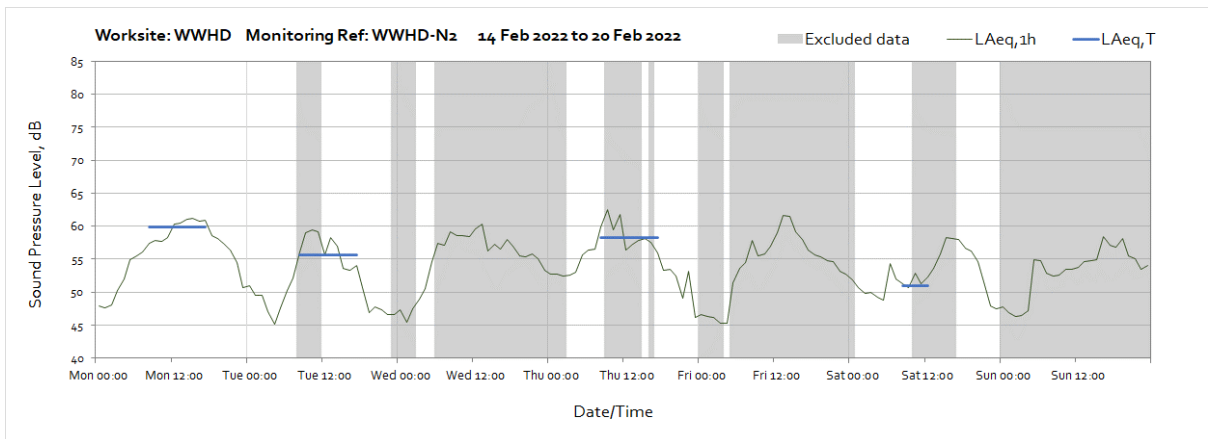



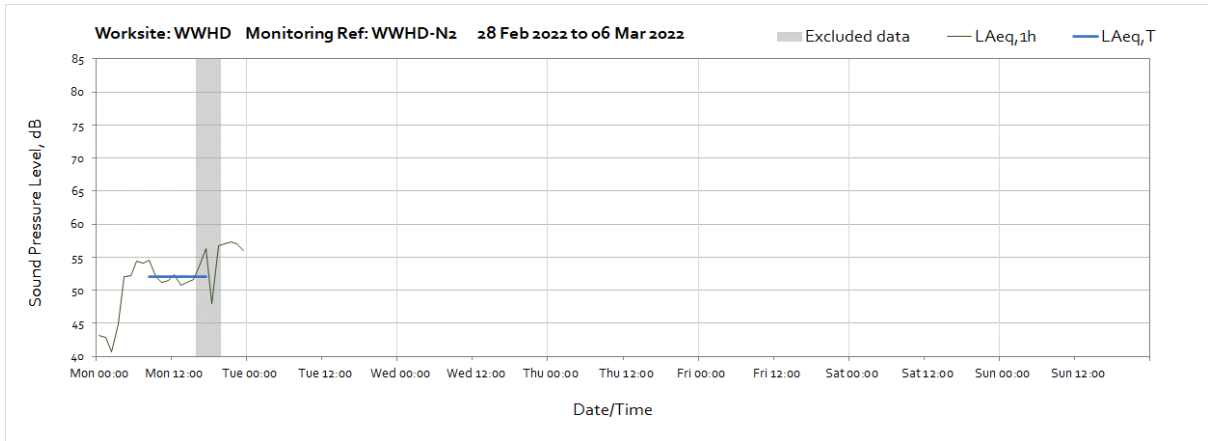




Worksite: Twisted Oak Stables (TOS) – Monitoring Ref: TOS-N1

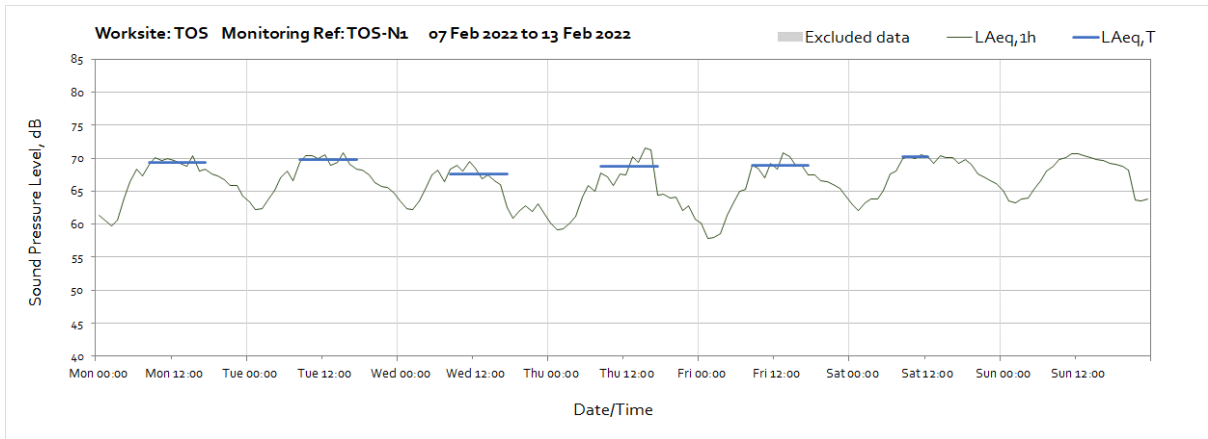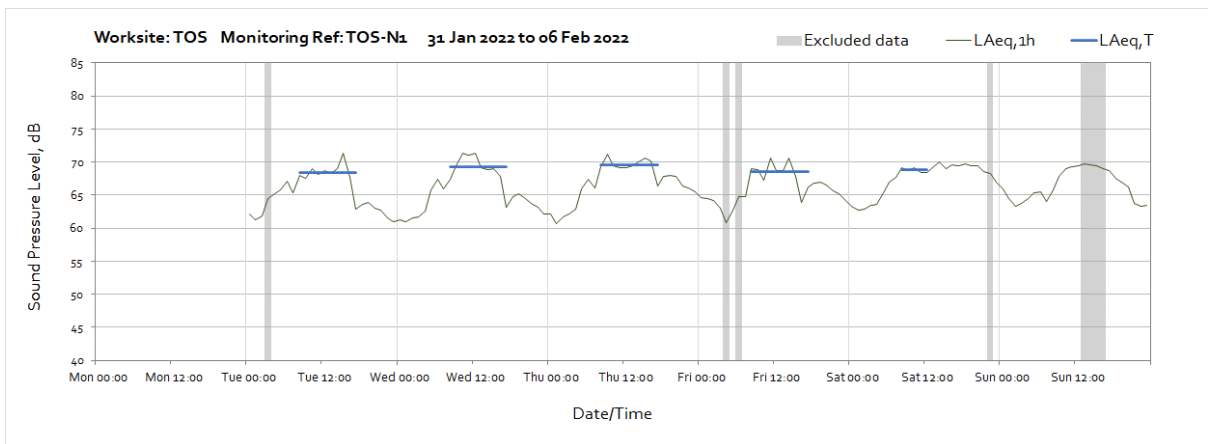

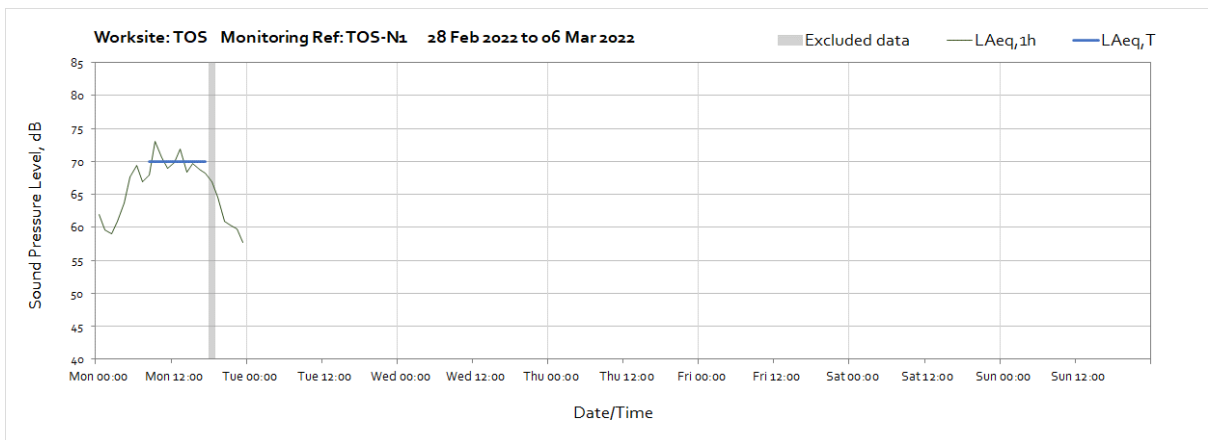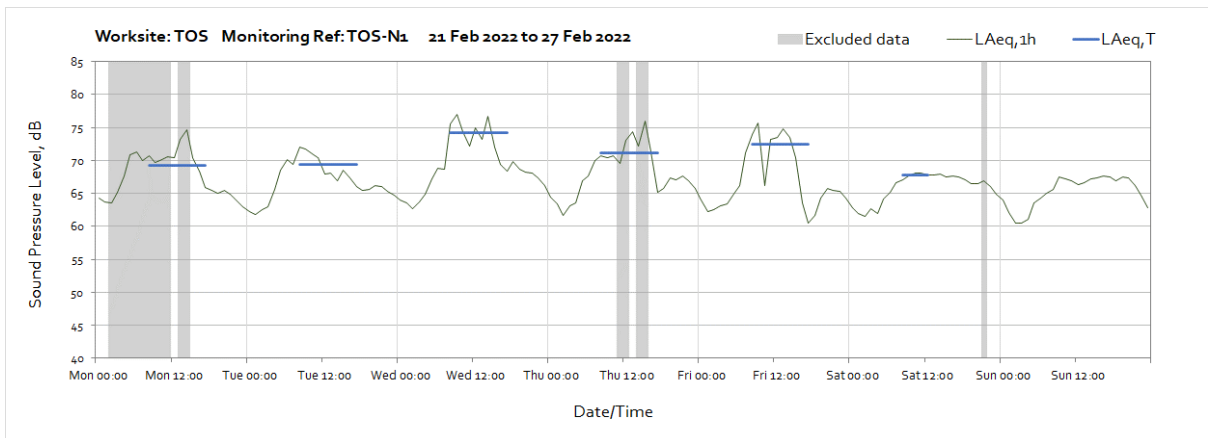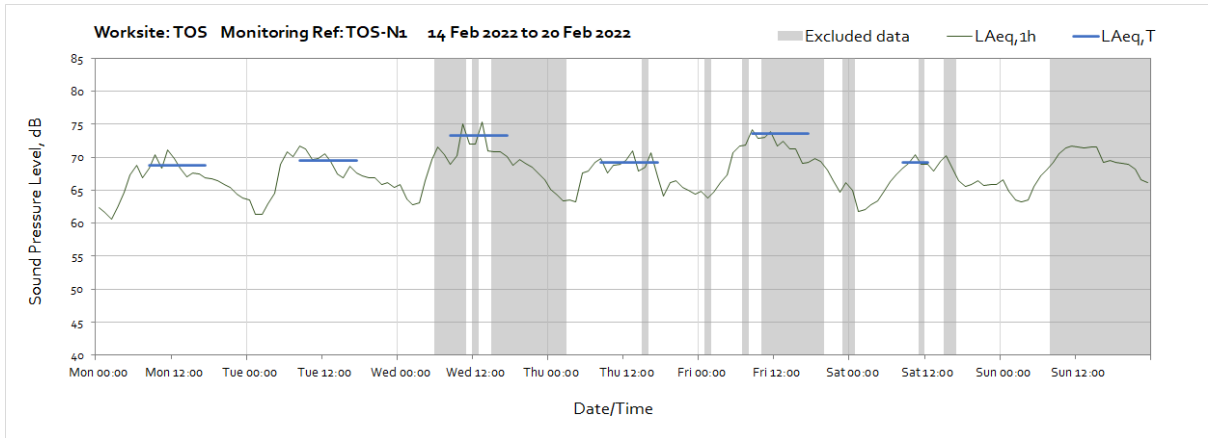





Worksite: SAS13 Bridge Replacement (SAS13) – Monitoring Ref: SAS13-N1

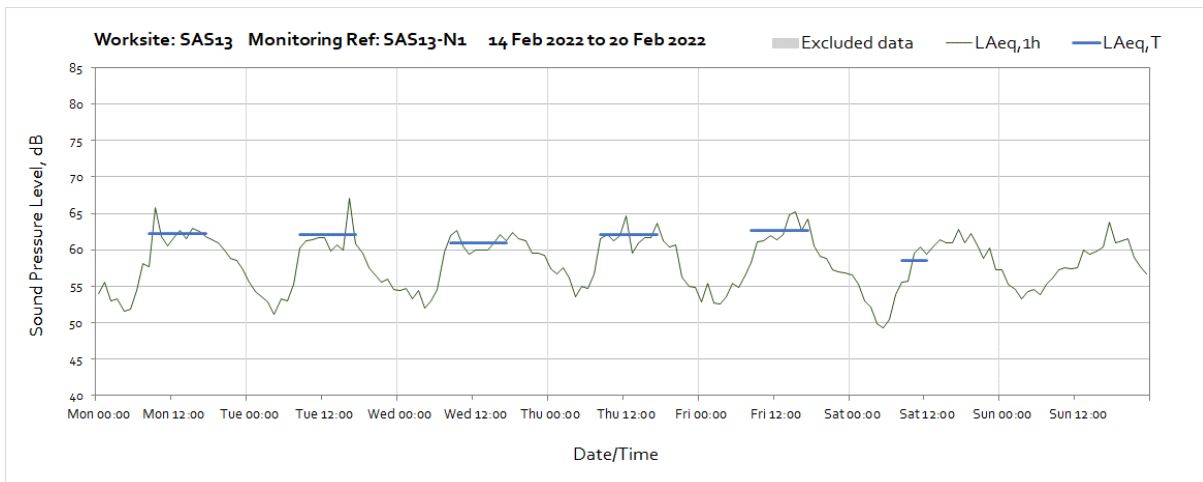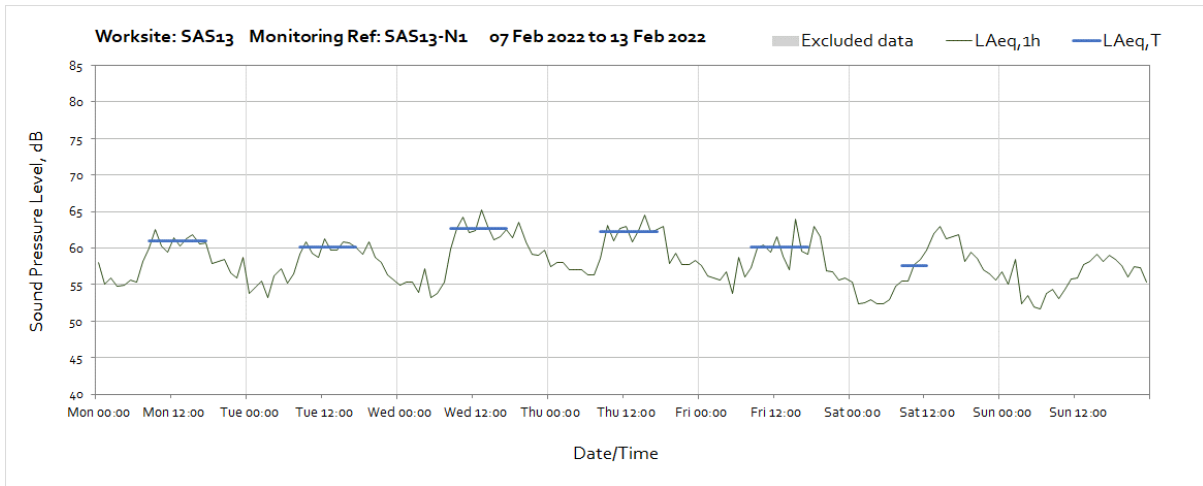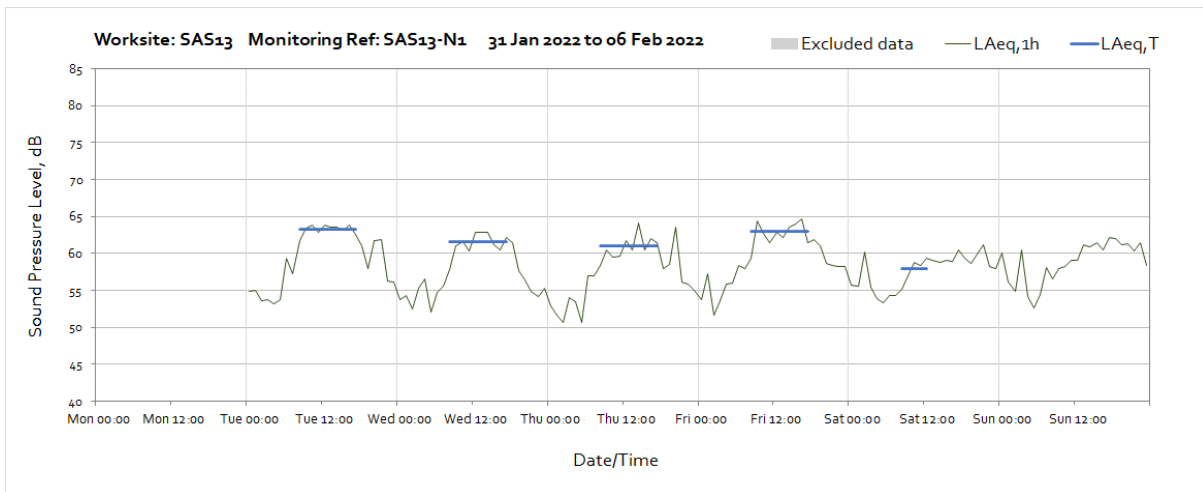


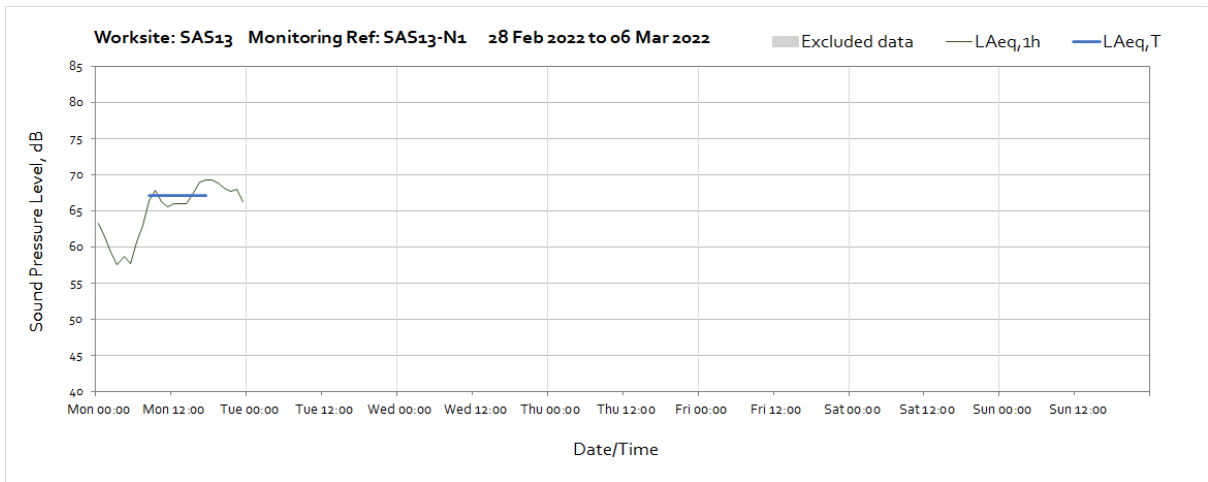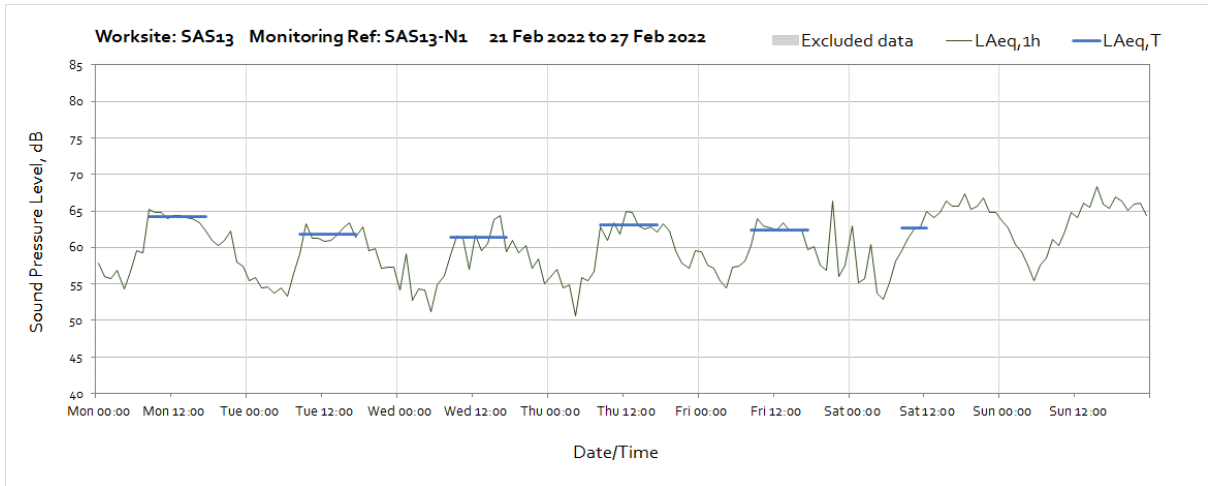

Worksite: SAS13 Bridge Replacement (SAS13) – Monitoring Ref: SAS13-N2

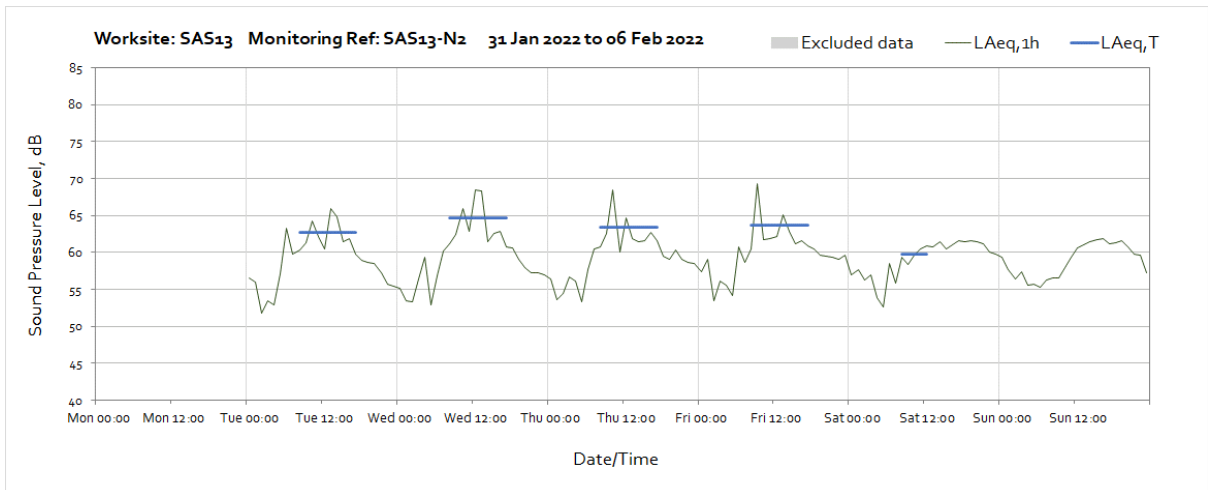

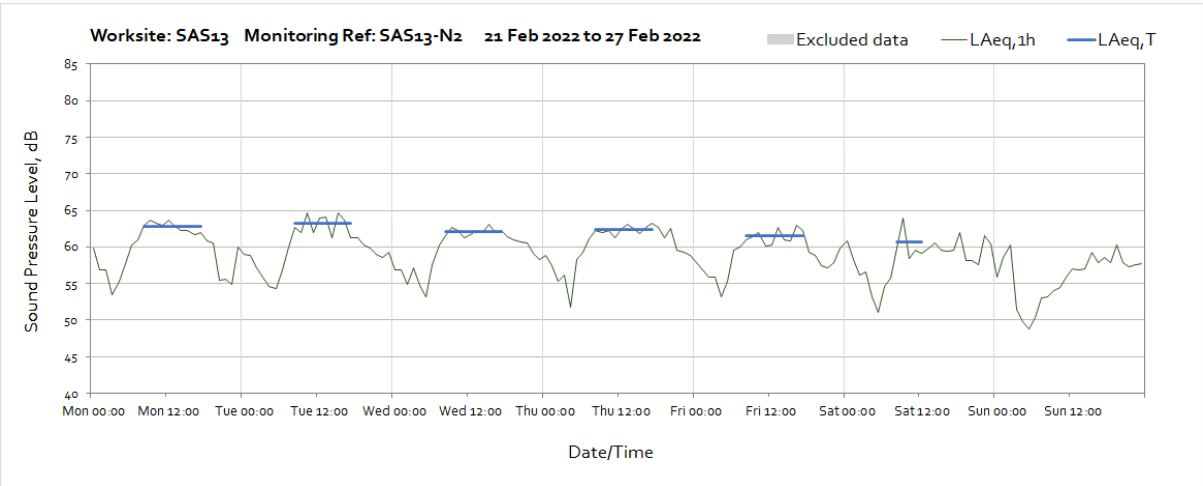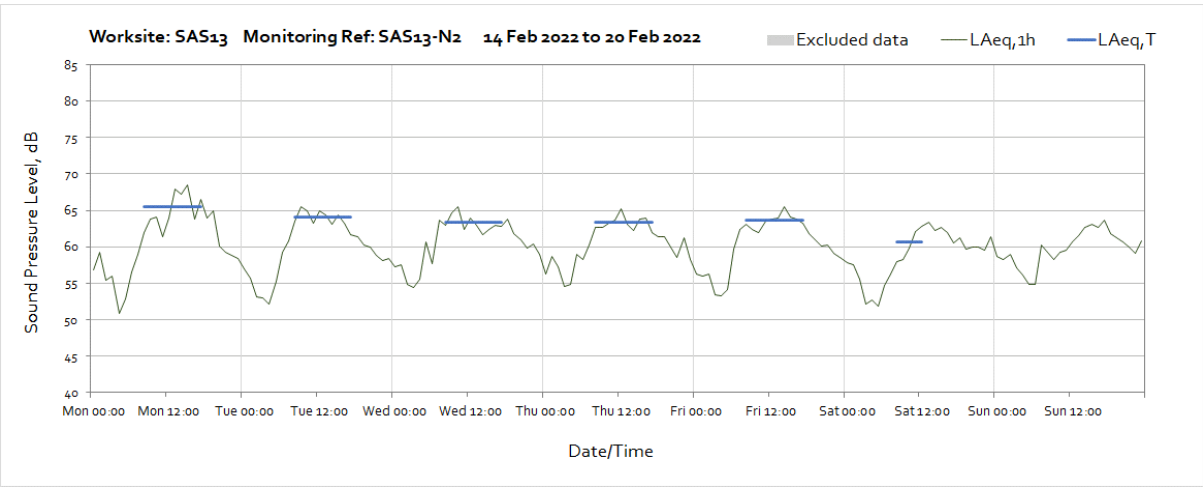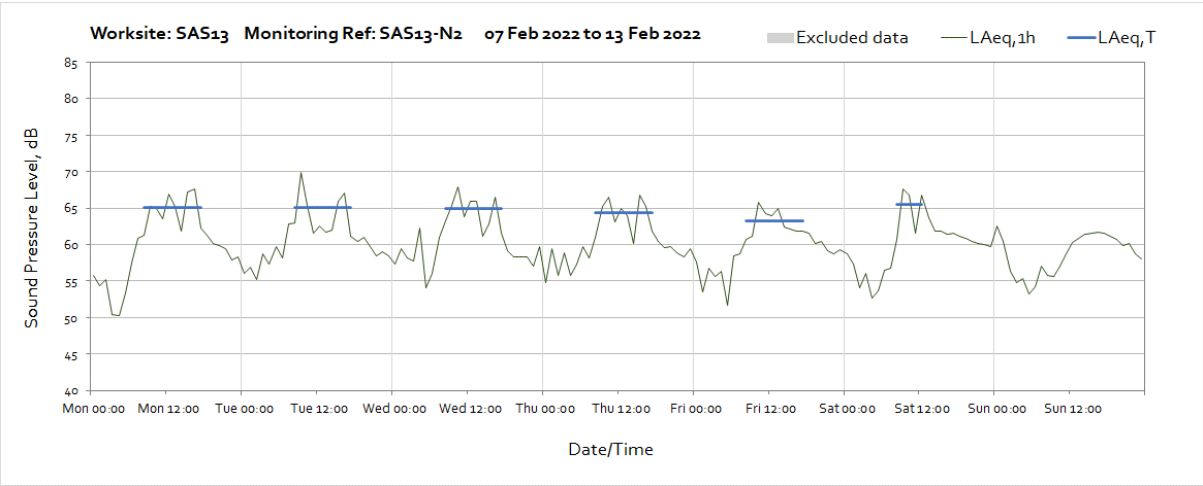


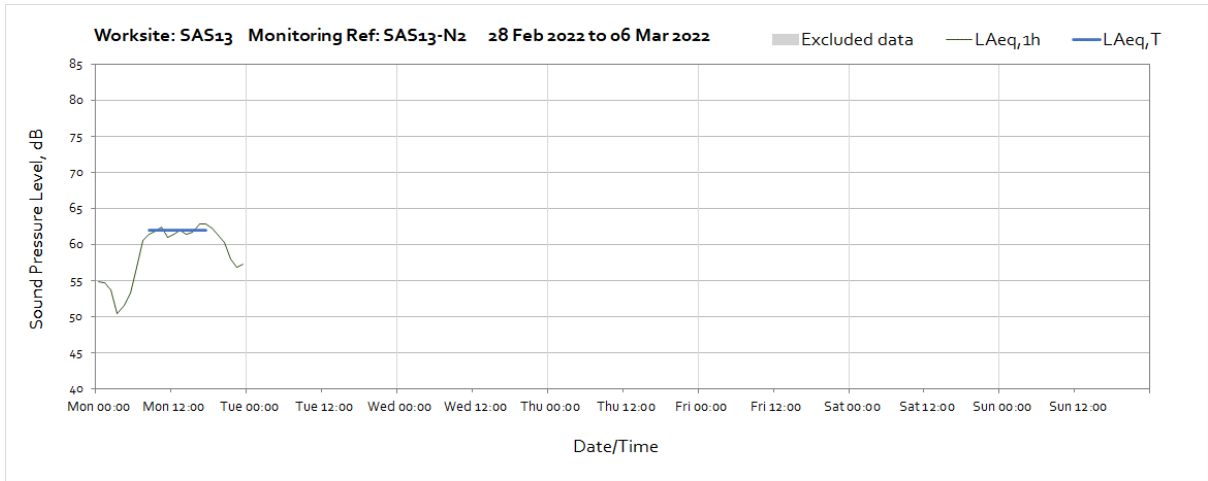


Vibration

The following graphs show the hourly measured peak particle velocity PPV recorded during the monitoring period. The graphs show the highest PPV of the three orthogonal axis x, y and z. Where high values of PPV were caused by local interference with the vibration monitor, which are not representative of HS2 construction works, these values have been greyed out in the following charts and have been excluded to calculate values in Table 4 of the main report.


Worksite: Twisted Oak Stables (TOS) – Monitoring Ref: TOS-V1

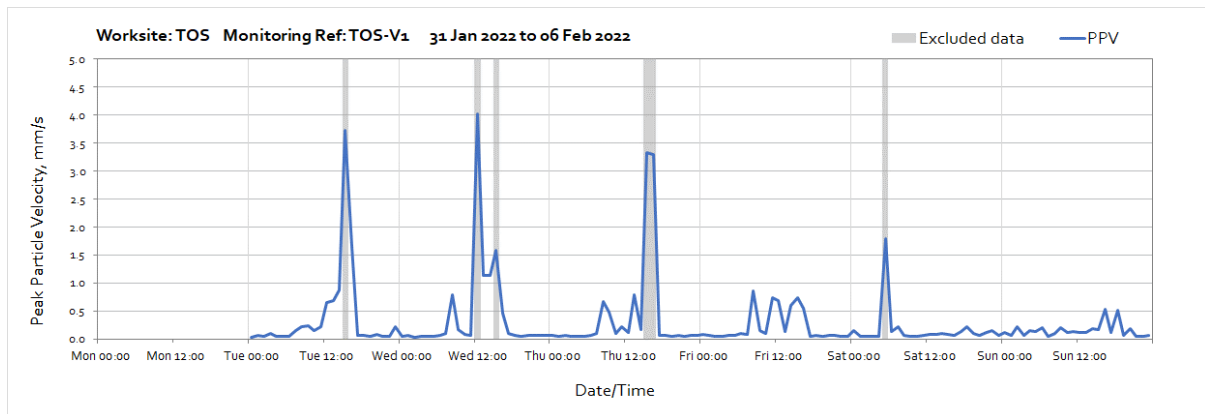


Note: High vibration data measured across the week were due to local disturbance at the monitor location and not representative of HS2 vibration levels at the receptor.

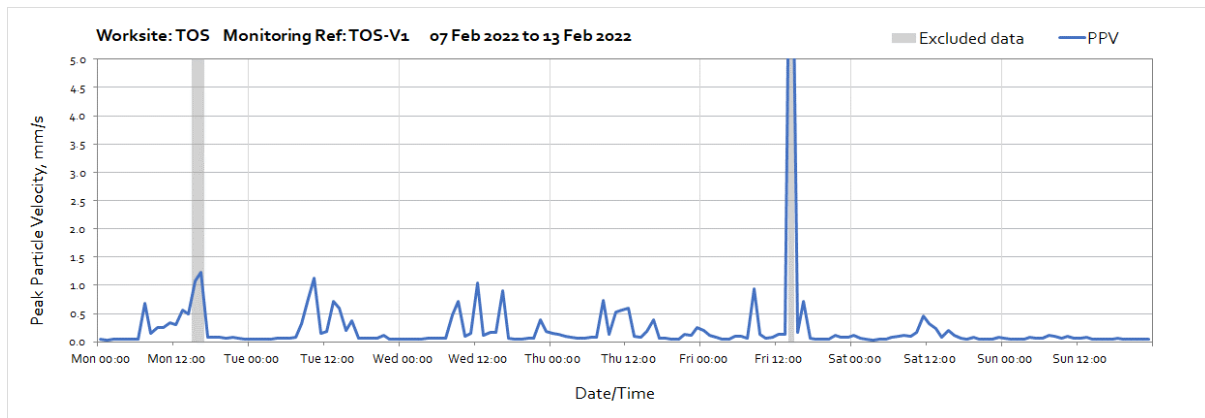


Note: High vibration data measured across the week were due to local disturbance at the monitor location and not representative of HS2 vibration levels at the receptor.

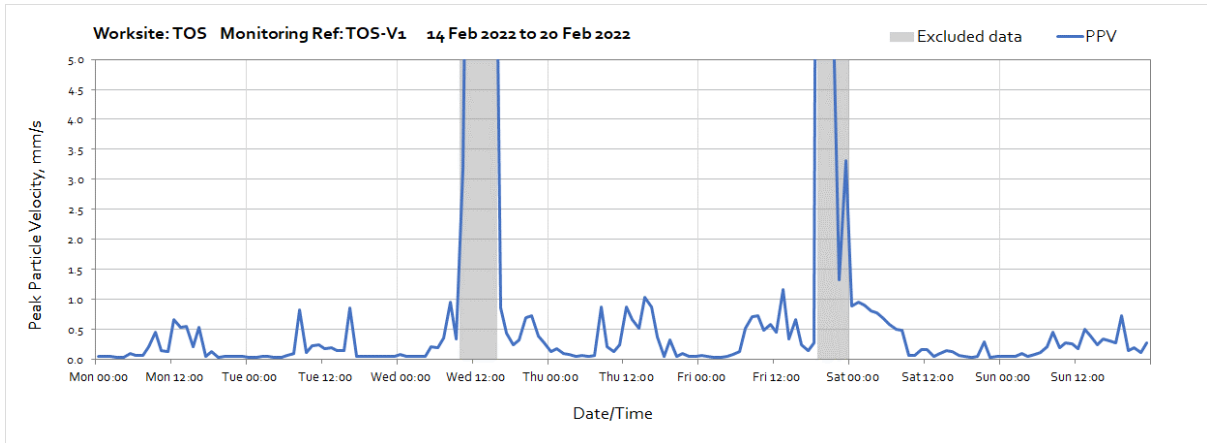




Note: High vibration data measured across the week were due to local disturbance at the monitor location and not representative of HS2 vibration levels at the receptor.


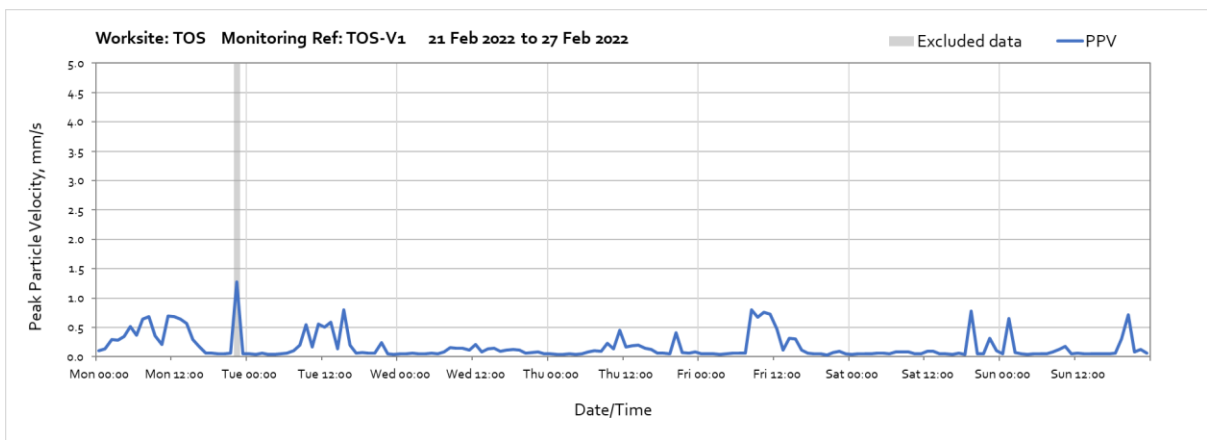


Note: High vibration data measured at 21:00 on Monday 21st February 2022 were due to local disturbance at the monitor location and not representative of HS2 vibration levels at the receptor.

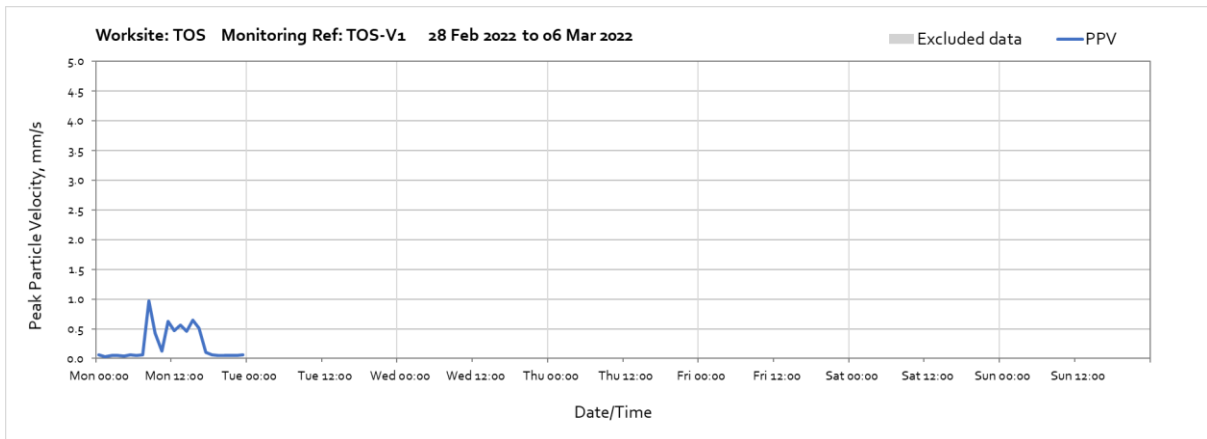


Worksite: Washwood Heath Depot (WWHD) – Monitoring Ref: WWHD-V1

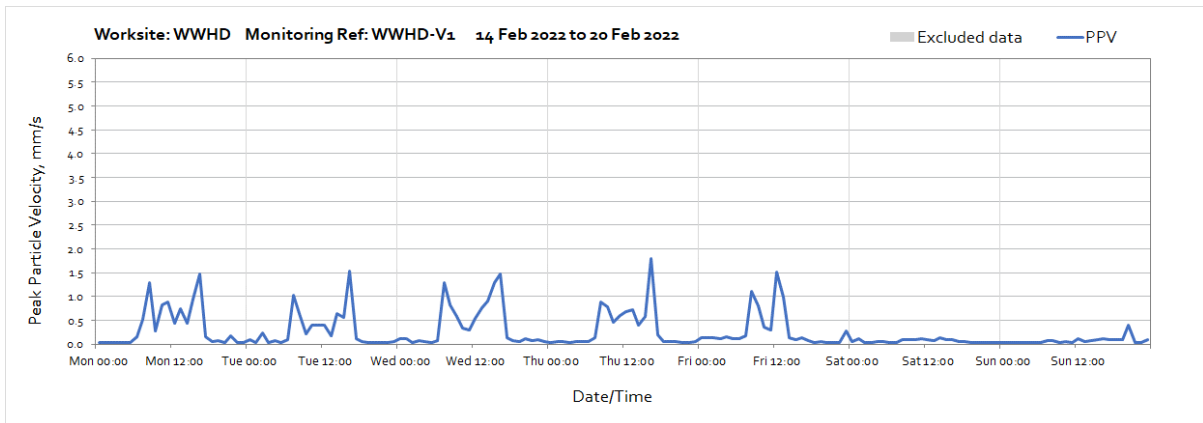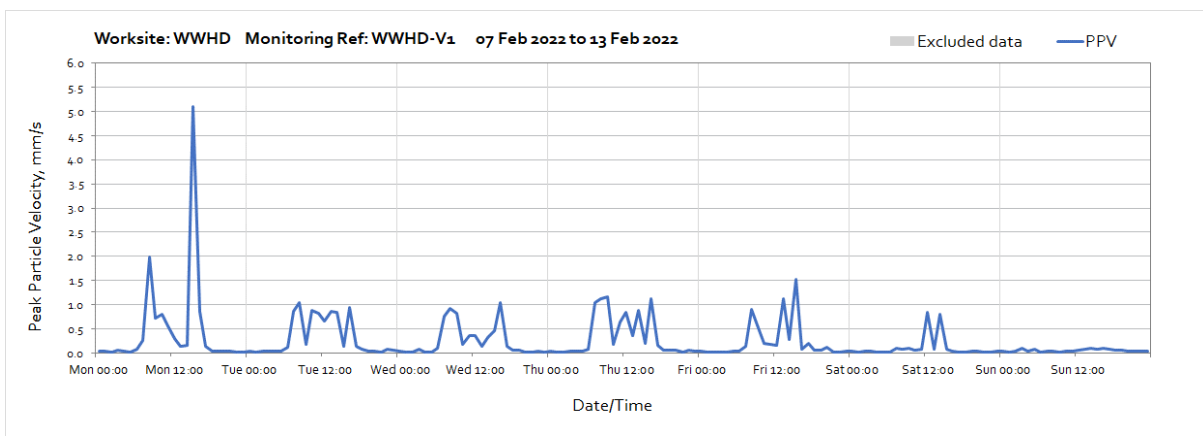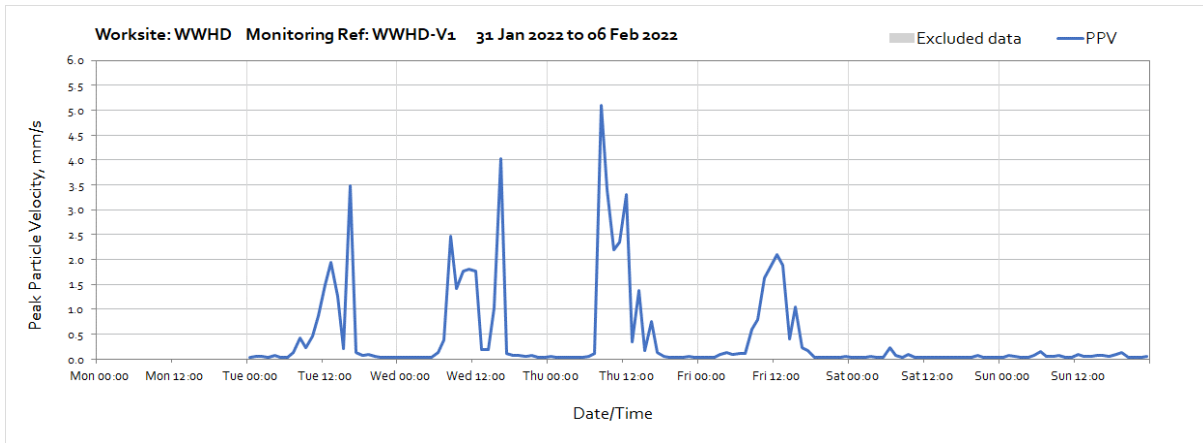

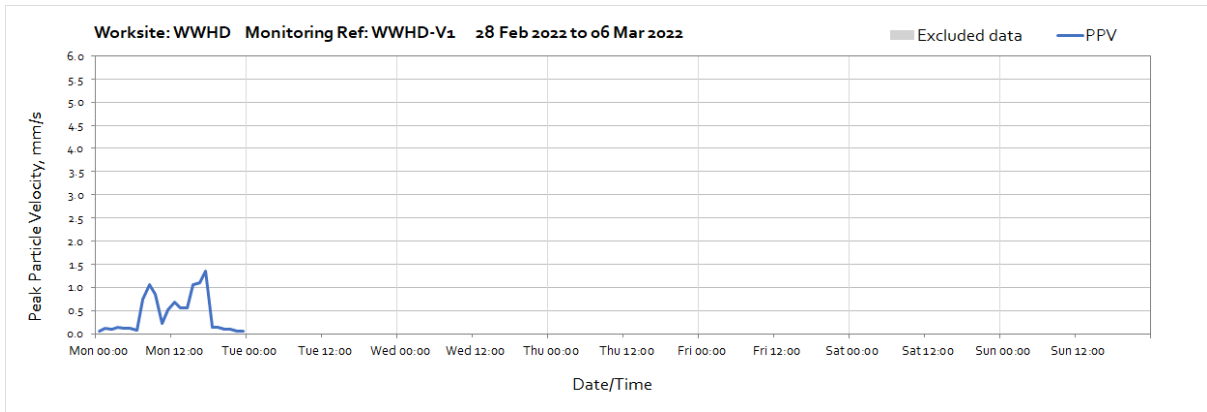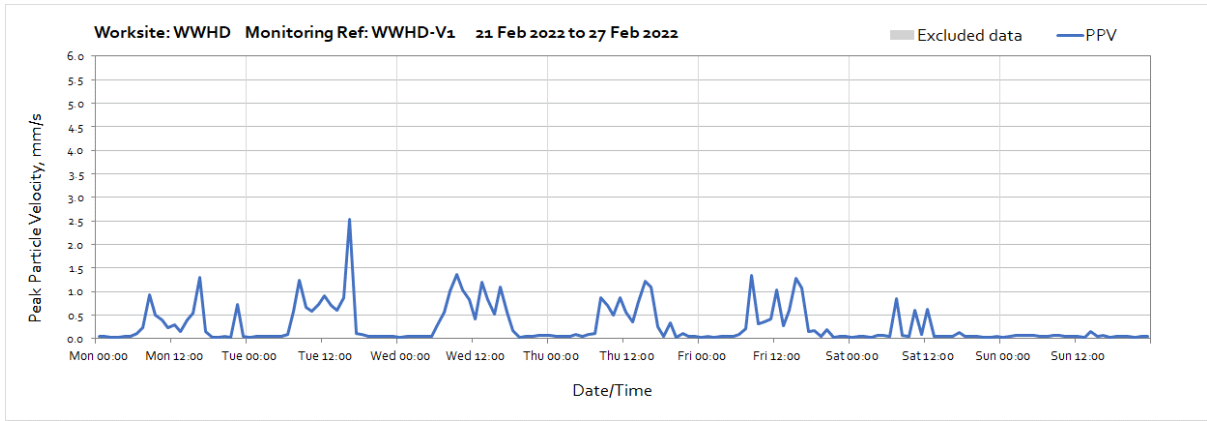

Worksite: Washwood Heath Depot (WWHD) – Monitoring Ref: WWHD-V2

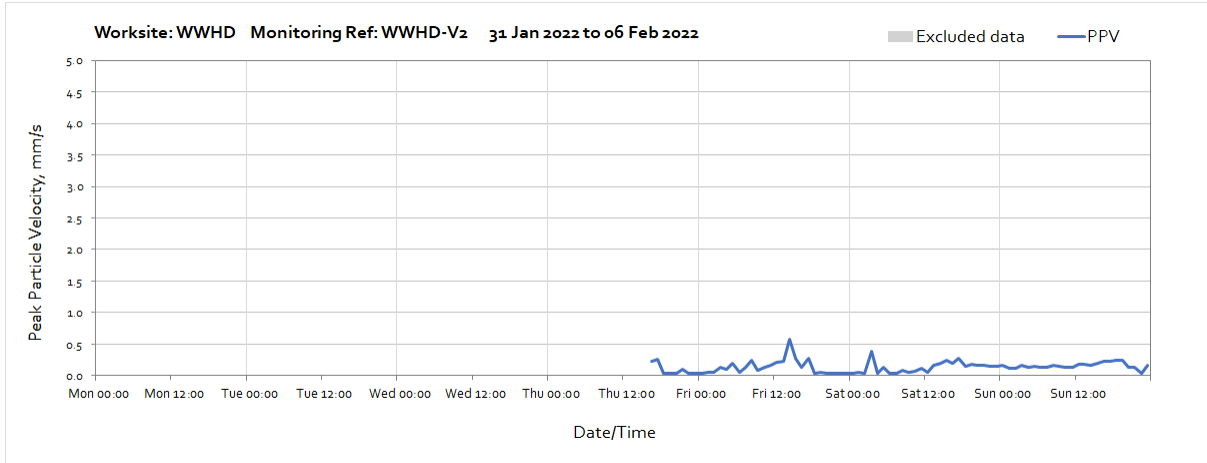

Note: Missing data from the beginning of February to 16:00 on Thursday 3rd February 2022 were due to monitor's system glitch and it is currently under investigation.

