


Advice : HSL-230217114125-1805 Does Not Cross Any Consultation Zones

Your Ref: S62A/2022/0011

Development Name: Land Near Pelham Substation, Maggots End Road, Manuden

Comments: Construction and operation of a solar farm comprising ground mounted solar photovoltaic (PV) arrays and battery storage together with associated development, including inverter cabins, DNO substation, customer switchgear, access, fencing, CCTV cameras and landscaping

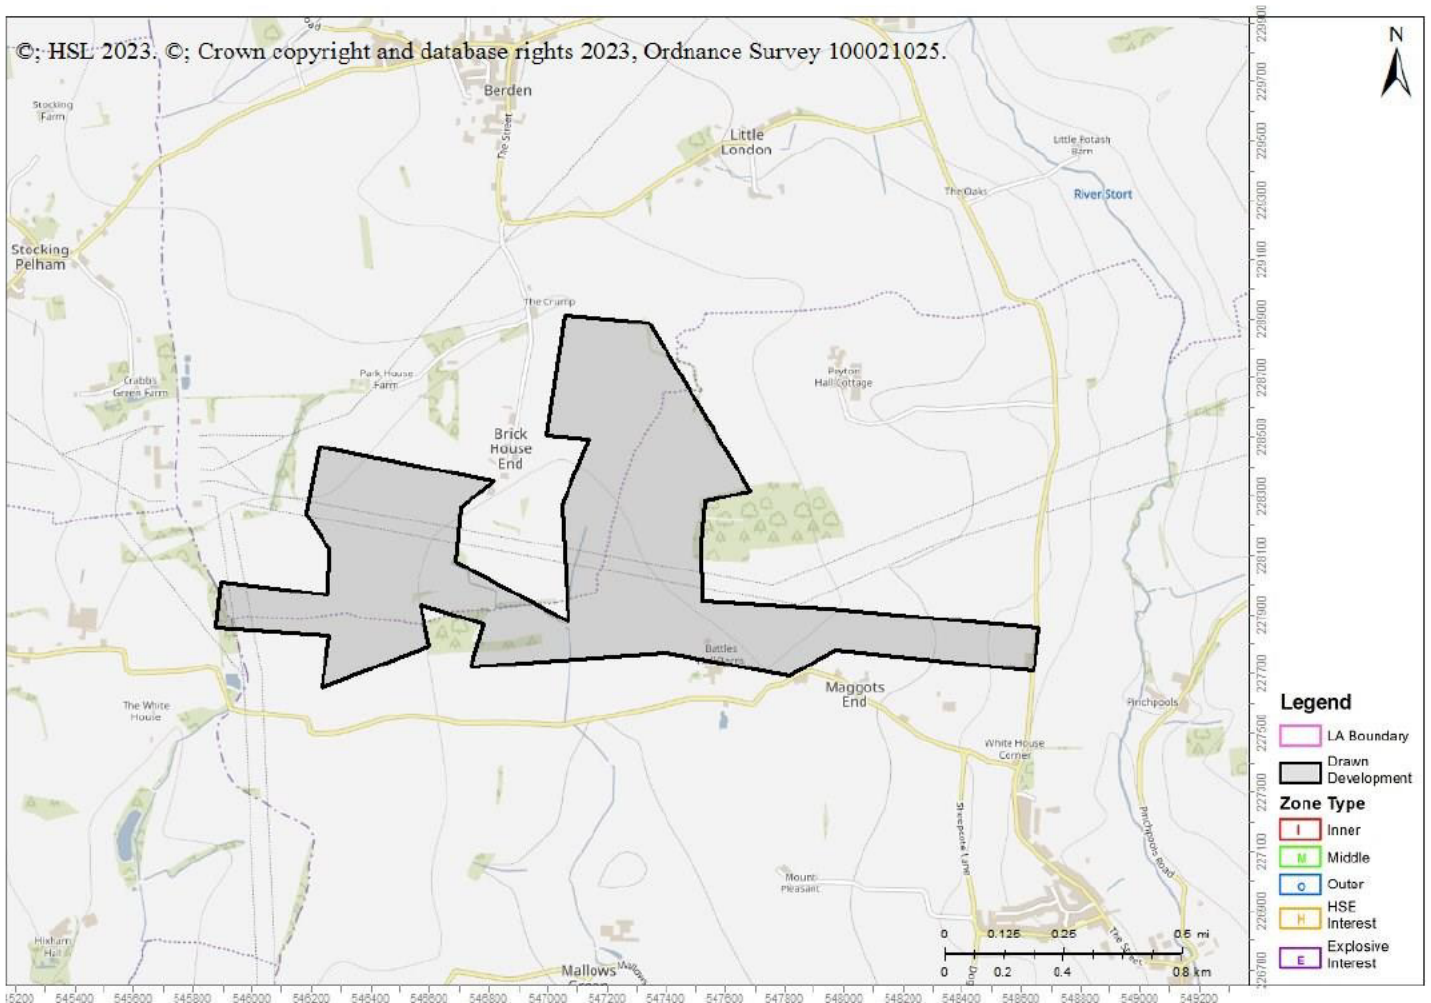

The proposed development site which you have identified does not currently lie within the consultation distance (CD) of a major hazard site or major accident hazard pipeline; therefore at present HSE does not need to be consulted on any developments on this site. However, should there be a delay submitting a planning application for the proposed development on this site, you may wish to approach HSE again to ensure that there have been no changes to CDs in this area in the intervening period.

This advice report has been generated using information supplied by Leanne Palmer at The Planning Inspectorate on 17 February 2023.