






ROLTON GROUP
ENGINEERING THE FUTURE™

FLOOD RISK ASSESSMENT & DRAINAGE STRATEGY

FOR

THAXTED ROAD LAND SOUTH OF SAFFRON WALDEN

PROJECT NUMBER:	22-0222
DOCUMENT REFERENCE:	220222-RGL-ZZ-XX-RP-C-0002
REVISION:	S2-P06

	NAME	POSITION	SIGNATURE
AUTHOR	Bryan Hoadley MEng GMICE	Senior Engineer	
CHECKER	Steven Truong MEng CEng	Associate Director	
VERIFIER	Steven Truong MEng CEng	Associate Director	

REVISION

REVISION	ISSUE DATE	REASON FOR ISSUE
S2-P01	16.11.2022	Information
S2-P02	25.11.2022	Re-issued as Drawing in Appendix B has been updated
S2-P03	25.11.2022	Small update to foul water section
S2-P04	13.01.2023	Updated to suit LLFA Comments
S2-P05	17.02.2023	Updated to suit revised site layout
S2-P06	28.02.2023	Updated Drawings to Appendix B

ISSUING OFFICE

HIGHAM FERRERS OFFICE

Rolton Group Ltd
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

PETERBOROUGH OFFICE

Rolton Group Ltd
26 Commerce Road
Lynch Wood
Peterborough
PE2 6LR

BIRMINGHAM OFFICE

Rolton Group Ltd
The David Rolton Building
Twelve Quartz Point
Stonebridge Road
Birmingham
B46 3JL

01933 410909 |  | enquiries@rolton.com

NOTE: IMPORTANT INFORMATION ABOUT YOUR RIGHTS TO READ AND USE THE CONTENT OF THIS DOCUMENT ARE CONTAINED AT THE BACK OF THIS DOCUMENT

CONTENTS

PREFACE 1

1.0 INTRODUCTION 2

2.0 SITE SUMMARY 2

3.0 SITE LEVELS – EXISTING AND PROPOSED 2

 3.1 EXISTING LEVELS2

 3.2 PROPOSED LEVELS2

4.0 EXISTING SITE DRAINAGE SYSTEM 3

5.0 HYDRAULIC INFLUENCES..... 3

 5.1 FIELD DRAINAGE DITCHES3

 5.2 GROUND CONDITIONS3

6.0 IDENTIFICATION OF POTENTIAL FLOODING SOURCES 4

 6.1 WATERCOURSES4

 6.2 RAINFALL4

 6.3 SEA4

 6.4 GROUND WATER.....5

 6.5 SURFACE WATER RUN-OFF/SEWERS.....5

 6.6 RESERVOIRS.....6

 6.7 ARTIFICIAL SOURCES.....6

7.0 EXISTING FLOOD RISKS..... 7

8.0 ANALYSIS OF PROPOSED DEVELOPMENT AND SURFACE WATER DRAINAGE SYSTEM..... 7

 8.1 PROPOSED DEVELOPMENT7

 8.2 SURFACE WATER DRAINAGE7

 8.3 PRELIMINARY DRAINAGE/SUDS DESIGN8

9.0 ASSESSMENT, PROBABILITY AND RATE OF POTENTIAL FLOODING11

10.0 FOUL WATER DRIANAGE SYSTEM.....12

11.0 CONCLUSION12

12.0 REFERENCES13

APPENDIX A - LOCATION PLAN.....

APPENDIX B – PROPOSED DEVELOPMENT PLAN AND DRAINAGE LAYOUT

APPENDIX C - TOPOGRAPHICAL SURVEY

APPENDIX D – INFILTRATION TESTING REPORT

APPENDIX E – ENVIRONMENT AGENCY’S PRODUCT 4 INFORMATION

APPENDIX F - SITE WIDE SURFACE WATER DRAINAGE CALCULATIONS.....

APPENDIX G - MAINTENANCE SCHEDULE

APPENDIX H - LLFA CORRESPONDENCE REGARDING SW FLOODING FLOW ROUTE

IMPORTANT INFORMATION

PREFACE

- a) The Flood Risk Assessment and Drainage Strategy and / or opinion has been prepared for the specific purpose stated therein.
- b) The Flood Risk Assessment Drainage Strategy has been prepared for the exclusive use by:-

Kier Ventures Ltd
- c) This document is issued only to the persons stated above and on the understanding that this Practice is not held responsible for the actions of others who obtain any unauthorised disclosure of its contents, or place reliance on any part of its findings, facts or opinions, be they specifically stated or implied.
- d) This study is a risk based assessment of potential flooding issues at the study site and the information presented and the conclusions drawn are for guidance only and provide no guarantee against flooding.

1.0 INTRODUCTION

This Flood Risk Assessment has been prepared on behalf of Kier Ventures Ltd in support of their outline planning Application for a residential development for up to 170 dwellings on the site Land West of Thaxted Road, Saffron Walden.

This report has been written and formatted generally in accordance with the requirements outlined in National Planning Policy Framework (NPPF) and its technical guidance.

This report has been updated to suit updates made to the site layout as a result of discussions with the Highways Authority and subsequent correspondence with the LLFA.

2.0 SITE SUMMARY

The proposed site is situated to the west of Thaxted Road, Saffron Walden and is centred approximately on National Grid Reference 554750, 237320.

The planning application site boundary and the extent of development area is approximately 8.35 hectares with existing ground that slopes in a north easterly direction.

The site is bounded by existing hedge lines and field boundaries to most sides. The ground conditions have been assessed from an initial desk study to contain undifferentiated Lewes Nodular Chalk Formation and Seaford Chalk Formation of the White Chalk Subgroup overlain by Head to the north-east and Lowestoft Formation toward the south-eastern end. Tributaries of the Slade system pass through the site although there are no other water bodies within the catchment and no historic ground water flooding has been identified.

Location plans of the site are included in **Appendix A**.

3.0 SITE LEVELS – EXISTING AND PROPOSED

3.1 EXISTING LEVELS

The general topography of the site, prior to development, consists of ground levels across the extent of the site varying quite sharply and also feature more local undulations, falling from approximately 103mAOD in the south west to 77mAOD in the north east.

Drawing 220222-RGL-ZZ-XX-DR-C-120-0001 Proposed Drainage Strategy Layout in **Appendix B** indicates the existing levels of the proposed site in the background of the proposed layout. A copy of the topographical survey drawings is included in **Appendix C** of this report.

3.2 PROPOSED LEVELS

The proposed development will mirror the existing site topography with the general fall across the site being maintained.

All levels are based on the Ordnance Datum, provided by Kier Group dated April 2022.

4.0 EXISTING SITE DRAINAGE SYSTEM

The overall site has no formal drainage system and therefore surface water run-off flows off of the site at the Greenfield run-off rate via overland flow routes to the existing field boundary and ditches located to the north east of the site. A system of field ditches passes through the northern section of the site and ultimately connect into The Slade System main River, which is located beyond the northern boundary to the north of the Lord Butler Fitness and Leisure Centre.

5.0 HYDRAULIC INFLUENCES

The key features of the existing site drainage infrastructure, which influence the hydrology of the site, are detailed below.

5.1 FIELD DRAINAGE DITCHES

From the topographic survey and site walkover the location of field drainage ditches on the site have been determined. These appear to be a combination of naturally occurring and purposefully constructed field drainage ditches, which are fed by flows from the site, as well as offsite flows from the adjacent fields to the south west of the site. As part of the proposed scheme, the reinstated / maintained ditch network will require some culverts for reasons of access.

It is not anticipated that the proposed levels adjacent to these ditches will be adjusted significantly, and as the proposed site levels will be similar to the existing site levels, any out of bank flooding would be directed towards the existing flow route which will be maintained to match the current situation. Levels to the plots will be designed to ensure that flows will be directed towards the drainage ditches and in the event of overtopping, surface water will not flow towards the buildings.

5.2 GROUND CONDITIONS

The published British Geological Survey (BGS) map for the area (Sheet 222 'Great Dunmow') and the BGS GeoIndex website show the site to be underlain by superficial deposits of the Lowestoft Formation (diamicton) at the far western extent of the site, and Head at the far eastern extent of the site. Superficial deposits are not shown to be present across the central portion of the site. The underlying solid geology is indicated to comprise of the undifferentiated Lewes Nodular Chalk Formation and Seaford Chalk Formation of the White Chalk Subgroup.

Soakaway testing has been carried out by Rolton Group (RGL) in accordance with BRE Digest 365. The locations of investigative positions were selected to target proposed locations of attenuation ponds, under drained swales, dwelling soakaway locations and available access. A total of ten pits were excavated, ref. SA101A, SA101B, SA102 to SA109, between the 10th and 12th of October 2022. The pits were formed using a backhoe excavator to depths between 0.97mbgl and 3.45mbgl. The excavations were recorded by a Rolton Group engineer and shown in document 220222-RGL-ZZ-XX-CO-Z-0004.

Soil permeability tests were completed in all the pits in accordance with BRE Digest DG 365 2016: Soakaway design. The soakaway tests included each pit being partially filled with water, with the subsequent drop in water level measured at regular intervals. Depending on the rate of infiltration, where possible the test was repeated twice more. The report, 220222-RGL-ZZ-XX-CO-Z-0004, can be found in **Appendix D**.

For the preliminary drainage design seen in **Appendix B** and calculations included in **Appendix F**, an infiltration rate of 1×10^{-5} m/s has been used.

6.0 IDENTIFICATION OF POTENTIAL FLOODING SOURCES

6.1 WATERCOURSES

The flood plain associated with the Slade System identifies that the site is located within flood zone 1, **Appendix E**. However, the tributaries upstream of the main River are not mapped as part of the main River modelling and therefore do not contribute to the flood zones. The surface water flooding map identifies that there is a risk of surface water flooding along the routes of the tributaries, particularly to the northern section of the site.

The tributary channels within the site are largely overgrown and poorly maintained and are therefore generating a larger surface water flood area. The entrance to the site off Thaxted Road will cross the surface water flow route, therefore this will need to be considered in order to ensure the flow route is maintained following the development of the site.

As part of this outline planning application, pre-application advice was sort from the Lead Local Flood Authority, where they said that the proposed development is not located within a Critical Drainage Area. As such it is not proposed to model the tributary channels, however this could be carried out as part of a reserved matters application if required.

6.2 RAINFALL

As the site is currently agricultural fields with the majority of rainfall being absorbed into the ground, the proposed development will keep this status quo. Infiltration rates calculated as part of the soakaway testing investigation show areas that are suitable for infiltration, as such surface water will be directed to these areas, being cleaned along the way by utilising under drained swales, permeable paving and the infiltration ponds themselves. Levels across the site will be designed to ensure that surface water flows, as a result of rainfall, will flow away from the buildings and towards permeable paving, under drained swales and open areas to provide active drainage.

6.3 SEA

As the site is a significant distance from the sea and at a level significantly above sea level, the potential of flooding from the sea to affect the site is very low.

6.4 GROUND WATER

During the infiltration tests in October, no ground water was observed. The infiltration pits were excavated to a depth between 0.97mbgl and 3.45mbgl.

According to BGS mapping accessed via the DEFRA online Magic Map application, the site ground conditions have EA aquifer classifications of Principal aquifer for bedrock and Secondary (Undifferentiated) aquifer for Superficial Drift. However, although the site is within a groundwater source protection zone 3, this is associated with the active groundwater abstraction at a significant distance, approximately 6.0km from the site near Puckeridge.

The site is indicated to have the High and Medium-High for Groundwater vulnerability as indicated on the Magic map extract below with a Soluble Rock Risk.

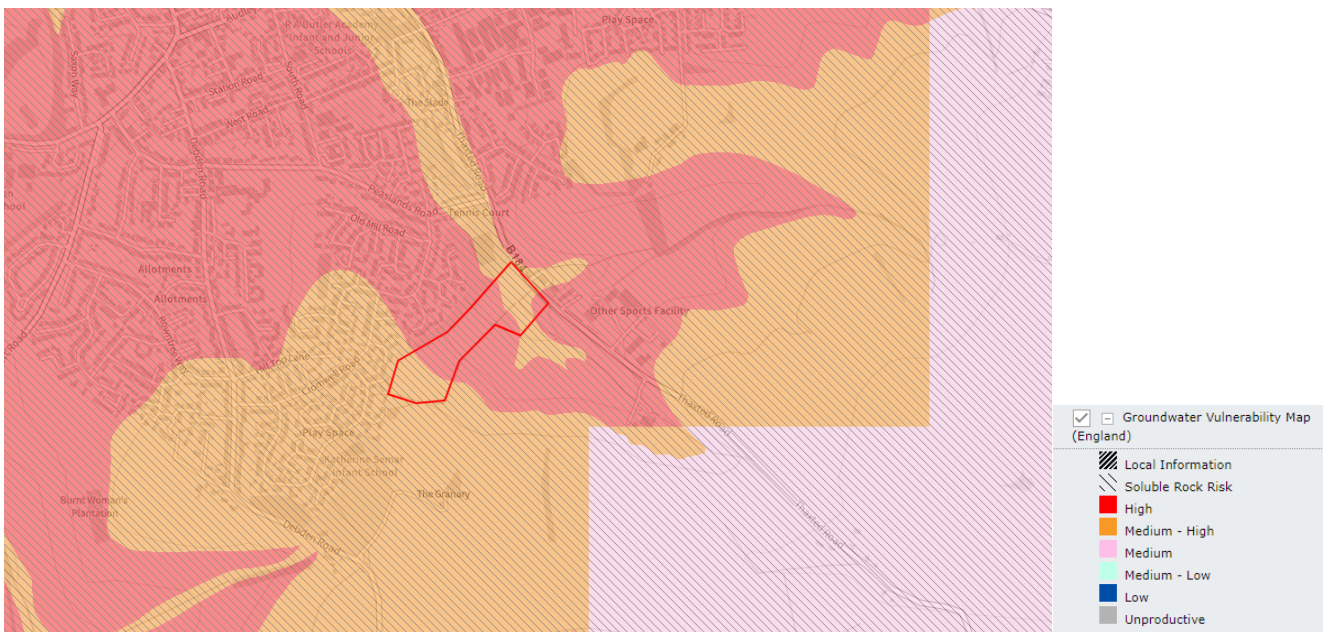


Figure 1 - Groundwater Vulnerability Map

6.5 SURFACE WATER RUN-OFF/SEWERS

The surface water run-off from the site will be directed towards and drained by areas of permeable paving, under drained swales, attenuation ponds and an infiltration basin.

The current surface water flood risk maps produced by the EA indicates that a small area proposed for residential development falls within an area of surface water flood risk. The EA surface water maps are derived from a rainfall event falling onto the land (not taking account any infiltration/permeability of the soils), and accumulating in low spots, hence why drainage channels/water courses are shown in dark blue and being at high risk. The surface water flood risk map (an extract covering the site is included below) shows the current flow route surface water takes. Reviewing the topographical survey of the site, surface water passes onto the site and flows to the northernmost corner where it would pond in a low area. Once this area has sufficiently filled, flood water would pass onto Thaxted Road to the north via the lowest point along the boundary, following which it will flow to the north along Thaxted road as indicated on the flood risk mapping.

The area in the northern half of the site will drain via infiltration through permeable paving, located in private drives and shared driveways. Surface water from the roofs of the proposed apartments and the run off from other impermeable surfaces will all drain into the proposed permeable paving, which will have an approximate subbase depth of 400mm, catering for the 100-year rainfall event including climate change and an allowance for urban creep, and making sure the surface water in this area is managed in a sustainable way

A copy of the flood risk map for surface water flooding can be found below. The preliminary drainage layout (**Appendix B**), also has the EA surface water map extent shown on it.



Figure 2 - Surface Water Flood Risk Map

In the event of surface water flooding, as indicated in the above map, flood water will be routed through the development via designated flow route areas, conveyance swales and storage areas to the northernmost area of the site to where flood water currently flows and subsequently leaves the site. Following the completion of the development, surface water flooding will flow onto the access road before discharging onto Thaxted Road as per the existing arrangement. This has been discussed with the LLFA and has been agreed, the correspondence regarding this can be found in **Appendix H**.

Where the conveyance routes/swales cross proposed roads and highways; where appropriate culverts will be designed and installed to ensure surface water conveyance without disrupting use of the roads. Refer to drawing 220222-RGL-ZZ-XX-DR-D-120-0001 found in **Appendix B** of this report for areas designated as conveyance routes and arrows indicating the direction of overland flow routes.

6.6 RESERVOIRS

There are no reservoirs in the vicinity of the site, therefore, this risk is considered to be very low.

6.7 ARTIFICIAL SOURCES

There are no other known artificial sources of potential flooding adjacent to the site.

7.0 EXISTING FLOOD RISKS

Included in **Appendix E** are the Environment Agency's flood maps covering the site, which identifies the proposed area for residential development as being outside of any area at risk of flooding from rivers or the sea, or from reservoirs.

As stated in section 6.4 of this report, it is expected that potential of flooding from groundwater is considered to be very low due to no ground water being observed on site during the infiltration testing.

8.0 ANALYSIS OF PROPOSED DEVELOPMENT AND SURFACE WATER DRAINAGE SYSTEM

8.1 PROPOSED DEVELOPMENT

The proposed development is for a residential development for up to 170 dwellings, landscaping, including open spaces, SuDS features, parking and access.

8.2 SURFACE WATER DRAINAGE

All developments should seek to dispose of surface water via infiltration before discharge to watercourses or local sewers. The site drainage strategy to dispose surface water has considered this concept and all surface water runoff will be discharged by direct infiltration. As indicated in section 5.2, the ground conditions are favourable for surface water infiltration, 10 No. infiltration tests were carried out by RGL in 2022, refer to **Appendix D** for exploratory hole layout and infiltration testing results.

It is proposed that in the southern part of the site, surface water from residential plots, driveways and the access road will be conveyed to the attenuation basins, prior to outfalling into the infiltration basin located in the northern area of the site.

In the northern portion of the site the residential plots will have individual soakaways, where ground conditions allow. Shared surfaces as well as the apartment building roofs will drain into areas of permeable paving which will be able to drain via infiltration. The main access highway will drain traditionally via gullies and will be conveyed towards the proposed swales and infiltration basin to then be discharged into the ground.

Utilising permeable paving, both Type A and B, surface water will be cleaned prior to discharge to the ground and will also allow for some attenuation within the subbase. It is also proposed that during the detailed design, raingardens and tree pits are considered, to increase the benefits to the site.

In line with the updated 2020 Essex County Council SuDS Design Guide, rainwater re-use should be considered as part of any development. Discussions have considered using the attenuated surface water held in the ponds/basin for irrigation of the landscaped areas, which will likely require the use of pumping, this can be explored further in the detailed design stages. It is proposed that water butts be utilised for all residential units as part of the detailed design stage.

8.3 PRELIMINARY DRAINAGE/SUDS DESIGN

The preliminary drainage design below is split into quantity (flow and volume) and quality in accordance with the latest CIRIA, EA and ECC guidance. SuDS are an approach to managing rainwater and surface water that replicates natural drainage, the key objective being to manage flow rate and volume of runoff to reduce the risk of flooding.

Due to the high level of this outline design it has not been possible to show exact locations of the under drained swales. It is the intention of the proposed development to have under drained swales where possible and these will form part of the detailed design once the layout is fixed. We didn't want to propose under drained swales in locations where they then may not be able to be sited due to any changes in the layout and / or levels.

8.3.1 DESIGN TO LIMIT FLOW AND VOLUME

The site has been split into four catchments;

- Eastern Catchment – Individual Soakaways and permeable paving (Type A),
- Central Catchment - Individual Soakaways and permeable paving (Type A),
- Western Catchment - Individual Soakaways and permeable paving (Type A),
- Southern Catchment – The storm water will be conveyed to areas of permeable paving (Type B, allowing for limited infiltration) and under drained swales where possible, although a piped network will likely be required as well, then onto the attenuation ponds before finally getting to the infiltration basin.

In addition to the above catchments, the area of proposed highway in the northern extent of the site will be drain via infiltration through conveyance swales or a proposed infiltration basin located within the area of public open space. The area designated for the discharge of the highway drainage will be sized to accommodate surface water run off resulting from the 1 in 100 year rainfall event with an allowance for climate change.

The individual house soakaways have been designed based on a 60sqm roof area with an infiltration rate based on the value ($1 \times 10^{-5} \text{m/s}$), requiring a cellular soakaway size of 2.5sqm and 1m depth. Refer to **Appendix F** for calculations. These soakaways have been designed and modelled so that the half drain time for each soakaway is less than 24 hours.

The infiltration basin serving the southern catchment has been designed to be 1 meter deep, with crates under that to provide extra storage. The crates will be 2m deep, at the closest trial pit SA106 no ground water was encountered.

All of the private property driveways are proposed to be constructed using permeable paving or designed to fall towards shared permeable driveways, to allow any surface water run off to be drained. Rainwater pipes from the plots themselves, will be drained into the porous subbase of the permeable paving where possible.

The surface water from the wider development drains to the north east area of the site where infiltration is at its best. In times of heavy rainfall events, surface water will back up within the drainage system and be attenuated in the areas of permeable paving, under drained swales and the attenuation and infiltration ponds.

The overall drainage strategy provides a solution that incorporates both above and below ground drainage system for conveying storm water. The storage requirements for the worst-case duration storm event (1 in 100) identifies a solution for attenuation ponds with a combined storage volume of approximately 3000m³, maximum depth of 1m and 1 in 3 side slopes with a minimum freeboard of 300mm.

The final detailed design requirement for the scheme will need to provide storage through a mixture of attenuation ponds, under drained swales, permeable paving, and infiltration basins to ensure the drainage can be adopted for future maintenance purposes. Storage will need to accommodate the worst case 1 in 100-year rainfall event including 40% climate change and a 10% allowance for urban creep. As per the ECC guidance, the roof areas have all had a 10% increase to account for this and drainage network modelling has included an additional flow of 10%.

Calculations for the infiltration basin network indicate that a half drain time cannot be calculated. Due to this, the network will also need to accommodate a 1 in 10-year storm event, 24hrs following the design event. Proposed infiltration systems will need to ensure they half empty within 24 hours in preparation for any back to back storm events.

The preliminary drainage layout for the site can be found in **Appendix B**.

8.3.2 DESIGN TO ENSURE WATER QUALITY

The pollution hazard indices for different land use classifications, as identified in table 26.2 of the SuDS manual, are as follows:-

LAND USE	POLLUTION HAZARD LEVEL	TOTAL SUSPENDED SOLIDS (TSS)	METALS	HYDROCARBONS
Residential Roofs	Very Low	0.2	0.2	0.05
Commercial yard and delivery areas, non-residential car parking with frequent change (e.g. hospitals, retail), all roads except low traffic roads and trunk roads/motorways	Medium	0.7	0.6	0.7

Table 1 – Pollution Hazard

Therefore, based on the use of permeable paving, under drained swales and attenuation features including the infiltration basin, the indicative SuDS mitigation indices as identified in table 26.4 of the SuDS manual, for discharges to groundwater (together with totals) are as follows:-

SUDS FEATURE	TSS	METALS	HYDROCARBONS
Permeable paving	0.7	0.6	0.7
Under Drained Swales	N/A	N/A	N/A
Detention Basin	0.5	0.5	0.6
Infiltration Basin	0.4	0.3	0.3
TOTAL (Min.) dived by 3	1.3	1.2	1.3

Table 2 – SuDS

For areas of proposed highway where additional SuDS features are not feasible prior to discharge into the infiltration basin, such as the northern most length of highway adjacent to the proposed basin, proprietary source control devices will be required to provide the necessary levels of treatment. This has been indicated on the preliminary drainage layout in **Appendix B** and will be subject to detailed design.

8.3.3 CLIMATE CHANGE AND DILAPIDATION

National Planning Policy Framework (which sets out the government requirements for the management and reduction of flood risk in the land use planning process) requires the investigation of climate change on the proposed development. The online climate change allowances indicate that up to 2115 the climate change allowance should be 25-40%.

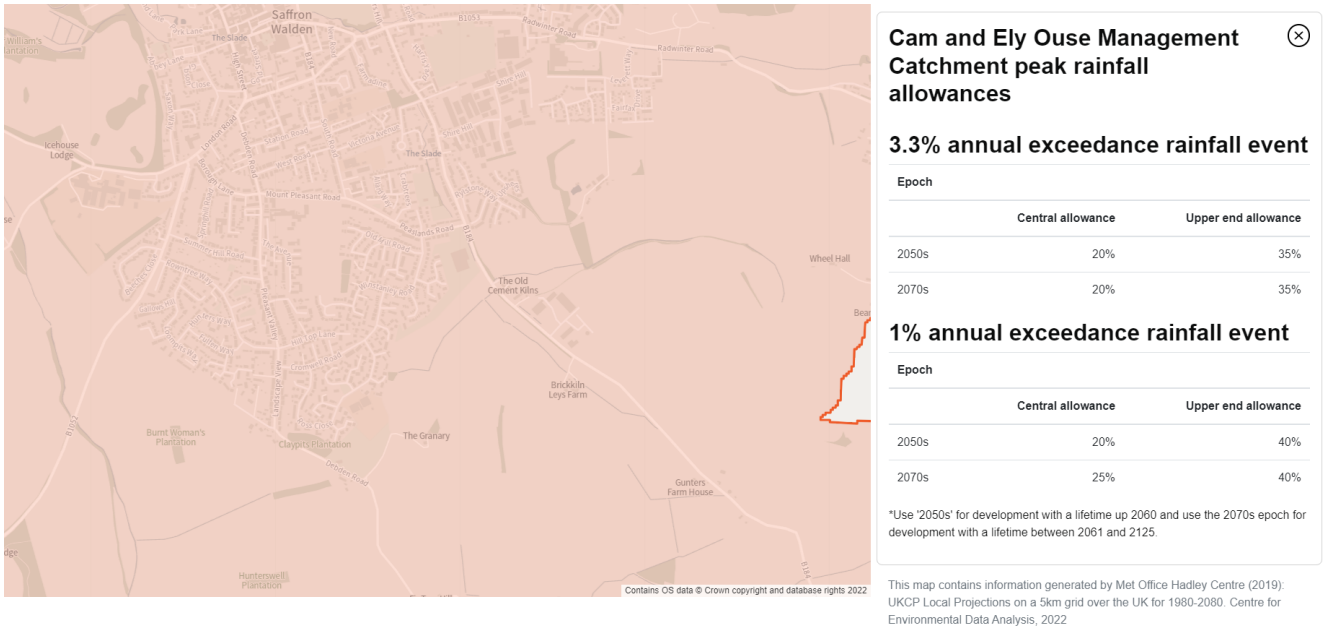


Figure 3 - Climate Change Allowance

The full 40% climate change allowance has been included in the proposed storage design and this should be retained through the detailed design.

8.3.4 MAINTENANCE OF DRAINAGE FEATURES

The proposed external drainage system will consist of a piped drainage network, soakaways, under drained swales, storage tanks (if required), flow control chambers, permeable paving, attenuation basins and infiltration basins. Subject to detailed design, it is recommended that the piped storage system including flow control should be adopted by Anglian Water under a S104 agreement and the estate roads should be adopted by ECC under a S38 agreement. The shared private drainage system, private storage and attenuation areas will be maintained by a management company and the individual private drainage and permeable paving would be maintained by the property owners.

The recommended maintenance regime for the main surface water assets are set out in **Appendix G**.

9.0 ASSESSMENT, PROBABILITY AND RATE OF POTENTIAL FLOODING

As the development is a residential use, it is deemed a “more vulnerable” category to table 2 of the NPPF. Due to its location within flood zone 1 the development is appropriate in accordance with table 3 of the NPPF as indicated below:-

Table 3: Flood risk vulnerability and flood zone ‘compatibility’

Paragraph: 067 Reference ID: 7-067-20140306

Flood Zones	Flood Risk Vulnerability Classification				
	Essential infrastructure	Highly vulnerable	More vulnerable	Less vulnerable	Water compatible
Zone 1	✓	✓	✓	✓	✓
Zone 2	✓	Exception Test required	✓	✓	✓
Zone 3a †	Exception Test required †	x	Exception Test required	✓	✓
Zone 3b *	Exception Test required *	x	x	x	✓*

Key:

- ✓ Development is appropriate
- x Development should not be permitted.

As the site is located within flood zone 1, the sequential test is not required as the site is sequentially preferable within flood zone 1. Also, in accordance with table 2 the exception test is not applicable.

10.0 FOUL WATER DRIANAGE SYSTEM

The proposed below ground foul drainage system will be designed in accordance with the Building Regulations approved Document H and the Design and Construction Guide (2020).

Foul water, or effluent, flows from the site will be managed in a new sewer system which will connect to the existing public foul sewer network, which is understood to have been extended to serve the recent Bellway development to the east of the site and is also understood to have been designed to serve the development at Knights Park, **Appendix B**.

Foul drainage should be disposed of by connecting to the extended sewer in agreement with the relevant asset owner.

During the detailed design stage for the development, this existing sewer will be investigated and the invert levels surveyed. If the invert level of the existing sewer would not allow for a gravity connection, a pump station designed to adoptable standards would need to be considered.

11.0 CONCLUSION

In conclusion, this FRA and Drainage Strategy has been undertaken in accordance with National Planning Policy in relation to development and Flood Risk in respect of the proposed residential development at land west of Thaxted Road, Saffron Walden.


The ground conditions show infiltration will work on site. SuDS will be used throughout the proposed development to slow, clean and attenuate surface water, and surface water flood risk will be managed on site and not increase risk to the development or third parties.

12.0 REFERENCES

- National Planning Policy Framework (NPPF) dated July 2021 by Ministry of Housing, Communities and Local Government.
- Online Planning Practice Guidance to the National Planning Policy Framework dated June 2021 by Department for Communities and Local Government.
- FRA Guidance Note 1 by the EA
- EA/DEFRA document W5-074/A/TR/1 revision E 'preliminary rainfall runoff management for new developments' dated January 2012
- HR Wallingford UK SuDS Greenfield Run Off Rate Estimation tool
- Ciria C753 SuDS Manual 2015
- Department for Environment Food and Rural Affairs Climate Change Allowances
- Online Gov.uk Long Term Flood Risk checking tool

APPENDIX A - LOCATION PLAN

APPENDIX B – PROPOSED DEVELOPMENT PLAN AND DRAINAGE LAYOUT

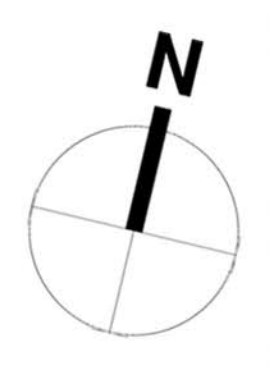

Client: Kier Group
 Project: Land West of Thaxted Road, Saffron Walden

Drawing Title: Illustrative Masterplan
 Scale: 1:500 @ A0




Project No: 3118 C
 Client: Kier Group
 Drawing No: 1005 PL D

Notes

- This drawing is to be read in conjunction with all the relevant contract documentation.
- This drawing and its contents shall not be reproduced or reused in whole or in part without Rolton Group's express permission in writing and Rolton Group accepts no liability for any damages, costs, losses, claims, proceedings or expenses arising from such use.
- All dimensions are in mm unless otherwise stated. Dimensions to be checked on site prior to construction and any discrepancies reported to the Rolton Group Engineer.
- Only drawings that indicate CONSTRUCTION as the issue purpose should be used for construction.
- Any CONSTRUCTION status issue does not provide or imply approval or validation of any third party information.
- Revision clouds are shown for assistance only, the whole drawing is to be checked for new/amended information.
- Not all hatches and linetypes shown on legends and keys may be present on this drawing. Drawings to be printed in colour by default, typical material colours are for clarity only.
- Contours shown are existing levels shown for information and clarity regarding surface water flows. Site levels design is to be carried out at detailed design stage.



NOTE: Drainage shown is indicative only and subject to detailed design.

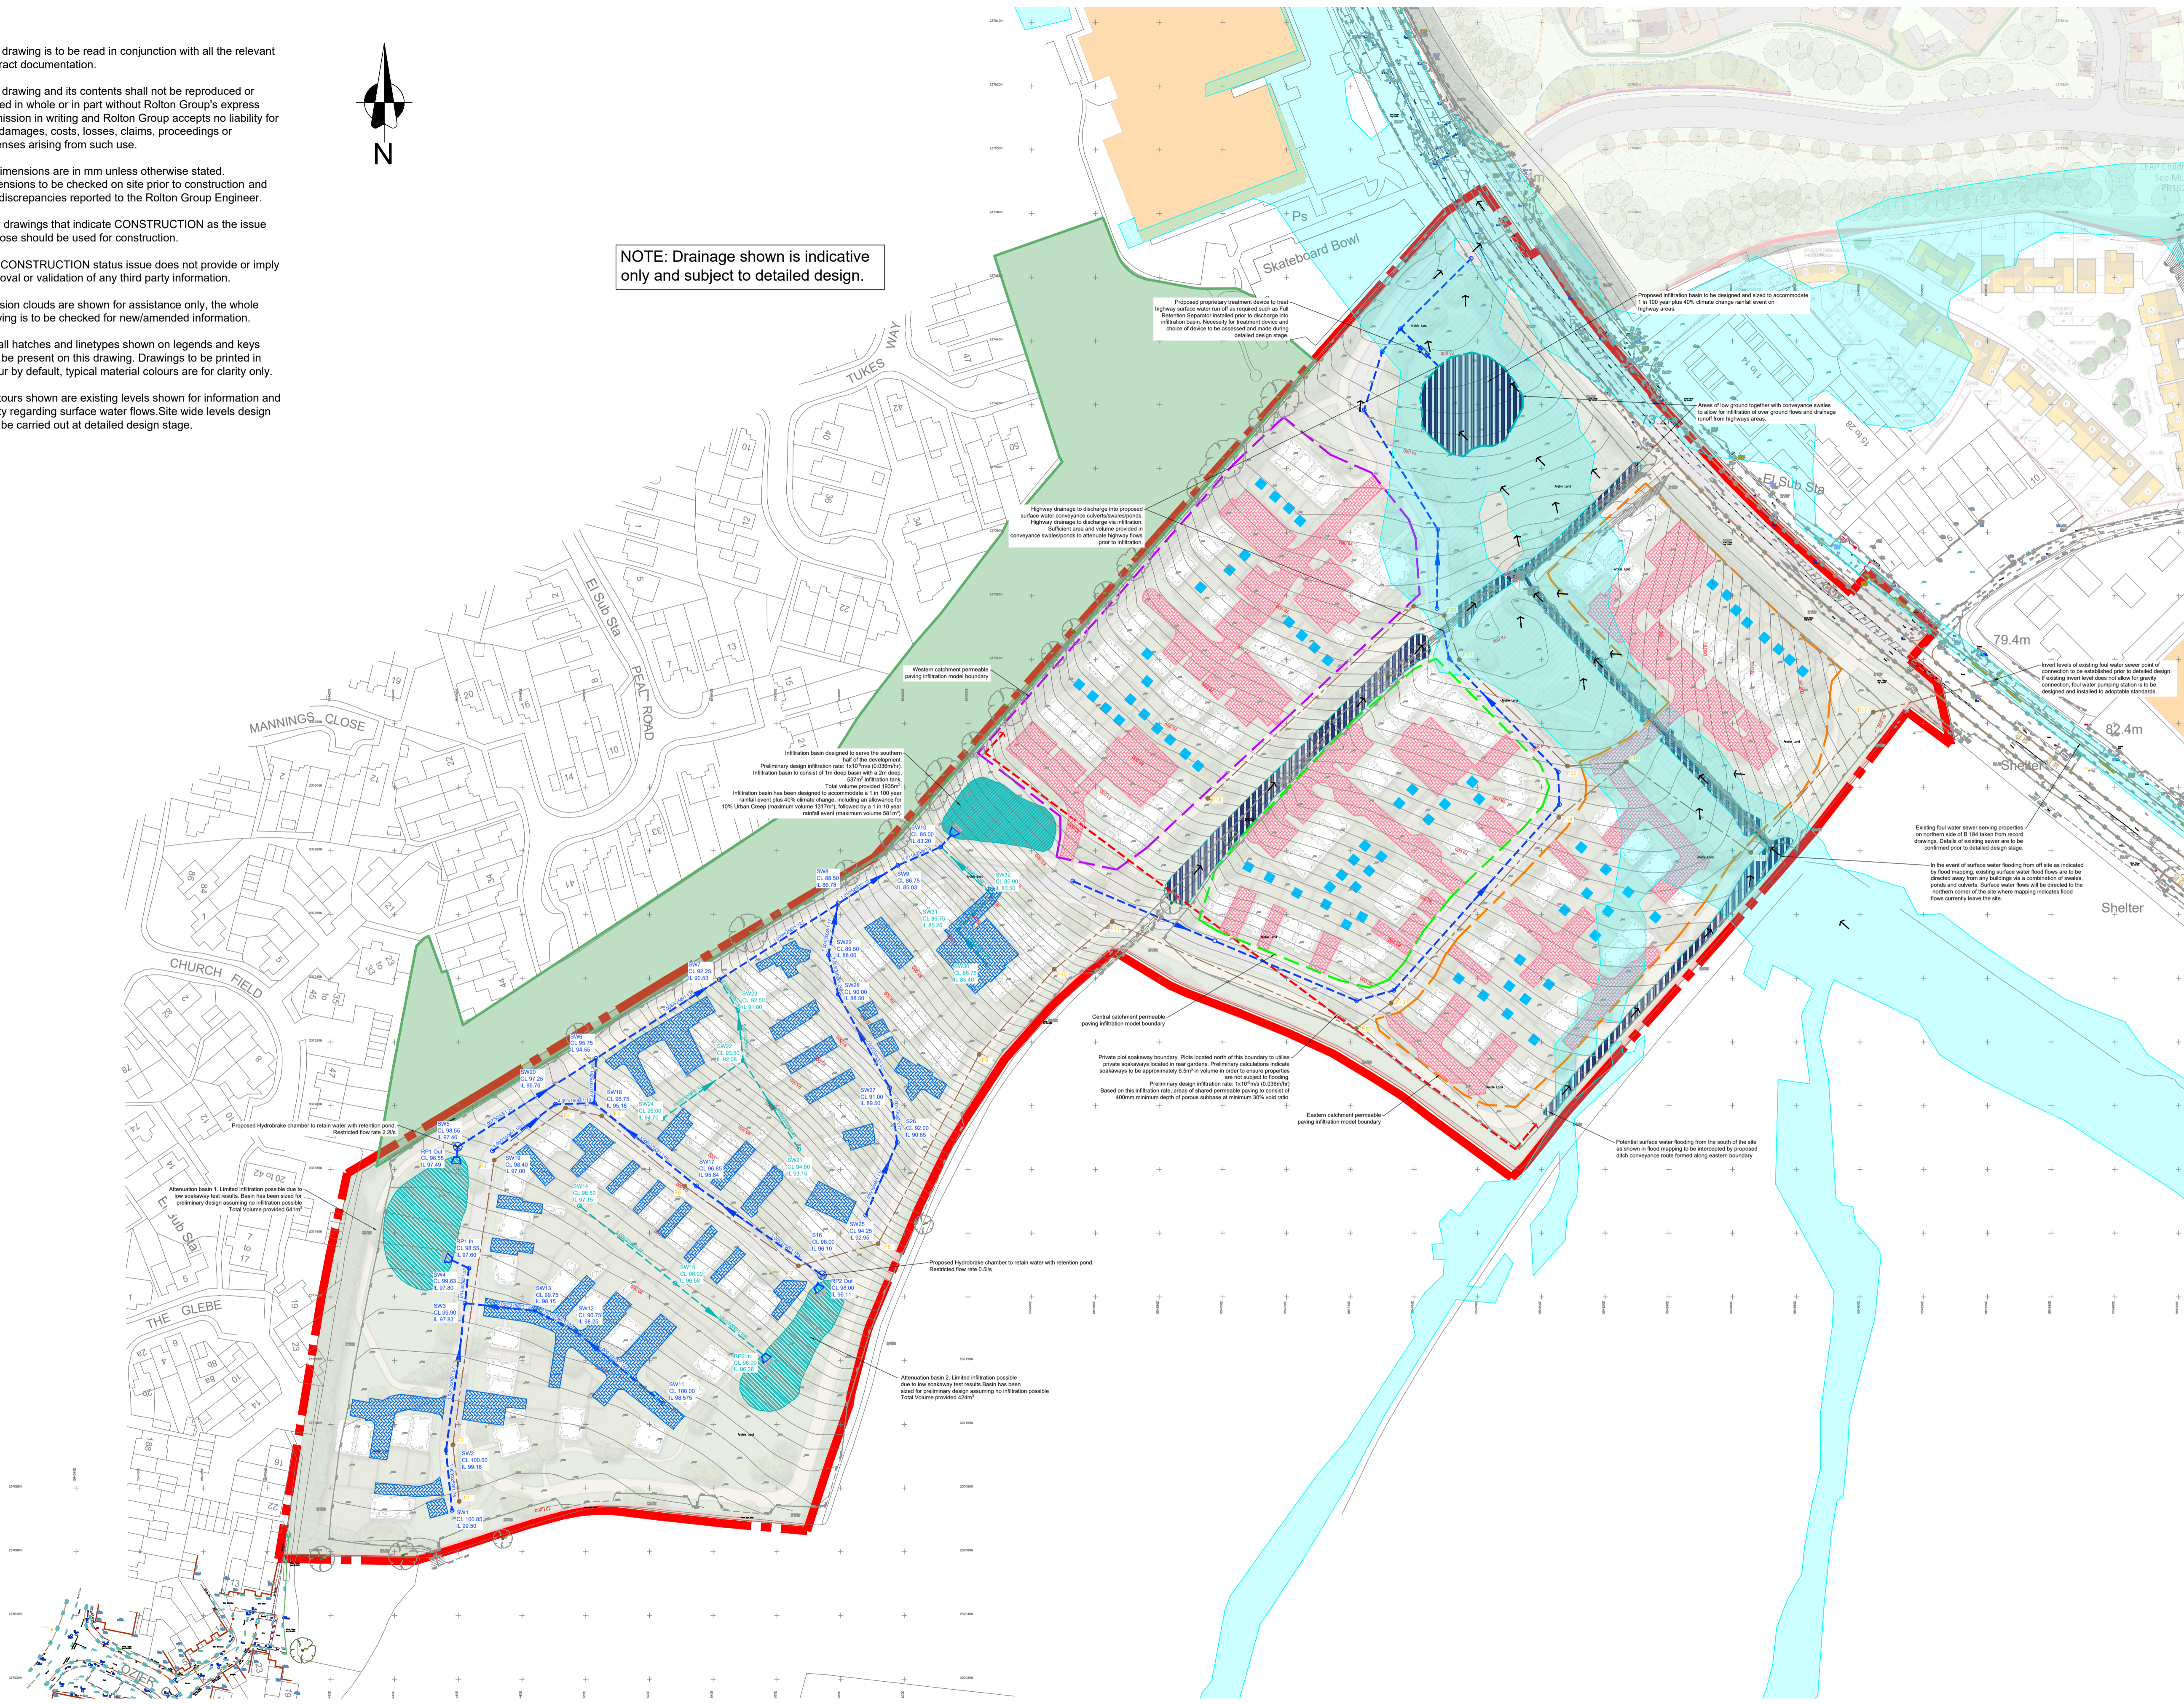

DO NOT SCALE Copyright Rolton Group Ltd 2023
This drawing shall remain the copyright of Rolton Group Ltd.

- Standard construction hazards that a competent contractor would be aware of have not been identified on this drawing. Risks that may not be immediately apparent are listed below.

Status	Date	Description	Dwn Eng	Chkd Veri
S2-P01	16.11.22	Information issue	BH	AJL AJL
S2-P02	25.11.22	Site plan updated	BH	AJL AJL
S2-P03	13.01.23	Drawing amended for clarity	BH	AC AC
S2-P04	13.01.23	Drawing amended to suit updates to site layout	BH	ST ST
S2-P05	27.02.22	Site plan updated	BH	ST ST

PROPOSED SEWER TYPE KEY

- Proposed Storm Water Gravity Sewer
- Proposed Foul Water Gravity Sewer
- Existing Storm Water Gravity Sewer
- Existing Foul Water Gravity Sewer
- Private Surface Water Sewer
- Private Foul Water Sewer
- Adoptable Road Gully
- Private Plot Soakaway Tank
- Type A Permeable Paving
- Type B Permeable Paving
- Retention Pond - No Infiltration
- Retention Pond - Full Infiltration
- Existing Surface Water Flood Risk Extent
- Surface Water Flooding Conveyance and Storage Areas
- Surface Water Flooding and Run Off Flow Route Direction
- Headwall (shwn NTS)

Drainage Model File Reference

- Sewer Diameter
- Sewer Gradient

PROPOSED MANHOLE/INSPECTION CHAMBER TYPE KEY

- Adoptable
- Private
- Storm Water PPC
- Foul Water PPC
- Foul Water PCC MH
- Storm Water PCC MH/CP
- Surface Water Hydrobrake Chamber
- Surface Water PCC MH with Backdrop Connection
- Foul Water PPC MH with Backdrop Connection



ROLTON GROUP
ENGINEERING THE FUTURE™
www.rolton.com 01933 410909

Project:
Land South of Saffron Walden, off Thaxted Road

Drawing Title:
Preliminary Drainage Layout

RGL Project Ref: 22-0222 Scale@A1: 1:1000 Scale@A3: 1:2000
Specification(s):

Drawing Number:
220222-RGL-ZZ-XX-DR-D-120-0001
Project-Originator-Zone-Level-Type-Role-Classification-Number

Issue Purpose:
INFORMATION

Status:
S2-P05
Submittal-Revision

APPENDIX C - TOPOGRAPHICAL SURVEY

237080N

237060N

237040N

237020N

237000N

236980N

236960N

236940N

554340E

554360E

554380E

554400E

554340E

554360E

554380E

554400E



Notes:

Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.


All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.

Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.

Contours only shown across open spaces.


2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.

Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

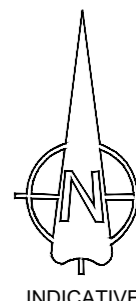

Legend:

Abbreviations:

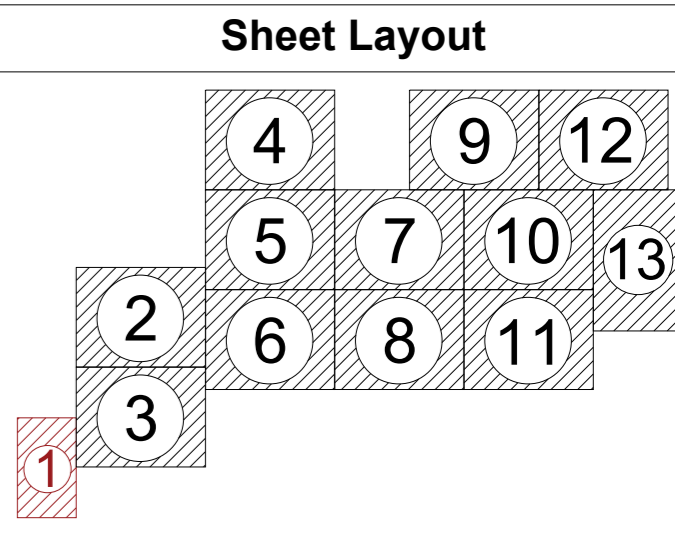

Rev. Suffix	Date	Initial	Revision Details

Surveyor L.H. LW Verified By L.H. LW CAD Operator AP Approved By AL Date 07.04.22

Levelling GNSS Datum OSGB36

To an OS GNSS Datum

Client

Location

Thaxted Road
Saffron Walden



Drawing Title

Topographical Survey
Sheet 1 of 13

Job No. 2203015	Old Job No.
Drawing Number K/2203015/1	Revision Suffix
Scale 1:200m (A1)	Date April 2022

CD SURVEYS LTD
LAND, BUILDING & SITE ENGINEERING

PENTIRE - STABLE 1 Tel (01932) 761196
FORDBRIDGE ROAD, Fax (01932) 786419
SUNBURY-ON-THAMES Email: mail@cdsurveys.com
MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

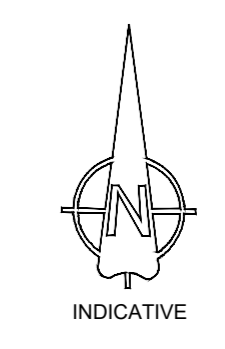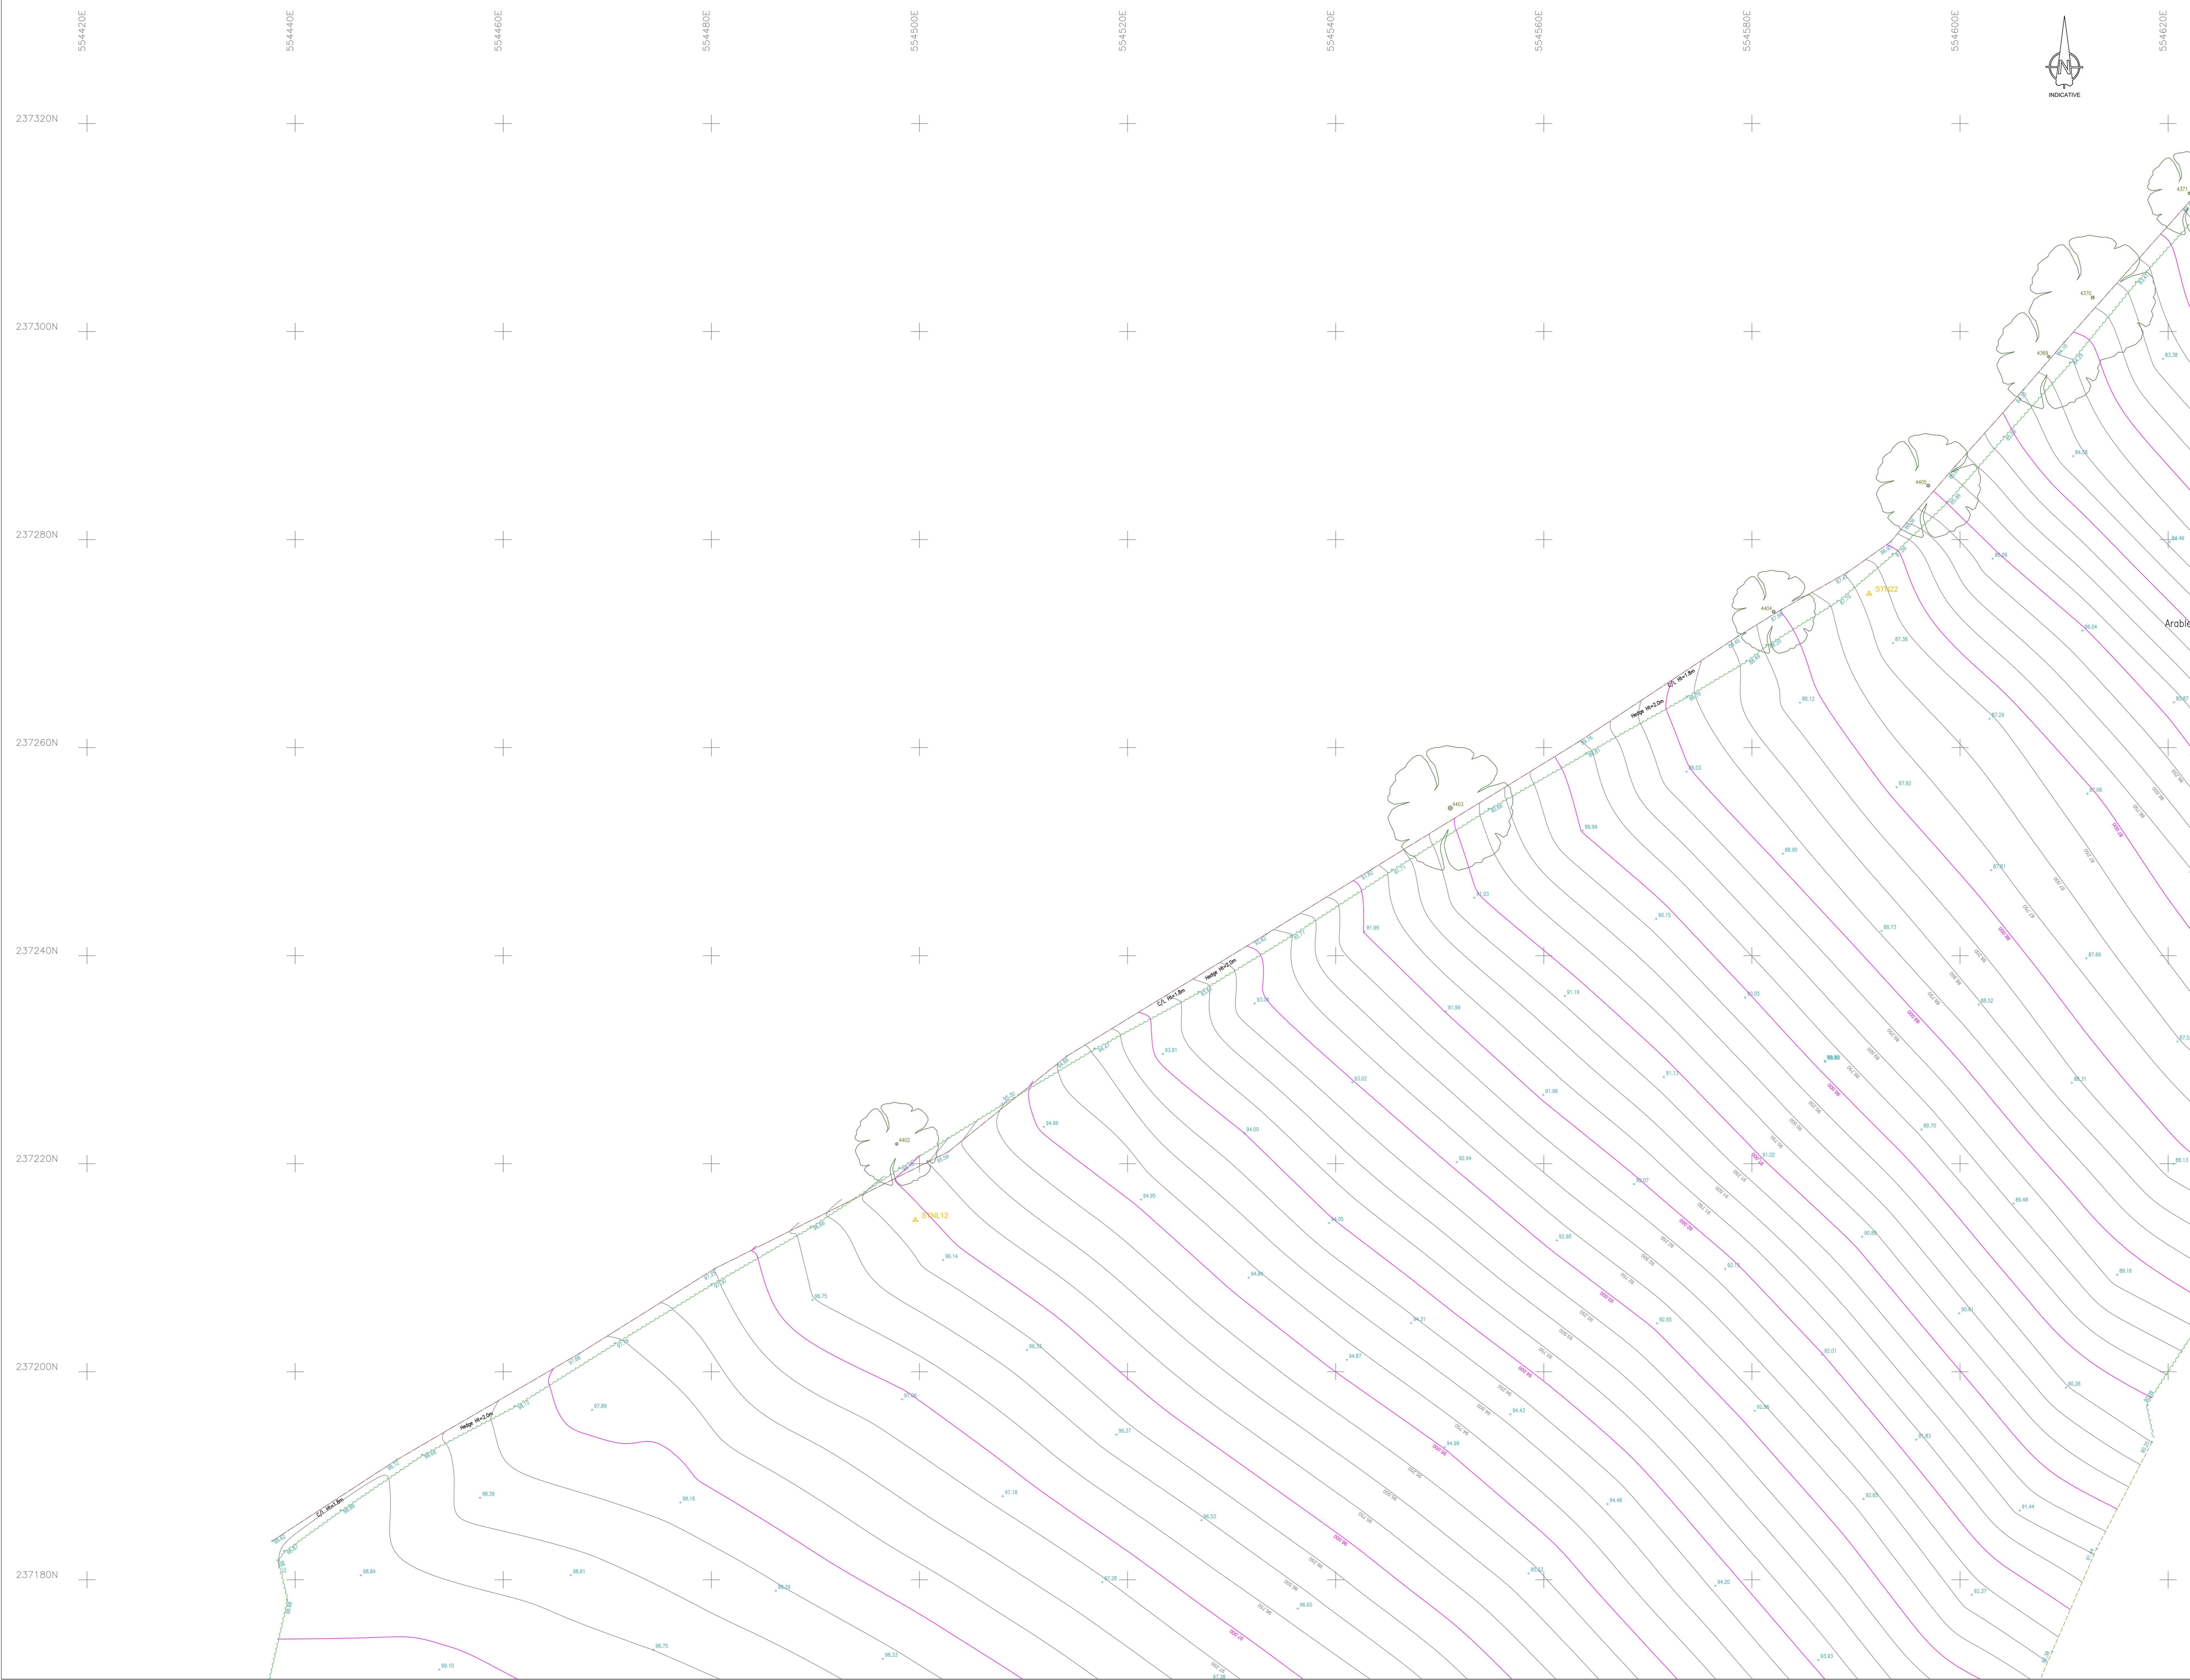


Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

Legend:

Boundary	Subsidiary	Field	Field
Contour	Contour	Contour	Contour
...

Abbreviations:

STN12	STN13	STN14	STN15	STN16	STN17	STN18	STN19	STN20	STN21	STN22
...

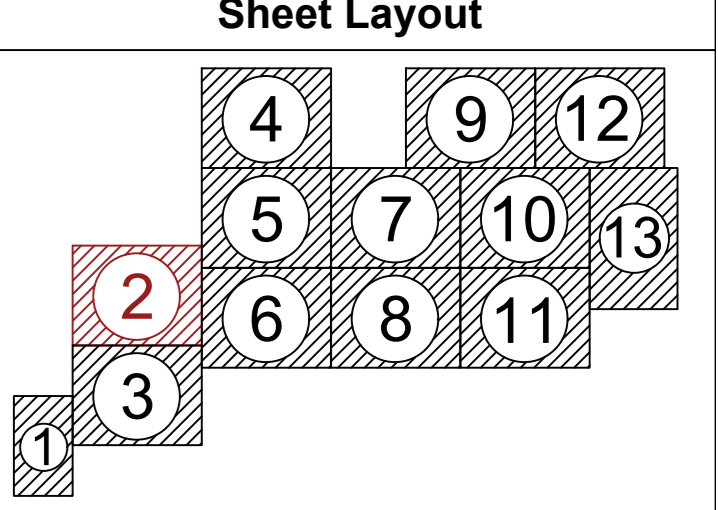

Tree Schedule

Pt No	Spread	Bole	Height	Species
2179	7.0	0.30	9.0	TREE UNKNOWN
2174	12.0	0.40	11.0	TREE UNKNOWN
2189	13.0	0.35	13.0	DAK
3656	8.0	0.25	12.0	TREE UNKNOWN
3659	8.0	0.30	12.0	TREE UNKNOWN
3660	10.0	0.35	12.0	TREE UNKNOWN
3661	10.0	0.30	12.0	TREE UNKNOWN
3662	10.0	0.30	12.0	TREE UNKNOWN
3663	10.0	0.30	12.0	TREE UNKNOWN
3664	10.0	0.30	12.0	TREE UNKNOWN
3665	10.0	0.30	12.0	TREE UNKNOWN
3673	10.0	0.25	9.0	TREE UNKNOWN
4189	12.0	0.30	12.0	TREE UNKNOWN
4369	10.0	0.25	10.0	TREE UNKNOWN
4370	12.0	0.30	11.0	TREE UNKNOWN
4371	8.0	0.25	9.0	TREE UNKNOWN
4372	12.0	0.35	12.0	TREE UNKNOWN
4373	8.0	0.25	9.0	TREE UNKNOWN
4374	8.0	0.25	9.0	TREE UNKNOWN
4375	8.0	0.25	9.0	TREE UNKNOWN
4376	9.0	0.30	10.0	TREE UNKNOWN
4377	8.0	0.25	9.0	TREE UNKNOWN
4378	8.0	0.25	9.0	TREE UNKNOWN
4379	8.0	0.25	9.0	TREE UNKNOWN
4380	12.0	0.35	12.0	TREE UNKNOWN
4381	8.0	0.25	12.0	TREE UNKNOWN
4382	8.0	0.25	12.0	TREE UNKNOWN
4383	12.0	0.35	12.0	TREE UNKNOWN
4402	8.0	0.25	10.0	TREE UNKNOWN
4403	12.0	0.40	12.0	TREE UNKNOWN
4404	8.0	0.30	10.0	TREE UNKNOWN
4405	10.0	0.30	10.0	TREE UNKNOWN
6012	8.0	0.80	14.0	TREE UNKNOWN
6013	5.0	0.40	14.0	TREE UNKNOWN
6014	5.0	0.40	14.0	TREE UNKNOWN
6015	5.0	0.40	14.0	TREE UNKNOWN
6016	5.0	0.35	14.0	TREE UNKNOWN
6017	5.0	0.50	14.0	TREE UNKNOWN
6018	6.0	0.30	14.0	TREE UNKNOWN
6019	6.0	0.40	16.0	TREE UNKNOWN
6020	7.0	0.50	15.0	TREE UNKNOWN
6021	5.0	0.30	12.0	TREE UNKNOWN
6022	5.0	0.45	10.0	TREE UNKNOWN
6023	7.0	0.65	14.0	TREE UNKNOWN
6027	3.0	0.30	8.0	TREE UNKNOWN
6068	4.0	0.30	9.0	TREE UNKNOWN
6069	4.0	0.25	8.0	TREE UNKNOWN
6070	4.0	0.50	10.0	TREE UNKNOWN
6071	5.0	0.28	10.0	TREE UNKNOWN
6072	5.0	0.30	12.0	TREE UNKNOWN
6078	3.0	0.20	11.0	TREE UNKNOWN
6119	3.0	0.20	11.0	TREE UNKNOWN
6120	5.0	0.25	11.0	TREE UNKNOWN
6121	5.0	0.30	11.0	TREE UNKNOWN
6122	6.0	0.25	11.0	TREE UNKNOWN
6123	6.0	0.25	11.0	TREE UNKNOWN
6124	6.0	0.40	11.0	TREE UNKNOWN
6125	6.0	0.40	11.0	TREE UNKNOWN
6126	6.0	0.32	8.0	TREE UNKNOWN
6161	6.0	0.30	12.0	TREE UNKNOWN
6162	6.0	0.30	12.0	TREE UNKNOWN
6163	6.0	0.30	12.0	TREE UNKNOWN
6355	7.0	0.70	13.0	TREE UNKNOWN
6298	5.0	0.55	9.0	TREE UNKNOWN
8310	6.0	1.00	11.0	TREE UNKNOWN
8311	6.0	0.25	7.0	TREE UNKNOWN
6405	9.0	0.80	17.0	DAK
6406	8.0	0.65	16.0	DAK
6409	6.0	0.60	13.0	TREE UNKNOWN
20759	9.0	0.30	12.0	SYCAMORE
25124	8.0	0.70	16.0	DAK

Rev. Suffix	Date	Initial	Revision Details

Surveyed by: JH18
 Levelling: GNSS
 Datum: OSGB36
 To an OS GNSS Datum




Client: Thaxted Road Saffron Walden


Drawing Title: Topographical Survey Sheet 2 of 13

Job No. 2203015
 Drawing Number K/2203015/2
 Scale 1:200m (A0)
 Date April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTIRE - STABLE 1
 FORDBRIDGE ROAD,
 SUNBURY-ON-THAMES
 MIDDLESEX, TW16 6AX

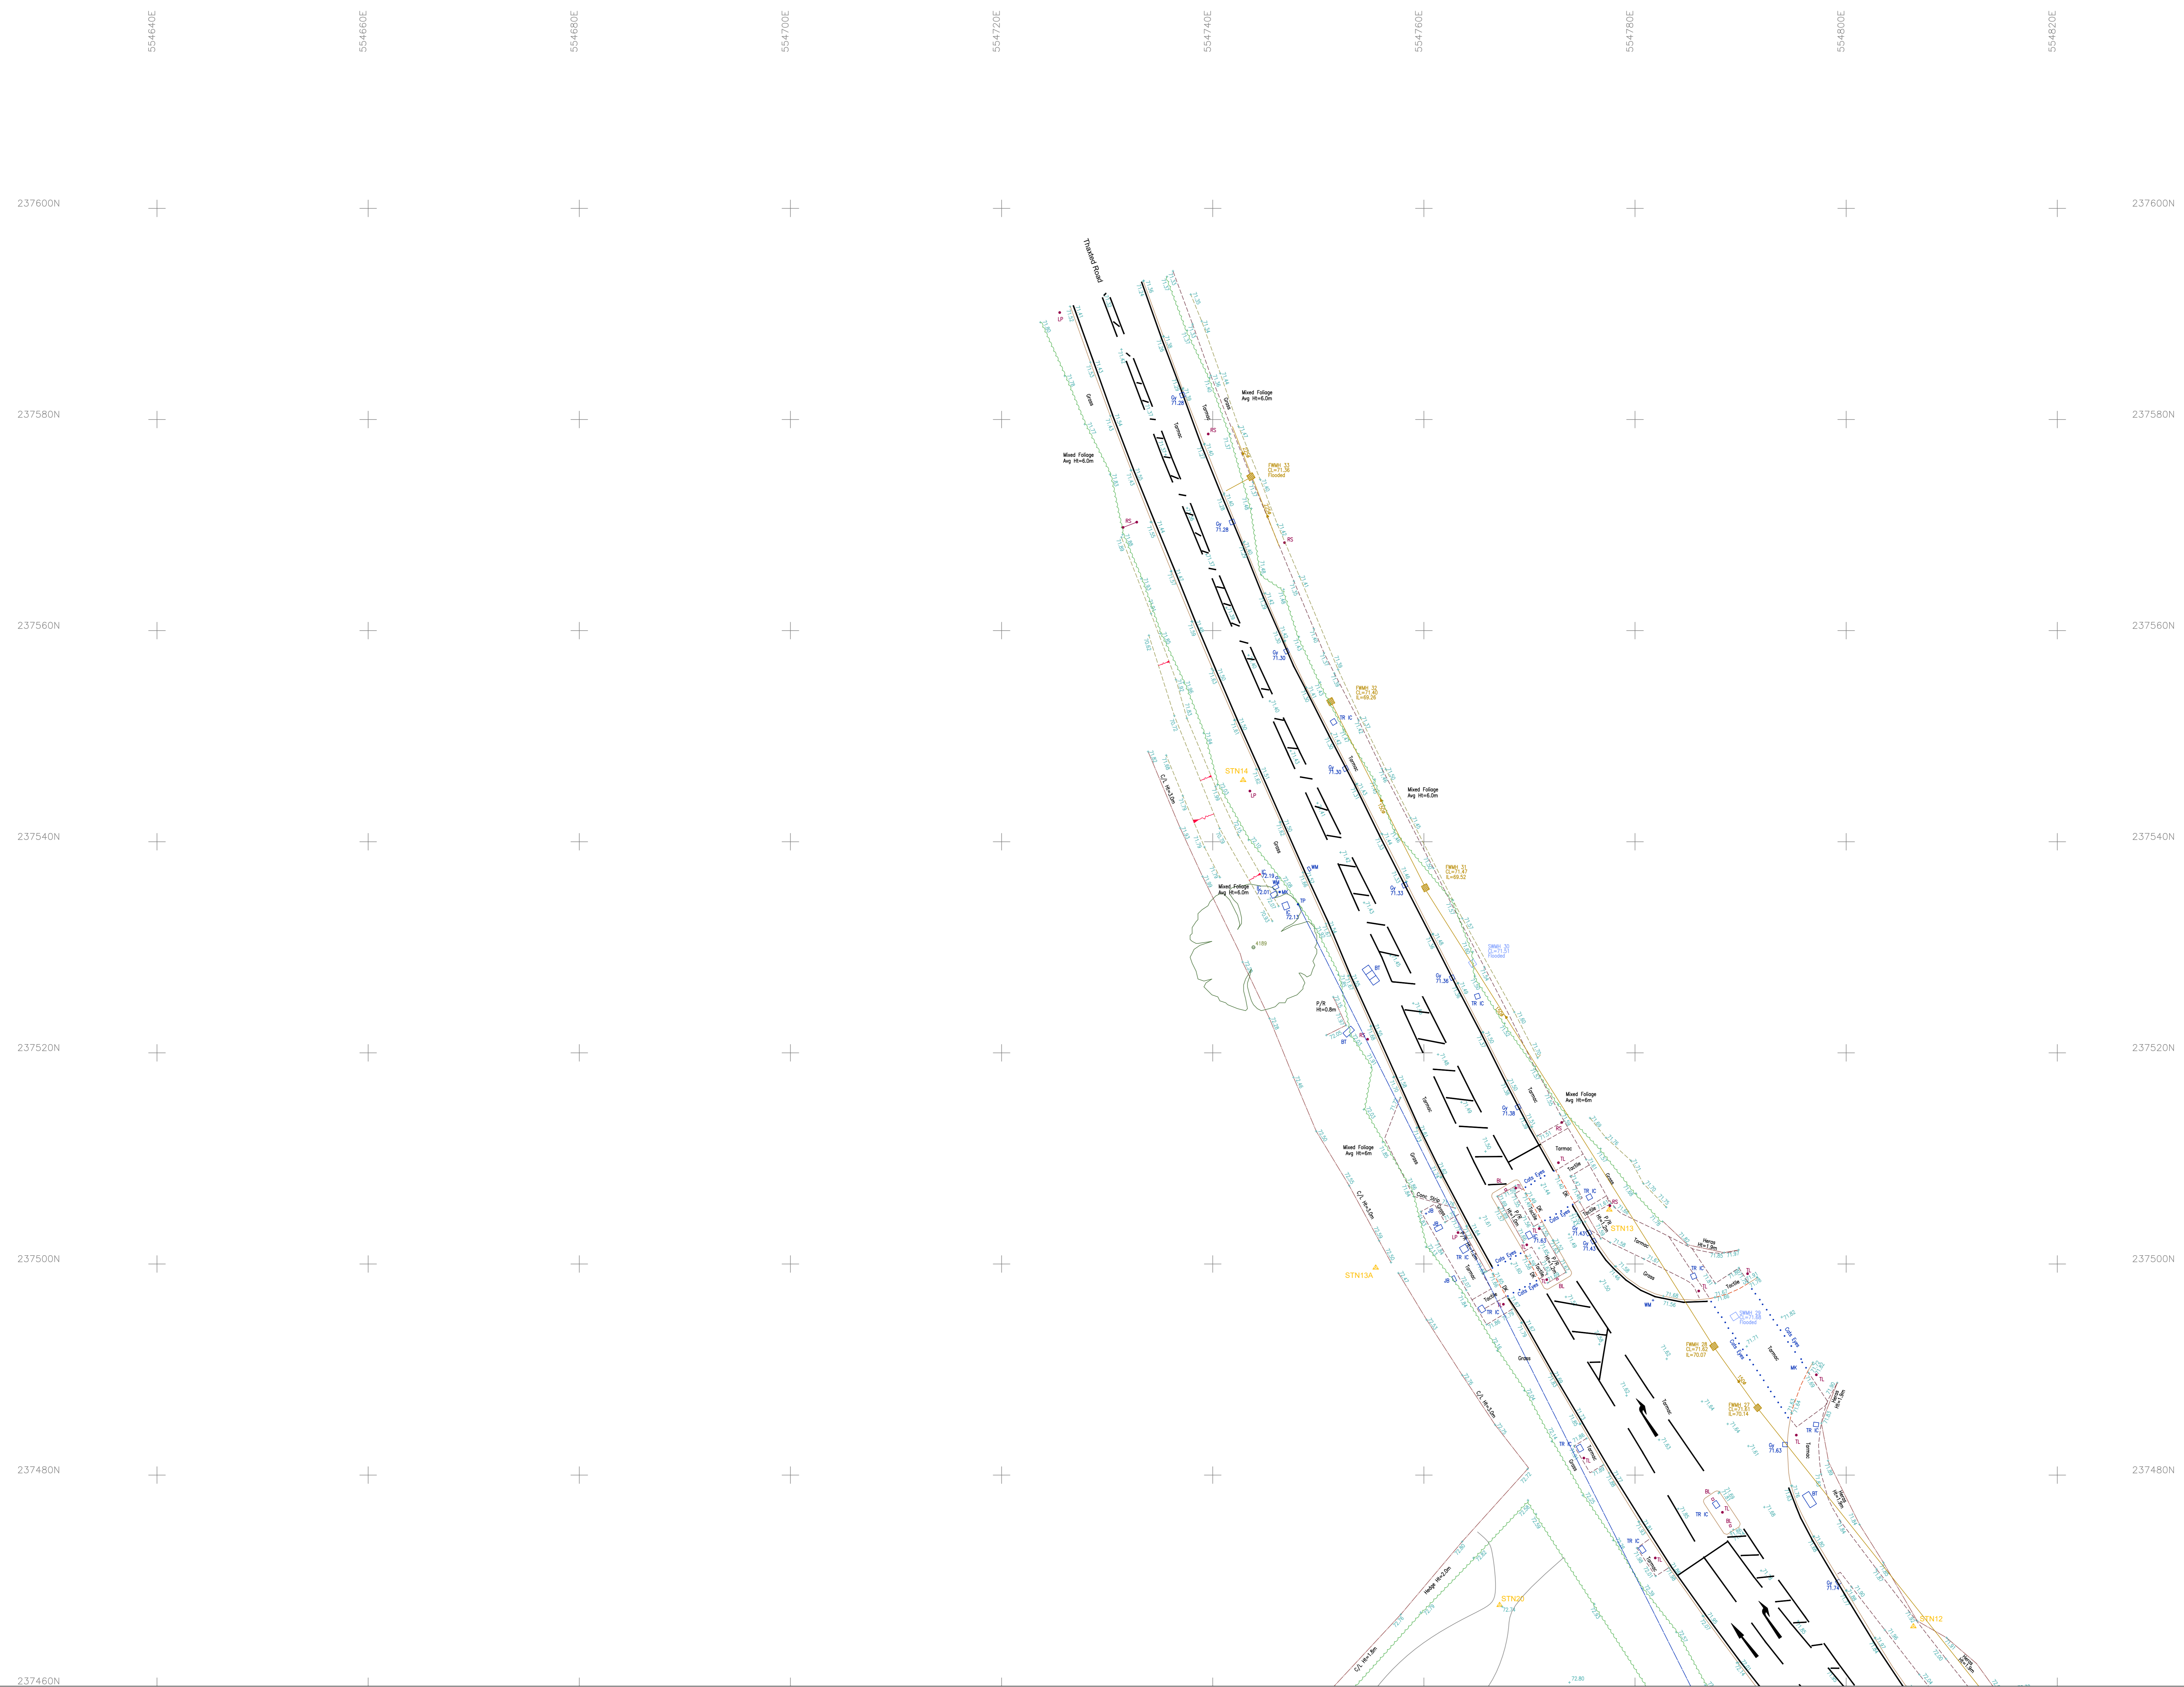

Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

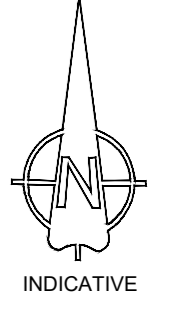


Legend:

fences	Buildings	Fences
Walls	Overhead Electric	Overhead Power Lines
Hedges	Overhead Phone	Drainage
Trees	Gate	Side

Abbreviations:

BLK	Block	CD	Control	EN	Electric	GP	Gas Pipe	HW	High Water	IS	Iron	IS	Iron	IS	Iron	IS	Iron	IS	Iron
MA	Main	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power
MA	Main	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power	OP	Overhead Power

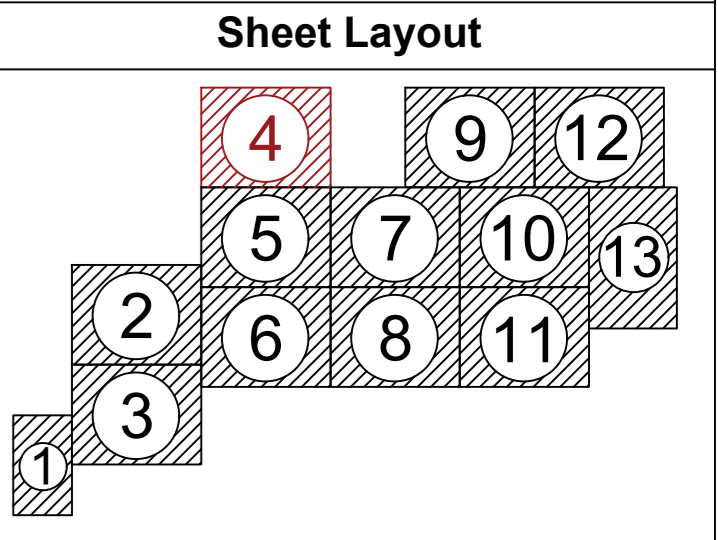

Rev. Suffix	Date	Initial	Revision Details

Surveyor: JHL/LS
 Levelling: GNSS
 Datum: OSGB36
 To an OS GNSS Datum

Client



Location
**Thaxted Road
 Saffron Walden**

Drawing Title
**Topographical Survey
 Sheet 4 of 13**

Job No. 2203015 Old Job No.
 Drawing Number K/2203015/4 Revision Suffix
 Scale 1:200m (A0) Date April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTIRE - STABLE 1 Tel: 01932 761196
 FORDBRIDGE ROAD, Fax: 01932 766419
 SUNBURY-ON-THAMES Email: mail@cdsurveys.com
 MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

Notes:
Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.
All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
Contours only shown across open spaces.
2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

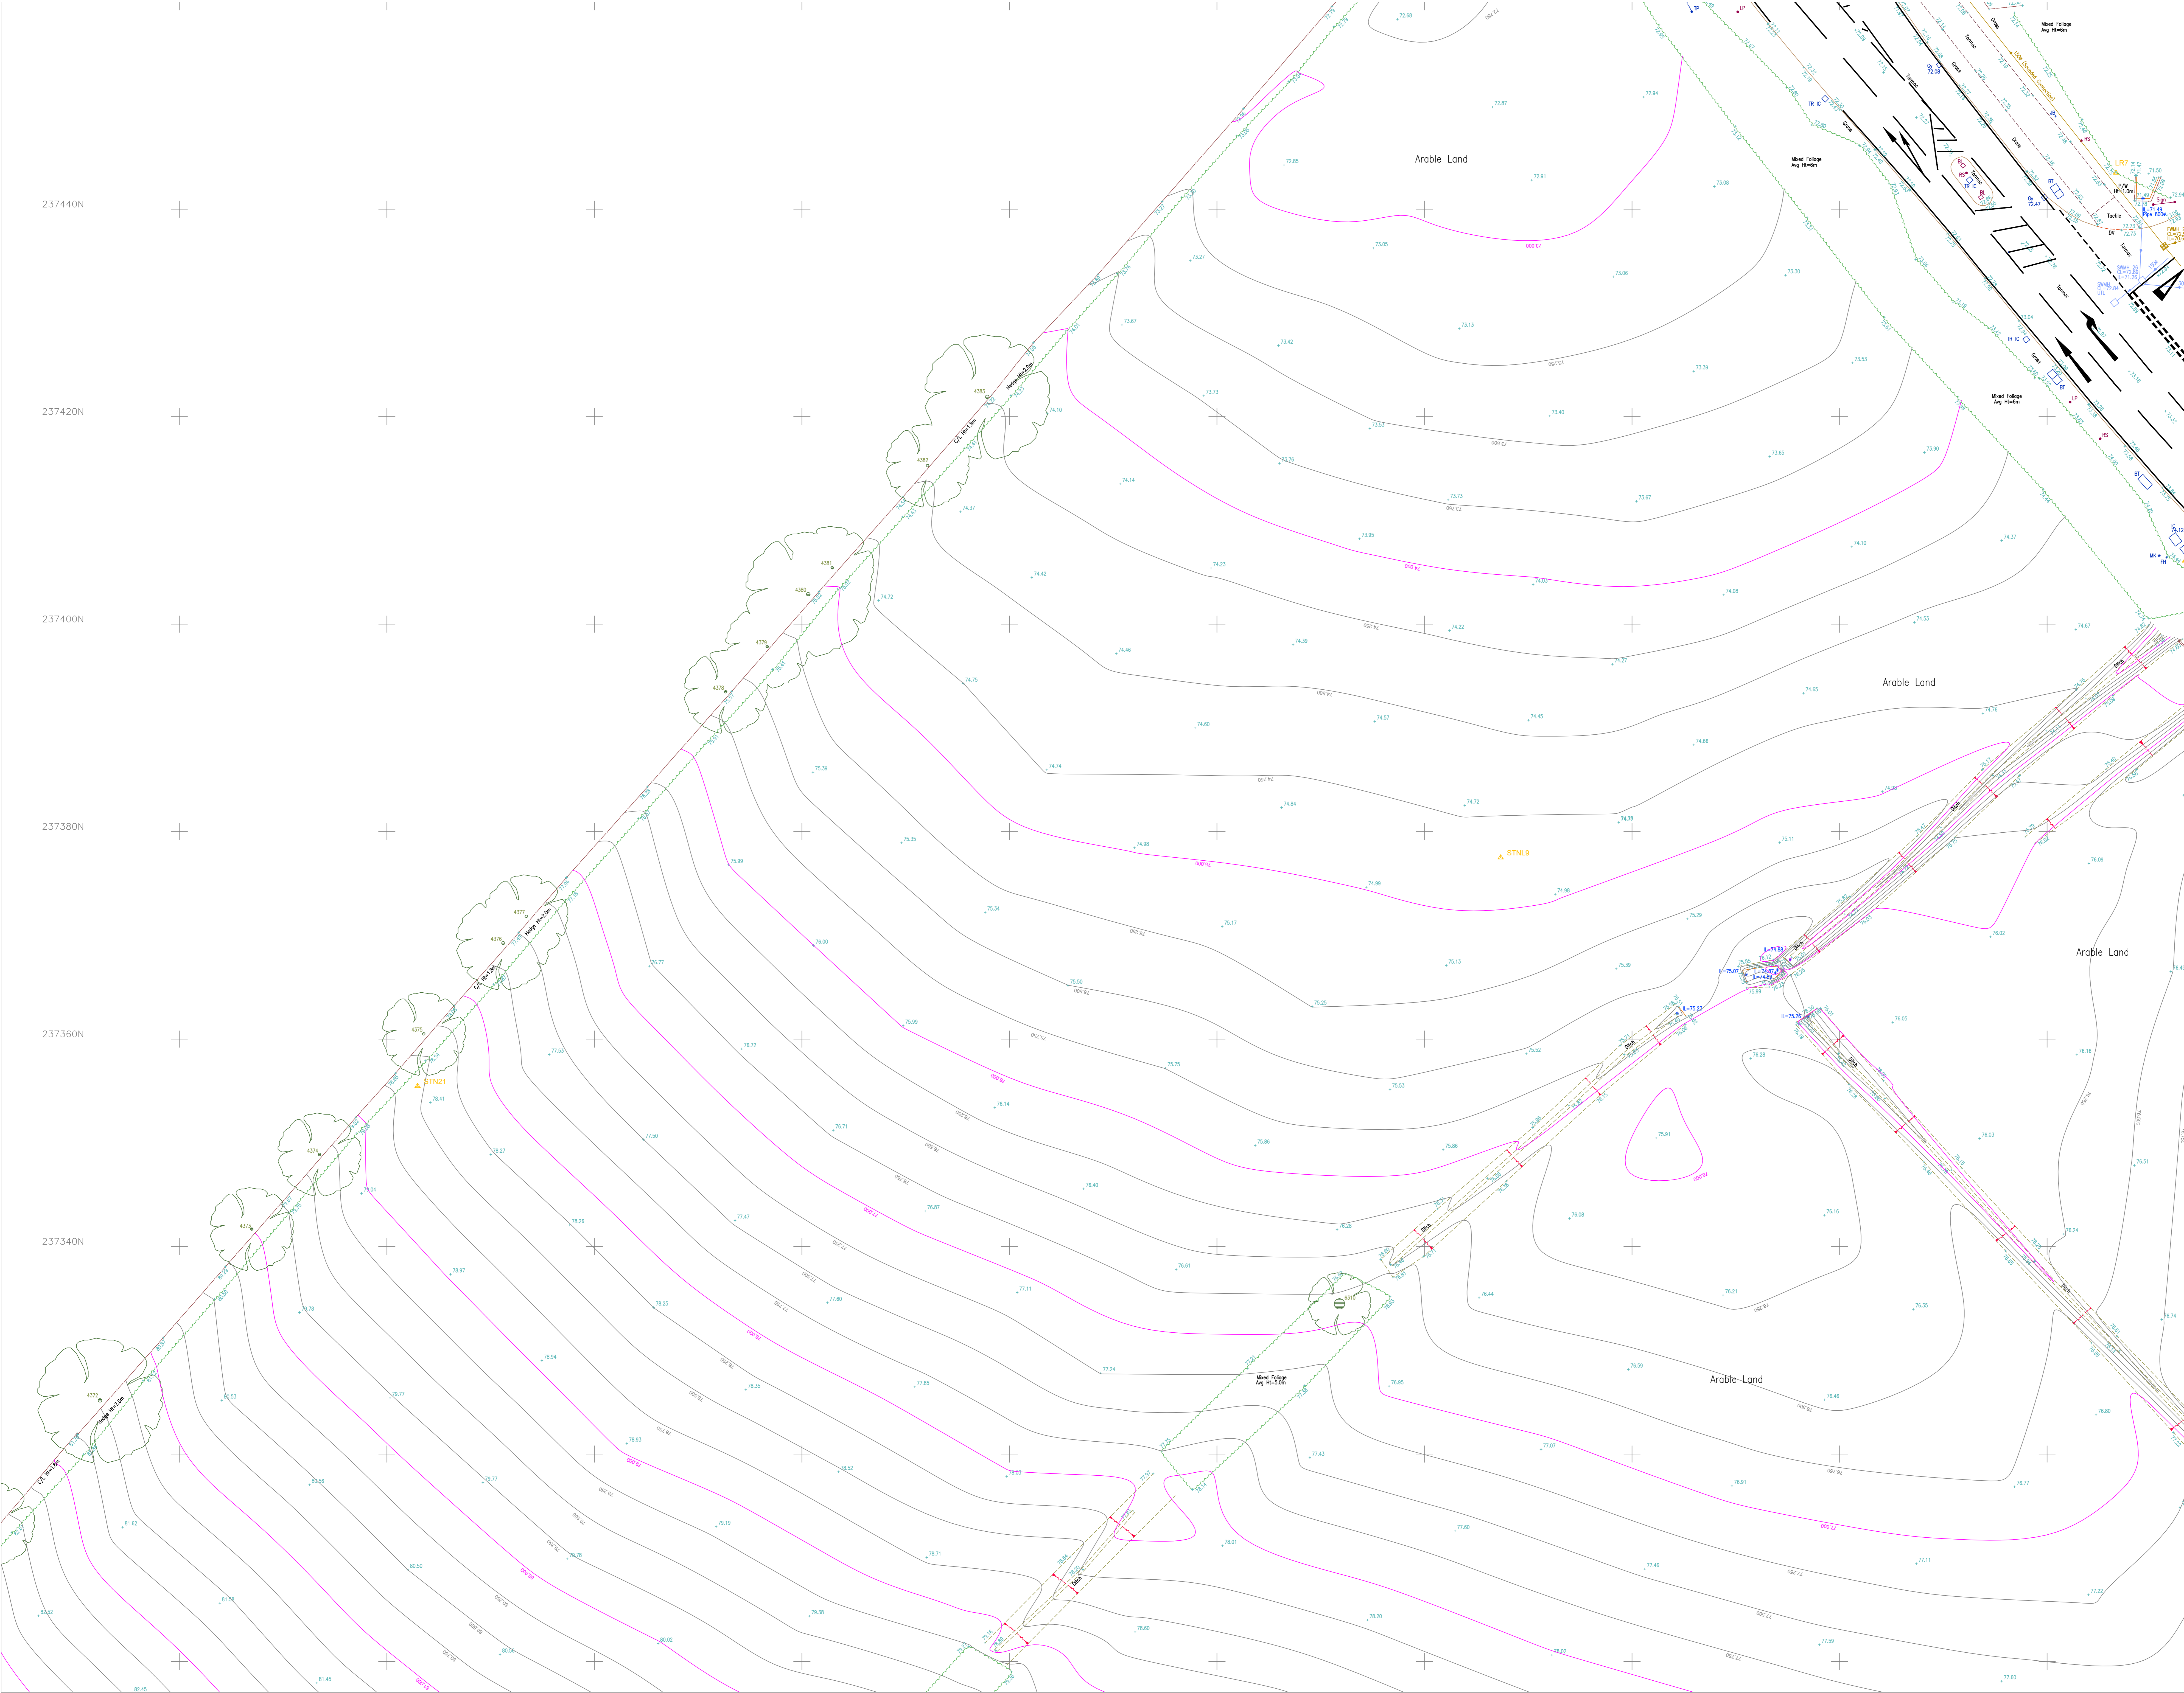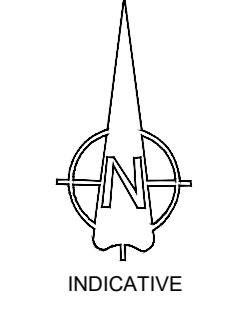


Legend:

Fences	Subsides	Fences
Walls	Overhead Cables	Overhead Cables
Hedges	Overhead Poles	Overhead Poles
Trees	Spikes	Spikes

Abbreviations:

BOUNDARY	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE
CONCRETE	CONCRETE	CONCRETE	CONCRETE

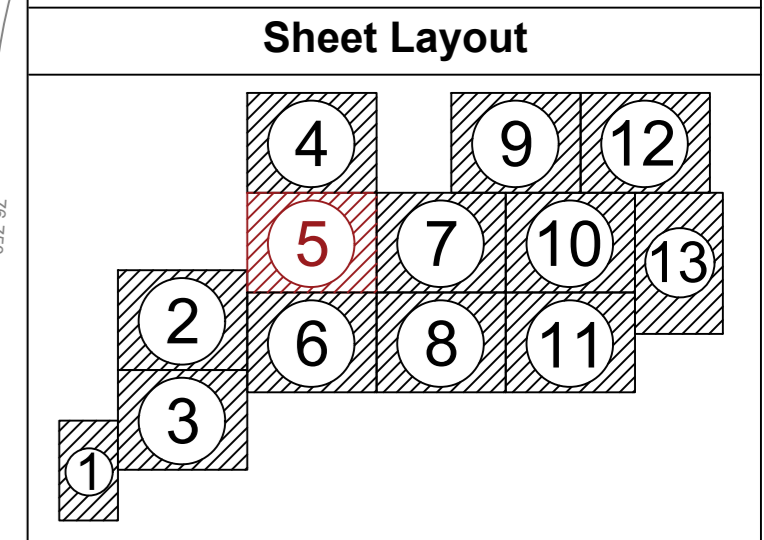

Rev. Suffix	Date	Initial	Revision Details

Surveyor: J.H.L.H. Verified By: J.H.L.H. CAD Operator: J.H.L.H. Approved By: J.H.L.H. Date: 07.04.22
Levelling: GNSS Datum: OSGB36
To an OS GNSS Datum




Client
Location
Thaxted Road
Saffron Walden


Drawing Title
Topographical Survey
Sheet 5 of 13

Job No. 2203015	Old Job No.
Drawing Number K/2203015/5	Revision Suffix
Scale 1:200m (A0)	Date April 2022

CD SURVEYS LTD
LAND, BUILDING & SITE ENGINEERING
PENTRE - STABLE 1 Tel: (01932) 761196
FORDSBIDGE ROAD, Fax: (01932) 766419
SUNBURY-ON-THAMES Email: mail@cdsurveys.com
MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

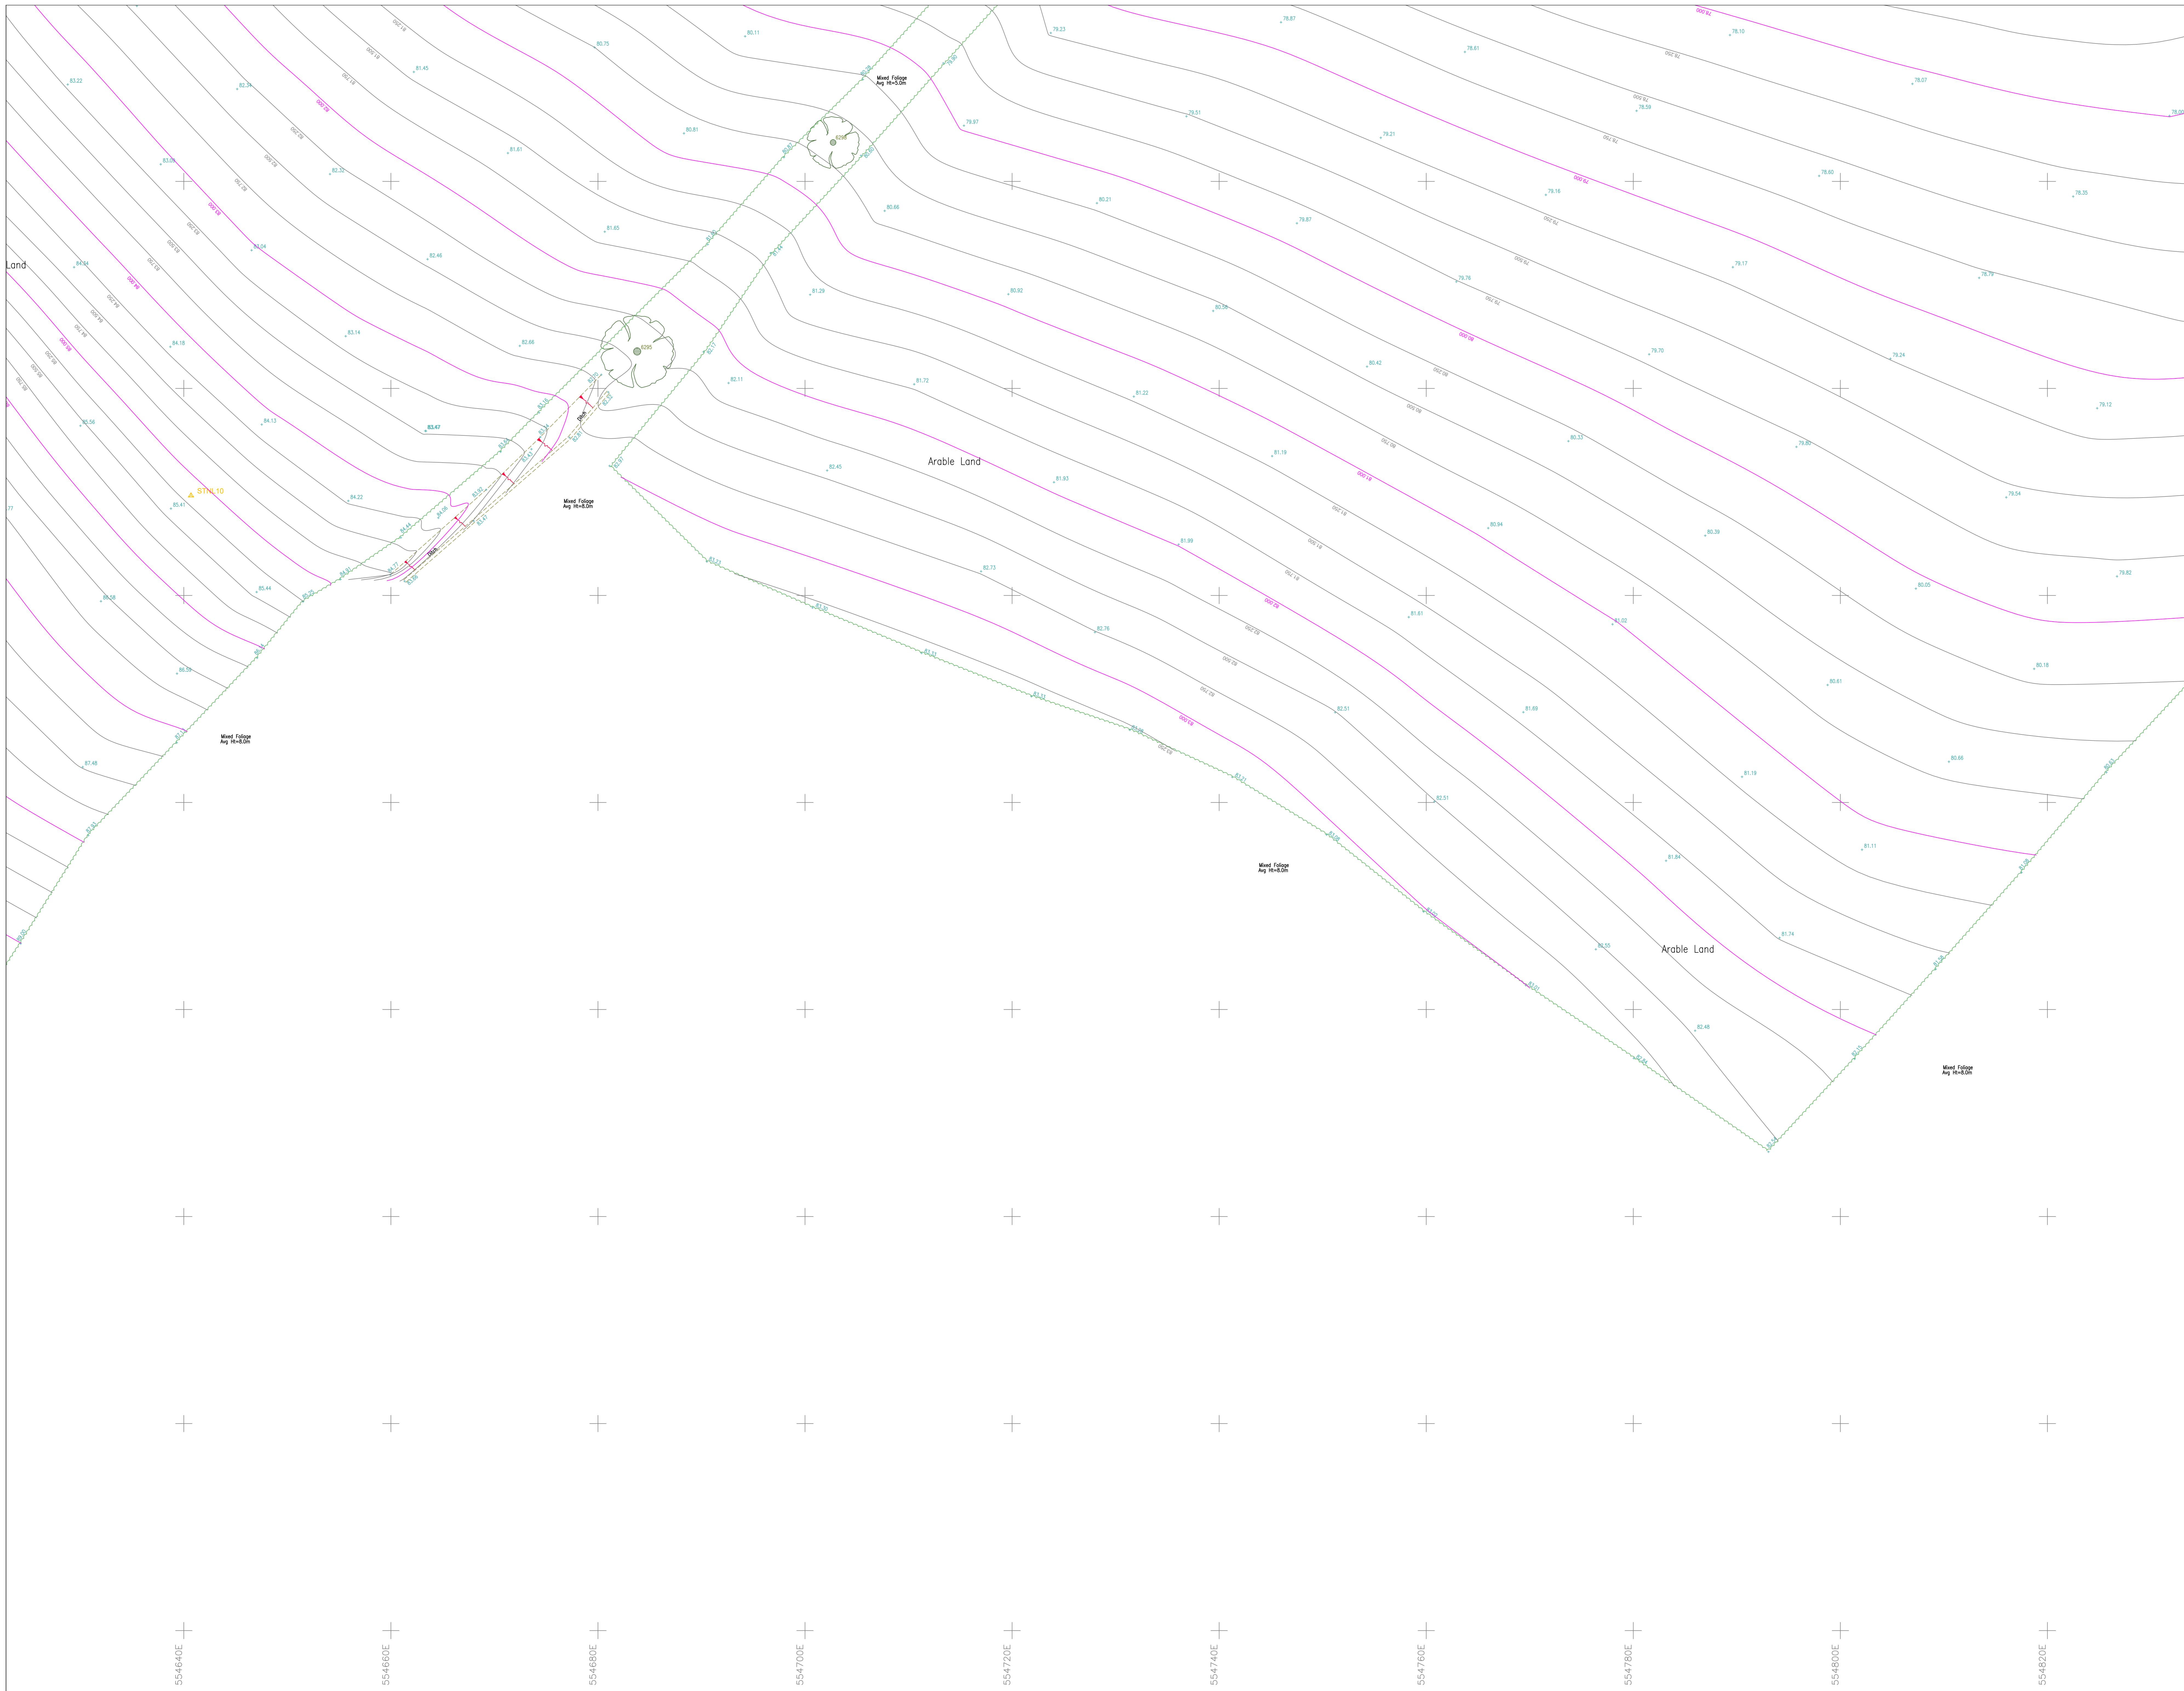

Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

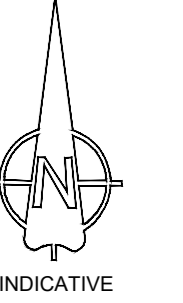


Legend:

Fence	Subsidence	Fence	Water	Water
Overhead Cable	Overhead Cable	Overhead Cable	Overhead Cable	Overhead Cable
Hedge	Overhead Pipe	Overhead Pipe	Overhead Pipe	Overhead Pipe
Tree	Gate	Gate	Gate	Gate

Abbreviations:

BOUND	BOUND	BOUND	BOUND	BOUND
CONTRACT	CONTRACT	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT	CONTRACT

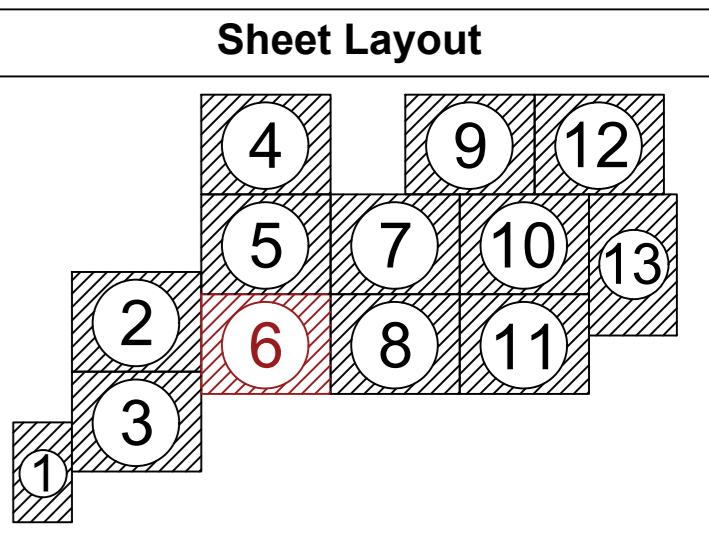

Rev. Suffix	Date	Initial	Revision Details

Surveyor	Checked By	Operator	Approved By	Date

Leveling: GNSS Datum: OSGB36

To an OS GNSS Datum


Client

Location
 Thaxted Road
 Saffron Walden


Drawing Title
 Topographical Survey
 Sheet 6 of 13

Job No.	2203015	Old Job No.	
Drawing Number	K/2203015/6	Revision Suffix	
Scale	1:200m (A0)	Date	April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTRE - STABLE 1 Tel: (01932) 761196
 FORDBRIDGE ROAD, Fax: (01932) 766419
 SUNBURY-ON-THAMES Email: mail@cdsurveys.com
 MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

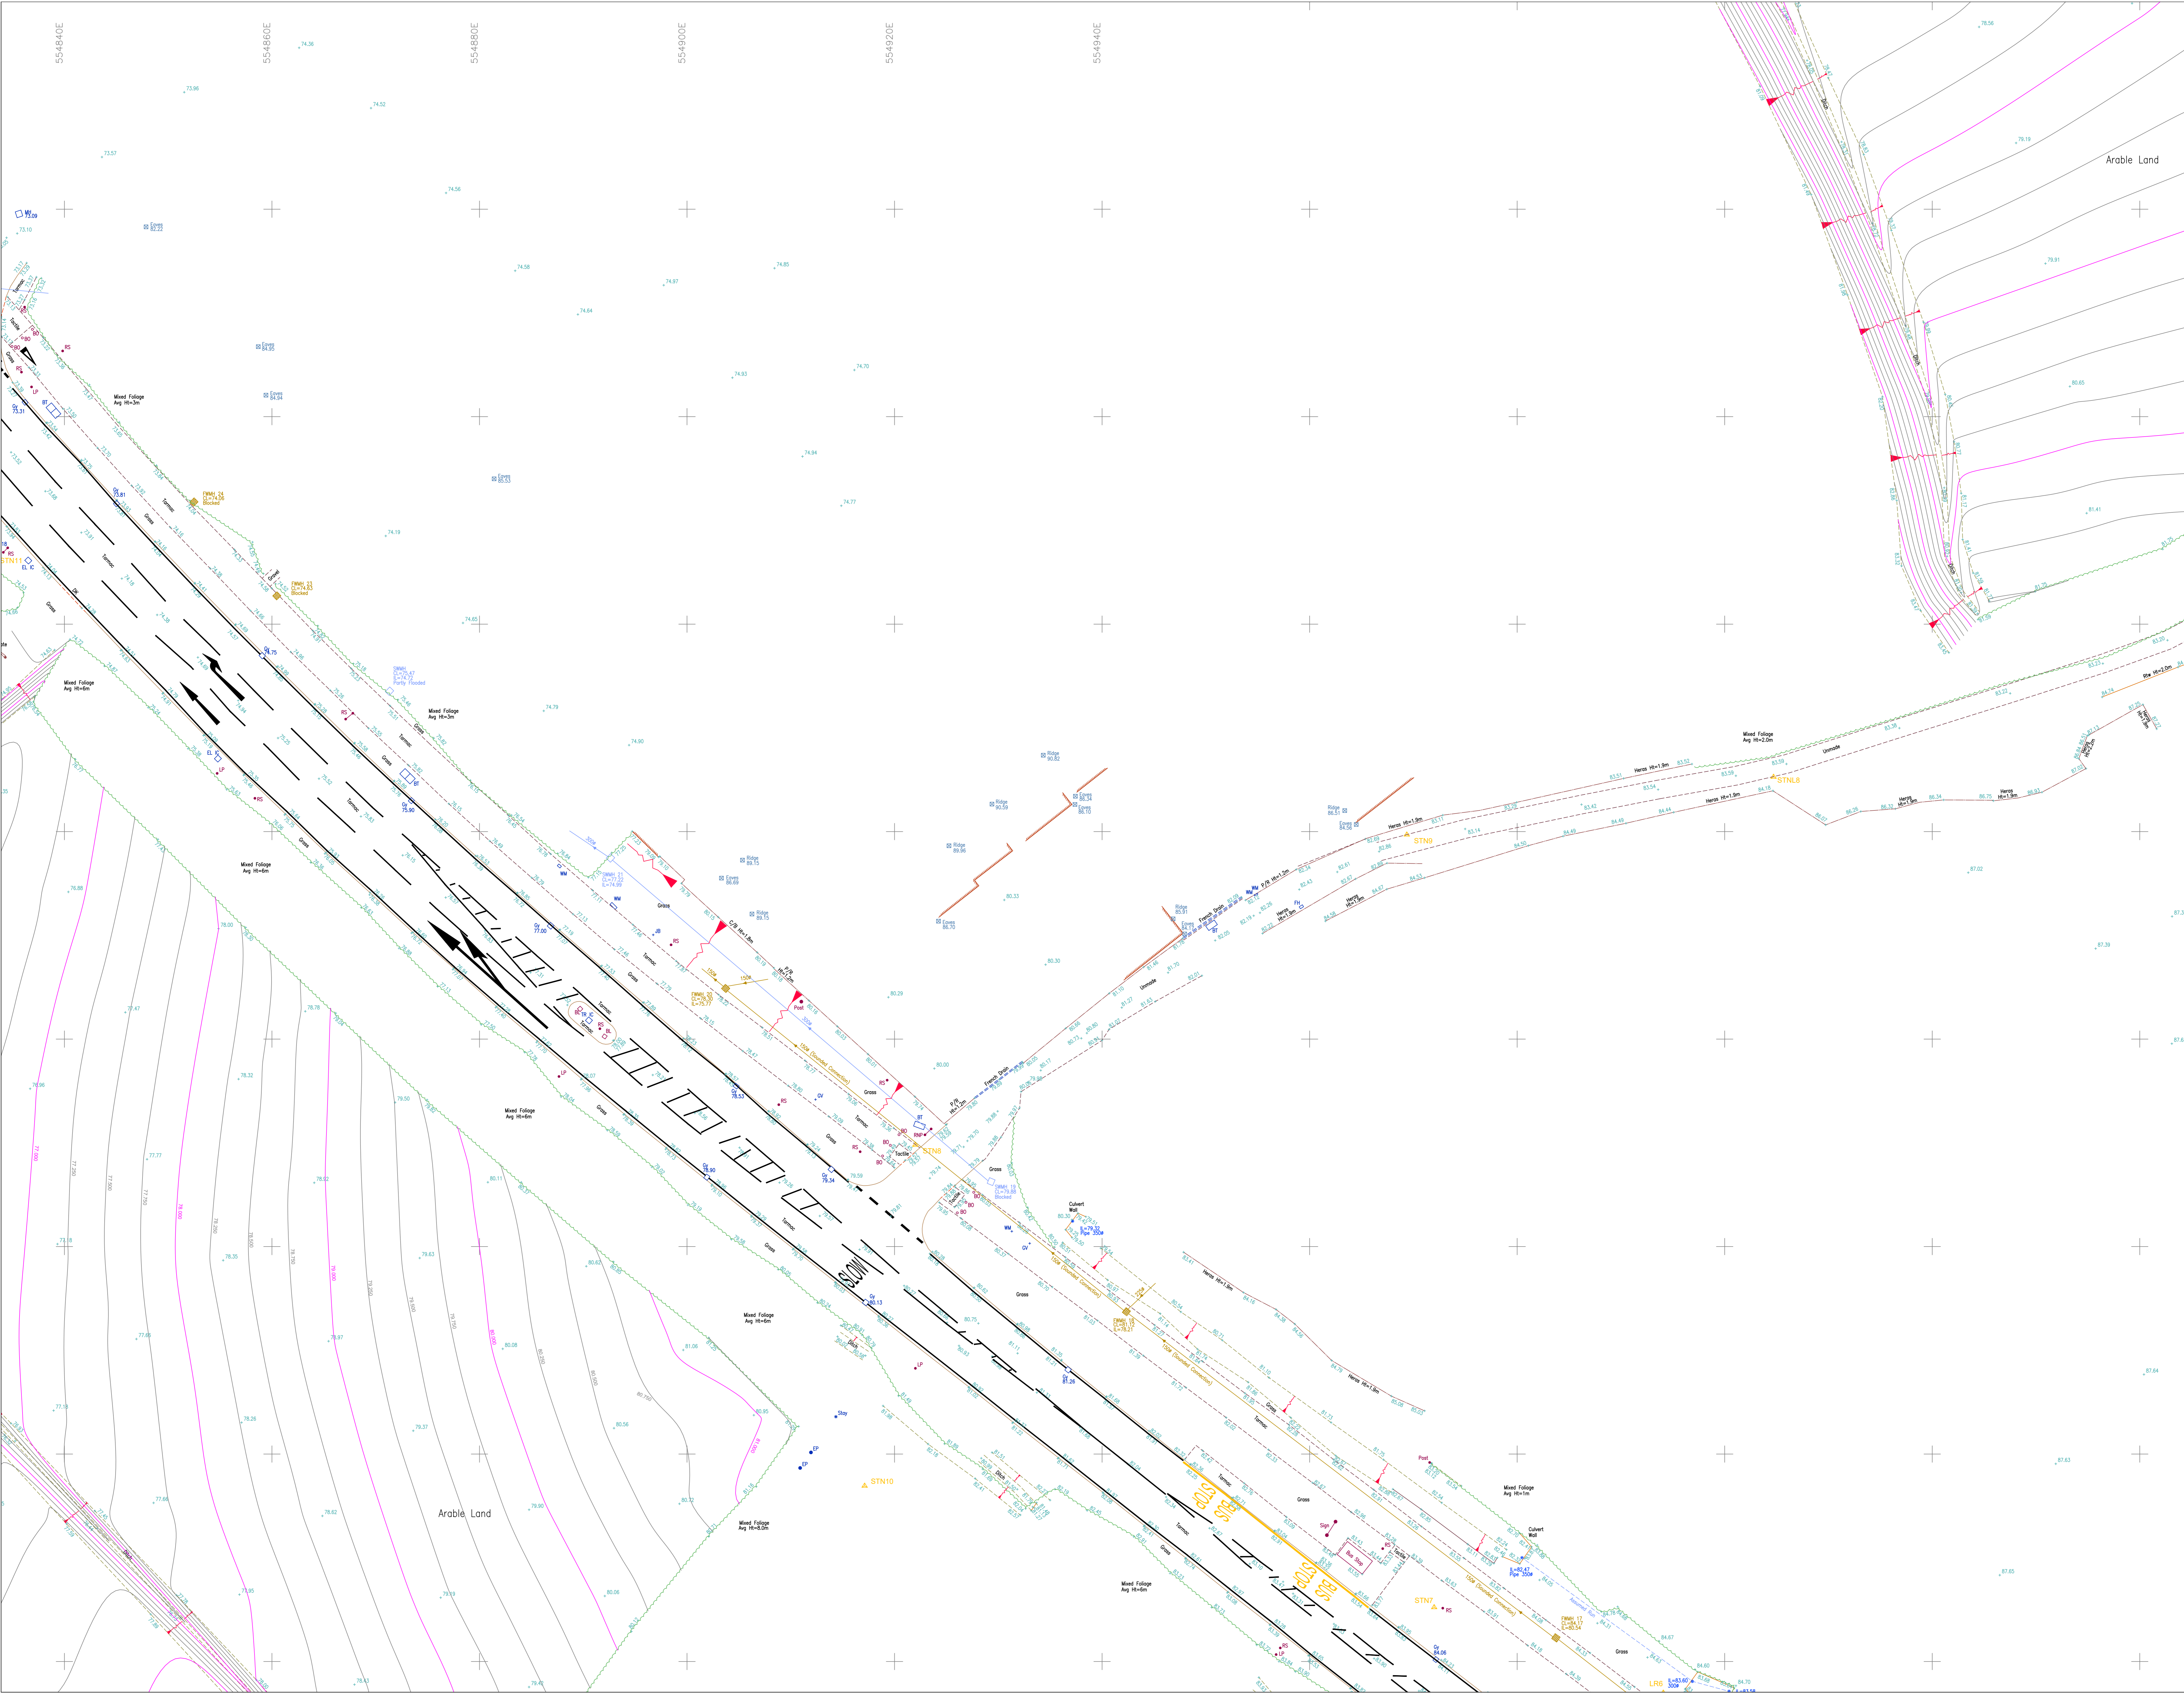

Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

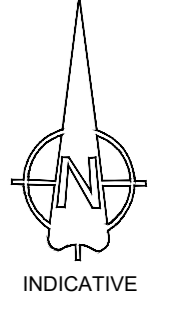


Legend:

Fences	Subsides	Fences
Walls	Overhead Cables	Overhead Cables
Hedges	Overhead Poles	Overhead Poles
Trees	Grid	Grid

Abbreviations:

SOILS	OS	OS	OS
CONCRETE	CONCRETE	CONCRETE	CONCRETE
ASPHALT	ASPHALT	ASPHALT	ASPHALT
GRAVEL	GRAVEL	GRAVEL	GRAVEL
GRASS	GRASS	GRASS	GRASS
WOOD	WOOD	WOOD	WOOD
...

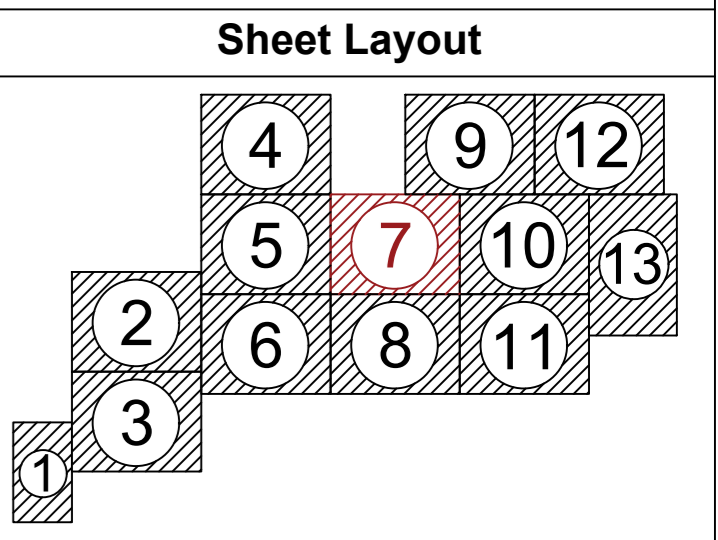

Rev. Suffix	Date	Initial	Revision Details

Surveyed by: JHL/RS
 Verified by: JHL/RS
 Levelling: GNSS
 Datum: OSGB36
 To an OS GNSS Datum


Client: **KIER GROUP**

Location: **Thaxted Road, Saffron Walden**

Drawing Title: **Topographical Survey Sheet 7 of 13**

Job No. 2203015 | Old Job No. |
 Drawing Number K/2203015/7 | Revision Suffix |
 Scale 1:200m (A0) | Date April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTRE - STABLE 1 | Tel: 01932 761196
 FORDSBIDGE ROAD, | Fax: 01932 766419
 SUNBURY-ON-THAMES | Email: mail@cdsurveys.com
 MIDDLESEX, TW16 6AX | Visit us at: www.cdsurveys.com

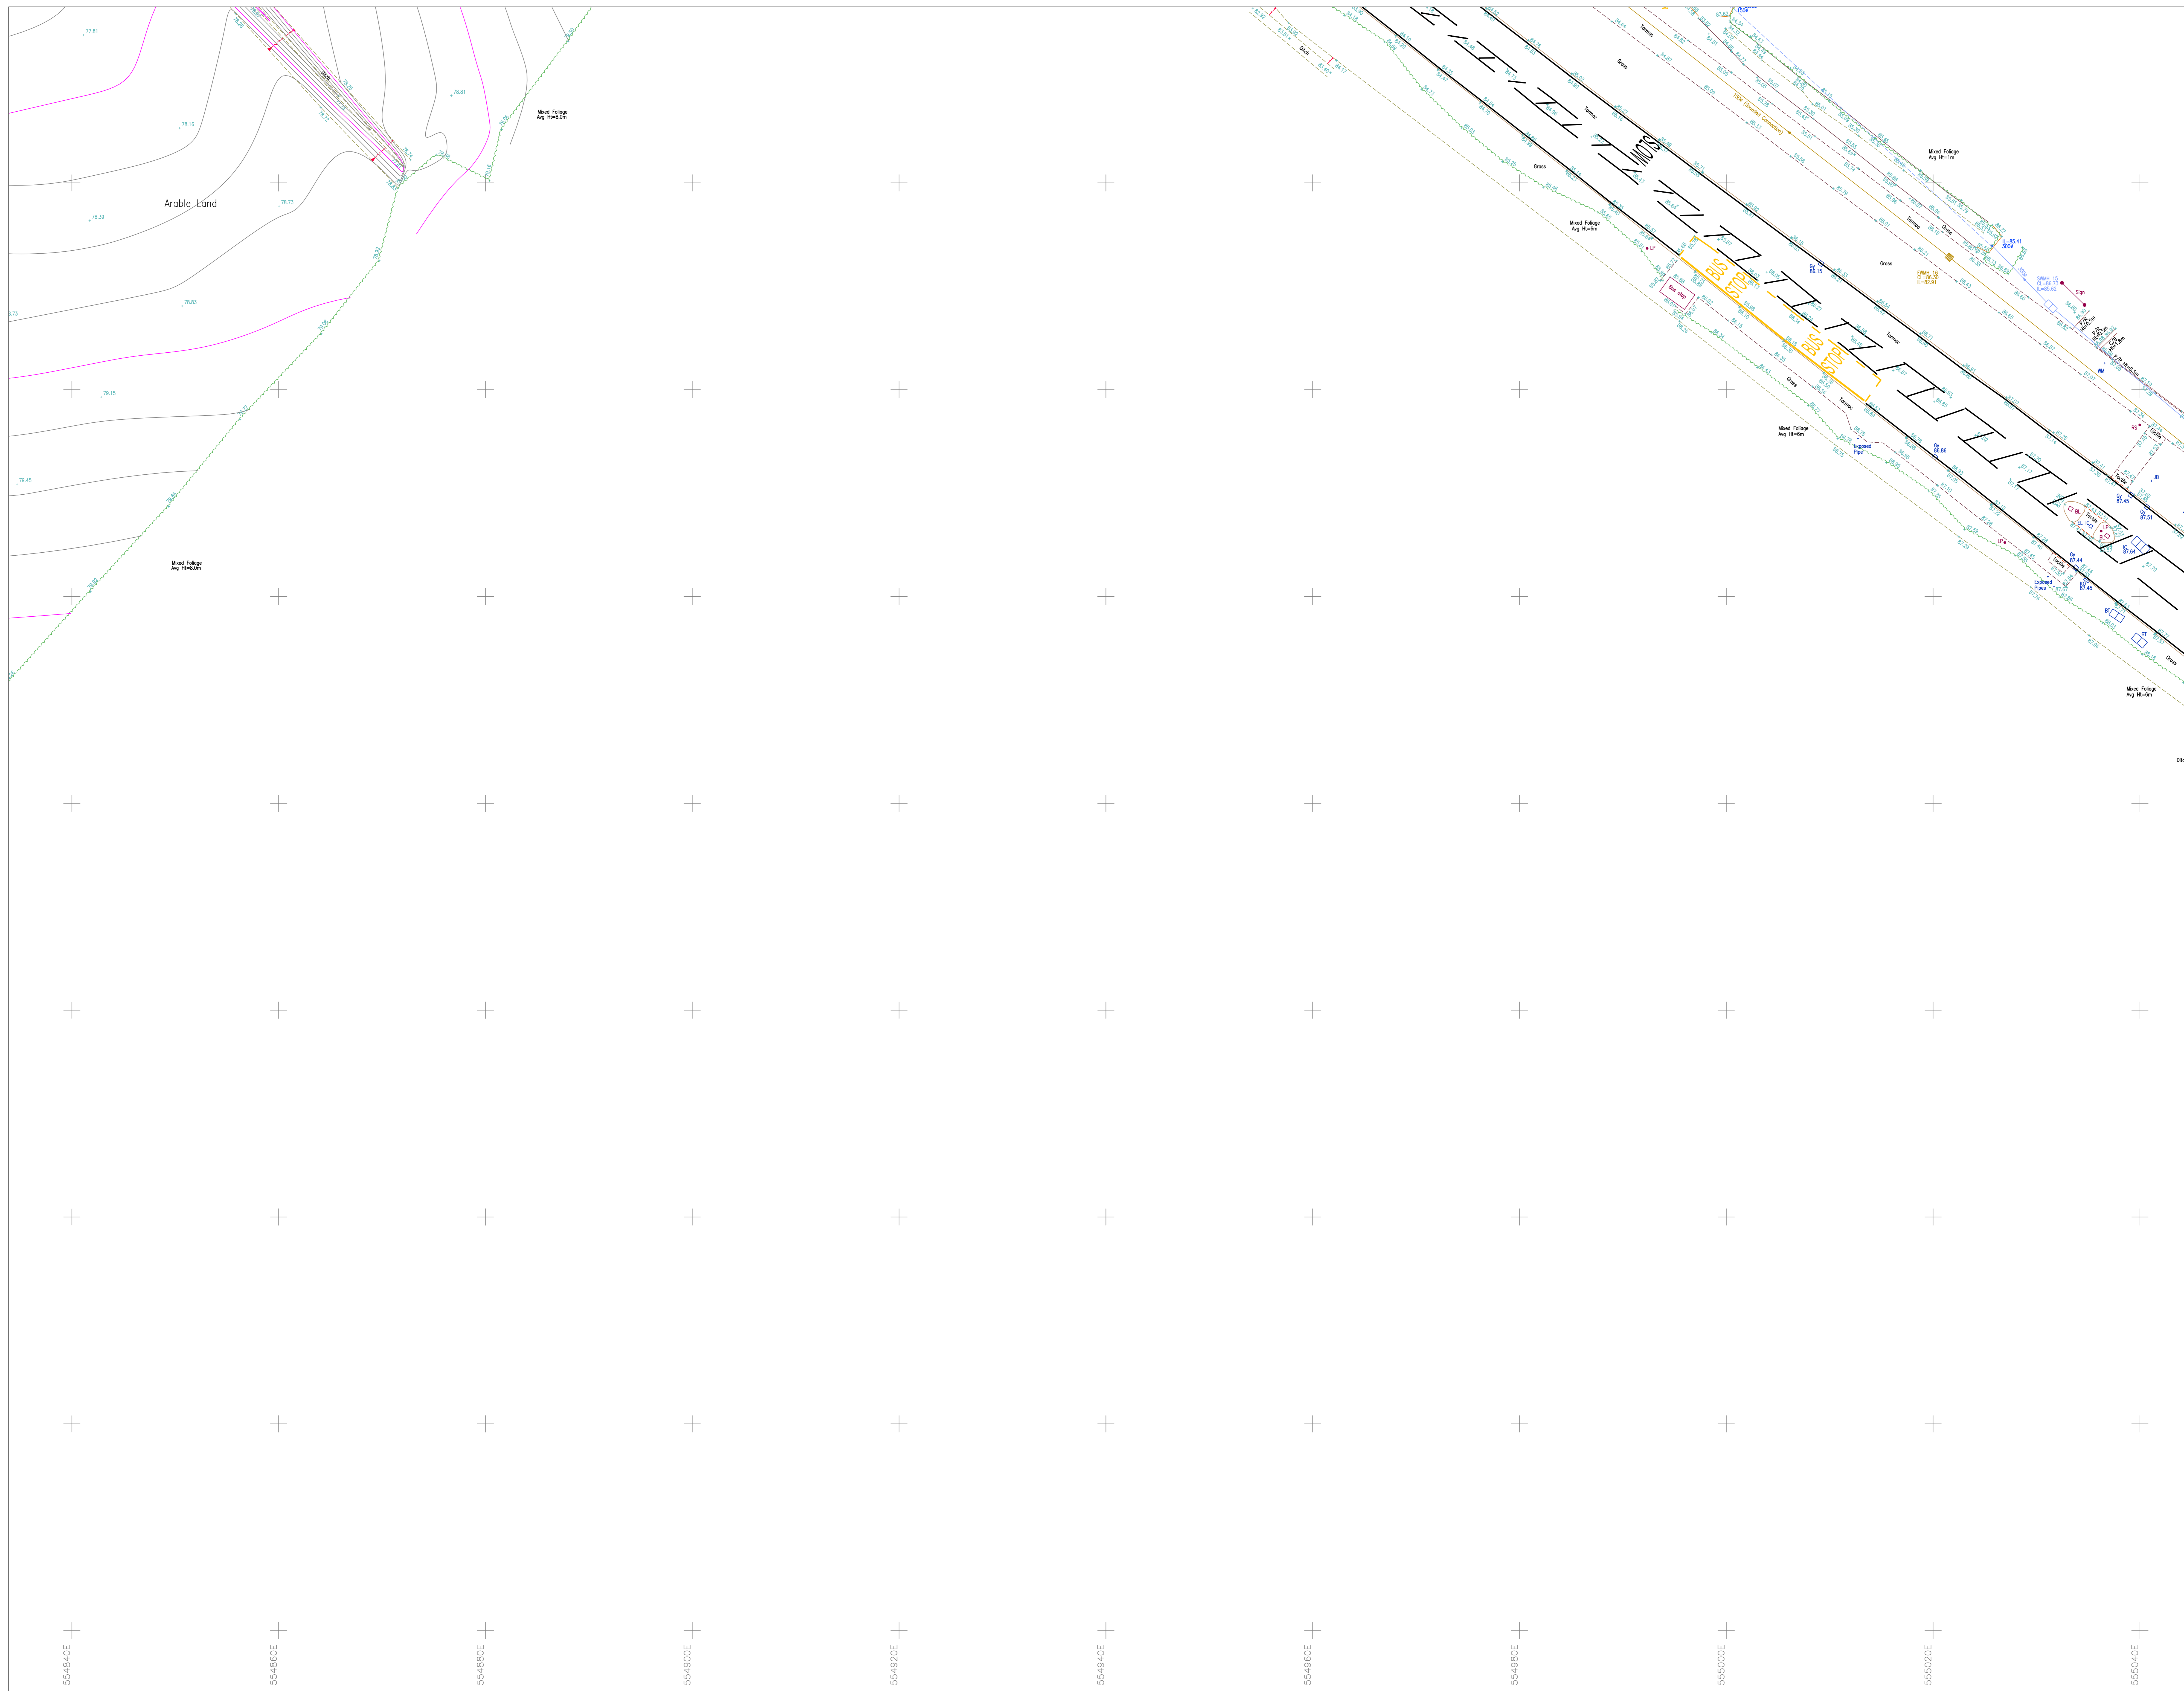

Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.




Legend:

Fence	Subsidiary	Fence	Water
Walls	Overhead Cables	Overhead Poles	Overhead Lines
Hedges	Overhead Poles	Overhead Lines	Overhead Lines
Trees	Gate	Gate	Gate

Abbreviations:

SOILS	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT
CONTRACT	CONTRACT	CONTRACT	CONTRACT

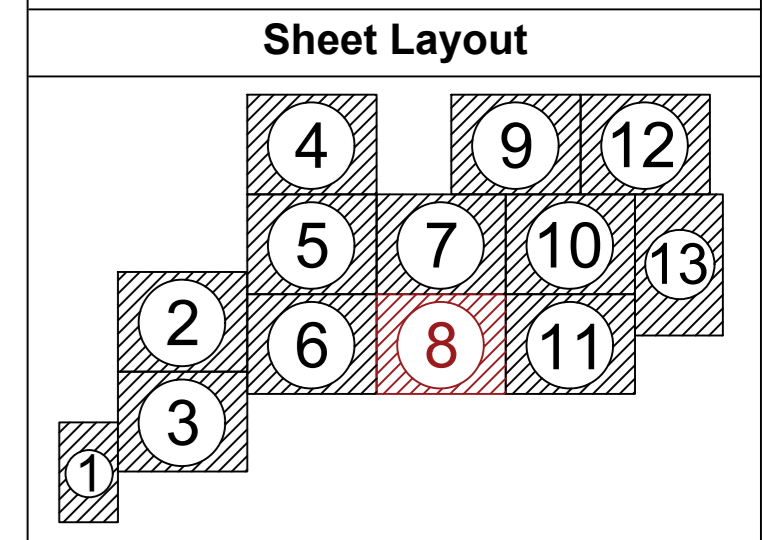

Rev. Suffix	Date	Initial	Revision Details
Surveyor	11/10/22		
Checked			
Approved			

Levelling GNSS Datum OSGB36
 To an OS GNSS Datum


Client

Location
**Thaxted Road
 Saffron Walden**


Drawing Title
**Topographical Survey
 Sheet 8 of 13**

Job No.	2203015	Old Job No.	
Drawing Number	K/2203015/8	Revision Suffix	
Scale	1:200m (A0)	Date	April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 FORDBRIDGE ROAD, SUNBURY-ON-THAMES, MIDDLESEX, TW16 6AX
 Tel: 01932 761196 Fax: 01932 766419 Email: mail@cdsurveys.com Visit us at: www.cdsurveys.com

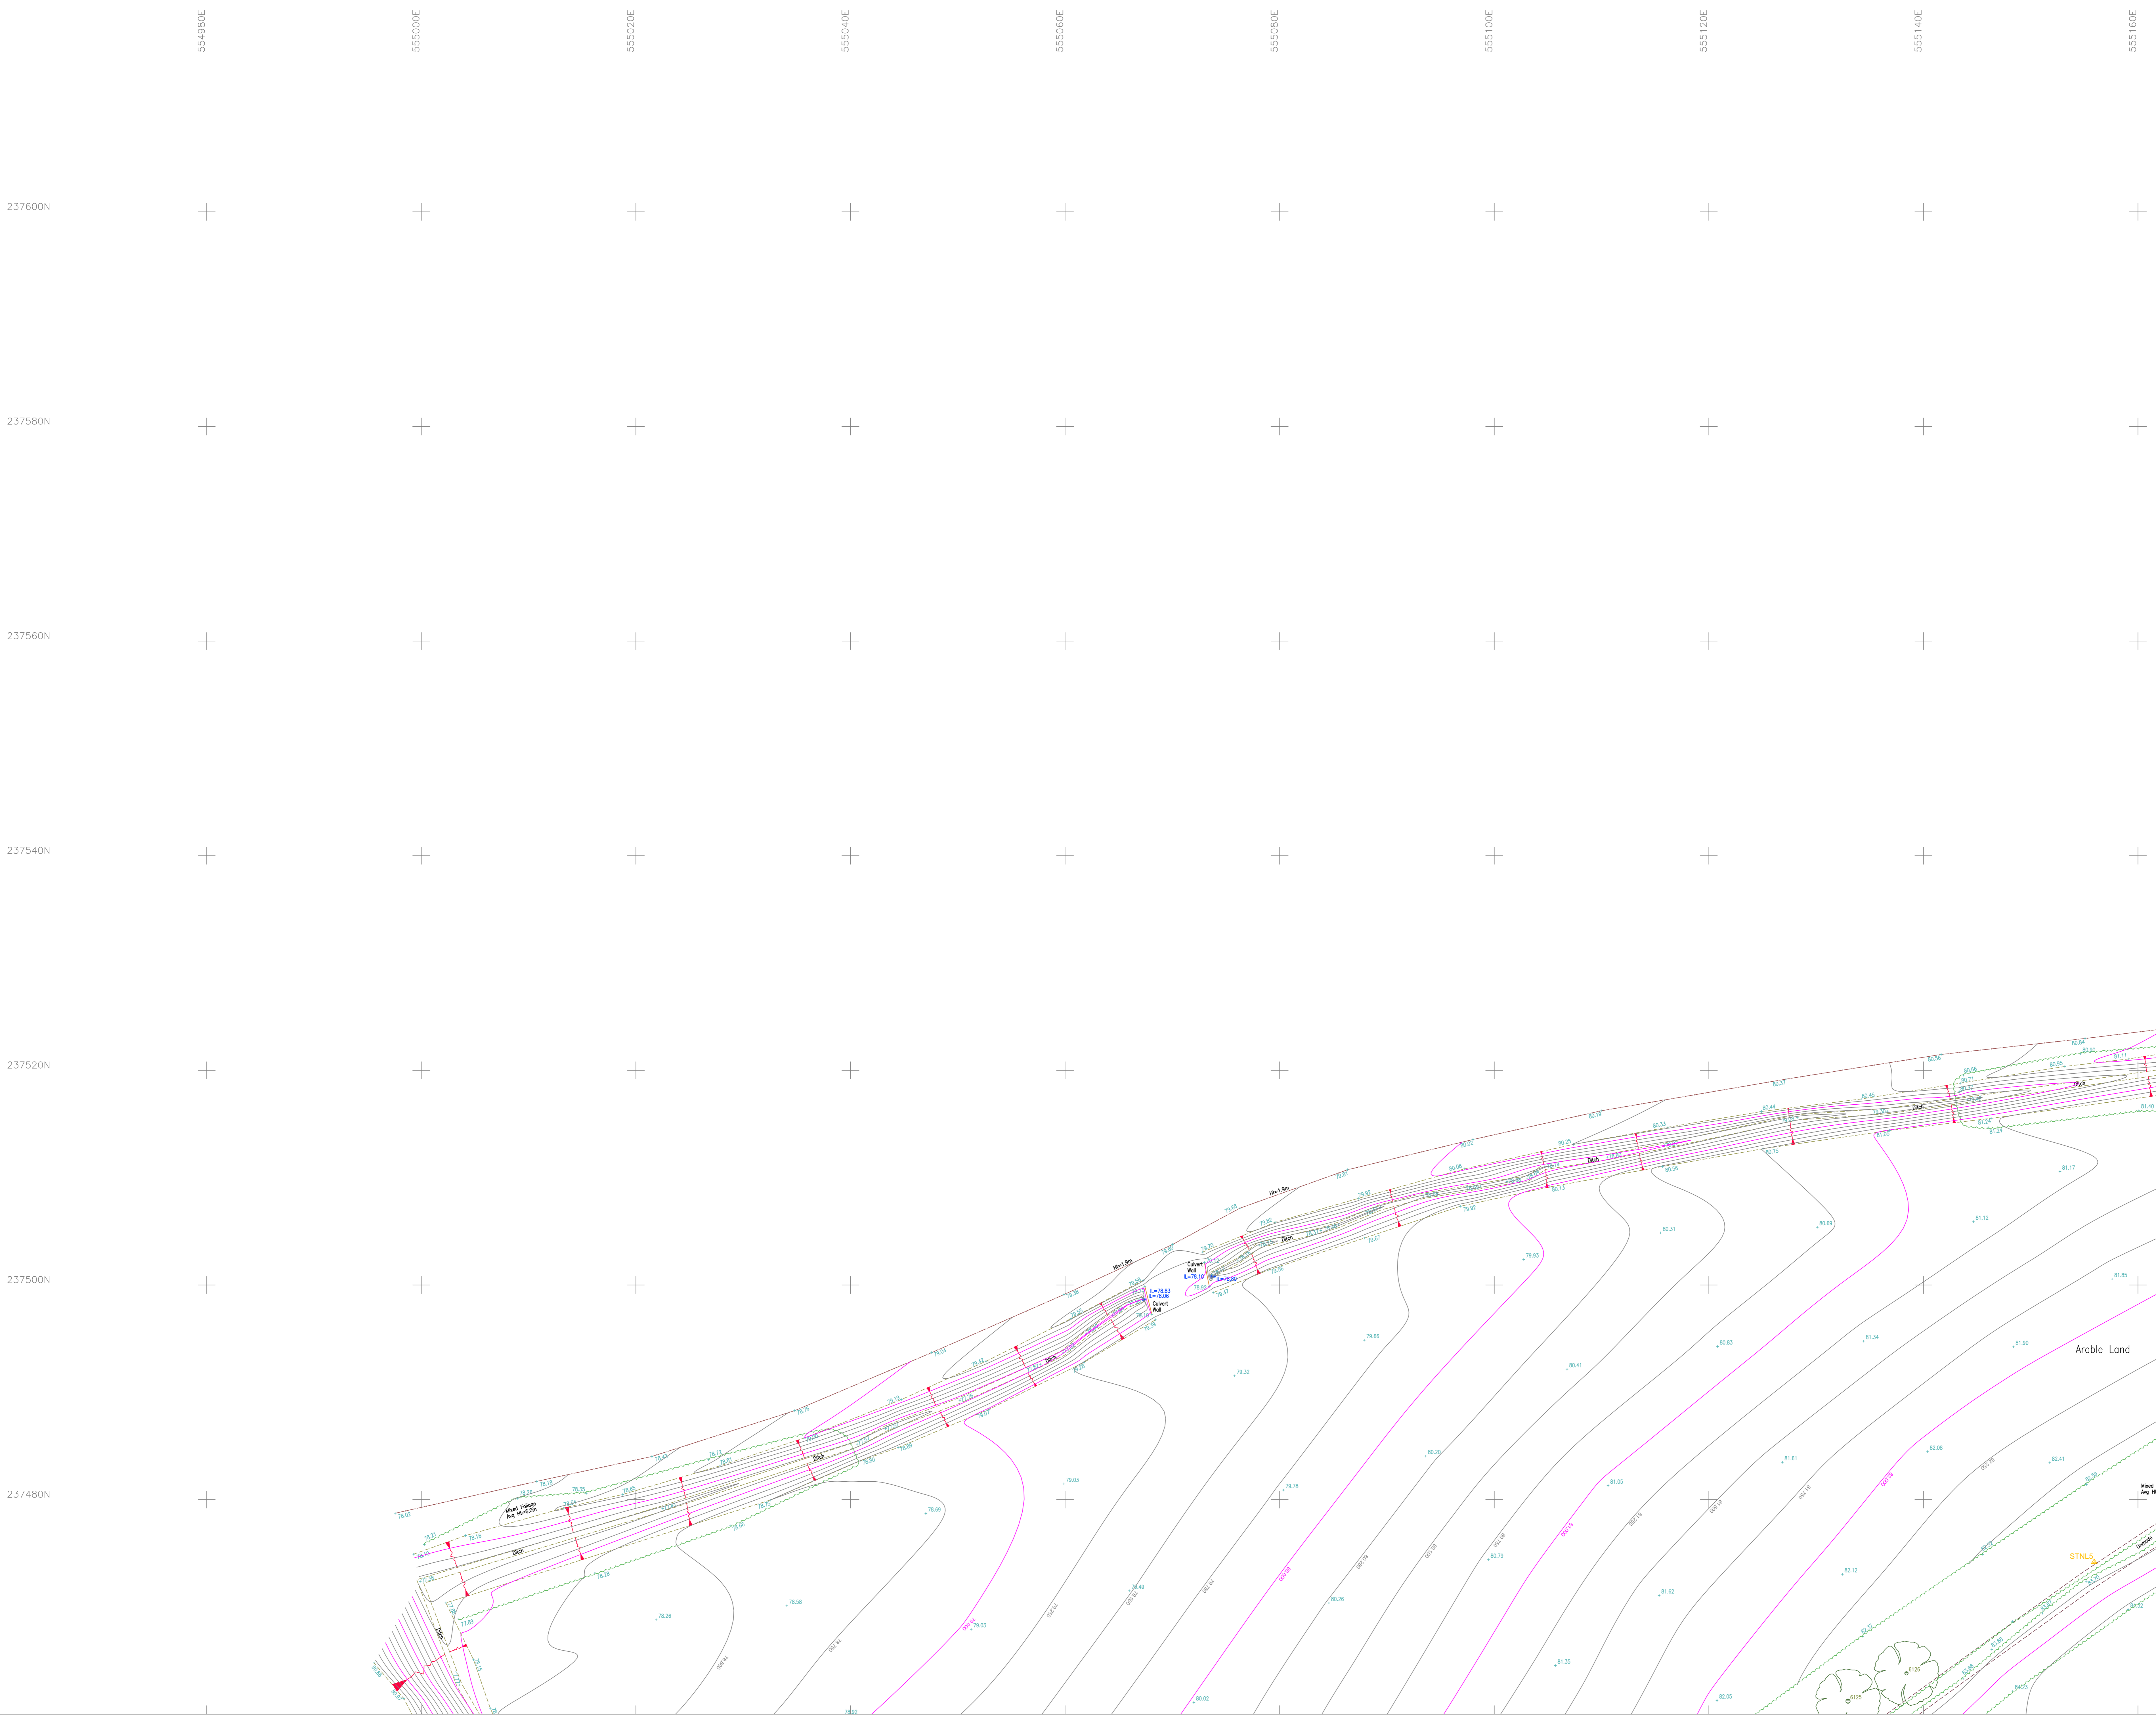


Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

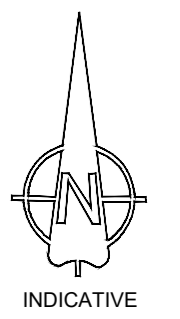

Legend:

Fence	Subsidence	Fence	Water
Walls	Overhead Cable	Overhead Cable	Overhead Cable
Hedges	Overhead Phone	Overhead Phone	Overhead Phone
Trees	Gate	Gate	Gate

Abbreviations:
 SOLAR, CONCRETE, BRICK, ASPHALT, GRASS, etc.

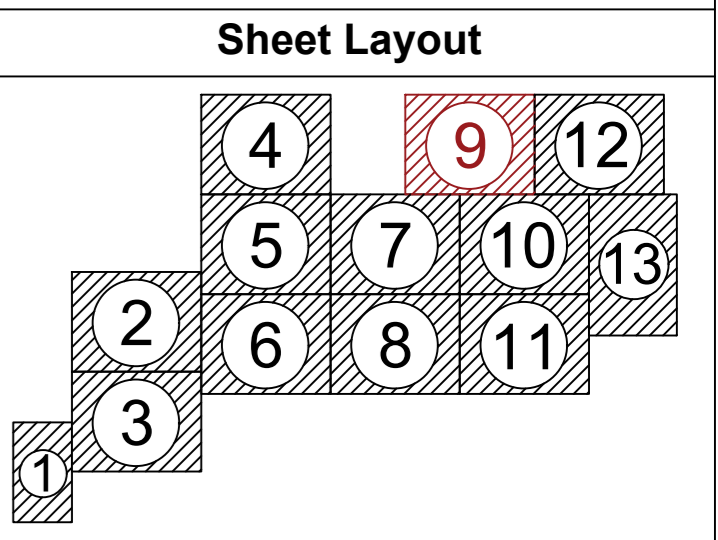

Rev. Suffix	Date	Initial	Revision Details

Surveyed by: JH, LHM, CAD Operator
 Approved by: AP, AL, Date: 07.04.22
 Levelling: GNSS Datum: OSGB36
 To an OS GNSS Datum




Client:
 Thaxted Road
 Saffron Walden


Drawing Title:
 Topographical Survey
 Sheet 9 of 13

Job No. 2203015	Old Job No.
Drawing Number MTP/2203015/9	Revision Suffix
Scale 1:200m (A0)	Date April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTRE - STABLE 1
 FORDBRIDGE ROAD, SUNBURY-ON-THAMES, MIDDLESEX, TW16 6AX
 Tel: (01932) 761196
 Fax: (01932) 766419
 Email: mail@cdsurveys.com
 Visit us at: www.cdsurveys.com

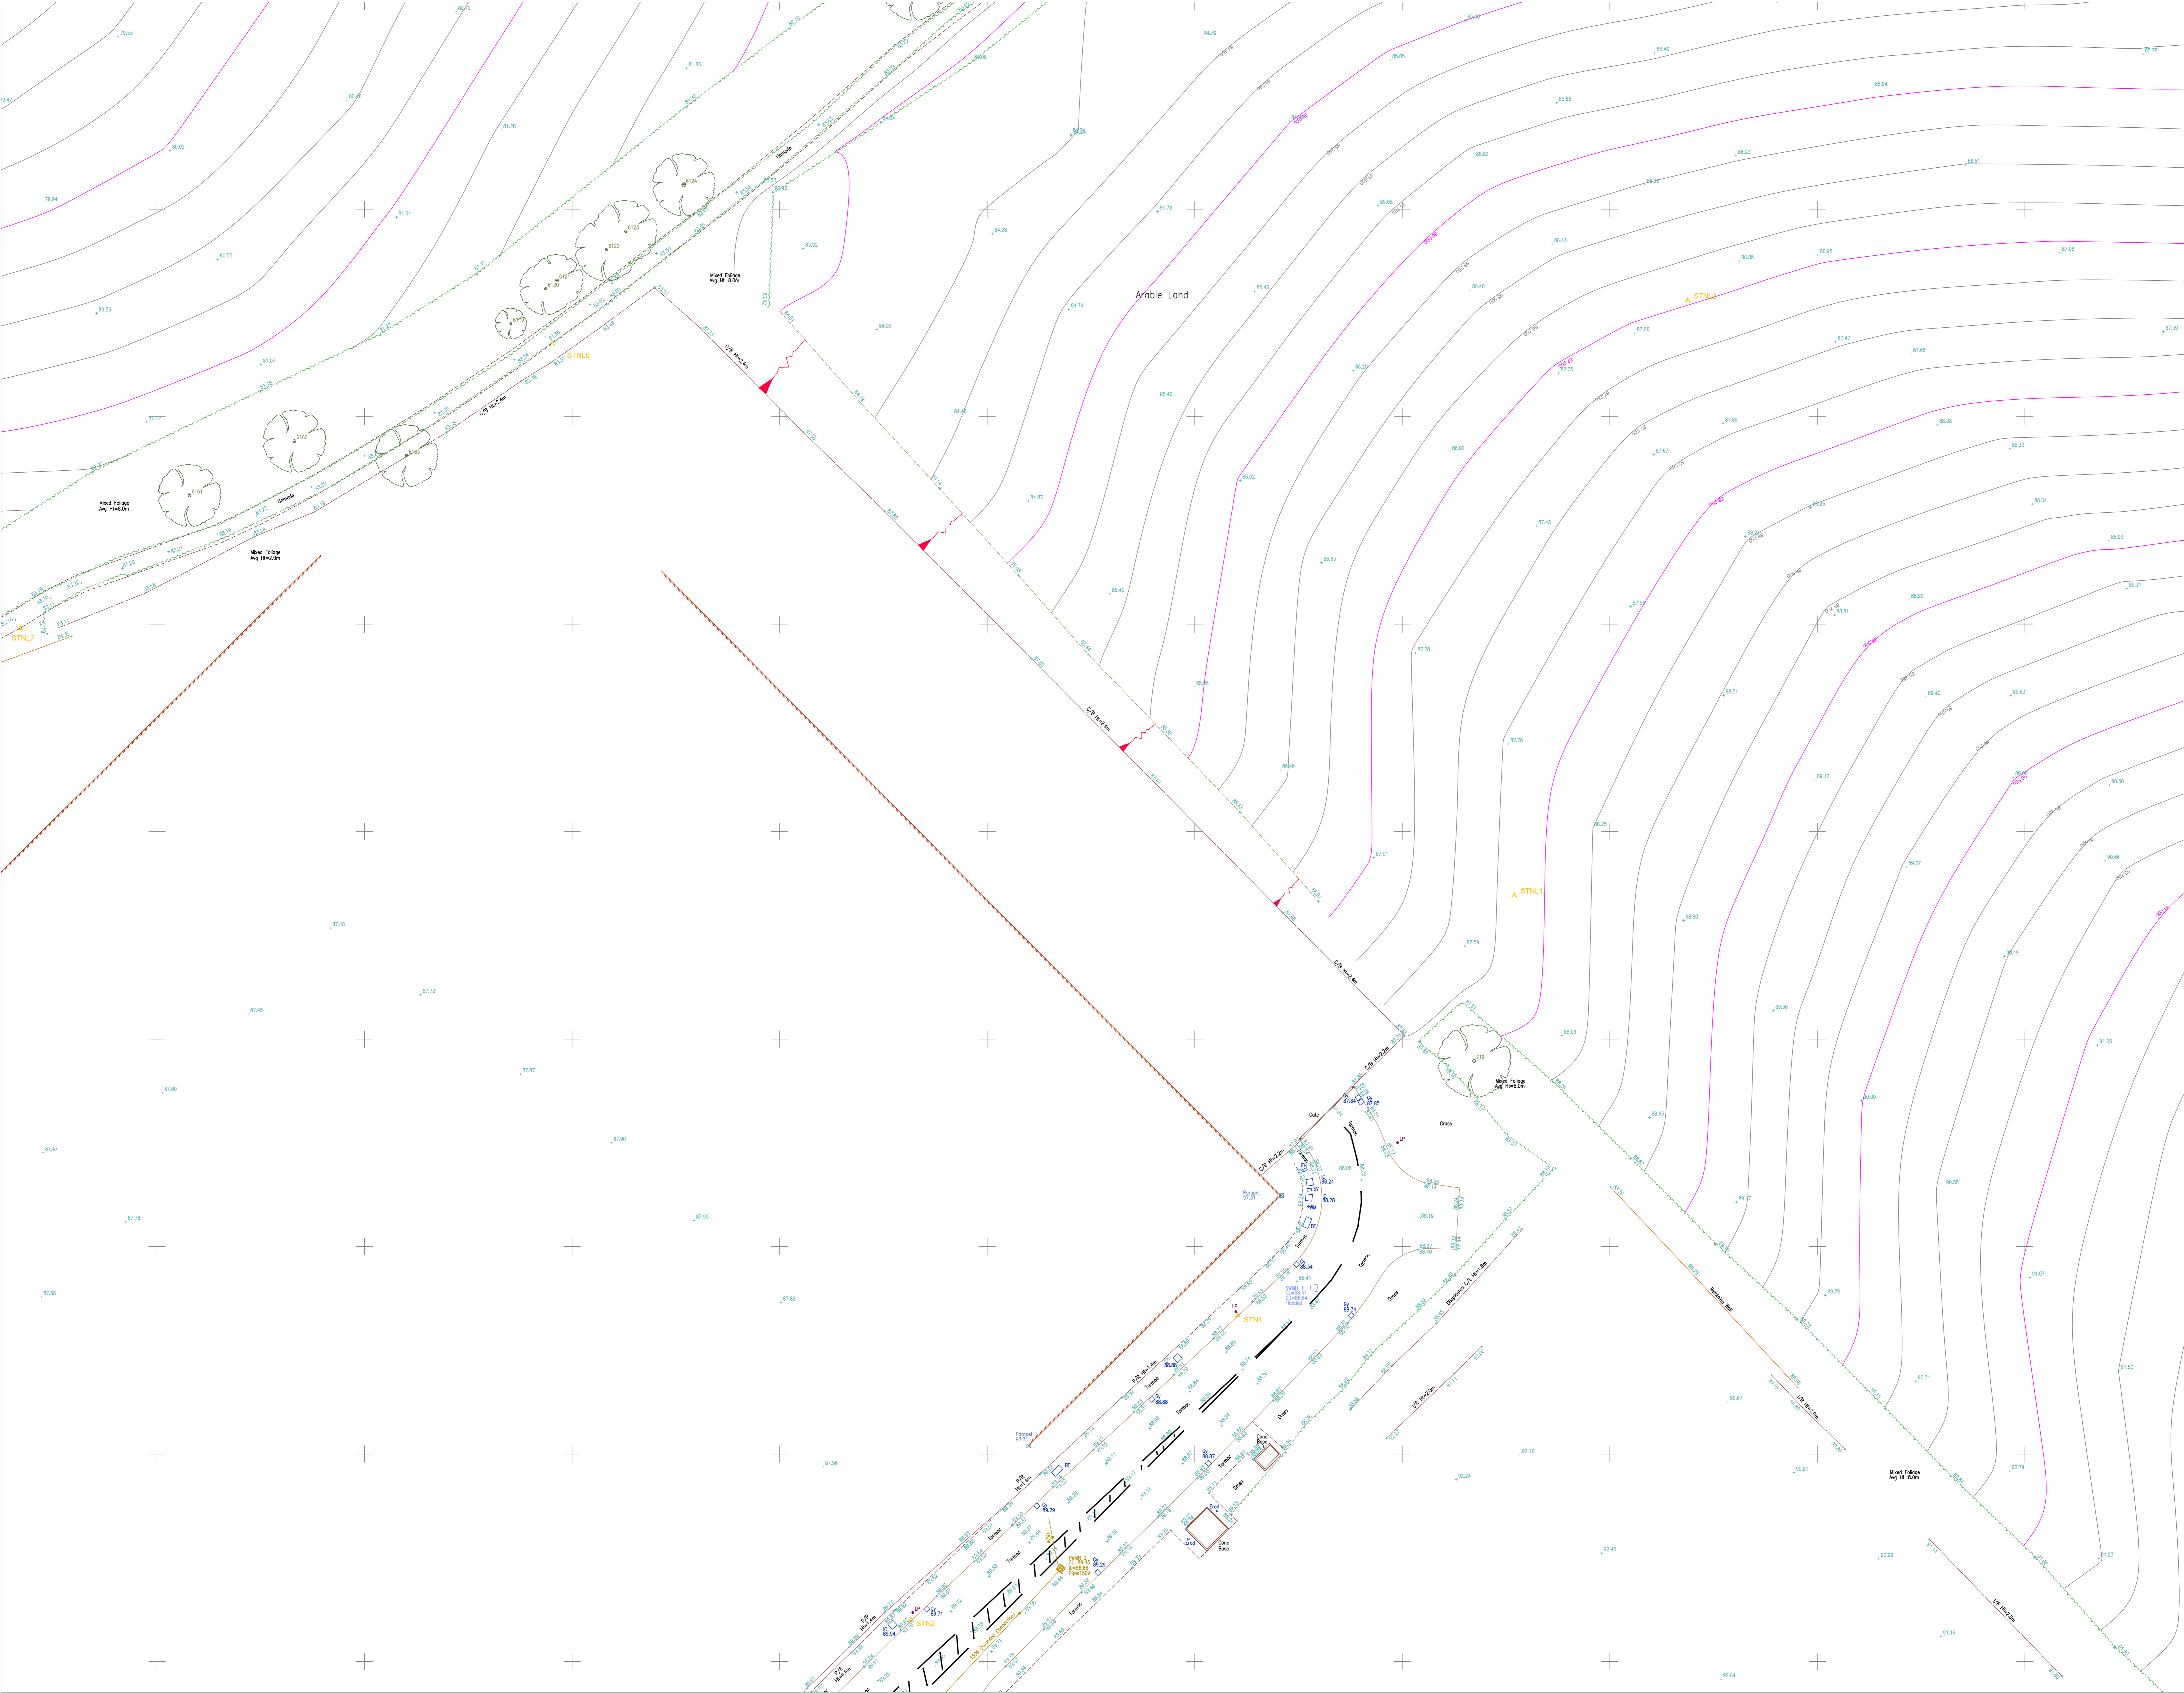


Notes:
 Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arboriculturist be consulted before any final decisions are made.
 All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.
 Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.
 Contours only shown across open spaces.
 2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.
 Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

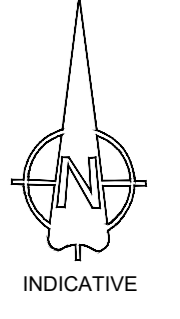

Legend:

Fence	Boundary	Fence
Overhead Cable	Overhead Cable	Overhead Cable
Hedge	Overhead Pipe	Overhead Pipe
Tree	Gate	Gate

Abbreviations:
 BOUND: BOUNDARY
 CONC: CONCRETE
 CORR: CORROSION
 DRAIN: DRAINAGE
 ELEV: ELEVATION
 FENCE: FENCE
 GATE: GATE
 GRASS: GRASS
 HEDGE: HEDGE
 INFRA: INFRASTRUCTURE
 LAND: LAND
 MANHOLE: MANHOLE
 PATH: PATH
 PIPE: PIPE
 ROAD: ROAD
 ROADWAY: ROADWAY
 SIGN: SIGN
 SURFACE: SURFACE
 TOWER: TOWER
 UTILITY: UTILITY
 WALL: WALL
 WIND: WIND

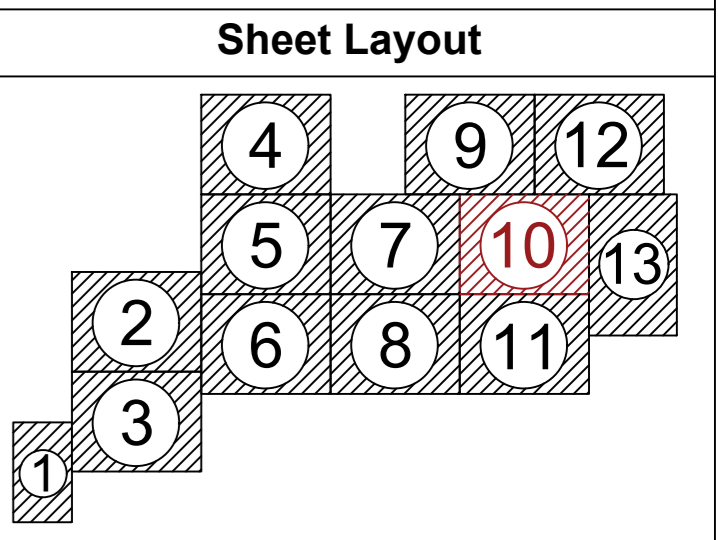

Rev. Suffix	Date	Initial	Revision Details

To an OS GNSS Datum


Client

Location
 Thaxted Road
 Saffron Walden

Drawing Title
**Topographical Survey
 Sheet 10 of 13**

Job No. 2203015	Old Job No.
Drawing Number K/2203015/10	Revision Suffix
Scale 1:200m (A0)	Date April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTRE - STABLE 1 Tel: 01932 761196
 FORDBRIDGE ROAD, Fax: 01932 766419
 SUNBURY-ON-THAMES Email: mail@cdsurveys.com
 MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

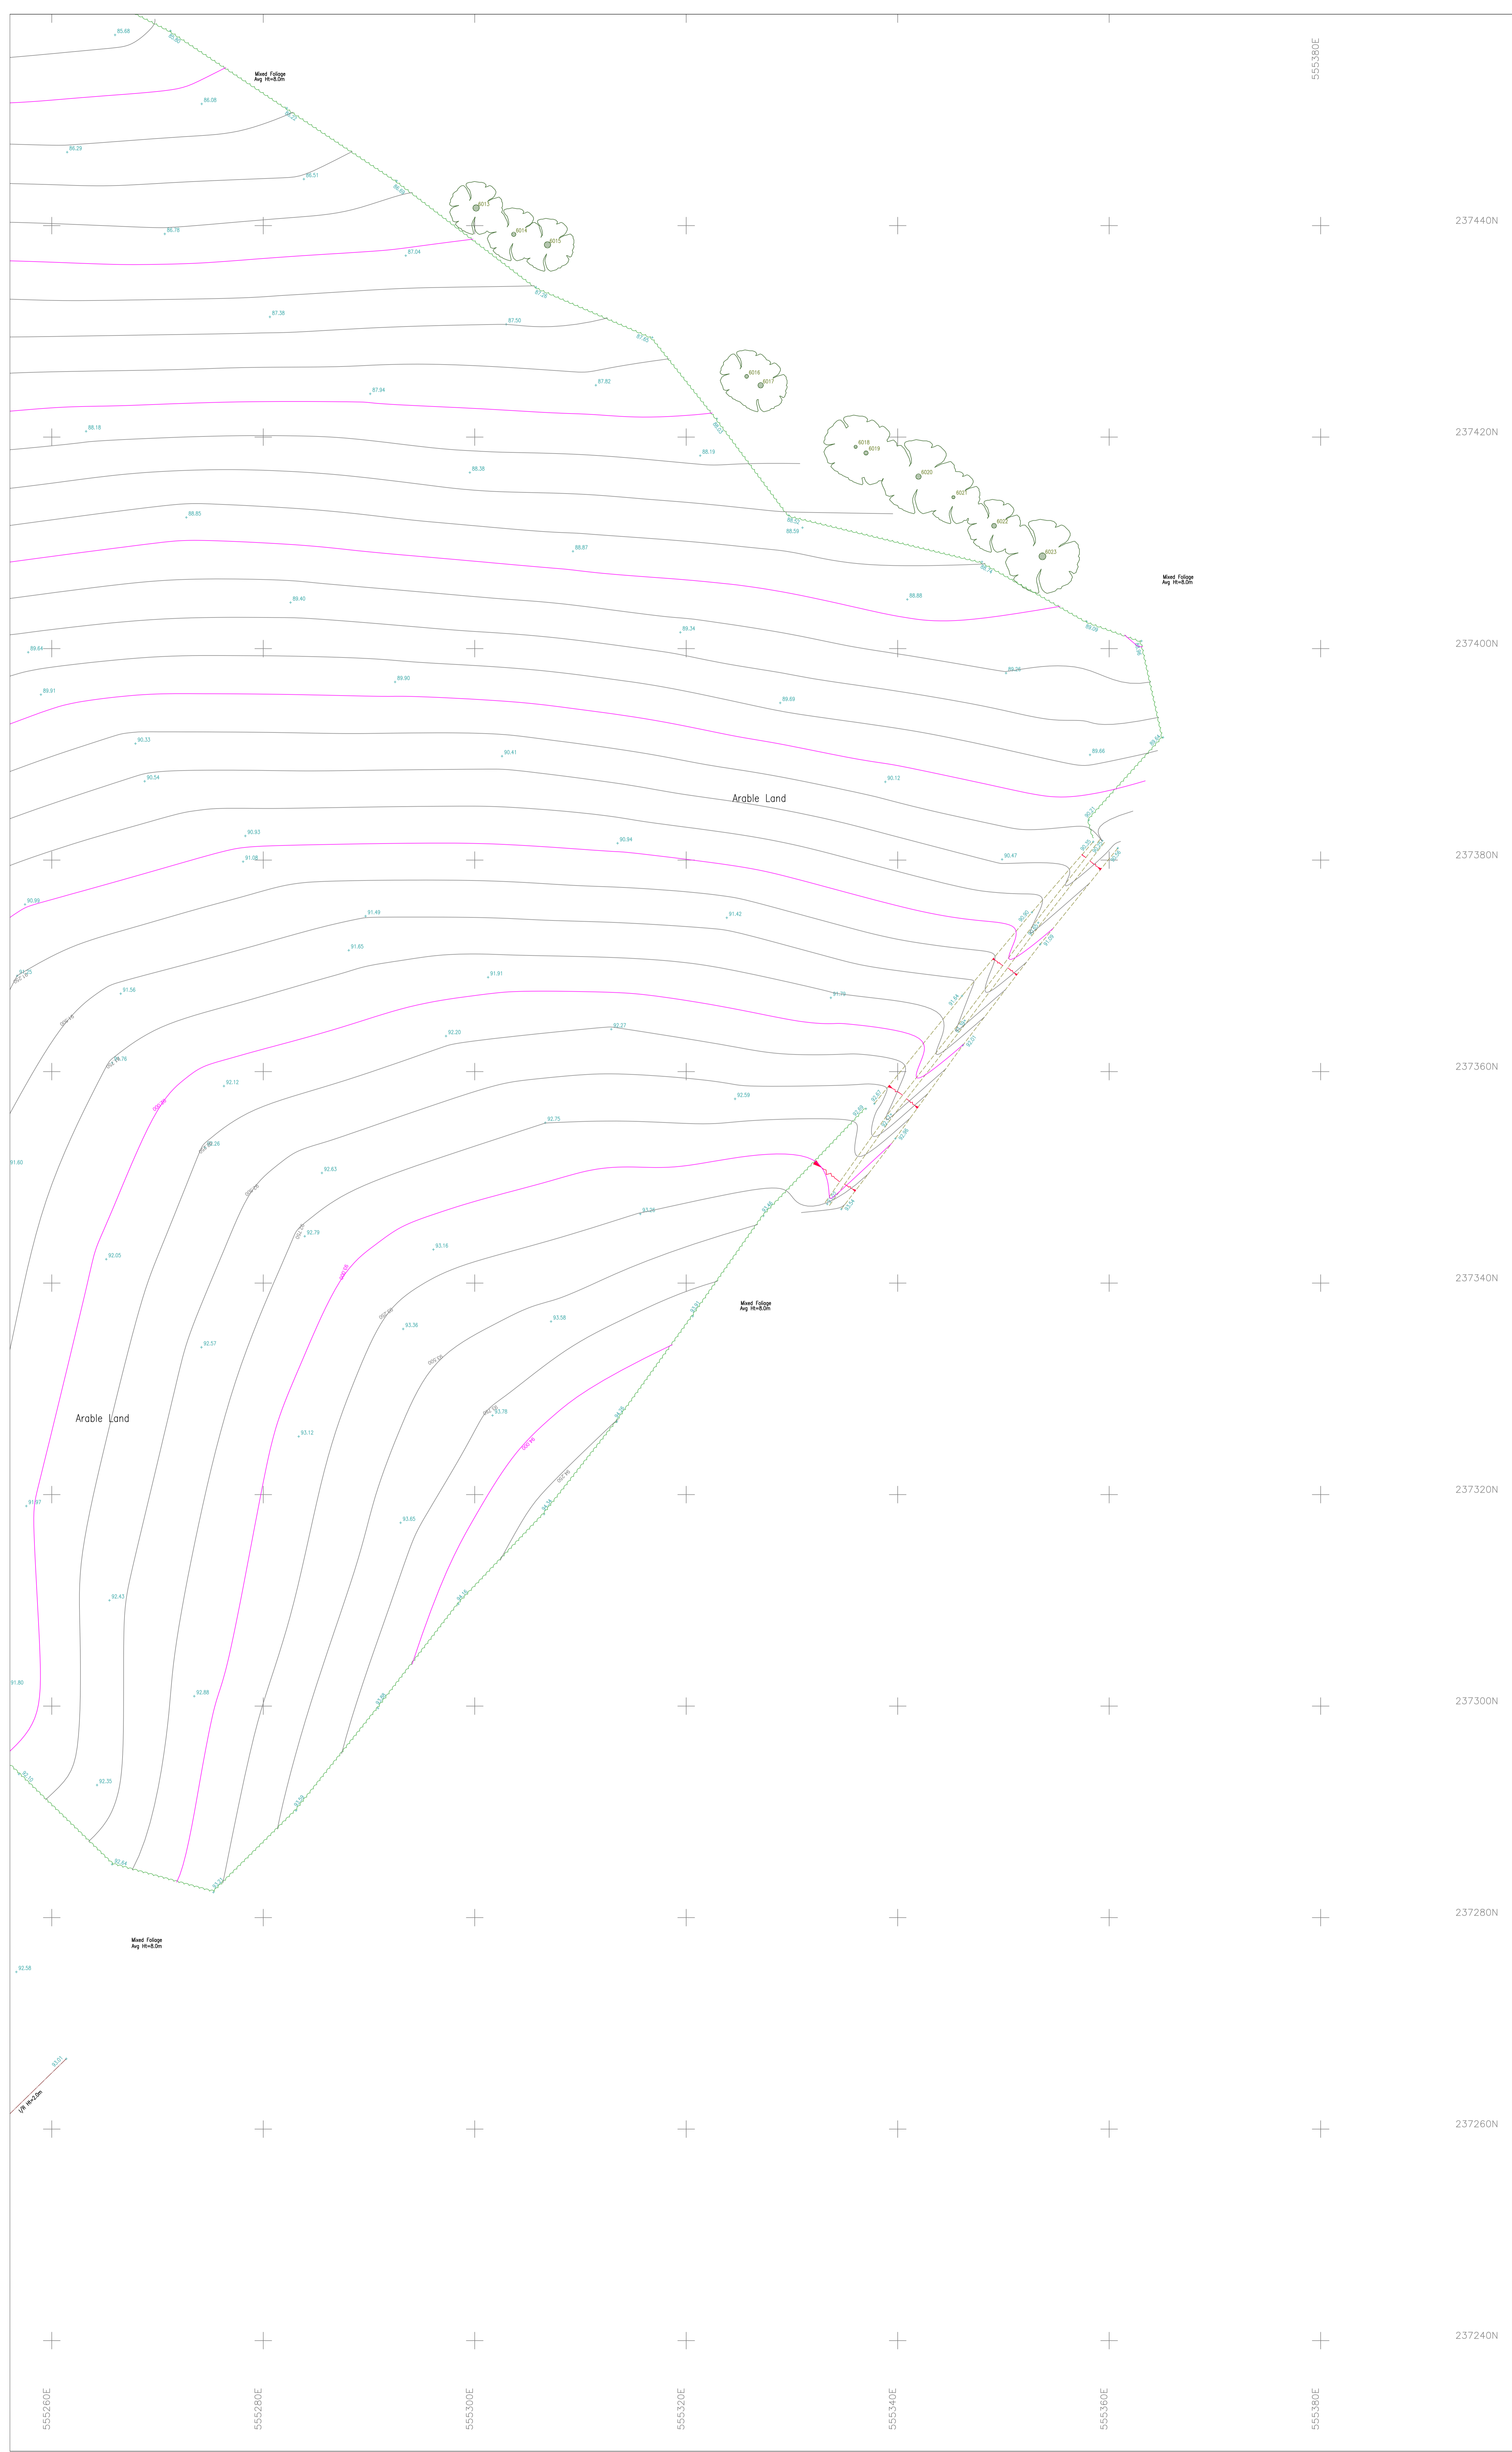

Notes:

Whilst every effort has been made to correctly identify species of trees on the site, we advise that an arborologist be consulted before any final decisions are made.


All information contained in this drawing (including digital data) should be checked and verified prior to any fabrication or construction.

Grid coordinates are based on an OS GNSS system on a plane grid with a scale factor of 1.0000.


Contours only shown across open spaces.

2D survey data may differ slightly to 3D data due to edits made across the drawing within AutoCAD.

Drainage shown should be checked and verified as a high volume of manholes were flooded which proved difficult to establish accurate depths, pipe sizes and to sound connections.

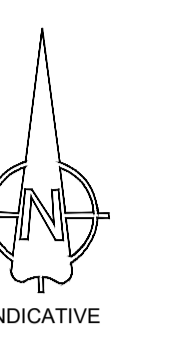

Symbol/Color	Description	Symbol/Color	Description	Symbol/Color	Description	Symbol/Color	Description
[Symbol]	Fences	[Symbol]	Buildings	[Symbol]	Fences	[Symbol]	Overhead Power
[Symbol]	Mile	[Symbol]	Overhead Electric	[Symbol]	Overhead Phone	[Symbol]	Water
[Symbol]	Highway	[Symbol]	Water	[Symbol]	Gate	[Symbol]	Manhole
[Symbol]	Manhole	[Symbol]	Manhole	[Symbol]	Manhole	[Symbol]	Manhole

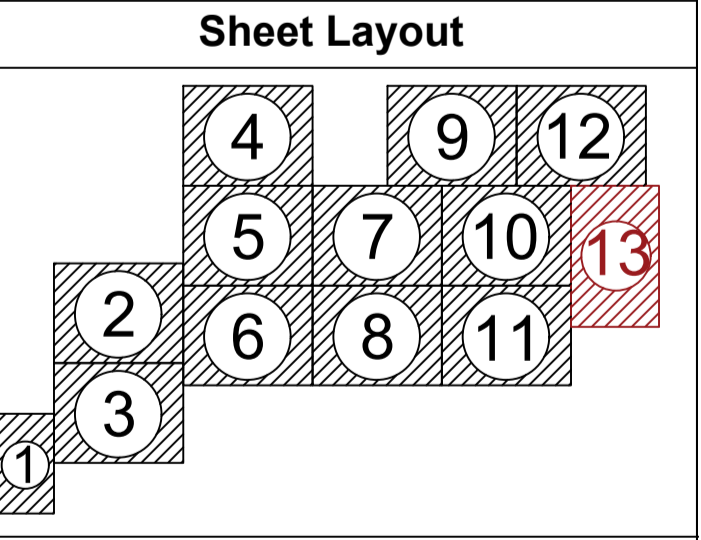

Rev. Suffix	Date	Initial	Revision Details			

Levelling GNSS Datum OSGB36 To an OS GNSS Datum

Client **KIER GROUP**

Location **Thaxted Road Saffron Walden**

Drawing Title **Topographical Survey Sheet 13 of 13**

Job No.	2203015	Old Job No.	
Drawing Number	K/2203015/13	Revision Suffix	
Scale	1:200m (A0)	Date	April 2022

CD SURVEYS LTD
 LAND, BUILDING & SITE ENGINEERING
 PENTIRE - STABLE 1 Tel (01932) 761196
 FORDBRIDGE ROAD, Fax (01932) 786419
 SUNBURY-ON-THAMES Email: mail@cdsurveys.com
 MIDDLESEX, TW16 6AX Visit us at: www.cdsurveys.com

APPENDIX D – INFILTRATION TESTING REPORT



ROLTON GROUP
ENGINEERING THE FUTURE™

Nicholas Sommerville
Kier Ventures Ltd
Optimum House
Clippers Quay
Salfrod
England
M50 3XP

21st October 2022
Our Ref: 220222-RGL-ZZ-XX-CO-Z-0004

Via email – [REDACTED]

Dear Nicholas,

SOAKAWAY TESTING AT LAND OFF THAXTED ROAD, SAFFRON WALDEN, CAMBRIDGESHIRE

1.0 INTRODUCTION

Kier Ventures (the Client) propose to develop a parcel of land in Saffron Walden, Cambridgeshire. It is understood that current proposals are to develop the site with approx. 150-180 residential properties consisting of apartments, terraced, semi-detached and detached dwellings with associated access roads, gardens and areas of Public Open Space (POS). The following briefly summarises the likely development:

- A residential housing development with new roads and areas of POS
- Access to the development will be off Thaxted Road via a newly created opening that will be required to meet highways standards
- Some localised re-profiling of the site levels would likely be required for the planned development.

The purpose of this investigation was to establish the ground conditions, complete soakaway tests in general accordance with BRE 365 and provide comments.

Previous reports for the site include Rolton Group (RG) a Phase I contaminated land desk study, ref. 220222-RGL-ZZ-XX-RP-G-0001, October 2022, that should be read in conjunction with this report.

2.0 SITE DETAILS

The site is situated to the west of Thaxted Road, approximately 1km south of Saffron Walden town centre in a semi-rural area. The site is irregular in shape, centered at national grid reference 554715, 237307 covering approximately 8.3 hectares. The site measures some 250m north-south and 500m east-west.

The site was currently in use as agricultural land, with a covering of crop stubble. The various site boundaries were marked by mature hedgerows, trees and drainage ditches. Ground levels across the extent of the site varied quite sharply and also feature more local undulations, falling from approximately 103mAOD in the south west to 77mAOD in the north east.

The published British Geological Survey (BGS) map for the area (Sheet 222 'Great Dunmow') and the BGS GeoIndex website show the site to be underlain by superficial deposits of the Lowestoft Formation (diamicton) at the far western extent of the site, and Head at the far eastern extent of the site. Superficial deposits are not shown to be present across the the central portion of the site. The underlying solid geology is indicated to comprise of the undifferentiated Lewes Nodular Chalk Formation and Seaford Chalk Formation of the White Chalk Subgroup.

A site location plan is appended to this report.

3.0 FIELDWORK AND SOAKAWAY TESTING

The locations of investigative positions were selected to target possible locations of proposed attenuation ponds, swales and soakaway locations for dwellings, and available access. Prior to excavation, buried service plans were consulted and a cable avoidance tool (CAT) was used to confirm each location was clear of detectable services.

A total of ten pits were excavated, ref. SA101A, SA101B, SA102 to SA109, between 10th and 12th October 2022. The pits were formed using a backhoe excavator to depths between 0.97mbgl and 3.45mbgl. The excavations were recorded by an RG engineer.

Soil permeability tests were completed in all the pits generally in accordance with BRE Digest DG 365 2016: Soakaway design. The soakaway tests included each pit being partially filled with water, with the subsequent drop in water level measured at regular intervals. Depending on the rate of infiltration, where possible the test was repeated twice more. Water used for the tests was provided with a bowser. Following completion of the tests the trial pit was backfilled.

Trial pit logs and soakaway test records are appended to this report.

4.0 ENCOUNTERED GROUND CONDITIONS AND SOAKAWAY TEST RESULTS

The encountered ground conditions and soakaway test results are summarised and dicussed below.

4.1 ENCOUNTERED GROUND CONDITIONS

The encounterd ground conditions initially comprised topsoil of greyish brown, slightly gravelly, clayey, organic sand, the gravel fraction being flint, quartzite, brick and chalk, to depths between 0.30mbgl to 0.45mbgl.

The topsoil was underlain by Head or the Lowestoft Formation that comprised firm or stiff, brown or light brown and locally bluish grey and greyish brown, variably sandy and gravelly, locally silty, clay with localised sand leses; the gravel comprised angular to rounded flint, quartzite, chalk, sandstone. Pits SA101B and SA107 were completed in the superficial deposits at depths of 0.97m and 2.85m respectively. In the remaining pits these strata were proved to depths between 0.80mbgl to 2.45mbgl.

The undifferentiated Lewes Nodular Chalk Formation and Seaford Chalk Formation solid geology was encountered beneath the Head deposits and initially comprised structurless chalk composed of gravelly, slightly sandy silt with occasional flint gravel (CIRIA C574 Grade Dm). Below between 2.80m and 3.20m in pits SA104 and SA105 the structureless chalk was composed of slightly sandy, silty chalk gravel (Grade Dc). The pits were completed in the chalk at depths between 2.58mbgl to 3.45mbgl.

The pits remained dry during excavation and their sides were stable.

4.2 SOAKAWAY TEST RESULTS

The results for the soakaway tests are summarised in Table 1 and discussed below.

LOCATION	STRATA TESTED	INFILTRATION RATE (M/S)		
		CYCLE 1	CYCLE 2	CYCLE 3
SA101A	Chalk	Insufficient soakage.		
SA101B	Head	5.07×10^{-5}	1.53×10^{-5}	-
SA102	Chalk	4.22×10^{-5}	2.58×10^{-5}	-
SA103	Chalk	6.89×10^{-6}	-	-
SA104	Chalk	8.08×10^{-5}	6.13×10^{-5}	6.09×10^{-5}
SA105	Head and chalk	3.76×10^{-5}	3.36×10^{-5}	-
SA106	Chalk	5.45×10^{-6}	-	-
SA107	Lowestoft Formation	Insufficient soakage.		
SA108	Chalk	Insufficient soakage.		
SA109	Chalk	1.19×10^{-5}	-	-

Table 1. Summary of Soakaway Test Results

In summary, the tests indicated an infiltration rate of between 5.1×10^{-5} m/s and 1.5×10^{-5} m/s for Head where tested at a single location, and for chalk a rate between 8.1×10^{-5} m/s and 5.5×10^{-6} m/s or locally the infiltration was too slow to allow a rate to be calculated, expected to be where the chalk was weathered to a silt. At the single location where tested, the infiltration rate was too slow to allow a rate to be calculated for the Lowestoft Formation.

Based on the rest results, a conservative rate of infiltration of 5×10^{-6} m/s for chalk may be adopted for soakaway design, however, this rate is likely to increase to 10^{-5} m/s when deepened into the predominantly gravel chalk (Grade Dc).

Once soakaway locations are confirmed it is recommended that additional testing be completed to confirm the soil infiltration rate is as, or better than, that assumed in design. Additional soakaway testing should be completed to confirm the infiltration rate for Head deposits. Soakaways in chalk should be positioned at least 10m from foundations or other structure/features and consideration should also be given to the use of silt traps along with interceptors for road and car park run-off. Groundwater levels may vary; consideration may be given to monitoring to confirm groundwater depths will not affect soakaway performance. Additional guidance is provided in BRE 365 and CIRIA C574. It is recommended that the Local Authority be contacted at an early stage to discuss drainage proposals.

Should you have any queries please do not hesitate to contact the undersigned.

Yours sincerely
for and on behalf of Rolton Group Ltd

Martin Gill | Project Engineer

Mob. [REDACTED]

Encs. Site Photographs
Exploratory Hole Location Layout
Infiltration Testing Results



Photo 1 Example of ground conditions in SA105 and view across site.



Photo 2 Pit SA101A : Example of Head deposit.





Photo 3 Pit SA107 : Example of Lowestoft Formation.

Standard construction hazards that a competent contractor would be aware of have not been identified on this drawing. Risks that may not be immediately apparent are listed below:

Status	Date	Description	Dwn Eng	Chkd	Verd
S2-P01	19.10.22	Issued for Information	MG	MG	AC AC

Key

 Denotes location of Rolton Group Soakaway pits in October 2022

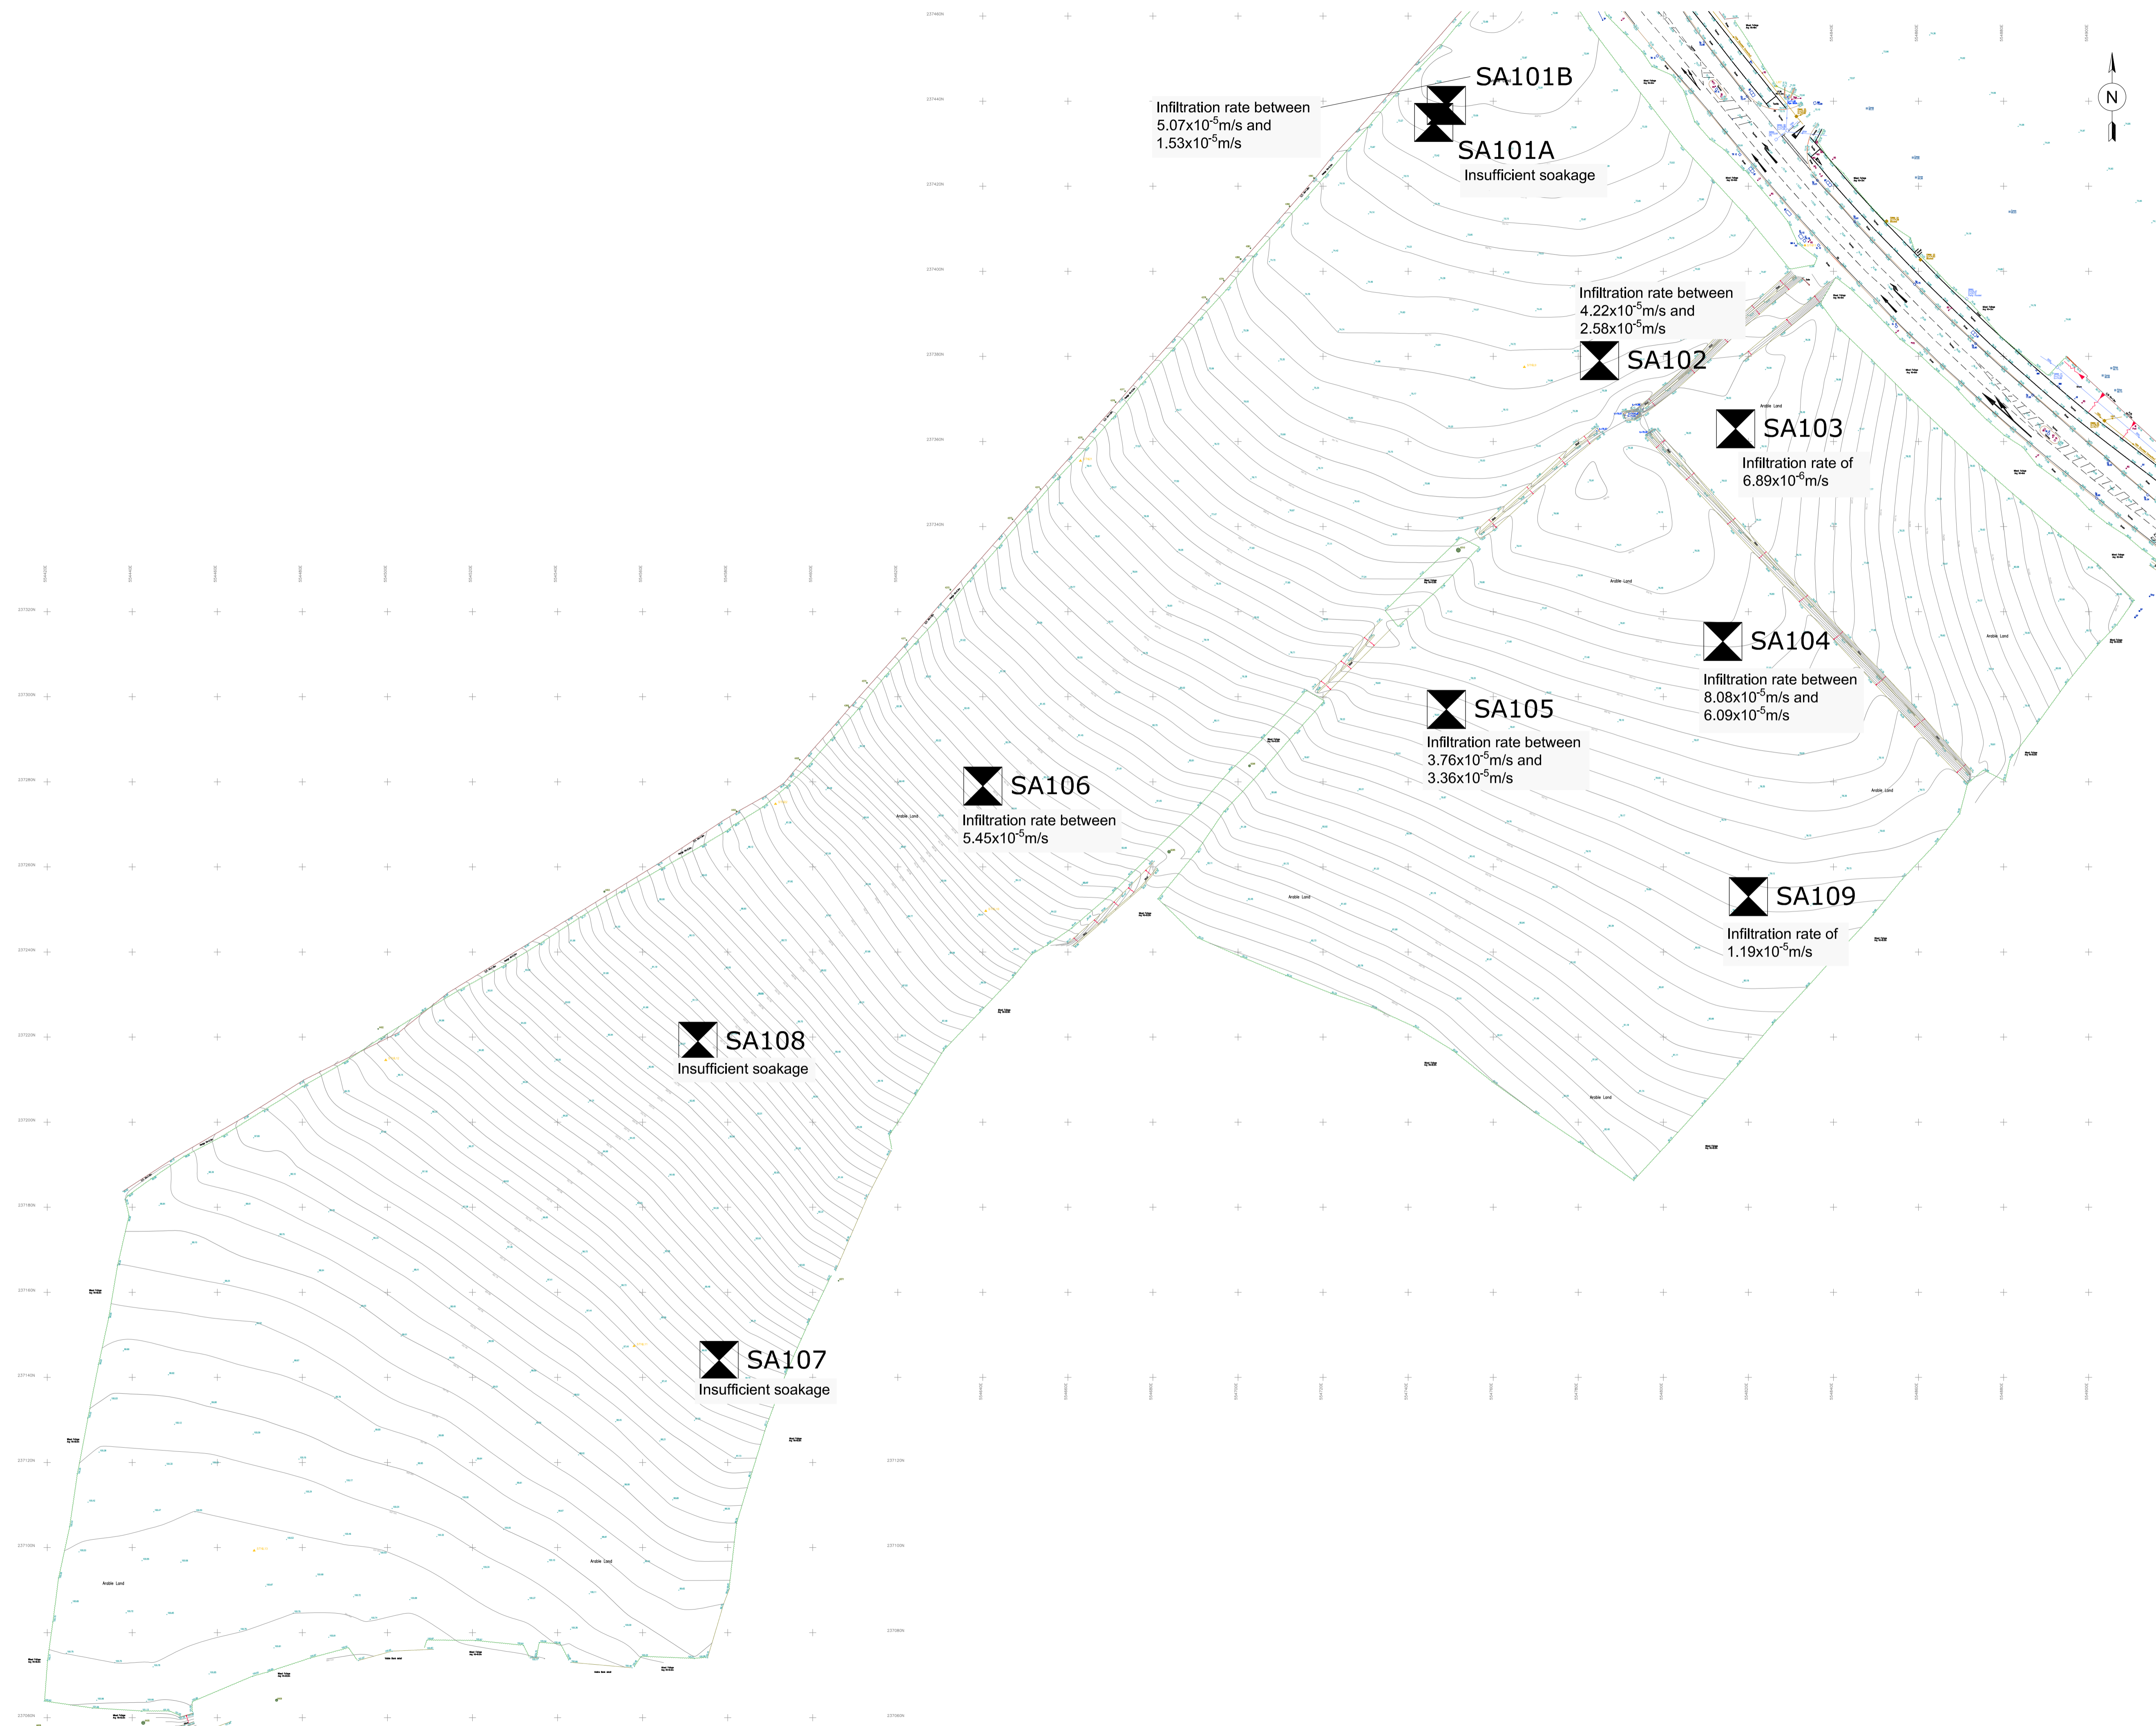

ROLTON GROUP
 ENGINEERING THE FUTURE™
 www.rolton.com 01933 410909

Project:
Kier Ventures Ltd
 Land off Thaxted Road,
 Saffron Walden

Drawing Title:
Exploratory Hole
 Location Layout

RGL Project Ref: 22-0222	Scale@A1 NTS	Scale@A3 NTS
Specification(s):		


Drawing Number: 22-0222-RGL-ZZ-XX-DR-G-900-0001	Status: S2-P01
Project-Originator-Zone-Level-Type-Role-Classification-Number	Subsidiary-Revision
Issue Purpose: INFORMATION	

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0001

Trial Pit Width Length Depth to Base
Dimensions (m) 0.80 2.90 3.02

Test Date 10/10/2022
Soakaway No. SA101A - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

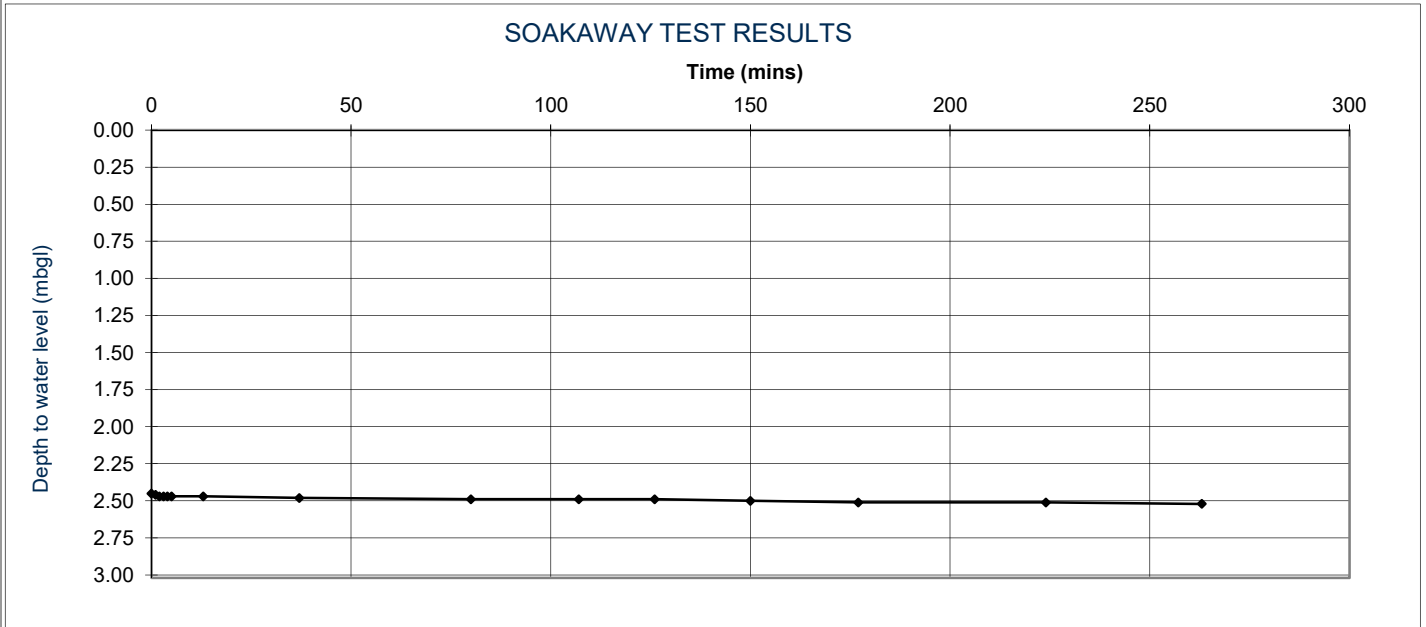

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.6612 m³
 ap50 = 4.429 m²
 tp75-25 = N/A min

General Geological Profile :

0.00 - 0.40	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.40 - 2.30	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
2.30 - 3.02	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)

Infiltration rate was insufficient to be calculated in accordance with BRE 365 (2016).


Soil Infiltration Rate (f) =	N/A	m/s	Permeability Guideline (m/s)		
			Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0002

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 1.90 0.97

Test Date 10/10/2022
Soakaway No. SA101B - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

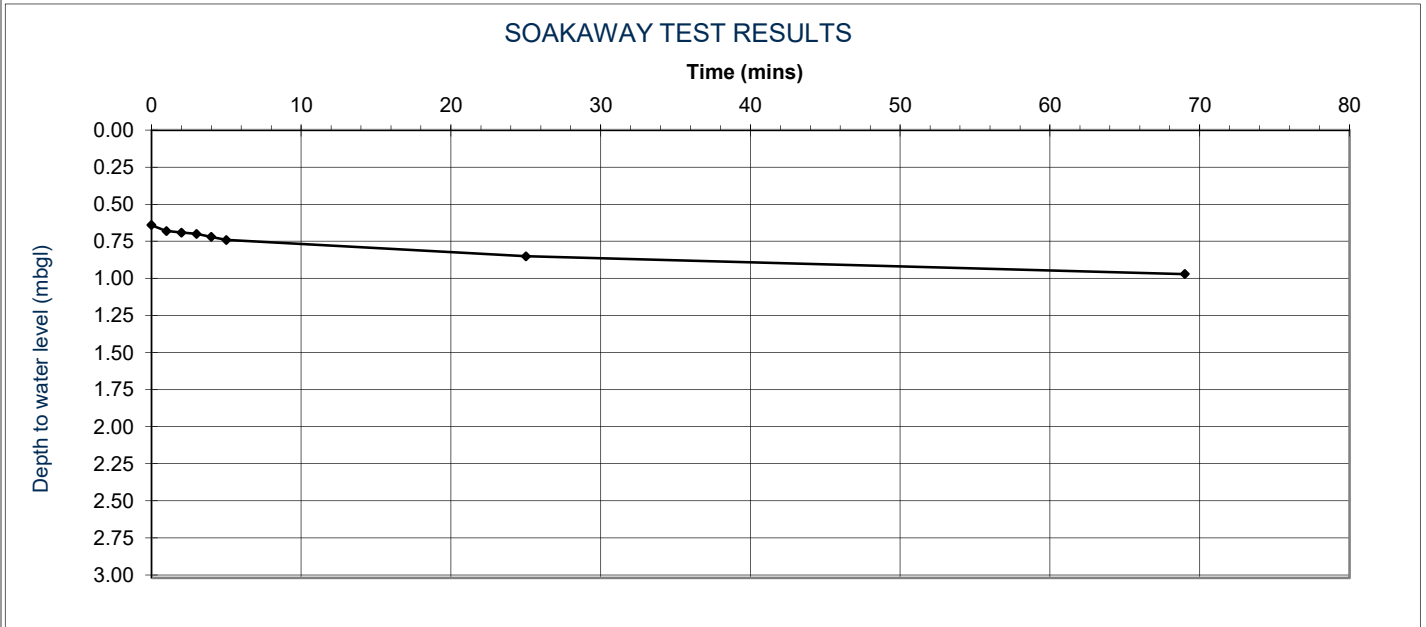

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

VP75-25 = 0.21945 m³
ap50 = 2.188 m²
tp75-25 = 33.0 min

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.
ap50 = Mean surface area through which the outflow occurs.
tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

General Geological Profile :

0.00 - 0.45 [Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)

0.45 - 0.97 Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)


Soil Infiltration Rate (f) = 5.07E-05 m/s	Permeability Guideline (m/s)	
	Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷
Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰		

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0003

Trial Pit Dimensions (m) Width Length Depth to Base
 0.70 1.90 0.97

Test Date 10/10/2022
 Soakaway No. SA101B - Cycle 2

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

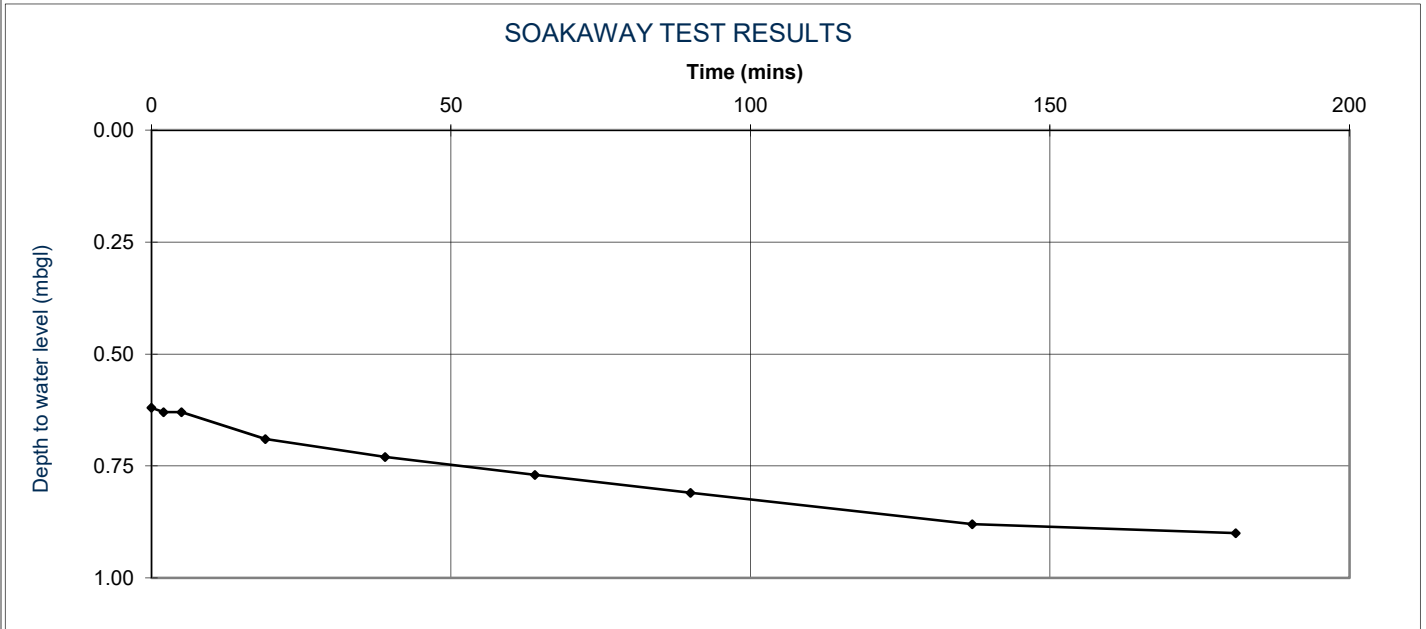

--	--	--	--	--	--	--	--	--	--

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.23275 m³
 ap50 = 2.24 m²
 tp75-25 = N/A min

General Geological Profile :

- 0.00 - 0.45 [Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
- 0.45 - 0.97 Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)


Soil Infiltration Rate (f) = 1.53E-05 m/s	Permeability Guideline (m/s)		
	Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0004

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.50 2.92

Test Date 10/10/2022
Soakaway No. SA102 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

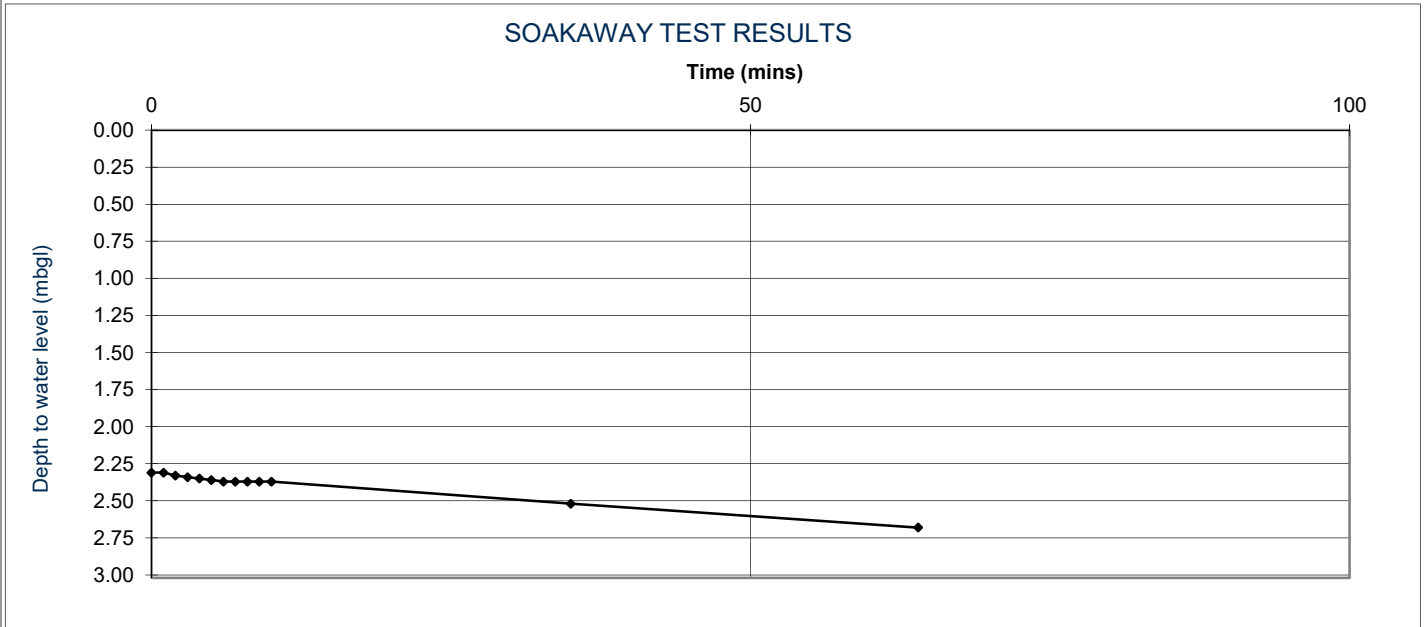

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

VP75-25 = 0.53375 m³
ap50 = 3.702 m²
tp75-25 = 57.0 min

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.
ap50 = Mean surface area through which the outflow occurs.
tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

General Geological Profile :

- 0.00 - 0.30 [Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
- 0.30 - 1.50 Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
- 1.50 - 2.92 Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)

Infiltration rate was extrapolated based on a constant rate of dissipation


Soil Infiltration Rate (f) =	4.22E-05 m/s	Permeability Guideline (m/s)		
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0005

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.50 2.92

Test Date 10/10/2022
Soakaway No. SA102 - Cycle 2

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

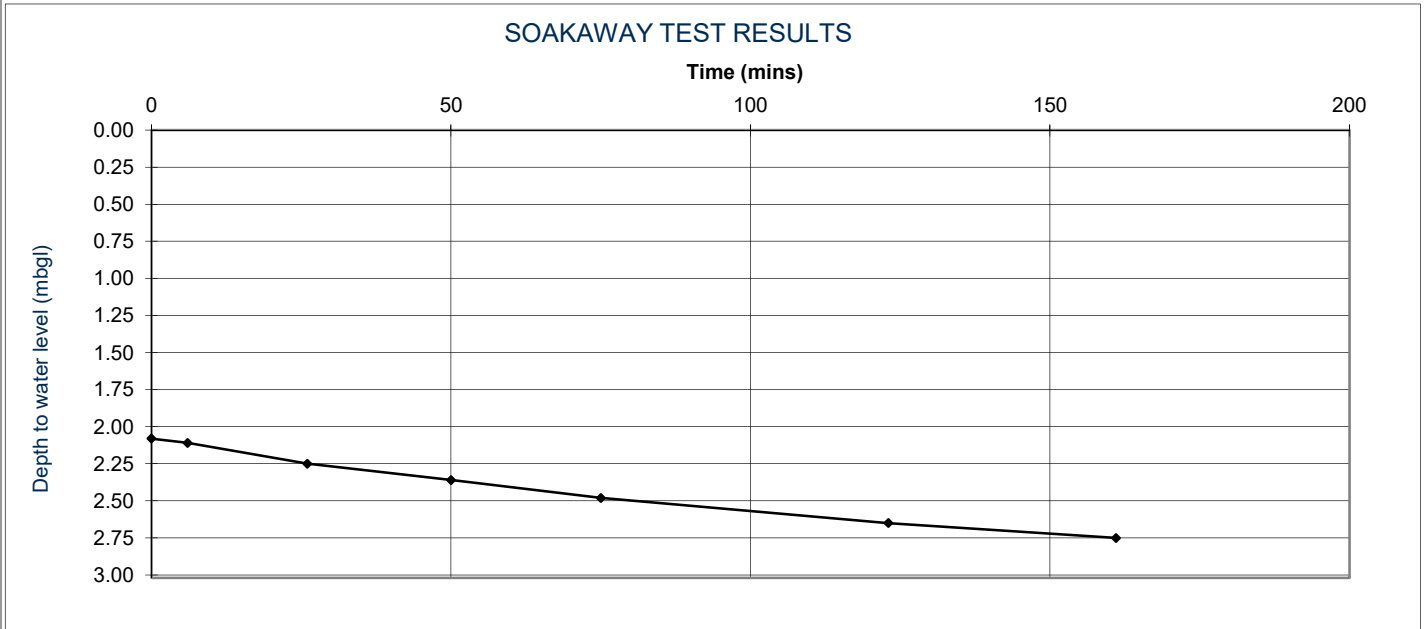

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

VP75-25 = 0.735 m³
ap50 = 4.438 m²
tp75-25 = 107.0 min

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.
ap50 = Mean surface area through which the outflow occurs.
tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

General Geological Profile :


- 0.00 - 0.30 [Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
- 0.30 - 1.50 Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
- 1.50 - 2.92 Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)

Soil Infiltration Rate (f) =	2.58E-05 m/s	Permeability Guideline (m/s)		
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0006

Trial Pit Width Length Depth to Base Test Date 10/10/2022
 Dimensions (m) 0.70 2.50 3.02 Soakaway No. SA103 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

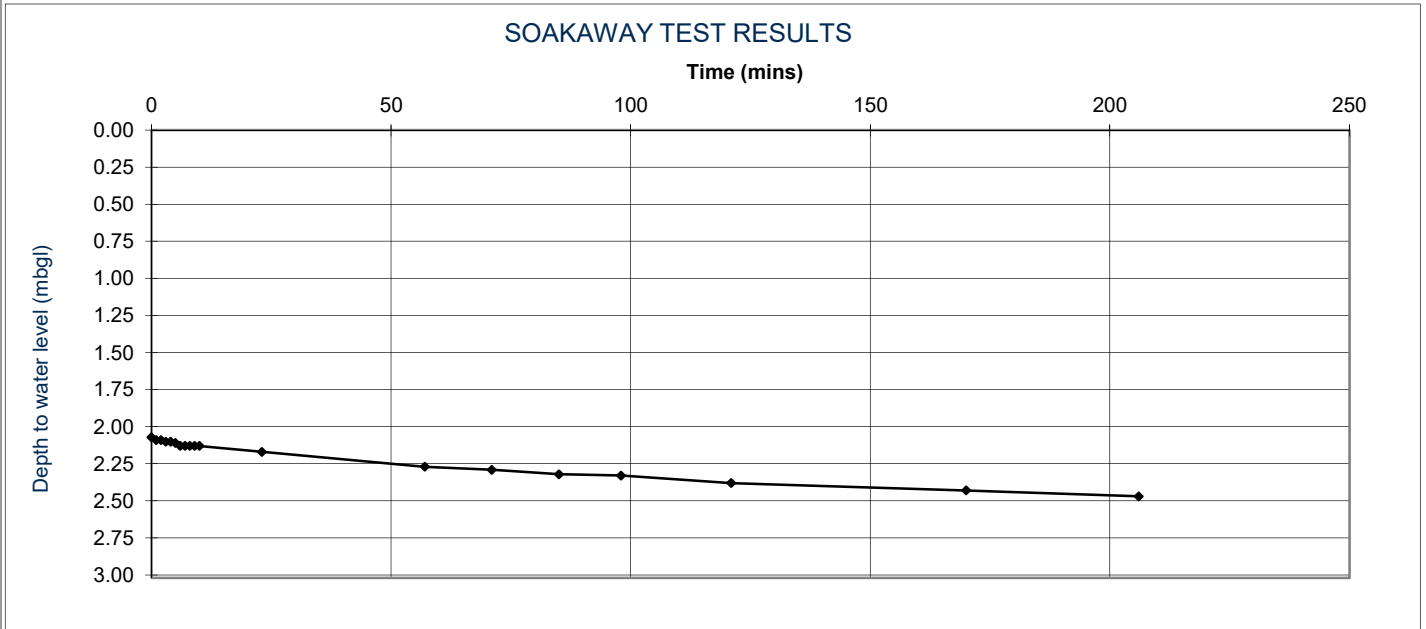

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.83125 m³
 ap50 = 4.79 m²
 tp75-25 = 420.0 min

General Geological Profile :

0.00 - 0.45	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.45 - 1.15	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.15 - 2.60	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.60 - 3.02	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)

Infiltration rate was extrapolated assuming a constant rate of dissipation


Soil Infiltration Rate (f) =	6.89E-06 m/s	Permeability Guideline (m/s)		
		Good	Poor	Practically Impervious
		10 ⁻³ - 10 ⁻⁵	10 ⁻⁶ - 10 ⁻⁷	10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0007

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.40 3.26

Test Date 11/10/2022
Soakaway No. SA104 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

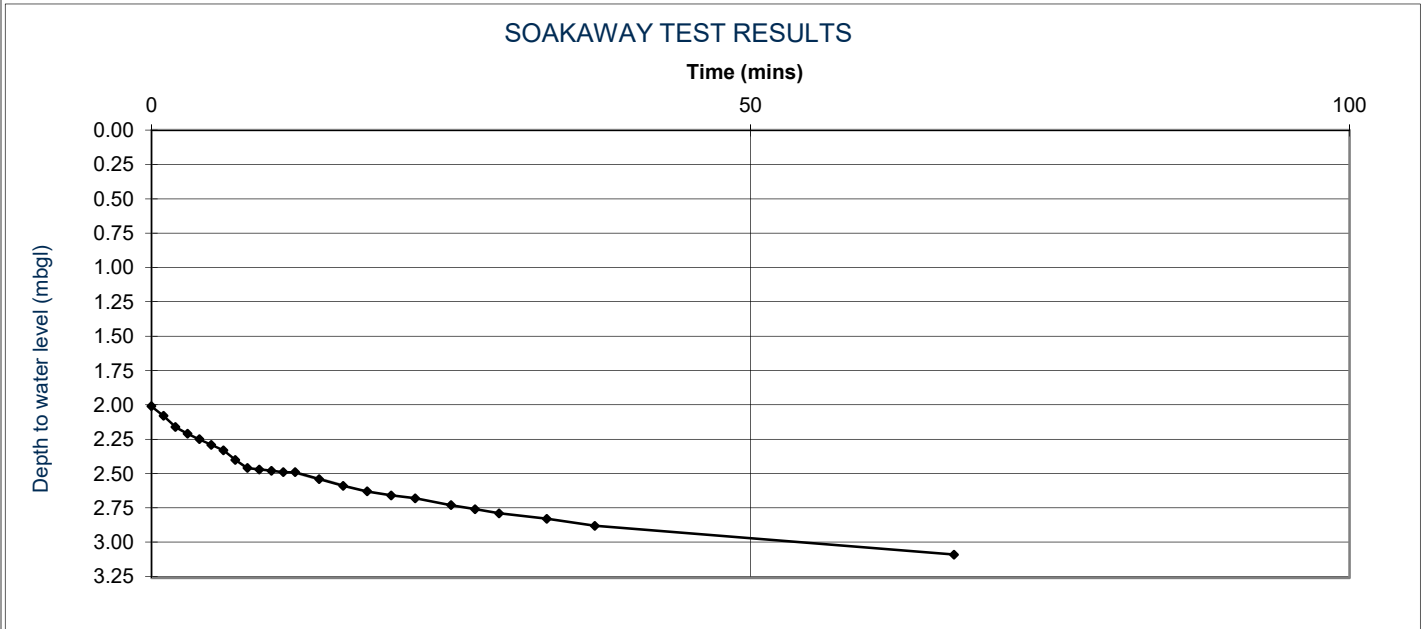

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP75-25}{ap50 \times tp75-25}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 1.05 m³
 ap50 = 5.555 m²
 tp75-25 = 39.0 min

General Geological Profile :


0.00 - 0.35	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.35 - 1.00	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.00 - 2.20	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.20 - 2.80	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.80 - 3.26	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION, GRADE Dc)

Soil Infiltration Rate (f) = 8.08E-05 m/s	Permeability Guideline (m/s)		
	Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0008

Trial Pit Width Length Depth to Base Test Date 11/10/2022
 Dimensions (m) 0.70 2.40 3.26 Soakaway No. SA104 - Cycle 2

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

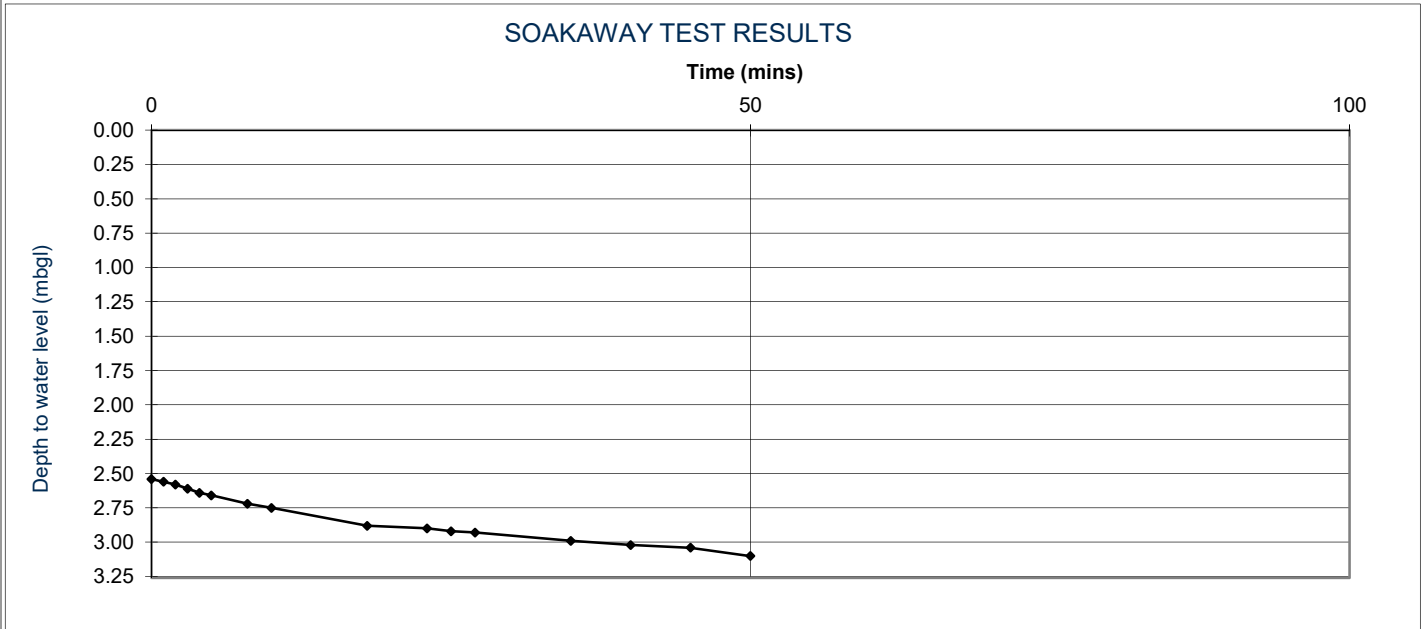

--	--	--	--	--	--	--	--	--	--

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.6048 m³
 ap50 = 3.912 m²
 tp75-25 = 42.0 min

General Geological Profile :

0.00 - 0.35	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.35 - 1.00	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.00 - 2.20	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.20 - 2.80	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.80 - 3.26	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION, GRADE Dc)


Soil Infiltration Rate (f) =	6.13E-05 m/s	Permeability Guideline (m/s)		
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0009

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.40 3.26

Test Date 11/10/2022
Soakaway No. SA104 - Cycle 3

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

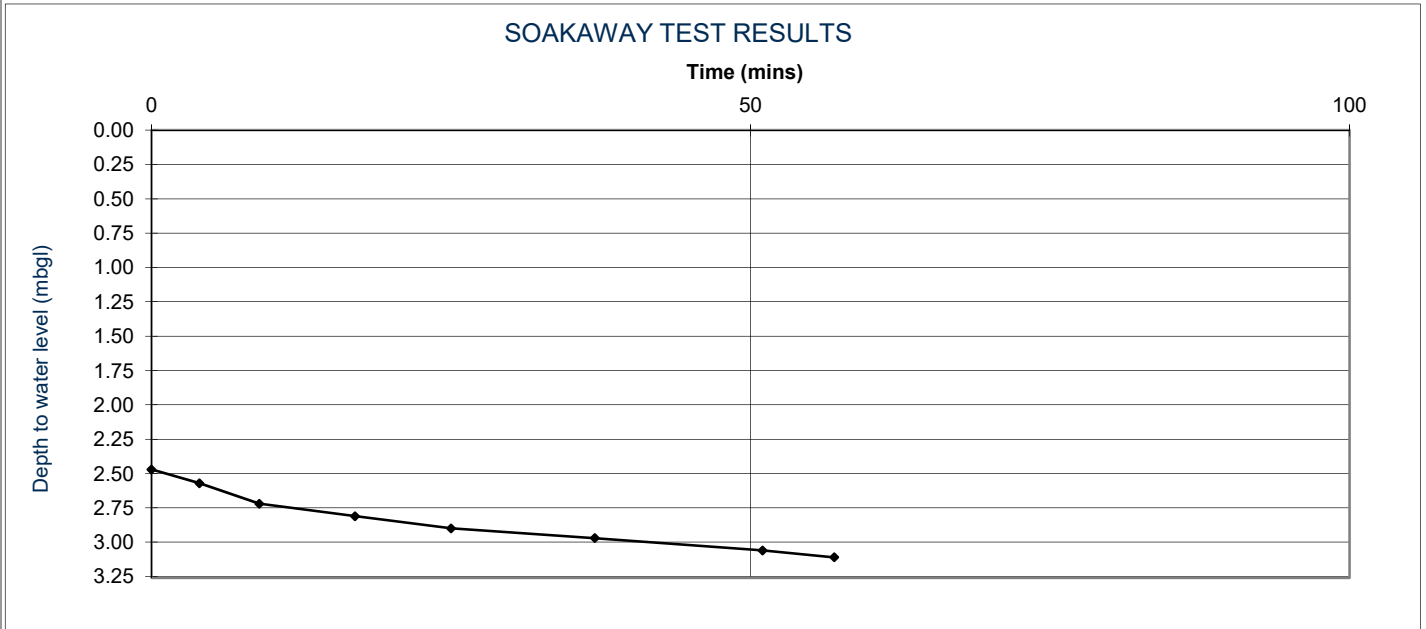

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.

ap50 = Mean surface area through which the outflow occurs.

tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.6636 m³
ap50 = 4.129 m²
tp75-25 = 44.0 min

General Geological Profile :

0.00 - 0.35	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.35 - 1.00	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.00 - 2.20	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.20 - 2.80	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.80 - 3.26	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION, GRADE Dc)


Soil Infiltration Rate (f) =	6.09E-05	m/s	Permeability Guideline (m/s)		
			Good	Poor	Practically Impervious
			10 ⁻³ - 10 ⁻⁵	10 ⁻⁶ - 10 ⁻⁷	10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0010

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.60 3.45

Test Date 11/10/2022
Soakaway No. SA105- Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

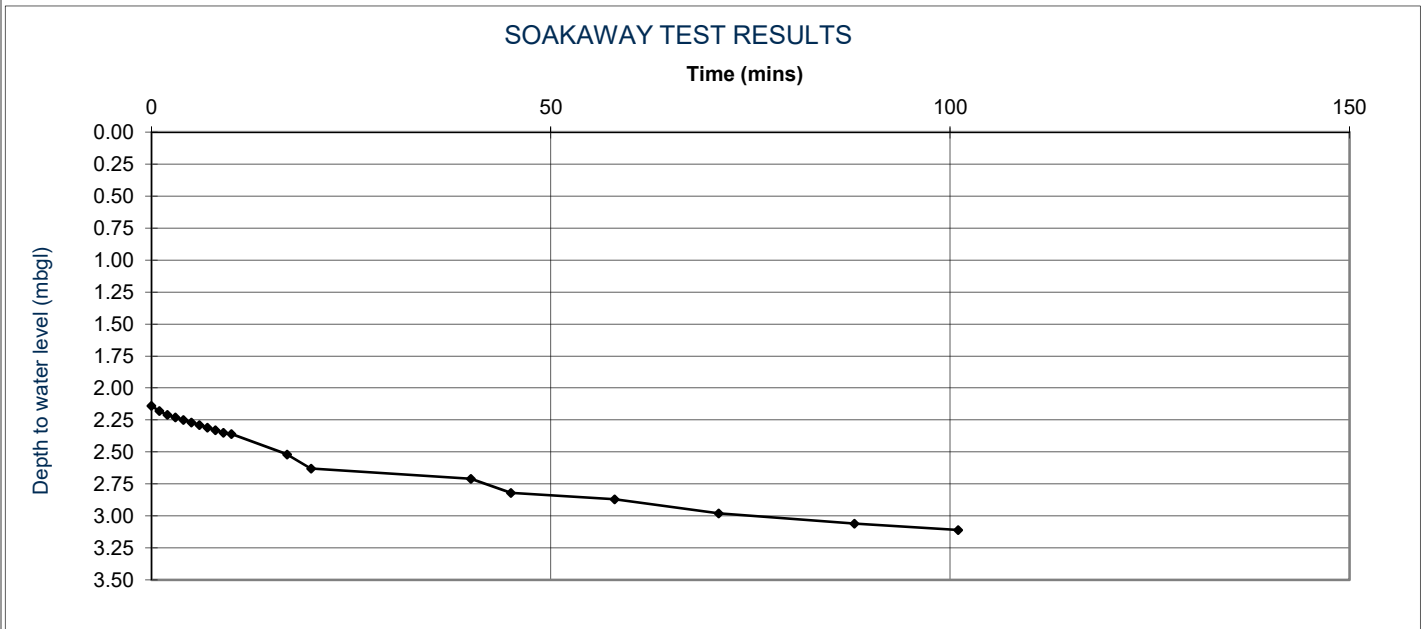

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.

ap50 = Mean surface area through which the outflow occurs.

tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 1.1921 m³
ap50 = 6.143 m²
tp75-25 = 86.0 min

General Geological Profile :

0.00 - 0.35	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.35 - 1.10	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
1.10 - 2.45	Firm light brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
2.45 - 3.20	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
3.20 - 3.40	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION. GRADE Dc)


Soil Infiltration Rate (f) =	3.76E-05 m/s	Permeability Guideline (m/s)	
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷
		Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰	

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0011

Trial Pit Dimensions (m) Width Length Depth to Base
0.70 2.60 3.45

Test Date 11/10/2022
Soakaway No. SA105- Cycle 2

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

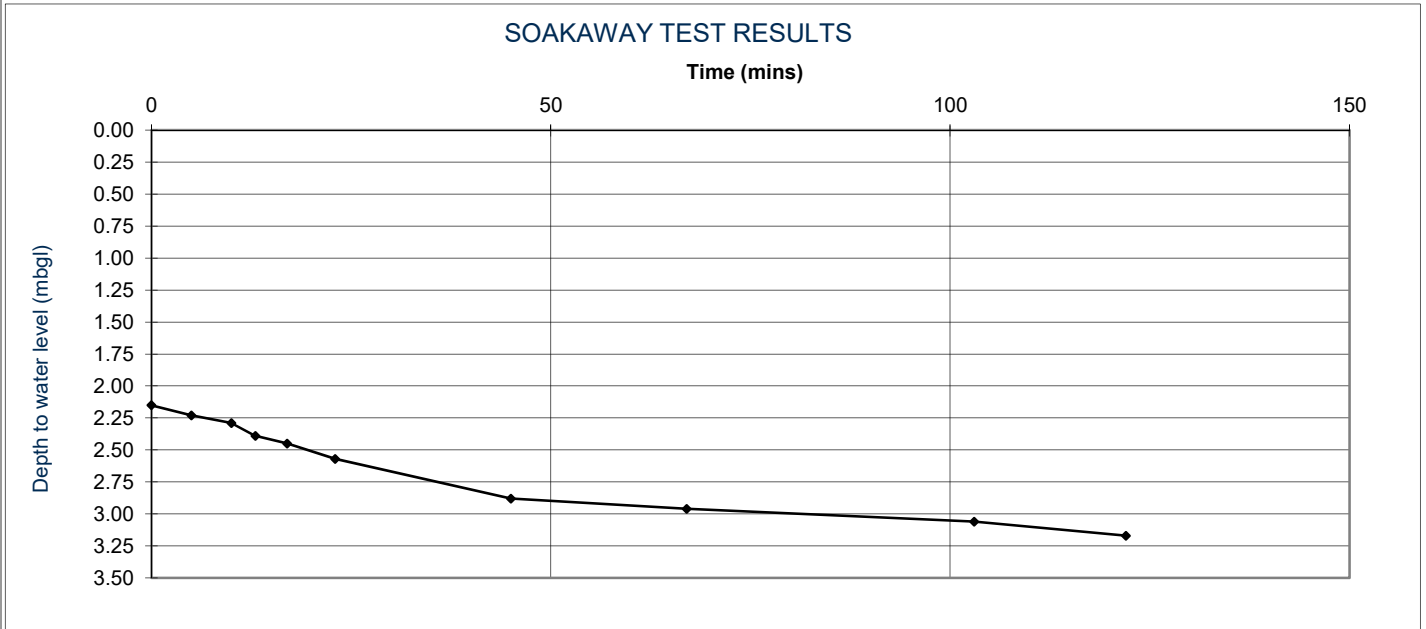

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP75-25}{ap50 \times tp75-25}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 1.183 m³
 ap50 = 6.11 m²
 tp75-25 = 96.0 min

General Geological Profile :


0.00 - 0.35	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.35 - 1.10	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.10 - 2.45	Firm light brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
2.45 - 3.20	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
3.20 - 3.40	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION. GRADE Dc)

Soil Infiltration Rate (f) =	3.36E-05 m/s	Permeability Guideline (m/s)		
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Cambridgeshire
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0012

Trial Pit Dimensions (m) Width Length Depth to Base Test Date 12/10/2022
 0.70 2.70 3.21 Soakaway No. SA106 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

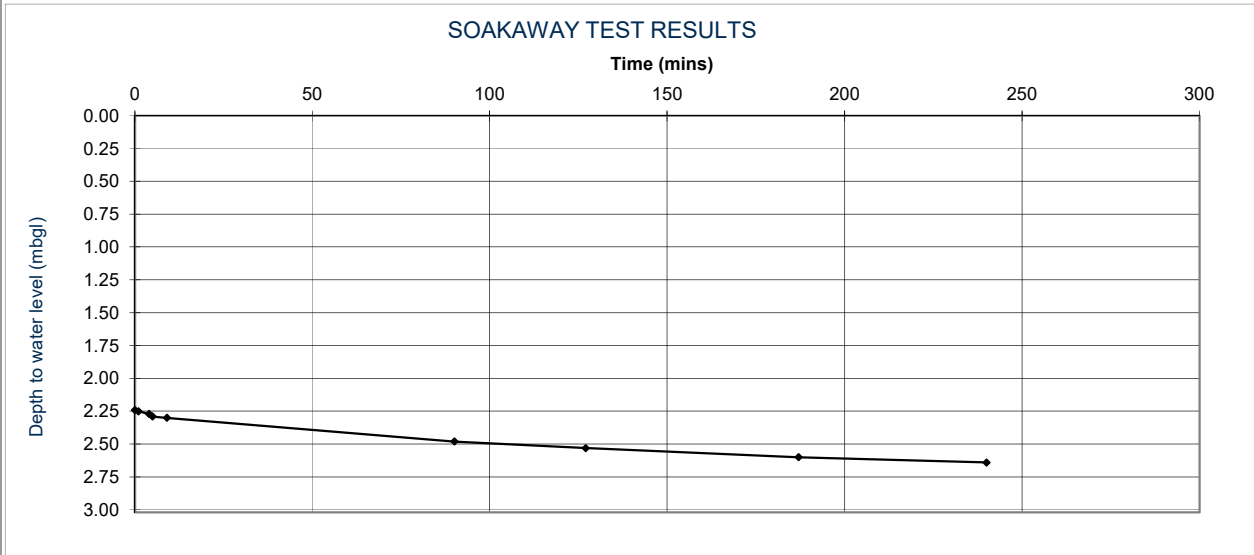

--	--	--	--	--	--	--	--	--	--

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$$

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.

ap50 = Mean surface area through which the outflow occurs.

tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.91665 m³
 ap50 = 5.188 m²
 tp75-25 = 540.0 min

General Geological Profile :

0.00 - 0.40	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.40 - 0.80	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
0.80 - 1.90	Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
1.90 - 2.90	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)


Soil Infiltration Rate (f) =	5.45E-06 m/s	Permeability Guideline (m/s)		
		Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-00013

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.80 2.85

Test Date 12/10/2022
Soakaway No. SA107 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

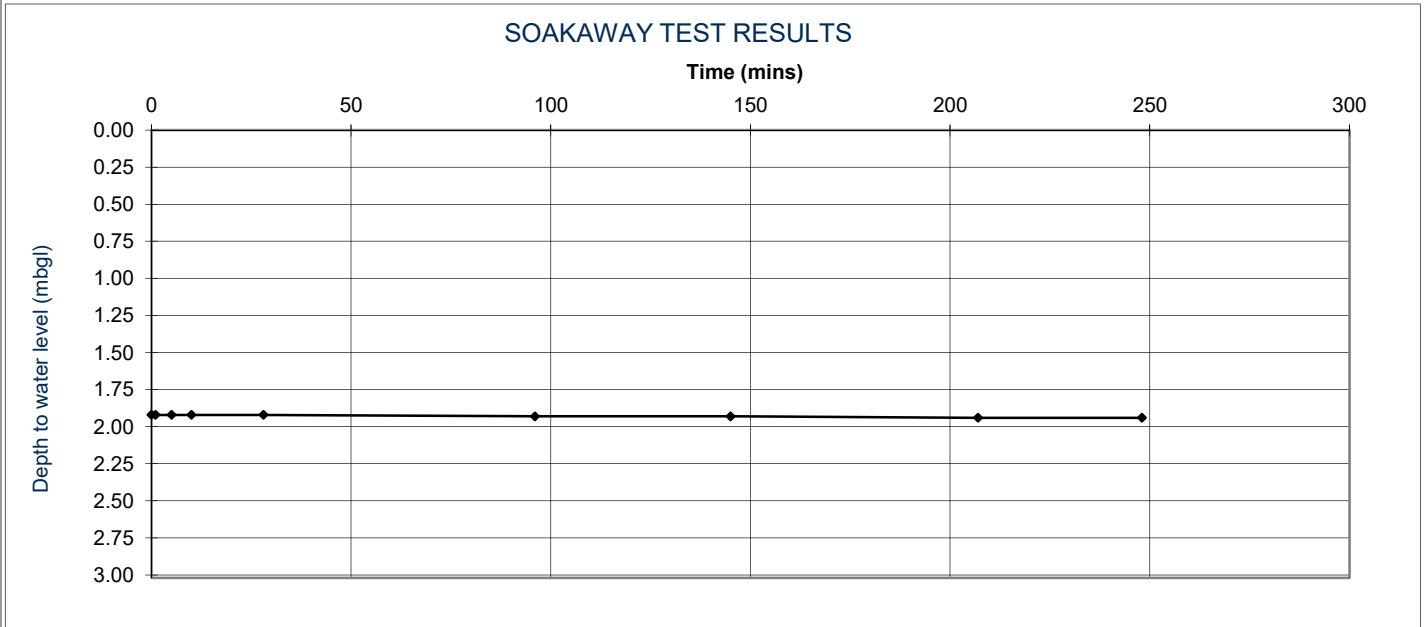

--	--	--	--	--	--	--	--	--	--

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP_{75-25}}{ap_{50} \times tp_{75-25}}$ using $VP_{75-25} =$ Volume outflowing between 75% and 25% of effective depth.
 $ap_{50} =$ Mean surface area through which the outflow occurs.
 $tp_{75-25} =$ Time for the outflow between 75% and 25% of the effective depth.

$VP_{75-25} = 0.9114 \text{ m}^3$
 $ap_{50} = 5.215 \text{ m}^2$
 $tp_{75-25} = \text{N/A min}$

General Geological Profile :

0.00 - 0.30	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.30 - 0.90	Stiff brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and chalk. Occasional 100mm lenses of orange brown sand throughout.(LOWESTOFT FORMATION)
0.90 - 2.00	Stiff bluish grey mottled greyish brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and sandstone.(LOWESTOFT FORMATION)
2.00 - 2.90	Very stiff bluish grey mottled greyish brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and sandstone.(LOWESTOFT FORMATION)

Infiltration rate was insufficient to be calculated in accordance with BRE 365 (2016).


Soil Infiltration Rate (f) =	N/A	m/s	Permeability Guideline (m/s)		
			Good	Poor	Practically Impervious
			$10^{-3} - 10^{-5}$	$10^{-6} - 10^{-7}$	$10^{-8} - 10^{-10}$

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Camb
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0014

Trial Pit Width Length Depth to Base
Dimensions (m) 0.70 2.40 2.58

Test Date 12/10/2022
Soakaway No. SA108 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

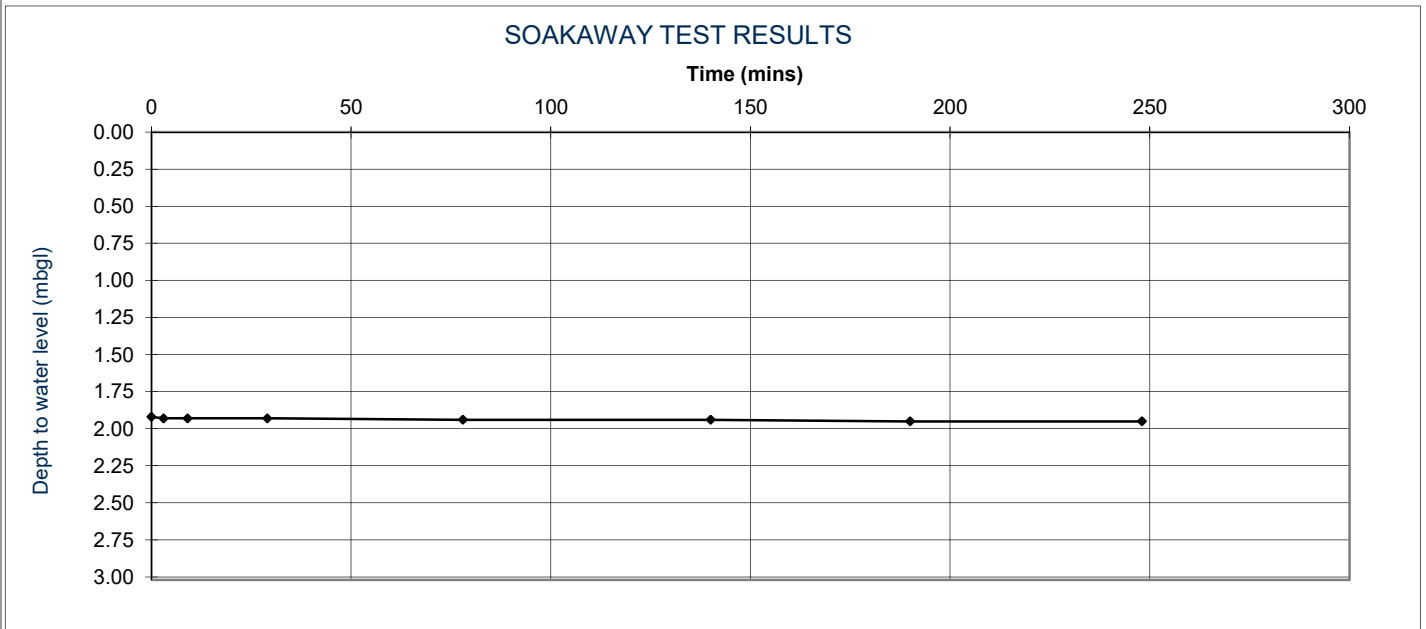

Calculation of Soil Infiltration Rate (f):

where

$$f = \frac{VP75-25}{ap50 \times tp75-25}$$

VP75-25 = 0.5544 m³
ap50 = 3.726 m²
tp75-25 = N/A min

using

VP75-25 = Volume outflowing between 75% and 25% of effective depth.
ap50 = Mean surface area through which the outflow occurs.
tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

General Geological Profile :

- 0.00 - 0.30 [Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
- 0.30 - 1.10 Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
- 1.10 - 2.60 Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)


Infiltration rate was insufficient to be calculated in accordance with BRE 365 (2016).

Soil Infiltration Rate (f) =	N/A	m/s	Permeability Guideline (m/s)		
			Good 10 ⁻³ - 10 ⁻⁵	Poor 10 ⁻⁶ - 10 ⁻⁷	Practically Impervious 10 ⁻⁸ - 10 ⁻¹⁰

PROJECT NO :	22-0222
PROJECT:	Land off Thaxted Road, Saffron Walden, Cambridgeshire
DOC REF:	220222-RGL-ZZ-XX-SH-G-500-0015

Trial Pit Dimensions (m) Width Length Depth to Base Test Date 12/10/2022
 0.70 2.30 2.94 Soakaway No. SA109 - Cycle 1

Calculation of Infiltration Rate in Accordance with BRE Digest 365.

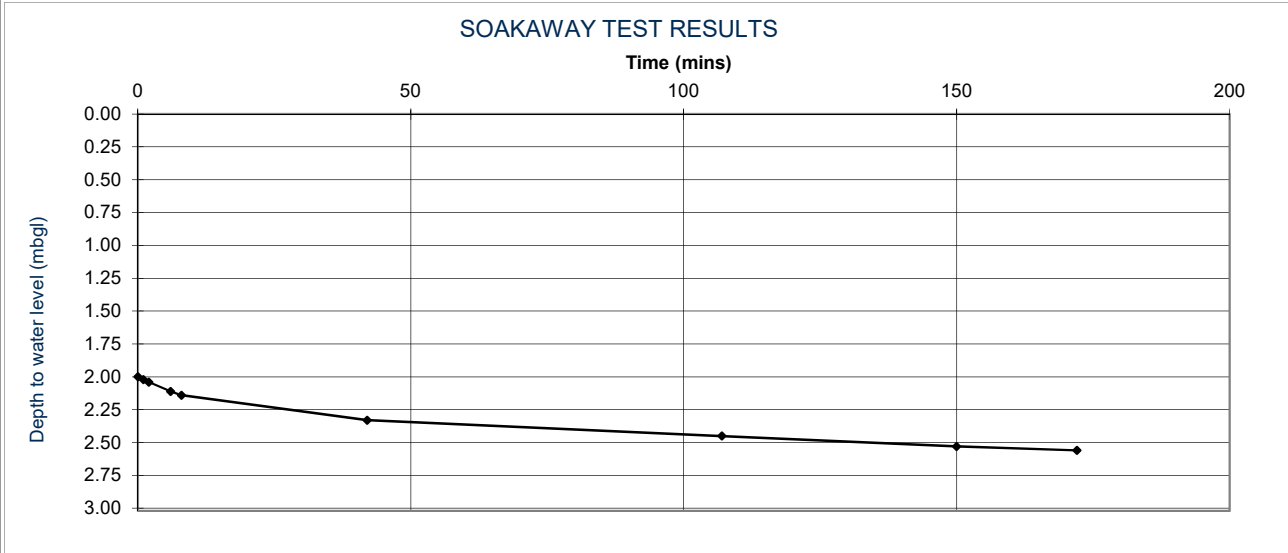

Calculation of Soil Infiltration Rate (f):

where $f = \frac{VP75-25}{ap50 \times tp75-25}$ using
 VP75-25 = Volume outflowing between 75% and 25% of effective depth.
 ap50 = Mean surface area through which the outflow occurs.
 tp75-25 = Time for the outflow between 75% and 25% of the effective depth.

VP75-25 = 0.7567 m³
 ap50 = 4.43 m²
 tp75-25 = 240.0 min

General Geological Profile :

0.00 - 0.40	[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
0.40 - 1.00	Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.00 - 1.60	Firm light brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk.(HEAD)
1.60 - 2.00	Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white.(LEWIS NODULAR CHALK FORMATION, GRADE Dm)
2.00 - 2.95	Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white.(LEWES NODULAR CHALK FORMATION, GRADE Dc)

Infiltration rate was extrapolated assuming a constant rate of dissipation.

Soil Infiltration Rate (f) =	1.19E-05 m/s	Permeability Guideline (m/s)	
		Good	Poor
		10 ⁻³ - 10 ⁻⁵	10 ⁻⁶ - 10 ⁻⁷
		Practically Impervious	
		10 ⁻⁸ - 10 ⁻¹⁰	



ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA101A
Sheet 1 of 1

Project Name:	Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.:	22-0222	Co-ords:	554746.00 - 237435.00	Level:		Date:	10/10/2022
Location:	Land off Thaxted Road, Saffron Walden, Cambridgeshire			Dimensions (m):	2.9			Scale:	1:30
Client:	Kier Ventures Ltd			Depth:	3.02			Logged:	MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.40			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				2.30			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				3.02			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
							End of pit at 3.02 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE


Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA101B
Sheet 1 of 1

Project Name:	Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.:	22-0222	Co-ords:	554749.00 - 237439.00	Level:		Date:	10/10/2022
Location:	Land off Thaxted Road, Saffron Walden, Cambridgeshire			Dimensions (m):	1.9			Scale:	1:30
Client:	Kier Ventures Ltd			Depth:	0.97			Logged:	MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.45			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				0.97			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
							End of pit at 0.97 m



Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA102
Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Project No.: 22-0222
Co-ords: 554785.00 - 237379.00
Level: 10/10/2022

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Dimensions (m): 2.5
Depth: 2.92

Client: Kier Ventures Ltd
Scale: 1:30
Logged: MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.30			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				1.50			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				2.92			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
							End of pit at 2.92 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No

SA103

Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.: 22-0222	Co-ords: 554814.00 - 237313.00 Level:	Date: 10/10/2022
--	-----------------------------	--	-------------------------

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire	Dimensions (m): Depth 3.02 0.7 2.5	Scale: 1:30
--	--	--------------------

Client: Kier Ventures Ltd	Logged: MG
----------------------------------	-------------------

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.45			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				1.15			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				2.60			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
				3.02			Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken. (LEWIS NODULAR CHALK FORMATION, GRADE Dm) End of pit at 3.02 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA104
Sheet 1 of 1

Project Name:	Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.:	22-0222	Co-ords:	554817.00 - 237363.00	Level:		Date:	11/10/2022
Location:	Land off Thaxted Road, Saffron Walden, Cambridgeshire			Dimensions (m):	2.4			Scale:	1:30
Client:	Kier Ventures Ltd			Depth:	3.26			Logged:	MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description	
	Depth	Type	Results					
				0.35			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)	
				1.00			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)	
				2.20			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)	1
				2.80			Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)	2
				3.26			Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white. (LEWES NODULAR CHALK FORMATION, GRADE Dc) End of pit at 3.26 m	3
								4
								5
								6

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No

SA105

Sheet 1 of 1

Project Name:	Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.	22-0222	Co-ords:	554749.00 - 237297.00	Date	11/10/2022
---------------	---	-------------	---------	----------	-----------------------	------	------------

Location:	Land off Thaxted Road, Saffron Walden, Cambridgeshire	Dimensions (m):	3.45	Scale	1:30
-----------	---	-----------------	------	-------	------

Client:	Kier Ventures Ltd	Depth	3.45	Logged	MG
---------	-------------------	-------	------	--------	----

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.35			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				1.10			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				2.45			Firm light brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				3.20			Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
				3.45			Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white. (LEWES NODULAR CHALK FORMATION, GRADE Dc) End of pit at 3.45 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA106
Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Project No.: 22-0222
Co-ords: 554640.00 - 237279.00
Level: 12/10/2022

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Dimensions (m): 2.7
Depth: 3.21

Client: Kier Ventures Ltd
Scale: 1:30
Logged: MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.40			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				0.80			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				1.90			Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
				3.21			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
							End of pit at 3.21 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA107
Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Project No.: 22-0222
Co-ords: 554578.00 - 237144.00
Level: 12/10/2022

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Dimensions (m): 2.8
Scale: 1:30

Client: Kier Ventures Ltd
Depth: 2.85
Logged: MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.30			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				0.90			Stiff brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and chalk. Occasional 100mm lenses of orange brown sand throughout. (LOWESTOFT FORMATION)
				2.00			Stiff bluish grey mottled greyish brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and sandstone. (LOWESTOFT FORMATION)
				2.85			Very stiff bluish grey mottled greyish brown slightly sandy gravelly silty CLAY. Gravel of fine to medium well rounded flint, quartzite and sandstone. (LOWESTOFT FORMATION)
							End of pit at 2.85 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No

SA108

Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire	Project No.: 22-0222	Co-ords: 554573.00 - 237219.00	Date: 12/10/2022
--	-----------------------------	---------------------------------------	-------------------------

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire	Dimensions (m): 2.58	Scale: 1:30
--	-----------------------------	--------------------

Client: Kier Ventures Ltd	Depth: 2.58	Logged: MG
----------------------------------	--------------------	-------------------

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.30			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				1.10			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				2.58			Structureless CHALK composed of sandy slightly gravelly clayey SILT with occasional cobbles. Gravel and cobbles are very weak low density chalk and flint chalk gravel is white and clean when broken. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
							End of pit at 2.58 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.





ROLTON GROUP
ENGINEERING THE FUTURE

Rolton Group Limited
The Charles Parker Building
Midland Road
Higham Ferrers
Northants
NN10 8DN

Trial Pit Log

Trialpit No
SA109
Sheet 1 of 1

Project Name: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Project No.: 22-0222
Co-ords: 554820.00 - 237253.00
Level: 2.3

Location: Land off Thaxted Road, Saffron Walden, Cambridgeshire
Dimensions (m): 0.7 x 2.3

Client: Kier Ventures Ltd
Depth: 2.94
Scale: 1:30
Logged: MG

Water Strike	Samples and In Situ Testing			Depth (m)	Level (m)	Legend	Stratum Description
	Depth	Type	Results				
				0.40			[Loose] greyish brown slightly gravelly clayey organic SAND. Gravel of angular to rounded flint, quartzite, brick and chalk. (TOPSOIL)
				1.00			Firm brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				1.60			Firm light brown sandy slightly gravelly CLAY. Gravel of angular to rounded flint, quartzite and chalk. (HEAD)
				2.00			Structureless CHALK composed of gravelly slightly sandy SILT with occasional cobbles of angular flint. Gravel is very weak low density chalk with frequent brown staining and black speckling to faces, clean white when broken. Matrix is uncompact brown mottled white. (LEWIS NODULAR CHALK FORMATION, GRADE Dm)
				2.94			Structureless CHALK composed of slightly sandy silty subangular to rounded mainly medium and coarse GRAVEL with many rounded cobbles. Gravel is very weak low density white with frequent black specks. Cobbles are weak medium density white with occasional black specks. Matrix is uncompact white. (LEWES NODULAR CHALK FORMATION, GRADE Dc)
							End of pit at 2.94 m

Remarks: No groundwater encountered.

Stability: Sides were stable for short period the pit was open.



APPENDIX E – ENVIRONMENT AGENCY’S PRODUCT 4 INFORMATION
















Product 4 Request - EAn/2022/255032							
Unique ID (Label)	Easting	Northing	Standard of Protection (Return Period)	Overall Condition Grade	Statutory Defence Level	Upstream Crest Level	Downstream Crest Level
172191	554650	237697	1 in 25 (4%)	3	Not Known	Not Known	Not Known
172195	554756	237499	1 in 25 (4%)	3	Not Known	Not Known	Not Known
173422	554760	237496	1 in 25 (4%)	3	Not Known	Not Known	Not Known
173631	554602	237770	1 in 25 (4%)	3	Not Known	Not Known	Not Known
174840	554604	237759	1 in 25 (4%)	3	Not Known	Not Known	Not Known
174841	554608	237750	1 in 25 (4%)	3	Not Known	Not Known	Not Known
174842	554649	237695	1 in 25 (4%)	3	Not Known	Not Known	Not Known



255032 Product 4 Map - (3rd Party Defences)



Legend

Defences (3rd party maintained)



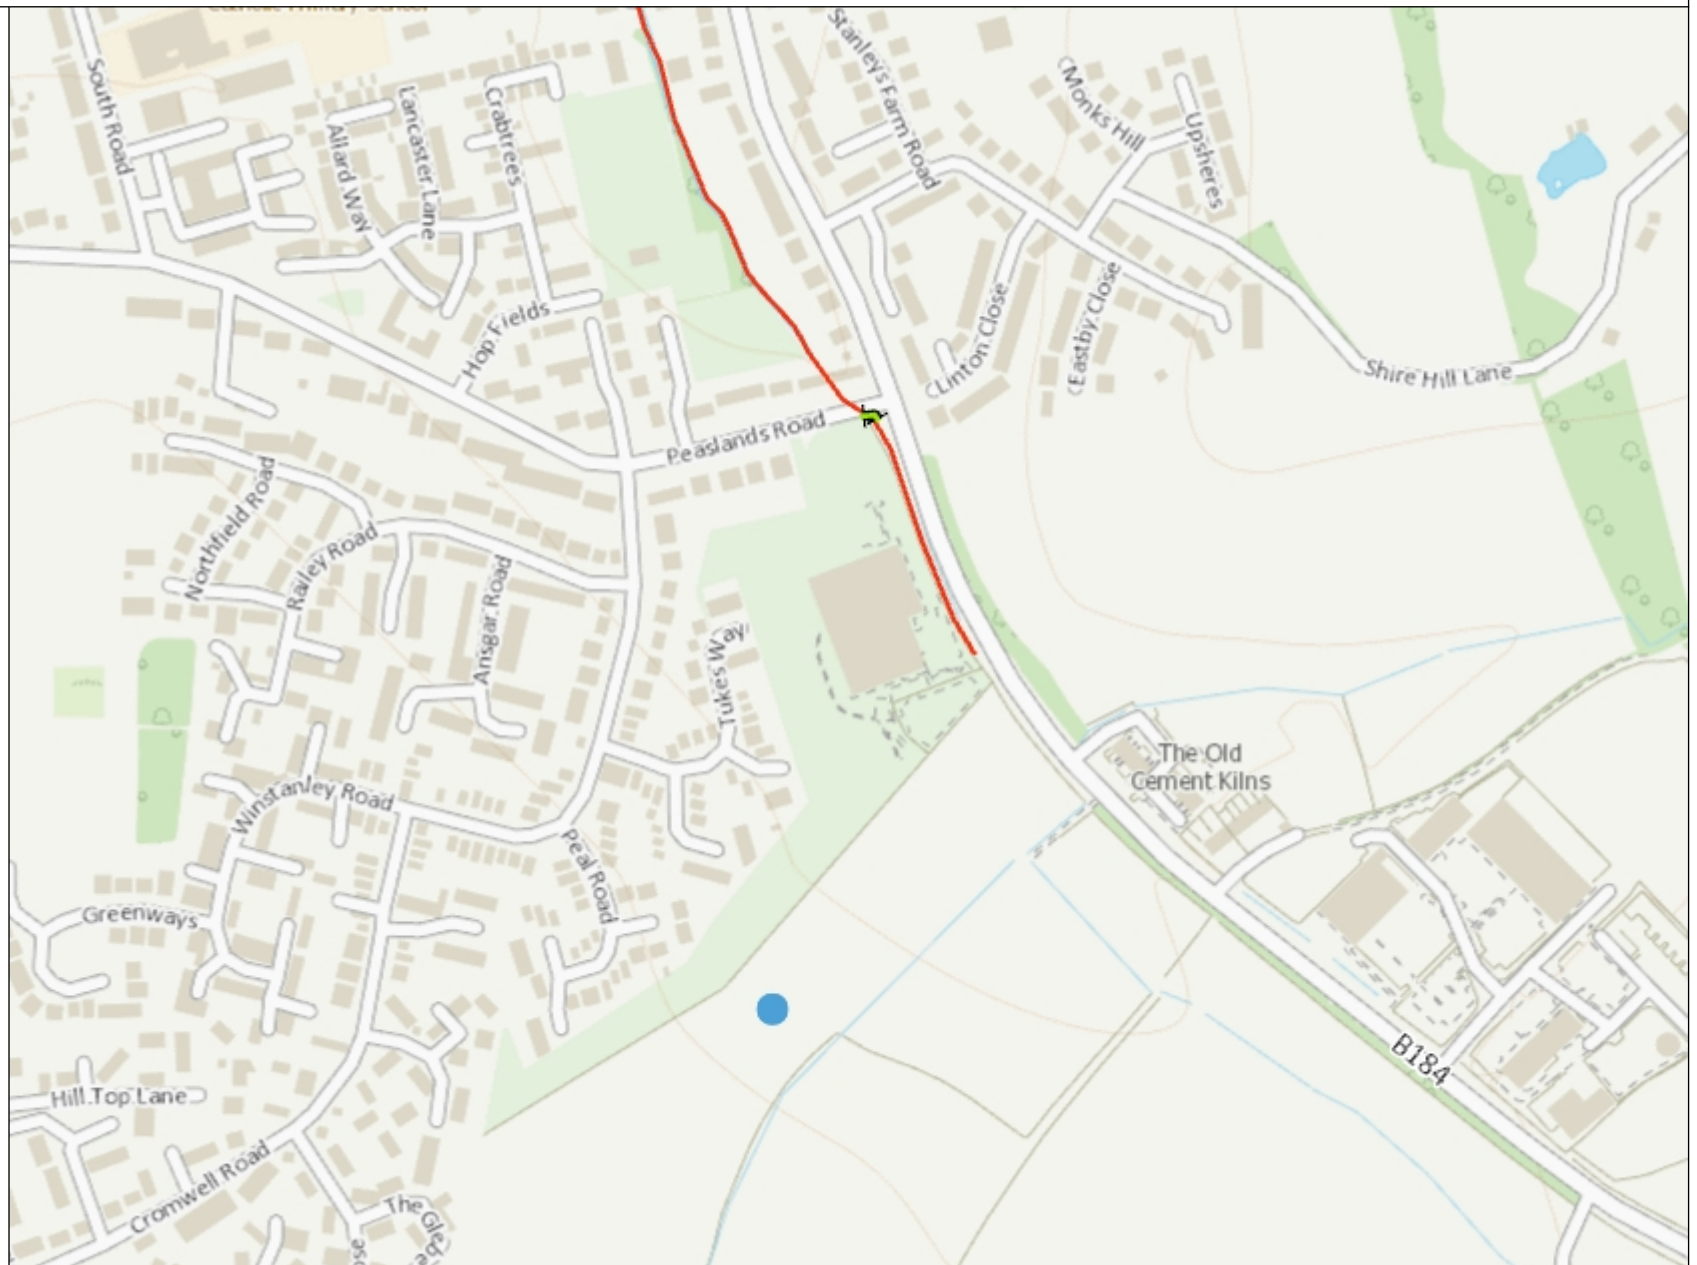









-  Embankment
-  Wall
-  Flood Gate
-  Demountable Defence
-  Bridge Abutment
-  Engineered High Ground
-  Natural High Ground
-  Cliff
-  Promenade
-  Quay
-  Beach
-  Barrier Beach
-  Dunes
-  Spillway
-  Statutory Main Rivers




255032 Product 4 Map

Legend

Defences (EA maintained)

-  Embankment
-  Wall
-  Flood Gate
-  Demountable Defence
-  Bridge Abutment
-  Engineered High Ground
-  Natural High Ground
-  Cliff
-  Promenade
-  Quay
-  Beach
-  Barrier Beach
-  Dunes
-  Spillway
-  Statutory Main Rivers

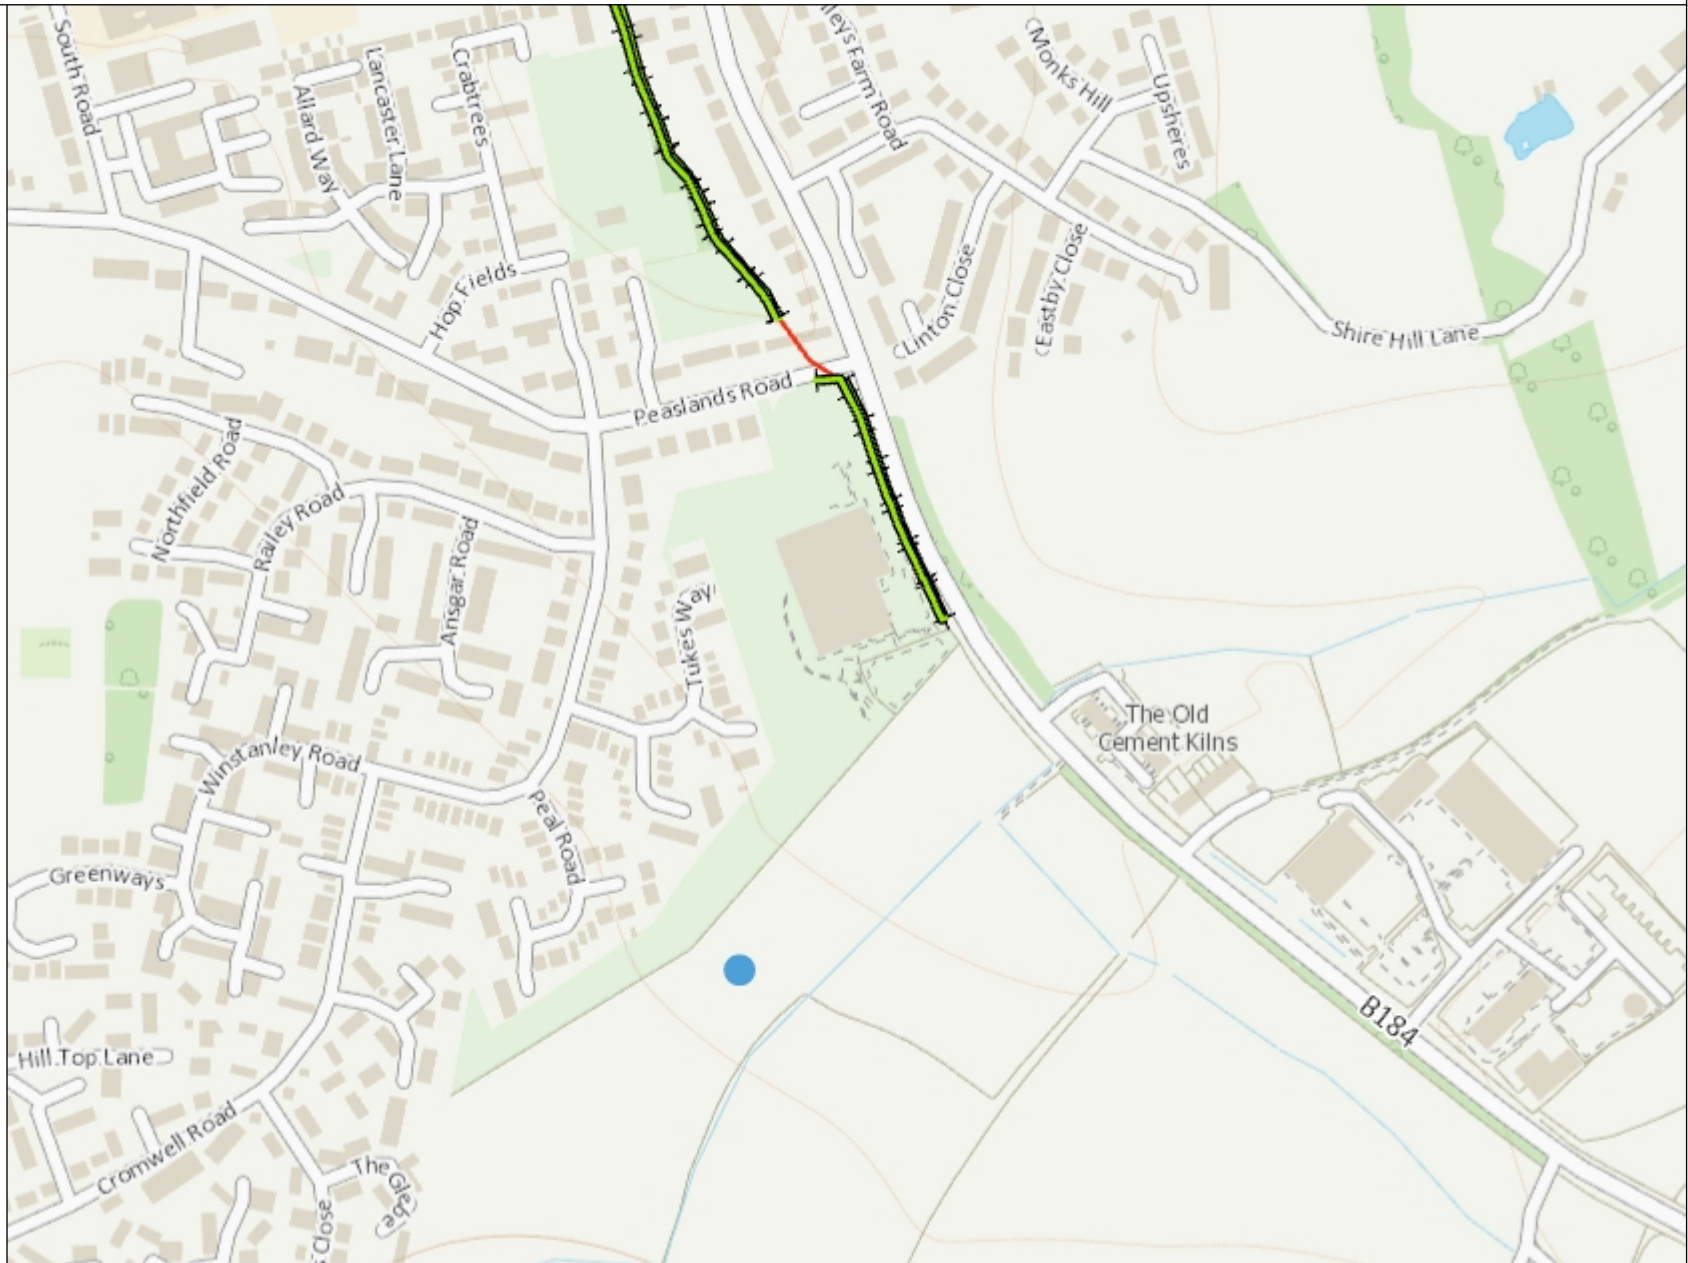

1: 5,000

0 125

Metres



Defended Climate Change Model Flood Outlines centred on Tukes Way, Pleasant Valley, Saffron Walden, Uttlesford, Essex CB11 3ES

NGR TL5462637265
Ref 255032
Created 05/04/2022

Environment Agency
Bromholme Lane,
Brampton,
Cambridgeshire
PE28 4NE



Legend

- Site
- 1% AEP + 20CC
- Main river

Information


Model Tolerance - Any data included in this product is subject to a standard modelling tolerance of +/- 150mm. The fluvial models used to produce these results are intended for strategic scale use only.

Flood Risk Assessments - The Environment Agency recommends any Flood Risk Assessment should only consider these results in the context of a site specific assessment.

AEP - Annual Exceedance Probability - The probability of a given event occurring in any one year. Please note this is not a return period.

Strategic Scale Model - This model has been designed for catchment wide flood risk mapping. It should be noted that it was not created to produce flood levels for specific development sites within the catchment. Modelled outlines take into account catchment wide defences if present.

Copyright © Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.
Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

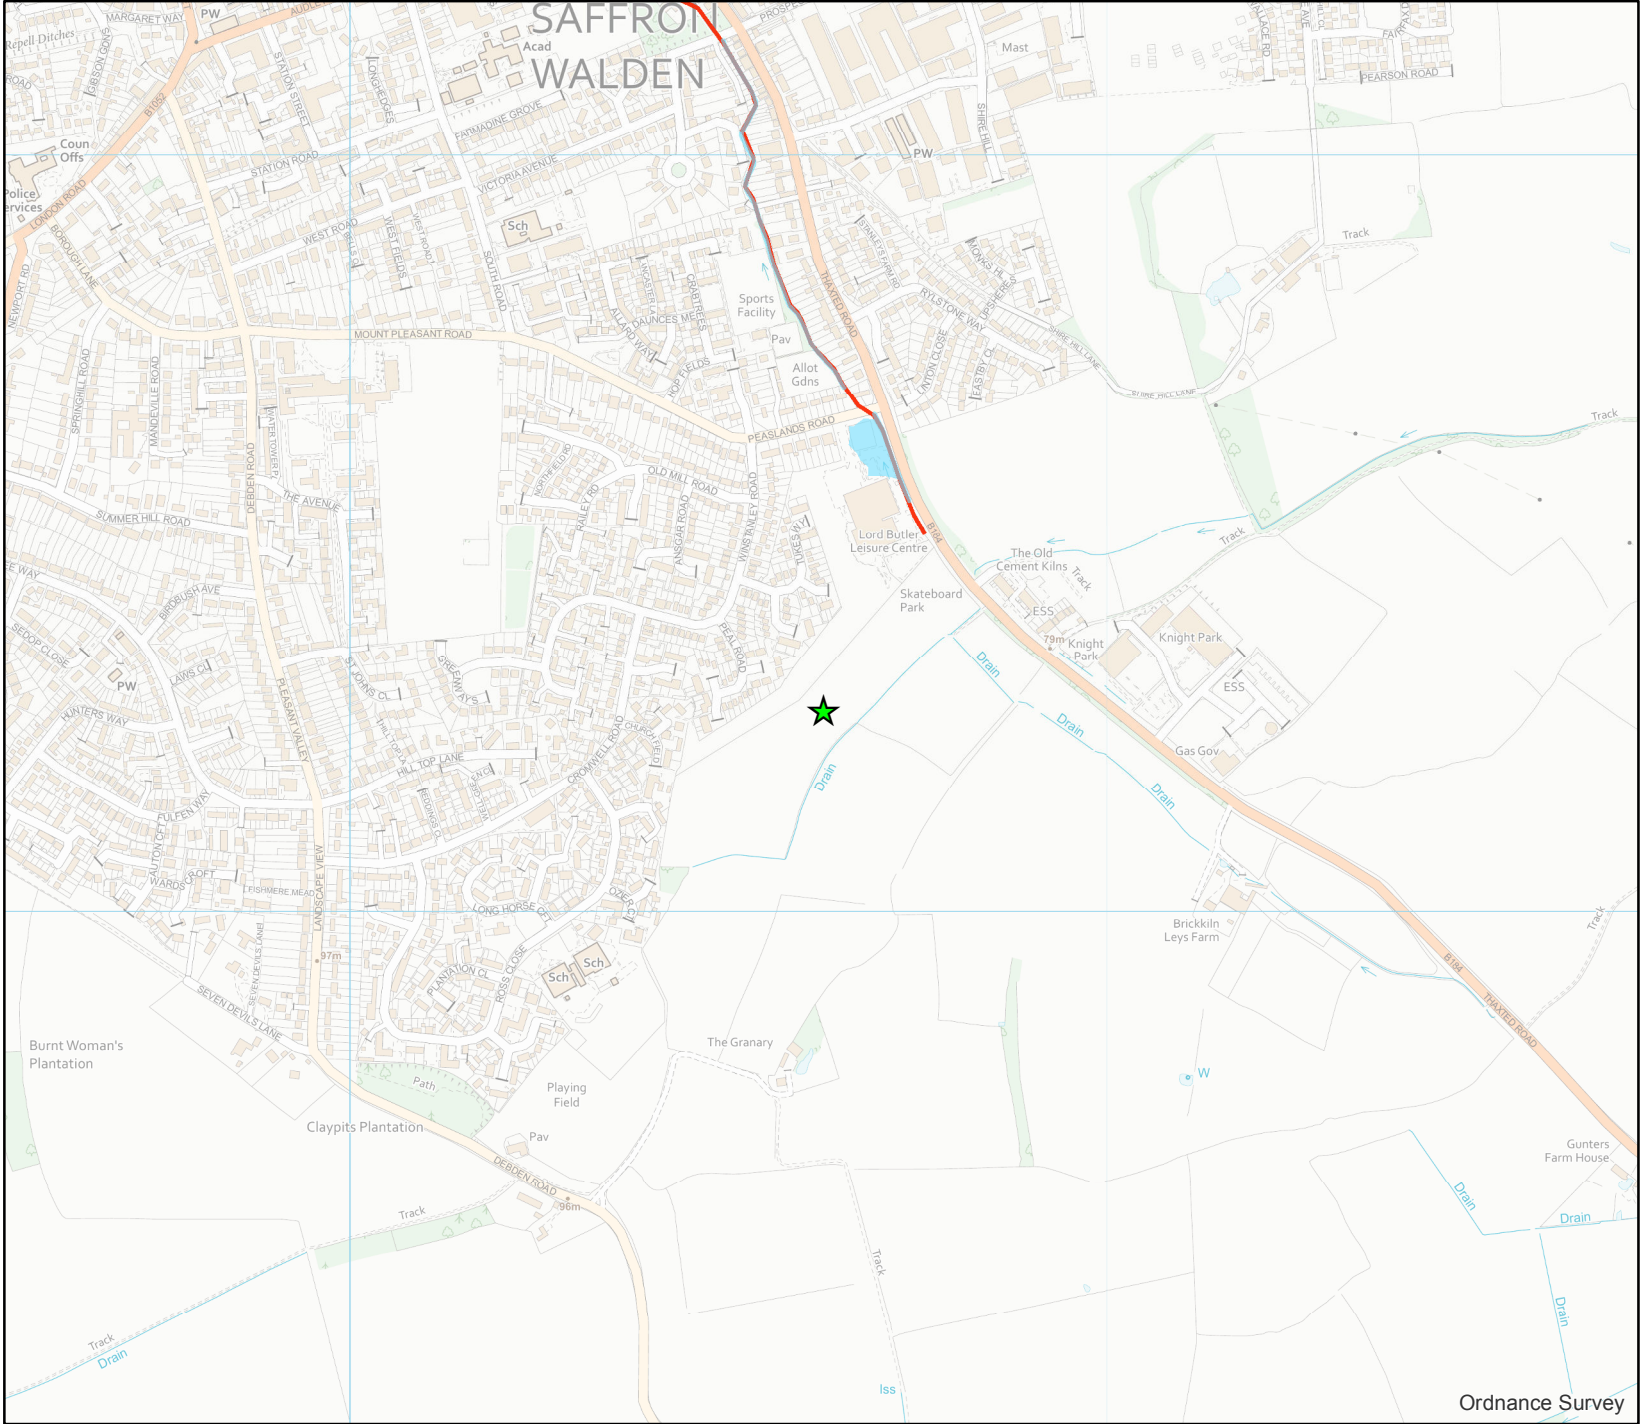

Ordnance Survey

Defended Climate Change Model Flood Outlines centred on Tukes Way, Pleasant Valley, Saffron Walden, Uttlesford, Essex CB11 3ES

NGR TL5462637265
Ref 255032
Created 05/04/2022

Environment Agency
Bromholme Lane,
Brampton,
Cambridgeshire
PE28 4NE



Legend

- ★ Site
- 1% AEP + 20CC
- Main river

Information


Model Tolerance - Any data included in this product is subject to a standard modelling tolerance of +/- 150mm. The fluvial models used to produce these results are intended for strategic scale use only.

Flood Risk Assessments - The Environment Agency recommends any Flood Risk Assessment should only consider these results in the context of a site specific assessment.

AEP - Annual Exceedance Probability - The probability of a given event occurring in any one year. Please note this is not a return period.

Strategic Scale Model - This model has been designed for catchment wide flood risk mapping. It should be noted that it was not created to produce flood levels for specific development sites within the catchment. Modelled outlines take into account catchment wide defences if present.

Copyright © Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.
Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

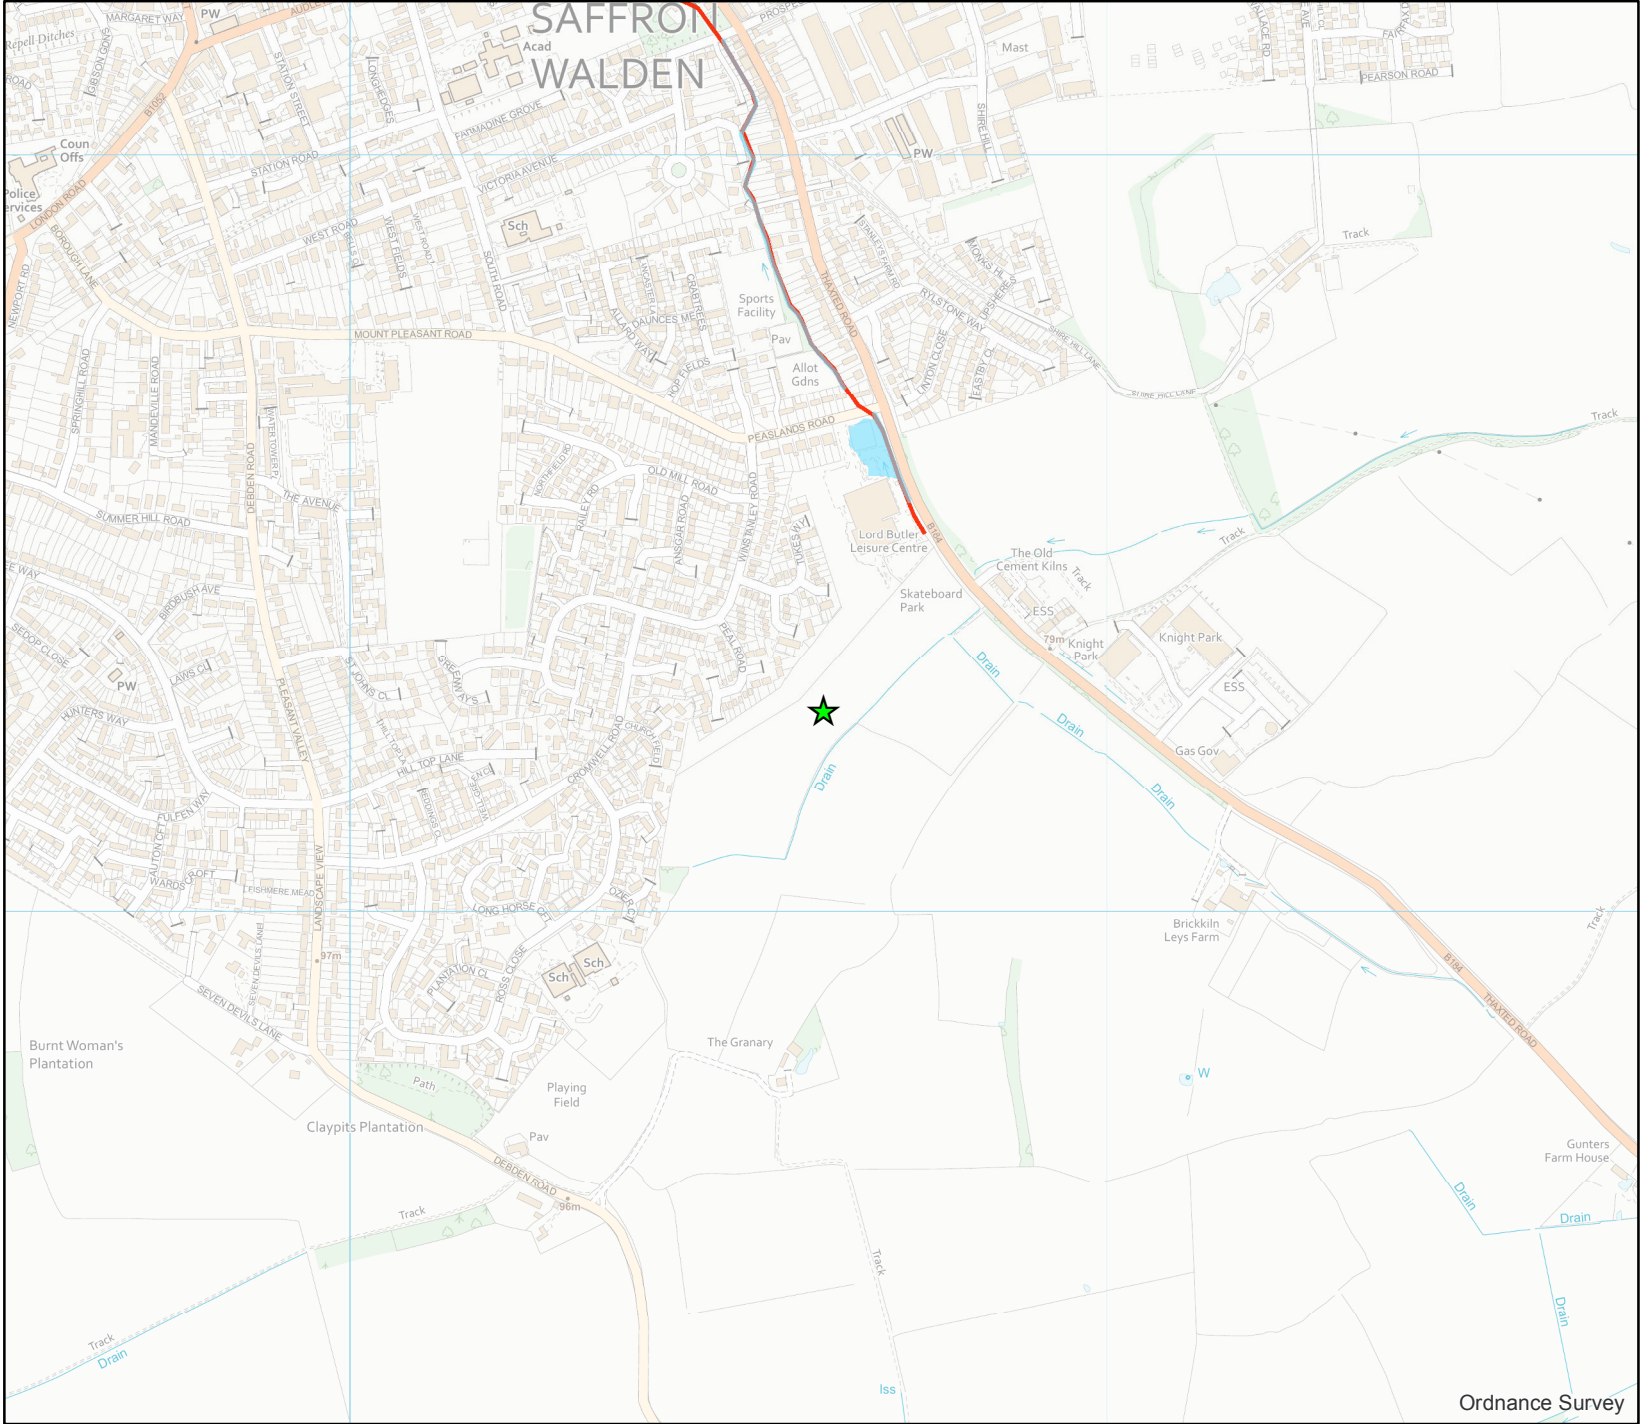

Ordnance Survey

Defended Model Flood Outlines centred on Tukes Way, Pleasant Valley, Saffron Walden, Uttlesford, Essex CB11 3ES


NGR TL5462637265
Ref 255032
Created 05/04/2022

Environment Agency
Bromholme Lane,
Brampton,
Cambridgeshire
PE28 4NE



Legend

- Site
- 5% AEP
- 1% AEP
- 0.1% AEP
- Main river



Information

Model Tolerance - Any data included in this product is subject to a standard modelling tolerance of +/- 150mm. The fluvial models used to produce these results are intended for strategic scale use only.

Flood Risk Assessments - The Environment Agency recommends any Flood Risk Assessment should only consider these results in the context of a site specific assessment.


AEP - Annual Exceedance Probability - The probability of a given event occurring in any one year. Please note this is not a return period.

Strategic Scale Model - This model has been designed for catchment wide flood risk mapping. It should be noted that it was not created to produce flood levels for specific development sites within the catchment. Modelled outlines take into account catchment wide defences if present.

Copyright © Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.

Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

Ordnance Survey

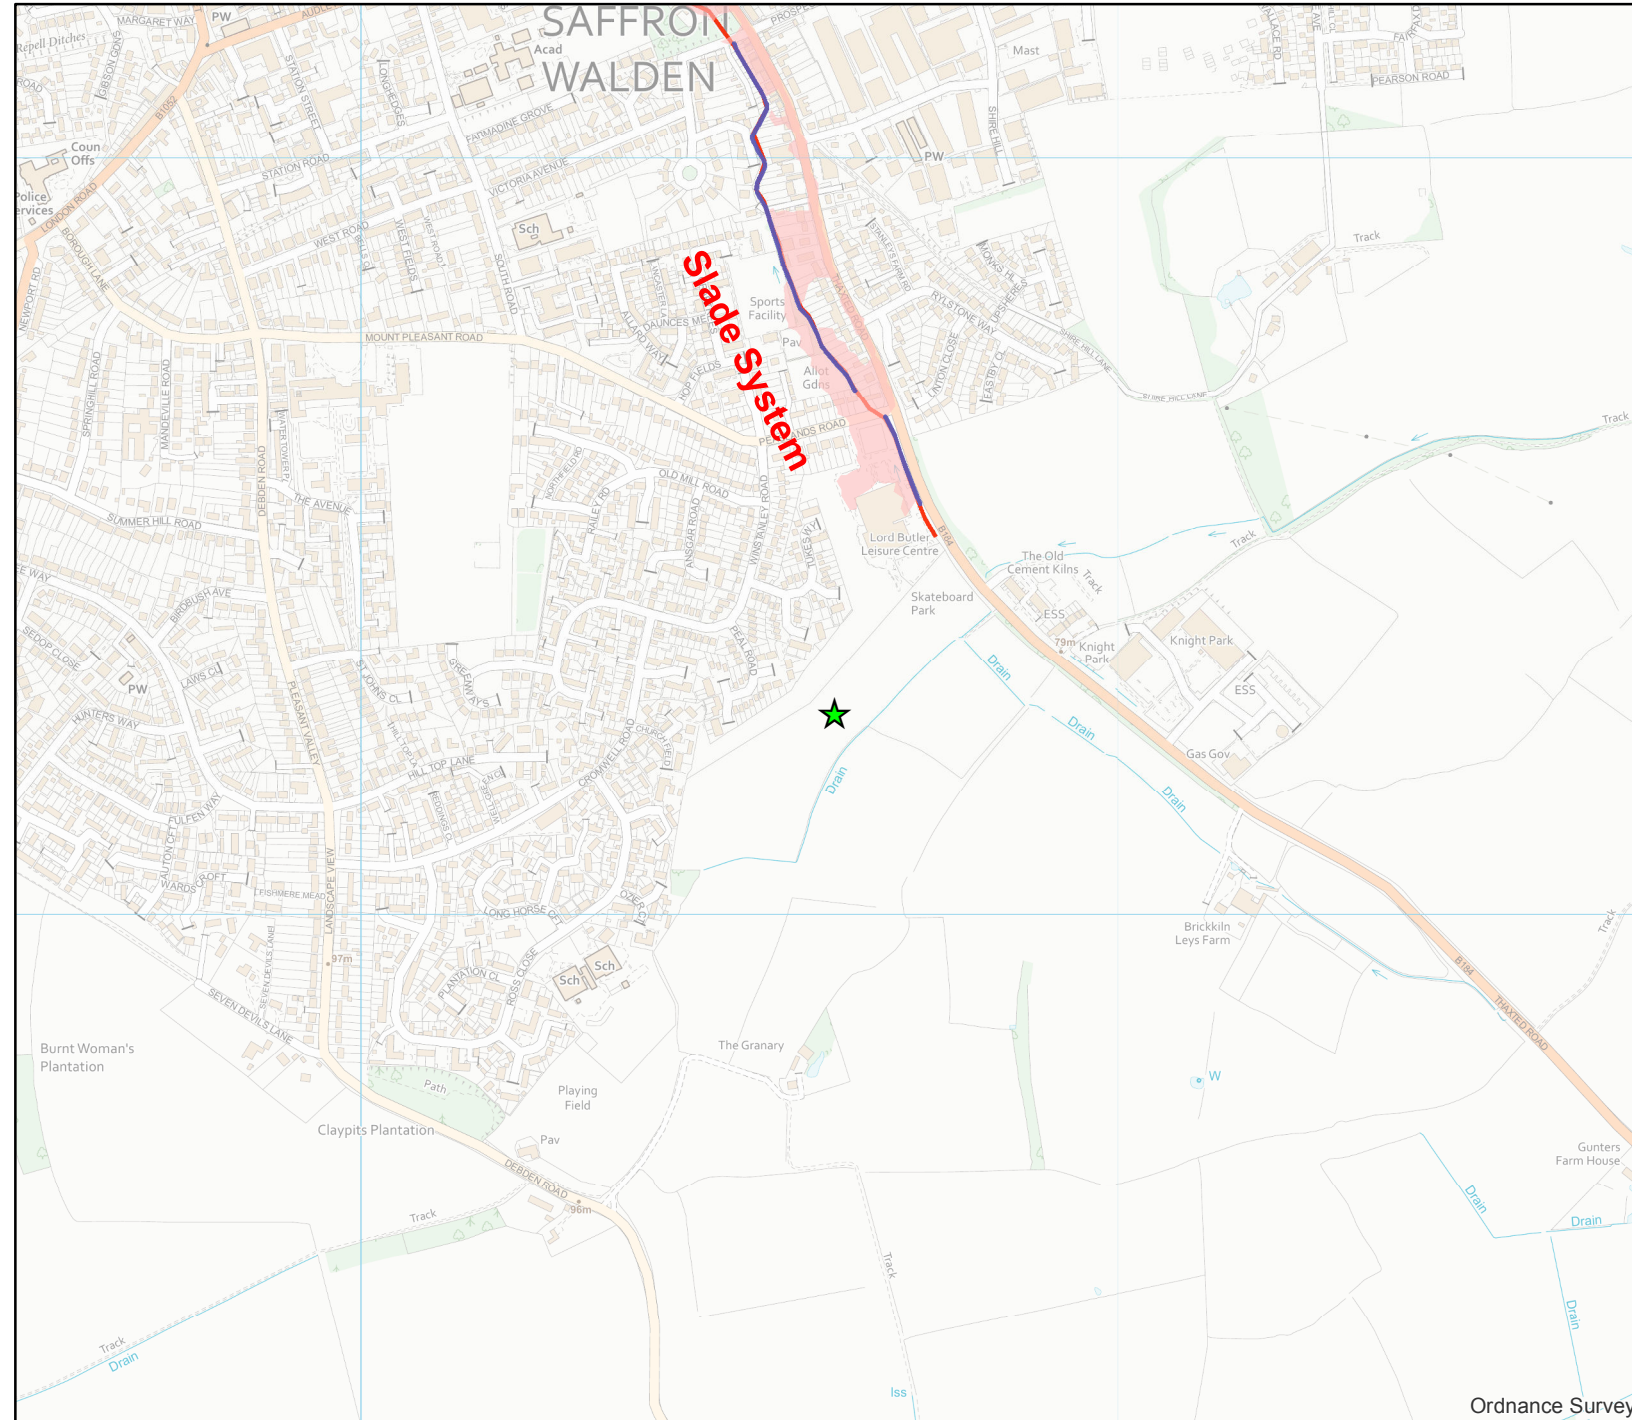

Flood risk assessments: Climate change allowances

Application of the allowances and local considerations

East Anglia; Essex, Norfolk, Suffolk, Cambridgeshire and Bedfordshire

1) The climate change allowances

The [National Planning Practice Guidance](#) refers planners, developers and advisors to the Environment Agency guidance on considering climate change in Flood Risk Assessments (FRAs). This guidance was updated in October 2021 and is available on [Gov.uk](#). The guidance can be used for planning applications, local plans, neighbourhood plans and other projects. It provides climate change allowances for peak river flow, peak rainfall, sea level rise, wind speed and wave height. The guidance provides a range of allowances to assess fluvial flooding, rather than a single national allowance. It advises on what allowances to use for assessment based on vulnerability classification, flood zone and development lifetime.

2) Assessment of climate change impacts on fluvial flooding

Where existing EA flood risk datasets and models do not provide the required climate change allowances, it is up to developers to undertake any work needed to appropriately assess the impacts of climate change on flood risk. They can do this by using the approaches in **Table A** below:

Table A below indicates the level of technical assessment of climate change impacts on fluvial flooding appropriate for new developments depending on their scale and location. This should be used as a **guide only**. Ultimately, the agreed approach should be based on expert local knowledge of flood risk conditions, local sensitivities and other influences. **For these reasons, we recommend that applicants and / or their consultants should contact the Environment Agency at the pre-planning application stage to confirm the assessment approach, on a case by case basis.** The email addresses for our Sustainable Places teams at our respective offices can be found in Section 8 below.

Table A defines three possible approaches to account for flood risk impacts due to climate change, in new development proposals:

- **Basic:** Developer can add an allowance to the 'design flood' (i.e. 1% annual probability) peak levels to account for potential climate change impacts. The allowance should be derived and agreed locally by Environment Agency teams.
- **Intermediate:** Developer can use existing modelled flood and flow data to construct a stage-discharge rating curve, which can be used to interpolate a flood level based on the required peak flow allowance being applied to the 'design flood' flow.
- **Detailed:** Perform detailed hydraulic modelling, either through re-running Environment Agency hydraulic models (if available) or construction of a new model by the developer.

Table A – Indicative guide to assessment approach

VULNERABILITY CLASSIFICATION	FLOOD ZONE	DEVELOPMENT TYPE		
		NON-MAJOR	SMALL-MAJOR	LARGE-MAJOR
ESSENTIAL INFRASTRUCTURE	Zone 2	Detailed		
	Zone 3a	Detailed		
	Zone 3b	Detailed		
HIGHLY VULNERABLE	Zone 2	Intermediate/ Basic	Intermediate/ Basic	Detailed
	Zone 3a	Not appropriate development		
	Zone 3b	Not appropriate development		
MORE VULNERABLE	Zone 2	Basic	Basic	Intermediate/ Basic
	Zone 3a	Intermediate/ Basic	Detailed	Detailed
	Zone 3b	Not appropriate development		
LESS VULNERABLE	Zone 2	Basic	Basic	Intermediate/ Basic
	Zone 3a	Basic	Basic	Detailed
	Zone 3b	Not appropriate development		
WATER COMPATIBLE	Zone 2	None		
	Zone 3a	Intermediate/ Basic		
	Zone 3b	Detailed		

Note: Where the table states 'not appropriate development', this is in line with national planning policy. If in exceptional circumstances such development types are proposed in these locations, we would expect a detailed modelling approach to be used.

NOTES:

- Non-Major: 1-9 dwellings/ less than 0.5 ha | Office / light industrial under 1ha | General industrial under 1 ha | Retail under 1 ha | Gypsy/traveller site between 0 and 9 pitches
- Small-Major: 10 to 30 dwellings | Office / light industrial 1ha to 5ha | General industrial 1ha to 5ha | Retail over 1ha to 5ha | Gypsy/traveller site over 10 to 30 pitches
- Large-Major: 30+ dwellings | Office / light industrial 5ha+ | General industrial 5ha+ | Retail 5ha+ | Gypsy/traveler site over 30+ pitches | any other development that creates a non-residential building or development over 1000 sq m.

The assessment approach should be agreed with the Environment Agency as part of pre-planning application discussions to avoid abortive work.

3) Specific local considerations

Where the Environment Agency and the applicant and / or their consultant has agreed that a 'basic' level of assessment is appropriate, the figures in Table B below can be used as a precautionary allowance for potential climate change impacts on peak 'design' (i.e. 1% annual probability) fluvial flood level rather than undertaking detailed modelling.

Table B – Local precautionary allowances for potential climate change impacts

Essex, Norfolk and Suffolk

Hydraulic Model (Watercourse)	Precautionary allowance (basic approach)
Blackwater & Brain - Blackwater between TL7520925623 and TL7820324314 Brain between TL7373323312 and TL7683821321	500mm
Other main rivers, tributaries and ordinary watercourses	For other main rivers, tributaries and ordinary watercourses that are not stated above, basic allowances have not been calculated. In this instance you can either: <ul style="list-style-type: none"> • If flow data is available you can request this data from us and can conduct an intermediate assessment yourself • Or alternatively, you can choose to undertake a Detailed Assessment and "perform detailed hydraulic modelling, through either re-running our hydraulic models (if available) or constructing a new model

Cambridgeshire and Bedfordshire

Watercourse / Model	Precautionary allowance (basic approach)
Alconbury Brook	600mm
River Kym	
Lower Ouse (Model Extent)	700mm
Mid Ouse (Cold Brayfield to Bromham – between SP9156852223 and TL0132950919)	700mm
Mid Ouse (East of Bedford to Roxton – between TL0791848903 and TL1618854543)	700mm
River Hiz and River Purwell	400mm
River Ivel	500mm
Pix Brook	450mm
Potton Brook	500mm
River Cam and tributaries (excluding the Cam Lodes and the Slade System)	450mm
Great Barford (ordinary watercourses)	500mm
Bromham (ordinary watercourse)	550mm

NOTES:

Urban areas excluded from the 'basic' approach: St Ives, Holywell, Godmanchester, Swavesey, Over, Bedford, Newport Pagnell, Buckingham and Leighton Buzzard. More detailed assessment of climate change allowances will need to be undertaken in these locations.

Use of these allowances will only be accepted after discussion with the Environment Agency.

4) Fluvial flood risk mitigation

For planning consultations where we are a statutory consultee and our [Flood risk standing](#) advice **does not** apply we use the following benchmarks to inform flood risk mitigation for different [vulnerability classifications](#). **These are a guide only. We strongly recommend you contact us at the pre-planning application stage to confirm this on a case by case basis.** For planning consultations where we are not a statutory consultee or our [Flood risk Standing advice](#) applies, we recommend that local planning authorities and developers use these benchmarks but we do not expect to be consulted.

- For development classed as **'essential infrastructure'** our benchmark for flood risk mitigation is for it to be designed to the **'higher central'** climate change allowance for the epoch that most closely represents the lifetime of the development, including decommissioning. Please note that nationally significant infrastructure projects (NSIPs) may also need to assess a **credible maximum climate change scenario** by applying the **'upper end'** allowance for peak river flow as a sensitivity test. This will help to determine how sensitive the development is to changes in the climate and to ensure that it can be adapted to large-scale climate change over its lifetime.
- For **highly vulnerable, more vulnerable, less vulnerable and water compatible** developments in flood zones 2 and 3a, the **'central'** climate change allowance is our minimum benchmark for flood risk mitigation. For large urban settlement extensions or developments that form new communities, the credible maximum climate change scenario must be assessed; in these circumstances, you should use the **'upper end'** allowance.
- For **water compatible** development in flood zone 3b, the **'central'** climate change allowance for the epoch that most closely represents the lifetime of the development is our minimum benchmark for flood risk mitigation.

For peak river flow allowances and a visual representation of the above, please see Tables 1 and 2 below.

Table 1 peak river flow allowances by Management Catchment (use 1961 to 1990 baseline)				
Management Catchment	Allowance category	Total potential change anticipated for '2020s' (2015 to 39)	Total potential change anticipated for '2050s' (2040 to 2069)	Total potential change anticipated for '2080s' (2070 to 2125)
Upper and Bedford Ouse	Upper end	24%	30%	58%
	Higher central	10%	11%	30%
	Central	5%	4%	19%
Cam and Ely Ouse	Upper End	21%	22%	45%
	Higher Central	7%	5%	19%
	Central	2%	-2%	9%
Old Bedford and Middle Level	Upper End	23%	22%	39%
	Higher central	9%	4%	15%
	Central	3%	-3%	6%
North West Norfolk	Upper End	30%	34%	57%
	Higher central	18%	18%	33%
	Central	13%	11%	23%
North Norfolk Rivers	Upper End	26%	27%	48%
	Higher central	13%	11%	24%
	Central	7%	4%	14%
Broadland Rivers	Upper End	27%	27%	44%
	Higher central	14%	10%	20%
	Central	8%	3%	11%
East Suffolk	Upper End	25%	29%	54%
	Higher central	13%	13%	29%
	Central	8%	7%	19%
Combined Essex	Upper End	27%	37%	72%
	Higher central	13%	16%	38%
	Central	7%	8%	25%

South Essex	Upper End	22%	27%	48%
	Higher central	11%	11%	26%
	Central	6%	5%	17%

If you are not sure which management catchment your site falls within, please use the guidance and link to the peak river flow map, which can be found at: <https://www.gov.uk/guidance/flood-risk-assessments-climate-change-allowances#peak-river-flow-allowances>

Table 2: Using peak river flow allowances for flood risk assessments					
Flood Zone	Essential Infrastructure	Highly Vulnerable	More Vulnerable	Less Vulnerable	Water Compatible
2	higher central ¹	central ²	central ²	central	central
3a	higher central ¹	X	central ²	central	central
3b	higher central ¹	X	X	X	central

X – Development should not be permitted
If (exceptionally) development is considered appropriate when not in accordance with flood zone vulnerability categories, then it would be appropriate to use the higher central allowance.

¹ For NSIPs, the ‘upper end’ allowance should be used to assess a credible maximum climate change scenario.

² For large urban settlement extensions or developments that form new communities, the credible maximum climate change scenario must be assessed. In these circumstances, you should use the ‘upper end’ allowance.

There may be circumstances where local evidence supports the use of other data or allowances. Where you think this is the case we may want to check this data and how you propose to use it.

Assessing off-site impacts and calculating floodplain compensation

The appropriate allowance to assess off-site impacts and calculation floodplain compensation requirements depends on the land uses in affected areas.

The ‘**central**’ allowance should be used in most cases. However, the ‘**higher central**’ allowance should be used when the affected area contains essential infrastructure.

5) Development in tidal flood risk areas

For flood risk assessments and strategic flood risk assessments, assess both the **higher central** and **upper end** allowances for all development vulnerability classes (see table 3 below).

For NSIPs and large urban settlement extensions or developments that form new communities, the **credible maximum climate change scenario** should be assessed (sea level rise and sensitivity test allowances for offshore wind speed and extreme wave height and storm surge uplift). To assess the flood risk from a high impact climate change scenario, you should use the H⁺⁺ allowance of 1.9m for the total sea level rise to 2100.

Table 3: sea level allowances for each epoch in mm for each year (based on a 1981 to 2000 baseline) – the total sea level risk for each epoch is in brackets

Area of England	Allowance	2000 to 2035 (mm)	2036 to 2065 (mm)	2066 to 2095 (mm)	2096 to 2125 (mm)	Cumulative rise 2000 to 2125 (metres)
Anglian	Higher central	5.8 (203)	8.7 (261)	11.6 (348)	13 (390)	1.20
Anglian	Upper end	7 (245)	11.3 (339)	15.8 (474)	18.1 (543)	1.60
South east	Higher central	5.7 (200)	8.7 (261)	11.6 (348)	13.1 (393)	1.20
South east	Upper end	6.9 (242)	11.3 (339)	15.8 (474)	18.2 (546)	1.60

6) Tidal flood risk mitigation

For planning consultations where we are a statutory consultee and our flood risk standing advice does not apply, we use the following benchmarks to inform flood risk mitigation for different [vulnerability classifications](#). **These are a guide only. We strongly recommend you contact us at the pre-planning application stage to confirm this on a case by case basis. Please note you may be charged for this advice.** For planning consultations where we are not a statutory consultee or our flood risk standing advice applies, we recommend that local planning authorities and developers use these benchmarks but we do not expect to be consulted.

- For development classed as essential Infrastructure, highly vulnerable development and more vulnerable development, our minimum benchmark for flood risk mitigation is the **‘upper end’** climate change allowance for the development lifetime (including decommissioning where relevant).
- For water compatible or less vulnerable development (e.g. commercial), our minimum benchmark for flood risk mitigation is the **‘higher central’** climate change allowance for the development lifetime. In sensitive locations it may be necessary to use the **‘upper end’** allowance to inform built in resilience.

If you are using our 2018 Coastal Flood Modelling Data outputs:

The **upper end** allowance become progressively higher each year than the climate change flood level outputs used in our current 2018 coastal flood model. So as an approximation we recommend that the following uplift values are added on to the on-site climate change flood levels provided in the Product 4:

- For development lifetimes extending to 2122, add 0.34m
- For development lifetimes extending to 2123, add 0.36m
- For development lifetimes extending to 2124, add 0.38m
- For development lifetimes extending to 2125, add 0.40m

If the proposed development is greater than 30 houses and the flood zone is in an open-coast location, we recommend that a more accurate impact of the increased upper end flood levels on the overtopping on-site flood levels is modelled by rerunning our coastal overtopping model with the new flood levels; you can obtain the model from us with a Product 6 and 7 request. If the site is located within a small or constrained tidal or coastal floodplain then regardless of the size of the development, you may also need to undertake remodelling of the flood levels to obtain an accurate assessment of the impacts of climate change; please contact us for advice (contact details in Section 8 below).

If you are using our Broads 2008 Flood Modelling Data outputs:

For the **upper end** allowance, please add the following uplift values onto the climate change flood levels provided in the Product 4:

- For development lifetimes extending to 2122, add 0.34m
- For development lifetimes extending to 2123, add 0.36m
- For development lifetimes extending to 2124, add 0.38m
- For development lifetimes extending to 2125, add 0.40m

If you are using our 2008 Thames Flood Modelling Data outputs:

Please add the appropriate climate change allowances for the South East River Basin District onto the present day flood levels obtained in the Product 4, starting from a base year of 2005. The allowances should be applied to the year appropriate to the respective development lifetime for residential or commercial developments.

**** note**:** *We anticipate that there will be updated flood modelling outputs available for the Thames Estuary in mid-2022. Developers preparing Flood Risk Assessments for developments in this area should check for availability of new data with the East Anglia (East) PSO team (contact details in Section 8 below).*

There may be circumstances where local evidence supports the use of other data or allowances. Where you think this is the case, we may want to check this data and how you propose to use it.

7) Assessment of climate change impacts for Surface Water Management

Please see the latest advice on the use of Peak Rainfall Intensity climate change allowances, which can be found here: <https://www.gov.uk/guidance/flood-risk-assessments-climate-change-allowances>

The Environment Agency is not a statutory consultee to the land use planning system for the consideration of surface water flood risk and management. We therefore recommend that you contact the relevant Lead Local Flood Authority (contact details listed below) to discuss Flood Risk Assessment requirements to support your development's surface water management proposals.

Cambridgeshire County Council - fr.planning@cambridgeshire.gov.uk
 Central Bedfordshire Council – floodrisk@centralbedfordshire.gov.uk
 Bedford Borough Council – floodrisk@bedford.gov.uk
 Milton Keynes Council – llfa@milton-keynes.gov.uk
 Buckinghamshire County Council - floodmanagement@buckscc.gov.uk
 Herts County Council - floodandwatermanagement@hertscc.gov.uk
 Northamptonshire County Council - floodandwater@northamptonshire.gov.uk
 Norfolk County Council – llfa@norfolk.gov.uk
 Suffolk County Council – floods@suffolk.gov.uk
 Essex County Council – suds@essex.gov.uk
 Thurrock Council – TransportDevelopment@thurrock.gov.uk
 Southend-on-Sea Council – llfa@southend.gov.uk

8) Our Service**Non-chargeable service**

We will give a free opinion on:

- What climate change allowance to apply to a particular development type
- Which technical approach is suitable in the FRA

Chargeable service:

- Review of climate change impacts using intermediate and detailed technical approaches (i.e. modelling review)
- Assessment and review of proposals for managed adaptation.

Contact Details


For East Anglia (Great Ouse Catchment): planning.brampton@environment-agency.gov.uk

For East Anglia (East): planning.ipswich@environment-agency.gov.uk

Appendix 1 – Further information on the Intermediate approach.

- 1) The methodology the chart is based on does not produce an accurate stage-discharge rating and is a simplified methodology for producing flood levels that can be applied in low risk small-scale development situations.
- 2) The method should not be applied where there is existing detailed modelled climate change outputs that use the new allowances. In such circumstances, the ‘with climate change’ modelled scenarios should be applied.

An example stage-discharge relationship is shown below.

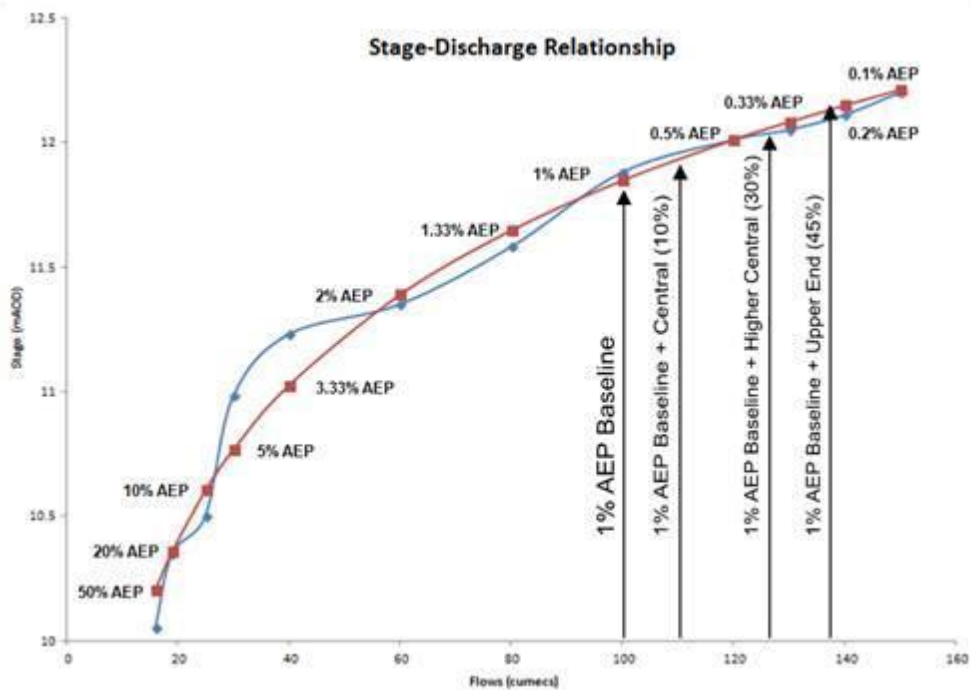

Modelled Node Point Locations centred on Tukes Way, Pleasant Valley, Saffron Walden, Uttlesford, Essex CB11 3ES


NGR TL5462637265
Ref 255032
Created 05/04/2022

Environment Agency
Bromholme Lane,
Brampton,
Cambridgeshire
PE28 4NE



Legend

- ★ Site
- ▲ Node Points selection
- Main river



Information

Model Tolerance - Any data included in this product is subject to a standard modelling tolerance of +/- 150mm. The fluvial models used to produce these results are intended for strategic scale use only.

Flood Risk Assessments - The Environment Agency recommends any Flood Risk Assessment should only consider these results in the context of a site specific assessment.


AEP - Annual Exceedance Probability - The probability of a given event occurring in any one year. Please note this is not a return period.

Strategic Scale Model - This model has been designed for catchment wide flood risk mapping. It should be noted that it was not created to produce flood levels for specific development sites within the catchment. Modelled outlines take into account catchment wide defences if present.

Copyright © Environment Agency copyright and / or database rights 2021. All rights reserved. © Crown Copyright and database right. All rights reserved. Environment Agency, 100026380, 2021.

Contact Us: National Customer Contact Centre, PO Box 544, Rotherham, S60 1BY Tel: 03708 506 506 (Mon-Fri 8-6). Email: enquiries@environment-agency.gov.uk

Ordnance Survey

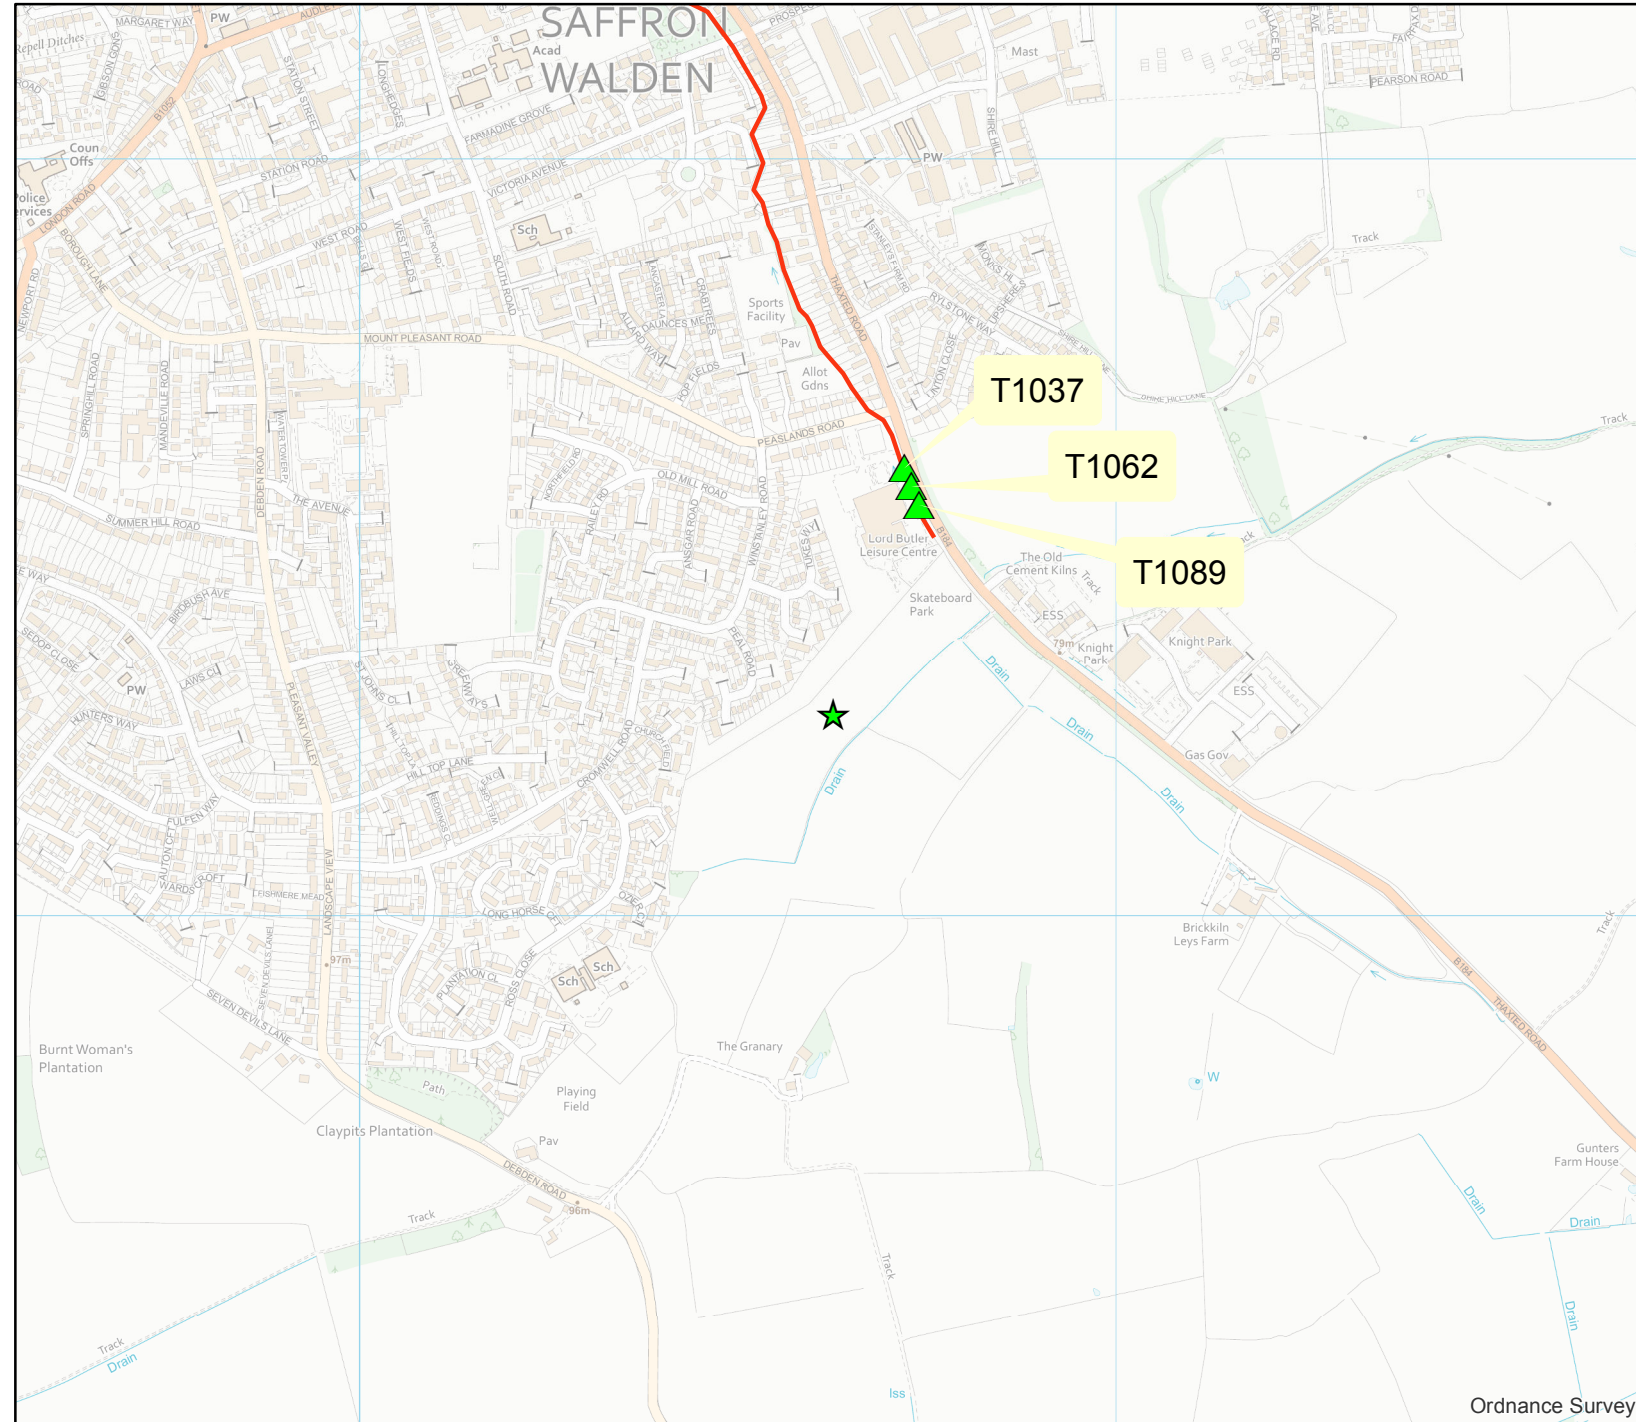



Datasheet - Product 4

05 April 2022

Reference Number	255032
Site	Tukes Way, Pleasant Valley, Saffron Walden, Uttlesford, Essex CB11 3ES
Customer	Tracey Mehew
NGR	TL5462637265

This datasheet provides supporting information for your Product 4. It will be clearly indicated if we are unable to provide information to fulfil any part of your request.

Model Summary

Model Name	Model Code
Cam Phase 2	EA052344
Cam Phase 2	EA052344

Important Information

The following information should be considered when using the material provided to fulfil this request.

Information

Limited Modelled Extents Provided	We have only provided a limited number of modelled flood extents for clarity. If you require further extents we will be happy to provide them.
Climate Change Allowances	The 1%+CC AEP flood level in the tables will be based on the 1% annual probability flood event including an additional 20% increase in peak flows to account for climate change impacts. Guidance on climate change allowances for the purpose of flood risk assessments is available on our website at https://www.gov.uk/guidance/flood-risk-assessments-climate-change-allowances . You may need to undertake further assessment / modelling of future flood risk using different climate change allowances to ensure your assessment of future flood risk is based on the best available evidence.
No Product 8 Data	Unfortunately we do not have any breach data at this location.

Modelled Water Levels and Flows

The following tables provide modelled in channel water level and flow values. Values are provided for Annual Exceedence Probability (AEP) events, which is the probability of a given event occurring in any one year. This is not a return period.

The fluvial models used to produce these results are intended for strategic scale use only.

If the tables show a value of -9999, this indicates that we have no level or flow data for that particular AEP or node point.

Level Data

Level values are measured in metres above Ordnance Datum (m aOD).

All level data included are subject to standard modelling tolerance of +/-150 millimetres.

Present Day Levels

Node	Model	Easting	Northing	20%	10%	5%	4%	2%	1.33%	1%	0.5%	0.1%
T1037	EA052344	554720	237591	70.95	71.02	71.09	71.12	71.2	71.26	71.3	71.38	71.51
T1062	EA052344	554729	237566	71.14	71.21	71.27	71.3	71.37	71.42	71.45	71.53	71.66
T1089	EA052344	554739	237542	71.27	71.34	71.4	71.42	71.5	71.54	71.58	71.66	71.81

Climate Change Levels

Node	Model	Easting	Northing	1%+20%cc	1%+25%cc	1%+35%cc	1%+65%cc	0.5%+20%cc	0.1%+20%cc
T1037	EA052344	554720	237591	71.39	-9999	-9999	-9999	-9999	-9999
T1062	EA052344	554729	237566	71.53	-9999	-9999	-9999	-9999	-9999
T1089	EA052344	554739	237542	71.66	-9999	-9999	-9999	-9999	-9999

Flow Data

Flow values are measured in cubic metres per second (cumecs - m³/s).

Present Day Flows

Node	Model	Easting	Northing	20%	10%	5%	4%	2%	1.33%	1%	0.5%	0.1%
T1037	EA052344	554720	237591	5.2	5.39	5.65	5.73	5.91	6	6.15	6.38	7.36
T1062	EA052344	554729	237566	5.2	5.39	5.65	5.73	5.91	6	6.15	6.38	7.36
T1089	EA052344	554739	237542	5.2	5.39	5.65	5.73	5.91	6	6.15	6.38	7.36

Climate Change Flows

Node	Model	Easting	Northing	1%+20%cc	1%+25%cc	1%+35%cc	1%+65%cc	0.5%+20%cc	0.1%+20%cc
T1037	EA052344	554720	237591	6.38	-9999	-9999	-9999	-9999	-9999
T1062	EA052344	554729	237566	6.38	-9999	-9999	-9999	-9999	-9999
T1089	EA052344	554739	237542	6.38	-9999	-9999	-9999	-9999	-9999

Recorded Flood Events

Where included, the Recorded Flood Event Outlines map provides an indication of areas which have flooded. Not all properties shown to be within the outline will have flooded.

Flood Event	Start	End	Source	Cause
None			N/A	We have no historic flood event information for this area. It is possible that other flooding may have occurred that we do not have records for, and other organisations such as: local authorities or IDBs may have records.

General Information

Flood Map for Planning (Rivers and Sea)

The Flood Map for Planning (Rivers and Sea) indicates the area at risk of flooding for a flood event with a 0.5% chance of occurring in any year for flooding from the sea, or a 1% chance of occurring in any year for fluvial (river) flooding (Flood Zone 3).

It also shows the extent of the Extreme Flood Outlines (Flood Zone 2) which represents the extent of a flood event with a 0.1% chance of occurring in any year, or the highest recorded historic extent if greater. The Flood Zones refer to the land at risk of flooding and do not refer to individual properties.

The Flood Map for Planning (Rivers and Sea) can be viewed and downloaded as a PDF file on GOV.UK by following this link: <https://flood-map-for-planning.service.gov.uk> or downloaded in GIS format under an open data licence from the following address: <https://data.gov.uk/publisher/environment-agency>

The Flood Map is updated on a quarterly basis to account for any amendments required.

Surface Water, Ordinary Watercourses and Groundwater Flooding

Lead Local Flood Authorities (LLFA) are responsible for managing local flood risk from ordinary watercourses, surface water flooding and groundwater flooding. You should check with the LLFA as they may have more up to date information regarding this type of flooding.

The Risk of Flooding from Surface Water Flood Map can be viewed and downloaded as a PDF file on GOV.UK by following this link: <https://flood-warning-information.service.gov.uk/long-term-flood-risk>

Information on how to reduce the impact of flooding from groundwater can be found online by the following link: <https://www.gov.uk/government/publications/flooding-from-groundwater>

Flooding from Reservoirs

The Risk of Flooding from Reservoirs Flood Map can be viewed and downloaded as a PDF file on GOV.UK by following this link: <https://flood-warning-information.service.gov.uk/long-term-flood-risk>

Sewer Flooding


Your local water company may have information on sewage flooding in your area of interest.

Areas Benefitting from Defences

Areas Benefitting from Defences show the area benefiting from defences from a 1 in 100 (1% AEP) year fluvial event or a 1 in 200 (0.5% AEP) tidal/coastal event.

The associated dataset can be downloaded in GIS from the following link: <https://data.gov.uk/dataset/flood-map-for-planning-rivers-and-sea-areas-benefiting-from-defences>

APPENDIX F - SITE WIDE SURFACE WATER DRAINAGE CALCULATIONS

Rolton Group		Page 1
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:27 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

STORM SEWER DESIGN by the Modified Rational Method

Design Criteria for Storm

Pipe Sizes STANDARD Manhole Sizes STANDARD

FSR Rainfall Model - England and Wales

Return Period (years)	100	PIMP (%)	100
M5-60 (mm)	20.000	Add Flow / Climate Change (%)	10
Ratio R	0.439	Minimum Backdrop Height (m)	0.000
Maximum Rainfall (mm/hr)	550	Maximum Backdrop Height (m)	0.000
Maximum Time of Concentration (mins)	30	Min Design Depth for Optimisation (m)	1.200
Foul Sewage (l/s/ha)	0.000	Min Vel for Auto Design only (m/s)	1.00
Volumetric Runoff Coeff.	1.000	Min Slope for Optimisation (1:X)	500

Designed with Level Soffits

Free Flowing Outfall Details for Storm

Outfall Pipe Number	Outfall Name	C. Level (m)	I. Level (m)	Min I. Level (m)	D,L (mm)	W (mm)
------------------------	-----------------	-----------------	-----------------	------------------------	-------------	-----------

S1.014	S	83.000	82.028	0.000	0	0
--------	---	--------	--------	-------	---	---


Simulation Criteria for Storm

Volumetric Runoff Coeff	1.000	Additional Flow - % of Total Flow	10.000
Areal Reduction Factor	1.000	MADD Factor * 10m ³ /ha Storage	0.000
Hot Start (mins)	0	Inlet Coefficient	0.800
Hot Start Level (mm)	0	Flow per Person per Day (l/per/day)	0.000
Manhole Headloss Coeff (Global)	0.500	Run Time (mins)	21600
Foul Sewage per hectare (l/s)	0.000	Output Interval (mins)	15

Number of Input Hydrographs	0	Number of Storage Structures	3
Number of Online Controls	3	Number of Time/Area Diagrams	0
Number of Offline Controls	0	Number of Real Time Controls	0

Synthetic Rainfall Details

Rainfall Model	FSR	Profile Type	Winter
Return Period (years)	100	Cv (Summer)	1.000
Region	England and Wales	Cv (Winter)	1.000
M5-60 (mm)	20.000	Storm Duration (mins)	8640
Ratio R	0.439		

Rolton Group		Page 2
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:27 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Online Controls for Storm

Hydro-Brake® Optimum Manhole: SSW5, DS/PN: S1.007, Volume (m³): 3.3

Unit Reference	MD-SHE-0065-2200-1400-2200
Design Head (m)	1.400
Design Flow (l/s)	2.2
Flush-Flo™	Calculated
Objective	Minimise upstream storage
Application	Surface
Sump Available	Yes
Diameter (mm)	65
Invert Level (m)	97.464
Minimum Outlet Pipe Diameter (mm)	100
Suggested Manhole Diameter (mm)	1200


Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.400	2.2
Flush-Flo™	0.284	1.8
Kick-Flo®	0.580	1.5
Mean Flow over Head Range	-	1.7

The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake® Optimum as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	1.5	1.200	2.0	3.000	3.1	7.000	4.6
0.200	1.8	1.400	2.2	3.500	3.3	7.500	4.8
0.300	1.8	1.600	2.3	4.000	3.6	8.000	4.9
0.400	1.8	1.800	2.5	4.500	3.8	8.500	5.1
0.500	1.7	2.000	2.6	5.000	4.0	9.000	5.2
0.600	1.5	2.200	2.7	5.500	4.1	9.500	5.3
0.800	1.7	2.400	2.8	6.000	4.3		
1.000	1.9	2.600	2.9	6.500	4.5		

Hydro-Brake® Optimum Manhole: SSW16, DS/PN: S3.005, Volume (m³): 2.8

Unit Reference	MD-SHE-0031-5000-1157-5000
Design Head (m)	1.157
Design Flow (l/s)	0.5
Flush-Flo™	Calculated
Objective	Minimise upstream storage
Application	Surface
Sump Available	Yes
Diameter (mm)	31
Invert Level (m)	96.098
Minimum Outlet Pipe Diameter (mm)	75
Suggested Manhole Diameter (mm)	1200

Rolton Group		Page 3
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:27 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Hydro-Brake® Optimum Manhole: SSW16, DS/PN: S3.005, Volume (m³): 2.8

Control Points	Head (m)	Flow (l/s)
Design Point (Calculated)	1.157	0.5
Flush-Flo™	0.138	0.3
Kick-Flo®	0.278	0.3
Mean Flow over Head Range	-	0.4


The hydrological calculations have been based on the Head/Discharge relationship for the Hydro-Brake® Optimum as specified. Should another type of control device other than a Hydro-Brake Optimum® be utilised then these storage routing calculations will be invalidated

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	0.3	1.200	0.5	3.000	0.8	7.000	1.1
0.200	0.3	1.400	0.5	3.500	0.8	7.500	1.2
0.300	0.3	1.600	0.6	4.000	0.9	8.000	1.2
0.400	0.3	1.800	0.6	4.500	0.9	8.500	1.2
0.500	0.3	2.000	0.6	5.000	1.0	9.000	1.3
0.600	0.4	2.200	0.7	5.500	1.0	9.500	1.3
0.800	0.4	2.400	0.7	6.000	1.0		
1.000	0.5	2.600	0.7	6.500	1.1		

Pump Manhole: SNo Outlet, DS/PN: S1.014, Volume (m³): 4.9

Invert Level (m) 82.037

Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)	Depth (m)	Flow (l/s)
0.100	0.0000	0.900	0.0000	1.700	0.0000	2.500	0.0000
0.200	0.0000	1.000	0.0000	1.800	0.0000	2.600	0.0000
0.300	0.0000	1.100	0.0000	1.900	0.0000	2.700	0.0000
0.400	0.0000	1.200	0.0000	2.000	0.0000	2.800	0.0000
0.500	0.0000	1.300	0.0000	2.100	0.0000	2.900	0.0000
0.600	0.0000	1.400	0.0000	2.200	0.0000	3.000	0.0000
0.700	0.0000	1.500	0.0000	2.300	0.0000		
0.800	0.0000	1.600	0.0000	2.400	0.0000		

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:27 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Storage Structures for Storm

Tank or Pond Manhole: SRP1, DS/PN: S1.005

Invert Level (m) 97.551

Depth (m)	Area (m ²)	Depth (m)	Area (m ²)
0.000	497.0	1.000	797.0

Tank or Pond Manhole: SRP2, DS/PN: S3.003

Invert Level (m) 96.272

Depth (m)	Area (m ²)	Depth (m)	Area (m ²)
0.000	280.0	1.000	587.0

Complex Manhole: SIP, DS/PN: S1.013

Cellular Storage


Invert Level (m) 80.000 Safety Factor 10.0
 Infiltration Coefficient Base (m/hr) 0.03600 Porosity 0.95
 Infiltration Coefficient Side (m/hr) 0.03600

Depth (m)	Area (m ²)	Inf. Area (m ²)	Depth (m)	Area (m ²)	Inf. Area (m ²)
0.000	537.0	537.0	1.500	537.0	676.0
0.500	537.0	583.0	2.000	537.0	722.0
1.000	537.0	629.0			

Infiltration Basin

Invert Level (m) 82.000 Safety Factor 10.0
 Infiltration Coefficient Base (m/hr) 0.03600 Porosity 1.00
 Infiltration Coefficient Side (m/hr) 0.03600

Depth (m)	Area (m ²)	Depth (m)	Area (m ²)
0.000	285.0	1.000	537.0

Rolton Group		Page 1
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 19:23 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor	1.000	Additional Flow - % of Total Flow	10.000
Hot Start (mins)	0	MADD Factor * 10m ³ /ha Storage	0.000
Hot Start Level (mm)	0	Inlet Coefficient	0.800
Manhole Headloss Coeff (Global)	0.500	Flow per Person per Day (l/per/day)	0.000
Foul Sewage per hectare (l/s)	0.000		

Number of Input Hydrographs	0	Number of Storage Structures	3
Number of Online Controls	3	Number of Time/Area Diagrams	0
Number of Offline Controls	0	Number of Real Time Controls	0

Synthetic Rainfall Details

Rainfall Model	FSR	Ratio R	0.439
Region	England and Wales	Cv (Summer)	1.000
M5-60 (mm)		20.000 Cv (Winter)	1.000

Margin for Flood Risk Warning (mm)	300.0
Analysis Timestep	2.5 Second Increment (Extended)
DTS Status	ON
DVD Status	OFF
Inertia Status	OFF

Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080
Return Period(s) (years)	1
Climate Change (%)	0

WARNING: Half Drain Time has not been calculated as the structure is too full.

PN	US/MH Name	Event	Water Surcharged Flooded				
			US/CL (m)	Level (m)	Depth (m)	Volume (m ³)	Overflow (l/s)
S1.000	SSW1	15 minute 1 year Summer I+0%	100.850	99.559	-0.166	0.000	
S1.001	SSW2	15 minute 1 year Summer I+0%	100.600	99.269	-0.206	0.000	
S2.000	SSW11	15 minute 1 year Summer I+0%	100.000	98.684	-0.191	0.000	
S2.001	SSW12	15 minute 1 year Summer I+0%	99.750	98.374	-0.251	0.000	
S2.002	SSW13	15 minute 1 year Summer I+0%	99.750	98.269	-0.254	0.000	
S1.002	SSW3	15 minute 1 year Summer I+0%	99.900	98.050	-0.314	0.000	
S1.003	SSW4	15 minute 1 year Summer I+0%	99.630	97.965	-0.365	0.000	
S1.004	SRP1 In	15 minute 1 year Summer I+0%	98.551	97.817	-0.308	0.000	
S1.005	SRP1	240 minute 1 year Winter I+0%	98.551	97.670	-0.406	0.000	
S1.006	SRP1 Out	360 minute 1 year Winter I+0%	98.551	97.671	-0.342	0.000	
S1.007	SSW5	240 minute 1 year Summer I+0%	98.551	97.672	-0.317	0.000	
S3.000	SSW14	15 minute 1 year Summer I+0%	98.500	97.218	-0.157	0.000	
S3.001	SSW15	15 minute 1 year Summer I+0%	98.000	96.678	-0.197	0.000	
S3.002	SRP2 In	15 minute 1 year Summer I+0%	98.000	96.468	-0.193	0.000	
S3.003	SRP2	1440 minute 1 year Winter I+0%	97.272	96.370	-0.203	0.000	


Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.000	SSW1	0.061	1.0		8.2	OK
S1.001	SSW2	0.102	1.5		27.2	OK
S2.000	SSW11	0.118	1.1		24.1	OK
S2.001	SSW12	0.211	0.9		29.4	OK
S2.002	SSW13	0.359	1.1		33.0	OK
S1.002	SSW3	0.408	0.7		60.3	OK
S1.003	SSW4	0.588	1.3		71.1	OK
S1.004	SRP1 In	0.541	0.8		70.7	OK
S1.005	SRP1	61.242	0.3		3.8	OK
S1.006	SRP1 Out	1.082	0.2		2.2	OK
S1.007	SSW5	0.684	0.3		1.8	OK
S3.000	SSW14	0.071	1.1		10.9	OK
S3.001	SSW15	0.113	0.9		20.0	OK
S3.002	SRP2 In	0.269	0.9		20.0	OK
S3.003	SRP2	28.831	0.4		6.0	OK

Summary of Critical Results by Maximum Level (Rank 1) for Storm


PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m ³)
S3.004	SRP2 Out	480 minute 1 year Winter I+0%	98.000	96.400	-0.082	0.000
S3.005	SSW16	1440 minute 1 year Winter I+0%	98.000	96.433	-0.040	0.000
S3.006	SSW17	15 minute 1 year Summer I+0%	96.850	95.888	-0.329	0.000
S4.000	SSW19	15 minute 1 year Summer I+0%	98.400	97.044	-0.106	0.000
S4.001	SSW20	15 minute 1 year Summer I+0%	97.250	96.790	-0.119	0.000
S3.007	SSW18	15 minute 1 year Summer I+0%	96.750	95.222	-0.328	0.000
S1.008	SSW6	15 minute 1 year Summer I+0%	95.750	94.568	-0.503	0.000
S5.000	SSW21	15 minute 1 year Summer I+0%	94.500	93.210	-0.165	0.000
S6.000	SSW24	15 minute 1 year Summer I+0%	96.000	94.730	-0.070	0.000
S5.001	SSW22	15 minute 1 year Summer I+0%	93.500	92.150	-0.150	0.000
S5.002	SSW23	15 minute 1 year Summer I+0%	92.500	91.097	-0.203	0.000
S1.009	SSW7	15 minute 1 year Summer I+0%	92.250	90.586	-0.464	0.000
S7.000	SSW25	15 minute 1 year Summer I+0%	94.250	92.984	-0.066	0.000
S7.001	SSW26	15 minute 1 year Summer I+0%	92.000	90.690	-0.110	0.000
S7.002	SSW30	15 minute 1 year Summer I+0%	91.000	89.569	-0.231	0.000
S7.003	SSW31	15 minute 1 year Summer I+0%	90.000	88.576	-0.224	0.000
S7.004	SSW32	15 minute 1 year Summer I+0%	89.500	88.069	-0.231	0.000
S1.010	SSW8	15 minute 1 year Summer I+0%	88.500	86.863	-0.437	0.000
S1.011	SSW9	15 minute 1 year Summer I+0%	86.750	85.116	-0.434	0.000
S8.000	SSW33	15 minute 1 year Summer I+0%	86.750	85.486	-0.139	0.000
S8.001	SSW34	15 minute 1 year Summer I+0%	86.750	85.318	-0.162	0.000
S8.002	SSW34	15 minute 1 year Summer I+0%	85.000	83.619	-0.256	0.000
S1.012	SSW10	15 minute 1 year Summer I+0%	85.000	83.334	-0.394	0.000
S1.013	SIP	4320 minute 1 year Winter I+0%	83.000	80.647	-2.228	0.000
S1.014	SNo Outlet	15 minute 1 year Summer I+0%	83.000	82.037	-0.825	0.000

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S3.004	SRP2 Out		0.976	0.2		3.6	OK
S3.005	SSW16		0.559	0.1		0.3	OK
S3.006	SSW17		0.129	0.7		5.2	OK
S4.000	SSW19		0.045	0.7		3.2	OK
S4.001	SSW20		0.043	1.9		4.8	OK
S3.007	SSW18		0.060	1.3		10.1	OK
S1.008	SSW6		0.030	1.9		10.7	OK
S5.000	SSW21		0.062	1.6		13.7	OK
S6.000	SSW24		0.028	1.7		3.2	OK
S5.001	SSW22		0.080	2.4		28.2	OK
S5.002	SSW23		0.104	1.4		28.0	OK
S1.009	SSW7		0.098	2.8		38.6	OK
S7.000	SSW25		0.033	1.9		4.4	OK
S7.001	SSW26		0.040	1.7		6.3	OK
S7.002	SSW30		0.073	1.7		21.4	OK
S7.003	SSW31		0.100	1.8		25.7	OK
S7.004	SSW32		0.085	2.3		27.5	OK
S1.010	SSW8		0.157	2.8		66.4	OK

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 19:23 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.011	SSW9		0.163	2.8		70.6	OK
S8.000	SSW33		0.091	1.0		14.1	OK
S8.001	SSW34		0.104	2.9		25.9	OK
S8.002	SSW34		0.163	1.0		29.8	OK
S1.012	SSW10		0.234	2.4		100.6	OK
S1.013	SIP		331.642	0.0		0.0	OK
S1.014	SNo Outlet		0.000	0.0		0.0	OK

Rolton Group		Page 1
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:18 File Southern SW Network 1 i...	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor	1.000	Additional Flow - % of Total Flow	10.000
Hot Start (mins)	0	MADD Factor * 10m ³ /ha Storage	0.000
Hot Start Level (mm)	0	Inlet Coefficient	0.800
Manhole Headloss Coeff (Global)	0.500	Flow per Person per Day (l/per/day)	0.000
Foul Sewage per hectare (l/s)	0.000		

Number of Input Hydrographs	0	Number of Storage Structures	3
Number of Online Controls	3	Number of Time/Area Diagrams	0
Number of Offline Controls	0	Number of Real Time Controls	0

Synthetic Rainfall Details

Rainfall Model	FSR	Ratio R	0.439
Region	England and Wales	Cv (Summer)	1.000
M5-60 (mm)		Cv (Winter)	1.000

Margin for Flood Risk Warning (mm)	300.0
Analysis Timestep	2.5 Second Increment (Extended)
DTS Status	ON
DVD Status	OFF
Inertia Status	OFF


Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080
Return Period(s) (years)	10
Climate Change (%)	0

WARNING: Half Drain Time has not been calculated as the structure is too full.

PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m ³)	Overflow (l/s)
S1.000	SSW1	15 minute 10 year Summer I+0%	100.850	99.584	-0.141	0.000	
S1.001	SSW2	15 minute 10 year Summer I+0%	100.600	99.327	-0.148	0.000	
S2.000	SSW11	15 minute 10 year Summer I+0%	100.000	98.735	-0.140	0.000	
S2.001	SSW12	15 minute 10 year Summer I+0%	99.750	98.435	-0.190	0.000	
S2.002	SSW13	15 minute 10 year Summer I+0%	99.750	98.332	-0.191	0.000	
S1.002	SSW3	15 minute 10 year Summer I+0%	99.900	98.181	-0.182	0.000	
S1.003	SSW4	15 minute 10 year Summer I+0%	99.630	98.056	-0.273	0.000	
S1.004	SRP1 In	15 minute 10 year Summer I+0%	98.551	97.959	-0.166	0.000	
S1.005	SRP1	360 minute 10 year Winter I+0%	98.551	97.783	-0.293	0.000	
S1.006	SRP1 Out	360 minute 10 year Winter I+0%	98.551	97.787	-0.226	0.000	
S1.007	SSW5	240 minute 10 year Winter I+0%	98.551	97.788	-0.201	0.000	
S3.000	SSW14	15 minute 10 year Summer I+0%	98.500	97.246	-0.129	0.000	
S3.001	SSW15	15 minute 10 year Summer I+0%	98.000	96.738	-0.137	0.000	
S3.002	SRP2 In	15 minute 10 year Summer I+0%	98.000	96.532	-0.129	0.000	
S3.003	SRP2	960 minute 10 year Winter I+0%	97.272	96.443	-0.130	0.000	

Summary of Critical Results by Maximum Level (Rank 1) for Storm


PN	US/MH Name	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.000	SSW1	0.089	1.2		15.9	OK
S1.001	SSW2	0.207	1.8		64.9	OK
S2.000	SSW11	0.175	1.2		46.6	OK
S2.001	SSW12	0.417	1.1		59.0	OK
S2.002	SSW13	0.705	1.3		67.6	OK
S1.002	SSW3	1.186	0.9		132.1	OK
S1.003	SSW4	1.139	1.6		158.3	OK
S1.004	SRP1 In	1.102	1.0		159.1	OK
S1.005	SRP1	123.884	0.3		9.4	OK
S1.006	SRP1 Out	2.318	0.2		6.8	OK
S1.007	SSW5	1.261	0.3		1.8	OK
S3.000	SSW14	0.103	1.3		21.0	OK
S3.001	SSW15	0.233	1.2		43.2	OK
S3.002	SRP2 In	0.703	1.1		43.8	OK
S3.003	SRP2	52.142	0.3		5.8	OK

Rolton Group		Page 3
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:18 File Southern SW Network 1 i...	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm


PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m ³)
S3.004	SRP2 Out	7200 minute 10 year Summer I+0%	98.000	96.509	0.027	0.000
S3.005	SSW16	7200 minute 10 year Summer I+0%	98.000	96.549	0.076	0.000
S3.006	SSW17	15 minute 10 year Summer I+0%	96.850	95.917	-0.301	0.000
S4.000	SSW19	15 minute 10 year Summer I+0%	98.400	97.063	-0.087	0.000
S4.001	SSW20	15 minute 10 year Summer I+0%	97.250	96.805	-0.104	0.000
S3.007	SSW18	15 minute 10 year Summer I+0%	96.750	95.249	-0.301	0.000
S1.008	SSW6	15 minute 10 year Summer I+0%	95.750	94.597	-0.474	0.000
S5.000	SSW21	15 minute 10 year Summer I+0%	94.500	93.236	-0.139	0.000
S6.000	SSW24	15 minute 10 year Summer I+0%	96.000	94.742	-0.058	0.000
S5.001	SSW22	15 minute 10 year Summer I+0%	93.500	92.192	-0.108	0.000
S5.002	SSW23	15 minute 10 year Summer I+0%	92.500	91.149	-0.151	0.000
S1.009	SSW7	15 minute 10 year Summer I+0%	92.250	90.615	-0.435	0.000
S7.000	SSW25	15 minute 10 year Summer I+0%	94.250	92.999	-0.051	0.000
S7.001	SSW26	15 minute 10 year Summer I+0%	92.000	90.710	-0.090	0.000
S7.002	SSW27	15 minute 10 year Summer I+0%	91.000	89.611	-0.189	0.000
S7.003	SSW28	15 minute 10 year Summer I+0%	90.000	88.624	-0.176	0.000
S7.004	SSW29	15 minute 10 year Summer I+0%	89.500	88.111	-0.189	0.000
S1.010	SSW8	15 minute 10 year Summer I+0%	88.500	86.911	-0.389	0.000
S1.011	SSW9	15 minute 10 year Summer I+0%	86.750	85.166	-0.384	0.000
S8.000	SSW30	15 minute 10 year Summer I+0%	86.750	85.526	-0.099	0.000
S8.001	SSW31	15 minute 10 year Summer I+0%	86.750	85.352	-0.128	0.000
S8.002	SSW32	15 minute 10 year Summer I+0%	85.000	83.687	-0.188	0.000
S1.012	SSW10	15 minute 10 year Summer I+0%	85.000	83.410	-0.318	0.000
S1.013	SIP	7200 minute 10 year Winter I+0%	83.000	81.132	-1.743	0.000
S1.014	SNo Outlet	15 minute 10 year Summer I+0%	83.000	82.037	-0.825	0.000

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S3.004	SRP2 Out		1.493	0.1		6.1	SURCHARGED
S3.005	SSW16		0.743	0.1		0.3	SURCHARGED
S3.006	SSW17		0.220	0.8		12.9	OK
S4.000	SSW19		0.066	0.9		6.1	OK
S4.001	SSW20		0.068	2.3		10.4	OK
S3.007	SSW18		0.099	1.5		23.1	OK
S1.008	SSW6		0.081	2.6		24.4	OK
S5.000	SSW21		0.091	1.9		26.4	OK
S6.000	SSW24		0.042	2.0		6.2	OK
S5.001	SSW22		0.132	3.0		61.6	OK
S5.002	SSW23		0.171	1.8		61.4	OK
S1.009	SSW7		0.151	3.5		84.2	OK
S7.000	SSW25		0.050	2.3		8.5	OK
S7.001	SSW26		0.062	2.0		13.3	OK
S7.002	SSW27		0.120	2.2		52.0	OK
S7.003	SSW28		0.184	2.3		63.3	OK
S7.004	SSW29		0.145	2.9		68.4	OK
S1.010	SSW8		0.264	3.5		151.4	OK

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:18 File Southern SW Network 1 i...	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.011	SSW9		0.276	3.5		161.3	OK
S8.000	SSW30		0.137	1.2		27.2	OK
S8.001	SSW31		0.164	3.5		57.5	OK
S8.002	SSW32		0.262	1.2		67.9	OK
S1.012	SSW10		0.406	2.9		228.7	OK
S1.013	SIP		580.500	0.0		0.0	OK
S1.014	SNo Outlet		0.000	0.0		0.0	OK

Rolton Group		Page 1
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 19:29 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor	1.000	Additional Flow - % of Total Flow	10.000
Hot Start (mins)	0	MADD Factor * 10m ³ /ha Storage	0.000
Hot Start Level (mm)	0	Inlet Coefficient	0.800
Manhole Headloss Coeff (Global)	0.500	Flow per Person per Day (l/per/day)	0.000
Foul Sewage per hectare (l/s)	0.000		

Number of Input Hydrographs	0	Number of Storage Structures	3
Number of Online Controls	3	Number of Time/Area Diagrams	0
Number of Offline Controls	0	Number of Real Time Controls	0

Synthetic Rainfall Details


Rainfall Model	FSR	Ratio R	0.439
Region	England and Wales	Cv (Summer)	1.000
M5-60 (mm)		Cv (Winter)	1.000

Margin for Flood Risk Warning (mm)	300.0
Analysis Timestep	2.5 Second Increment (Extended)
DTS Status	ON
DVD Status	OFF
Inertia Status	OFF

Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080
Return Period(s) (years)	30
Climate Change (%)	35

WARNING: Half Drain Time has not been calculated as the structure is too full.

PN	US/MH Name	Event	US/CL (m)	Water			Volume (m ³)
				Level (m)	Surcharged Depth (m)	Flooded	
S1.000	SSW1	15 minute 30 year Summer I+35%	100.850	99.614	-0.111	0.000	
S1.001	SSW2	15 minute 30 year Summer I+35%	100.600	99.393	-0.082	0.000	
S2.000	SSW11	15 minute 30 year Summer I+35%	100.000	98.807	-0.068	0.000	
S2.001	SSW12	15 minute 30 year Summer I+35%	99.750	98.531	-0.094	0.000	
S2.002	SSW13	15 minute 30 year Summer I+35%	99.750	98.470	-0.053	0.000	
S1.002	SSW3	15 minute 30 year Winter I+35%	99.900	98.364	0.000	0.000	
S1.003	SSW4	15 minute 30 year Summer I+35%	99.630	98.290	-0.040	0.000	
S1.004	SRP1 In	15 minute 30 year Summer I+35%	98.551	98.167	0.042	0.000	
S1.005	SRP1	720 minute 30 year Winter I+35%	98.551	97.980	-0.096	0.000	
S1.006	SRP1 Out	720 minute 30 year Winter I+35%	98.551	97.989	-0.025	0.000	
S1.007	SSW5	720 minute 30 year Winter I+35%	98.551	97.989	0.000	0.000	
S3.000	SSW14	15 minute 30 year Summer I+35%	98.500	97.283	-0.092	0.000	
S3.001	SSW15	15 minute 30 year Summer I+35%	98.000	96.815	-0.060	0.000	
S3.002	SRP2 In	15 minute 30 year Summer I+35%	98.000	96.626	-0.035	0.000	
S3.003	SRP2	2160 minute 30 year Winter I+35%	97.272	96.577	0.004	0.000	

Rolton Group		Page 2
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 19:29 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1


Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.000	SSW1		0.123	1.4		27.3	OK
S1.001	SSW2		0.355	2.0		111.2	OK
S2.000	SSW11		0.257	1.4		79.8	OK
S2.001	SSW12		1.036	1.2		101.2	OK
S2.002	SSW13		1.530	1.3		115.4	OK
S1.002	SSW3		2.749	0.9		203.0	OK
S1.003	SSW4		2.631	1.6		265.7	OK
S1.004	SRP1 In		1.888	1.2		264.6	SURCHARGED
S1.005	SRP1		241.292	0.3		5.8	OK
S1.006	SRP1 Out		4.448	0.2		3.2	OK
S1.007	SSW5		2.182	0.3		1.8	SURCHARGED
S3.000	SSW14		0.145	1.5		36.0	OK
S3.001	SSW15		0.441	1.3		73.9	OK
S3.002	SRP2 In		1.557	1.2		71.6	OK
S3.003	SRP2		98.674	0.3		9.2	SURCHARGED

Summary of Critical Results by Maximum Level (Rank 1) for Storm


PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m ³)
S3.004	SRP2 Out	2160 minute 30 year Winter I+35%	98.000	96.670	0.188	0.000
S3.005	SSW16	2160 minute 30 year Winter I+35%	98.000	96.687	0.213	0.000
S3.006	SSW17	15 minute 30 year Summer I+35%	96.850	95.938	-0.279	0.000
S4.000	SSW19	15 minute 30 year Summer I+35%	98.400	97.087	-0.063	0.000
S4.001	SSW20	15 minute 30 year Summer I+35%	97.250	96.820	-0.089	0.000
S3.007	SSW18	15 minute 30 year Summer I+35%	96.750	95.271	-0.279	0.000
S1.008	SSW6	15 minute 30 year Summer I+35%	95.750	94.609	-0.462	0.000
S5.000	SSW21	15 minute 30 year Summer I+35%	94.500	93.267	-0.108	0.000
S6.000	SSW24	15 minute 30 year Summer I+35%	96.000	94.758	-0.042	0.000
S5.001	SSW22	15 minute 30 year Summer I+35%	93.500	92.244	-0.056	0.000
S5.002	SSW23	15 minute 30 year Summer I+35%	92.500	91.213	-0.087	0.000
S1.009	SSW7	15 minute 30 year Summer I+35%	92.250	90.645	-0.405	0.000
S7.000	SSW25	15 minute 30 year Summer I+35%	94.250	93.020	-0.030	0.000
S7.001	SSW26	15 minute 30 year Summer I+35%	92.000	90.732	-0.068	0.000
S7.002	SSW30	15 minute 30 year Summer I+35%	91.000	89.651	-0.149	0.000
S7.003	SSW31	15 minute 30 year Summer I+35%	90.000	88.670	-0.130	0.000
S7.004	SSW32	15 minute 30 year Summer I+35%	89.500	88.152	-0.148	0.000
S1.010	SSW8	15 minute 30 year Summer I+35%	88.500	86.957	-0.343	0.000
S1.011	SSW9	15 minute 30 year Summer I+35%	86.750	85.213	-0.337	0.000
S8.000	SSW33	15 minute 30 year Summer I+35%	86.750	85.626	0.001	0.000
S8.001	SSW34	15 minute 30 year Summer I+35%	86.750	85.389	-0.091	0.000
S8.002	SSW34	15 minute 30 year Summer I+35%	85.000	83.765	-0.110	0.000
S1.012	SSW10	15 minute 30 year Summer I+35%	85.000	83.485	-0.243	0.000
S1.013	SIP	8640 minute 30 year Winter I+35%	83.000	82.009	-0.866	0.000
S1.014	SNo Outlet	15 minute 30 year Summer I+35%	83.000	82.037	-0.825	0.000

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S3.004	SRP2 Out		1.782	0.1		3.3	SURCHARGED
S3.005	SSW16		0.942	0.1		0.3	SURCHARGED
S3.006	SSW17		0.287	1.0		22.0	OK
S4.000	SSW19		0.093	1.0		10.5	OK
S4.001	SSW20		0.093	2.7		17.8	OK
S3.007	SSW18		0.130	1.8		39.7	OK
S1.008	SSW6		0.103	2.8		40.8	OK
S5.000	SSW21		0.127	2.2		45.3	OK
S6.000	SSW24		0.060	2.3		10.7	OK
S5.001	SSW22		0.212	3.3		105.6	OK
S5.002	SSW23		0.257	2.0		105.2	OK
S1.009	SSW7		0.203	4.0		144.8	OK
S7.000	SSW25		0.073	2.5		14.6	OK
S7.001	SSW26		0.087	2.3		22.7	OK
S7.002	SSW30		0.166	2.5		89.2	OK
S7.003	SSW31		0.289	2.6		108.5	OK
S7.004	SSW32		0.224	3.3		117.3	OK
S1.010	SSW8		0.371	4.0		260.3	OK

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 19:29 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m ³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.011	SSW9		0.388	4.1		276.0	OK
S8.000	SSW33		0.250	1.3		46.0	SURCHARGED
S8.001	SSW34		0.281	4.0		98.0	OK
S8.002	SSW34		0.382	1.4		116.0	OK
S1.012	SSW10		0.831	3.4		391.5	OK
S1.013	SIP		1032.639	0.0		0.0	OK
S1.014	SNo Outlet		0.000	0.0		0.0	OK

Rolton Group		Page 1
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 15/11/2022 16:26 File Southern SW Network.MDX	Designed by Bryan Hoadley Checked by	
Micro Drainage		Network 2020.1

Summary of Critical Results by Maximum Level (Rank 1) for Storm

Simulation Criteria

Areal Reduction Factor	1.000	Additional Flow - % of Total Flow	10.000
Hot Start (mins)	0	MADD Factor * 10m ³ /ha Storage	0.000
Hot Start Level (mm)	0	Inlet Coefficient	0.800
Manhole Headloss Coeff (Global)	0.500	Flow per Person per Day (l/per/day)	0.000
Foul Sewage per hectare (l/s)	0.000		

Number of Input Hydrographs	0	Number of Storage Structures	3
Number of Online Controls	3	Number of Time/Area Diagrams	0
Number of Offline Controls	0	Number of Real Time Controls	0

Synthetic Rainfall Details

Rainfall Model	FSR	Ratio R	0.439
Region	England and Wales	Cv (Summer)	1.000
M5-60 (mm)		Cv (Winter)	1.000

Margin for Flood Risk Warning (mm)	300.0
Analysis Timestep	2.5 Second Increment (Extended)
DTS Status	ON
DVD Status	OFF
Inertia Status	OFF

Profile(s)	Summer and Winter
Duration(s) (mins)	15, 30, 60, 120, 180, 240, 360, 480, 600, 720, 960, 1440, 2160, 2880, 4320, 5760, 7200, 8640, 10080
Return Period(s) (years)	100
Climate Change (%)	40

WARNING: Half Drain Time has not been calculated as the structure is too full.

PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m ³)
S1.000	SSW1	15 minute 100 year Summer I+40%	100.850	99.805	0.080	0.000
S1.001	SSW2	15 minute 100 year Summer I+40%	100.600	99.696	0.221	0.000
S2.000	SSW11	15 minute 100 year Summer I+40%	100.000	99.235	0.360	0.000
S2.001	SSW12	15 minute 100 year Summer I+40%	99.750	98.861	0.236	0.000
S2.002	SSW13	15 minute 100 year Summer I+40%	99.750	98.750	0.227	0.000
S1.002	SSW3	15 minute 100 year Summer I+40%	99.900	98.584	0.220	0.000
S1.003	SSW4	15 minute 100 year Summer I+40%	99.630	98.446	0.116	0.000
S1.004	SRP1 In	15 minute 100 year Summer I+40%	98.551	98.248	0.123	0.000
S1.005	SRP1	720 minute 100 year Winter I+40%	98.551	98.141	0.065	0.000
S1.006	SRP1 Out	720 minute 100 year Winter I+40%	98.551	98.444	0.430	0.000
S1.007	SSW5	720 minute 100 year Winter I+40%	98.551	98.494	0.505	0.000
S3.000	SSW14	15 minute 100 year Summer I+40%	98.500	97.416	0.041	0.000
S3.001	SSW15	15 minute 100 year Summer I+40%	98.000	97.048	0.173	0.000
S3.002	SRP2 In	15 minute 100 year Summer I+40%	98.000	96.717	0.056	0.000
S3.003	SRP2	1440 minute 100 year Summer I+40%	97.272	96.678	0.106	0.000

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.000	SSW1		0.340	1.4		38.4	SURCHARGED
S1.001	SSW2		1.277	2.1		142.9	SURCHARGED
S2.000	SSW11		0.741	1.5		104.6	SURCHARGED
S2.001	SSW12		3.276	1.2		127.9	SURCHARGED
S2.002	SSW13		2.300	1.3		143.6	SURCHARGED
S1.002	SSW3		3.672	1.3		282.5	SURCHARGED
S1.003	SSW4		3.184	1.6		336.5	SURCHARGED
S1.004	SRP1 In		2.106	1.6		334.1	SURCHARGED
S1.005	SRP1		345.577	0.4		40.7	SURCHARGED
S1.006	SRP1 Out		5.674	0.2		19.4	FLOOD RISK
S1.007	SSW5		3.181	0.3		1.8	FLOOD RISK
S3.000	SSW14		0.296	1.6		48.1	SURCHARGED
S3.001	SSW15		1.366	1.4		96.3	SURCHARGED
S3.002	SRP2 In		2.348	1.4		95.2	SURCHARGED
S3.003	SRP2		137.174	0.3		4.1	SURCHARGED

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Event	US/CL (m)	Water Level (m)	Surcharged Depth (m)	Flooded Volume (m³)
S3.004	SRP2 Out	1440 minute 100 year Summer I+40%	98.000	96.837	0.355	0.000
S3.005	SSW16	1440 minute 100 year Summer I+40%	98.000	96.865	0.392	0.000
S3.006	SSW17	15 minute 100 year Summer I+40%	96.850	95.955	-0.262	0.000
S4.000	SSW19	15 minute 100 year Summer I+40%	98.400	97.107	-0.043	0.000
S4.001	SSW20	15 minute 100 year Summer I+40%	97.250	96.831	-0.077	0.000
S3.007	SSW18	15 minute 100 year Summer I+40%	96.750	95.288	-0.262	0.000
S1.008	SSW6	15 minute 100 year Summer I+40%	95.750	94.618	-0.453	0.000
S5.000	SSW21	15 minute 100 year Summer I+40%	94.500	93.292	-0.083	0.000
S6.000	SSW24	15 minute 100 year Summer I+40%	96.000	94.771	-0.029	0.000
S5.001	SSW22	15 minute 100 year Summer I+40%	93.500	92.768	0.468	0.000
S5.002	SSW23	15 minute 100 year Summer I+40%	92.500	91.337	0.037	0.000
S1.009	SSW7	15 minute 100 year Summer I+40%	92.250	90.662	-0.388	0.000
S7.000	SSW25	15 minute 100 year Summer I+40%	94.250	93.210	0.160	0.000
S7.001	SSW26	15 minute 100 year Summer I+40%	92.000	90.746	-0.054	0.000
S7.002	SSW30	15 minute 100 year Summer I+40%	91.000	89.680	-0.120	0.000
S7.003	SSW31	15 minute 100 year Summer I+40%	90.000	88.707	-0.093	0.000
S7.004	SSW32	15 minute 100 year Summer I+40%	89.500	88.182	-0.118	0.000
S1.010	SSW8	15 minute 100 year Summer I+40%	88.500	86.987	-0.313	0.000
S1.011	SSW9	15 minute 100 year Summer I+40%	86.750	85.244	-0.306	0.000
S8.000	SSW33	15 minute 100 year Summer I+40%	86.750	85.749	0.124	0.000
S8.001	SSW34	15 minute 100 year Summer I+40%	86.750	85.422	-0.058	0.000
S8.002	SSW34	15 minute 100 year Summer I+40%	85.000	83.904	0.029	0.000
S1.012	SSW10	15 minute 100 year Summer I+40%	85.000	83.542	-0.187	0.000
S1.013	SIP 8640	minute 100 year Winter I+40%	83.000	82.348	-0.527	0.000
S1.014	SNo Outlet 8640	minute 100 year Winter I+40%	83.000	82.377	-0.485	0.000

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S3.004	SRP2 Out		2.021	0.1		1.5	SURCHARGED
S3.005	SSW16		1.197	0.1		0.4	SURCHARGED
S3.006	SSW17		0.388	1.1		29.4	OK
S4.000	SSW19		0.116	1.1		14.1	OK
S4.001	SSW20		0.112	2.9		24.0	OK
S3.007	SSW18		0.155	1.9		53.0	OK
S1.008	SSW6		0.119	3.1		54.6	OK
S5.000	SSW21		0.155	2.3		61.1	OK
S6.000	SSW24		0.075	2.4		14.4	OK
S5.001	SSW22		1.456	3.4		136.4	SURCHARGED
S5.002	SSW23		0.459	2.0		137.1	SURCHARGED
S1.009	SSW7		0.233	4.3		191.9	OK
S7.000	SSW25		0.289	2.6		18.4	SURCHARGED
S7.001	SSW26		0.104	2.5		29.1	OK
S7.002	SSW30		0.200	2.7		118.7	OK
S7.003	SSW31		0.375	2.8		144.8	OK
S7.004	SSW32		0.282	3.5		156.7	OK
S1.010	SSW8		0.446	4.2		340.2	OK

Summary of Critical Results by Maximum Level (Rank 1) for Storm

PN	US/MH Name	Overflow (l/s)	Maximum Vol (m³)	Maximum Velocity (m/s)	Half Drain Time (mins)	Pipe Flow (l/s)	Status
S1.011	SSW9		0.470	4.3		364.2	OK
S8.000	SSW33		0.389	1.6		62.5	SURCHARGED
S8.001	SSW34		0.394	4.2		132.5	OK
S8.002	SSW34		0.618	1.4		155.8	SURCHARGED
S1.012	SSW10		1.284	3.6		519.3	OK
S1.013	SIP		1316.570	0.0		3.3	OK
S1.014	SNo Outlet		1.492	0.0		0.0	OK

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 747 minutes.


Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
15 min Summer	76.702	0.252	2.3	91.2	Flood Risk
30 min Summer	76.745	0.295	2.3	120.5	Flood Risk
60 min Summer	76.786	0.336	2.3	148.9	Flood Risk
120 min Summer	76.823	0.373	2.3	174.5	Flood Risk
180 min Summer	76.841	0.391	2.3	187.0	Flood Risk
240 min Summer	76.852	0.402	2.3	194.0	Flood Risk
360 min Summer	76.861	0.411	2.3	200.2	Flood Risk
480 min Summer	76.863	0.413	2.3	202.1	Flood Risk
600 min Summer	76.862	0.412	2.3	201.2	Flood Risk
720 min Summer	76.859	0.409	2.3	198.9	Flood Risk
960 min Summer	76.852	0.402	2.3	194.3	Flood Risk
1440 min Summer	76.837	0.387	2.3	184.2	Flood Risk
2160 min Summer	76.814	0.364	2.3	168.1	Flood Risk
2880 min Summer	76.791	0.341	2.3	152.3	Flood Risk
4320 min Summer	76.750	0.300	2.3	124.1	Flood Risk
5760 min Summer	76.717	0.267	2.3	101.1	Flood Risk
7200 min Summer	76.691	0.241	2.3	83.8	O K
8640 min Summer	76.674	0.224	2.1	72.3	O K
10080 min Summer	76.659	0.209	2.0	62.9	O K
15 min Winter	76.702	0.252	2.3	91.3	Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
15 min Summer	142.716	0.0	26
30 min Summer	92.222	0.0	41
60 min Summer	56.713	0.0	70
120 min Summer	33.722	0.0	128
180 min Summer	24.576	0.0	188
240 min Summer	19.534	0.0	246
360 min Summer	14.061	0.0	364
480 min Summer	11.142	0.0	482
600 min Summer	9.297	0.0	600
720 min Summer	8.015	0.0	664
960 min Summer	6.338	0.0	770
1440 min Summer	4.546	0.0	1022
2160 min Summer	3.257	0.0	1428
2880 min Summer	2.568	0.0	1824
4320 min Summer	1.836	0.0	2600
5760 min Summer	1.445	0.0	3344
7200 min Summer	1.200	0.0	4040
8640 min Summer	1.031	0.0	4760
10080 min Summer	0.906	0.0	5456
15 min Winter	142.716	0.0	26

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	76.745	0.295	2.3	120.6	Flood Risk
60 min Winter	76.786	0.336	2.3	148.9	Flood Risk
120 min Winter	76.823	0.373	2.3	174.6	Flood Risk
180 min Winter	76.842	0.392	2.3	187.2	Flood Risk
240 min Winter	76.852	0.402	2.3	194.2	Flood Risk
360 min Winter	76.861	0.411	2.3	200.4	Flood Risk
480 min Winter	76.864	0.414	2.3	202.4	Flood Risk
600 min Winter	76.863	0.413	2.3	201.8	Flood Risk
720 min Winter	76.860	0.410	2.3	199.5	Flood Risk
960 min Winter	76.850	0.400	2.3	192.6	Flood Risk
1440 min Winter	76.831	0.381	2.3	179.8	Flood Risk
2160 min Winter	76.799	0.349	2.3	157.7	Flood Risk
2880 min Winter	76.767	0.317	2.3	135.9	Flood Risk
4320 min Winter	76.713	0.263	2.3	98.8	Flood Risk
5760 min Winter	76.679	0.229	2.2	75.1	O K
7200 min Winter	76.654	0.204	2.0	59.9	O K
8640 min Winter	76.634	0.184	1.8	48.6	O K
10080 min Winter	76.617	0.167	1.6	40.0	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	92.222	0.0	40
60 min Winter	56.713	0.0	68
120 min Winter	33.722	0.0	126
180 min Winter	24.576	0.0	184
240 min Winter	19.534	0.0	242
360 min Winter	14.061	0.0	356
480 min Winter	11.142	0.0	470
600 min Winter	9.297	0.0	580
720 min Winter	8.015	0.0	686
960 min Winter	6.338	0.0	790
1440 min Winter	4.546	0.0	1082
2160 min Winter	3.257	0.0	1524
2880 min Winter	2.568	0.0	1940
4320 min Winter	1.836	0.0	2692
5760 min Winter	1.445	0.0	3408
7200 min Winter	1.200	0.0	4120
8640 min Winter	1.031	0.0	4848
10080 min Winter	0.906	0.0	5552

Rolton Group		Page 3
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:39 File Western Catchment Model...	Designed by Bryan Hoadley Checked by	
Micro Drainage		Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	1.000
Region	England and Wales	Cv (Winter)	1.000
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.439	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.294

Time (mins) Area			Time (mins) Area			Time (mins) Area		
From:	To:	(ha)	From:	To:	(ha)	From:	To:	(ha)
0	4	0.098	4	8	0.098	8	12	0.098

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:39 File Western Catchment Model...	Designed by Bryan Hoadley Checked by	
Micro Drainage	Source Control 2020.1	

Model Details

Storage is Online Cover Level (m) 77.000

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.03600	Width (m)	47.9
Membrane Percolation (mm/hr)	1000	Length (m)	47.9
Max Percolation (l/s)	637.3	Slope (1:X)	200.0
Safety Factor	10.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	76.450	Cap Volume Depth (m)	0.420

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 795 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
15 min Summer	78.695	0.225	1.1	46.9	O K
30 min Summer	78.741	0.271	1.1	61.9	Flood Risk
60 min Summer	78.785	0.315	1.1	76.4	Flood Risk
120 min Summer	78.825	0.355	1.1	89.5	Flood Risk
180 min Summer	78.845	0.375	1.1	95.9	Flood Risk
240 min Summer	78.856	0.386	1.1	99.5	Flood Risk
360 min Summer	78.865	0.395	1.1	102.8	Flood Risk
480 min Summer	78.869	0.399	1.1	103.8	Flood Risk
600 min Summer	78.868	0.398	1.1	103.5	Flood Risk
720 min Summer	78.864	0.394	1.1	102.2	Flood Risk
960 min Summer	78.856	0.386	1.1	99.5	Flood Risk
1440 min Summer	78.839	0.369	1.1	93.9	Flood Risk
2160 min Summer	78.812	0.342	1.1	85.4	Flood Risk
2880 min Summer	78.787	0.317	1.1	77.1	Flood Risk
4320 min Summer	78.743	0.273	1.1	62.4	Flood Risk
5760 min Summer	78.705	0.235	1.1	50.1	Flood Risk
7200 min Summer	78.675	0.205	1.1	40.1	O K
8640 min Summer	78.651	0.181	1.1	32.4	O K
10080 min Summer	78.634	0.164	1.1	26.9	O K
15 min Winter	78.696	0.226	1.1	46.9	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
15 min Summer	142.716	0.0	26
30 min Summer	92.222	0.0	41
60 min Summer	56.713	0.0	70
120 min Summer	33.722	0.0	130
180 min Summer	24.576	0.0	188
240 min Summer	19.534	0.0	246
360 min Summer	14.061	0.0	364
480 min Summer	11.142	0.0	482
600 min Summer	9.297	0.0	602
720 min Summer	8.015	0.0	698
960 min Summer	6.338	0.0	798
1440 min Summer	4.546	0.0	1042
2160 min Summer	3.257	0.0	1448
2880 min Summer	2.568	0.0	1848
4320 min Summer	1.836	0.0	2640
5760 min Summer	1.445	0.0	3360
7200 min Summer	1.200	0.0	4104
8640 min Summer	1.031	0.0	4760
10080 min Summer	0.906	0.0	5440
15 min Winter	142.716	0.0	26

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	78.741	0.271	1.1	61.9	Flood Risk
60 min Winter	78.785	0.315	1.1	76.4	Flood Risk
120 min Winter	78.825	0.355	1.1	89.6	Flood Risk
180 min Winter	78.845	0.375	1.1	96.0	Flood Risk
240 min Winter	78.856	0.386	1.1	99.6	Flood Risk
360 min Winter	78.866	0.396	1.1	102.9	Flood Risk
480 min Winter	78.869	0.399	1.1	104.0	Flood Risk
600 min Winter	78.869	0.399	1.1	103.8	Flood Risk
720 min Winter	78.865	0.395	1.1	102.7	Flood Risk
960 min Winter	78.854	0.384	1.1	99.1	Flood Risk
1440 min Winter	78.833	0.363	1.1	92.0	Flood Risk
2160 min Winter	78.798	0.328	1.1	80.5	Flood Risk
2880 min Winter	78.763	0.293	1.1	69.1	Flood Risk
4320 min Winter	78.702	0.232	1.1	48.9	Flood Risk
5760 min Winter	78.655	0.185	1.1	33.7	O K
7200 min Winter	78.628	0.158	1.0	24.9	O K
8640 min Winter	78.611	0.141	0.9	19.9	O K
10080 min Winter	78.597	0.127	0.8	16.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	92.222	0.0	40
60 min Winter	56.713	0.0	70
120 min Winter	33.722	0.0	126
180 min Winter	24.576	0.0	184
240 min Winter	19.534	0.0	242
360 min Winter	14.061	0.0	358
480 min Winter	11.142	0.0	472
600 min Winter	9.297	0.0	582
720 min Winter	8.015	0.0	690
960 min Winter	6.338	0.0	884
1440 min Winter	4.546	0.0	1096
2160 min Winter	3.257	0.0	1540
2880 min Winter	2.568	0.0	1968
4320 min Winter	1.836	0.0	2764
5760 min Winter	1.445	0.0	3416
7200 min Winter	1.200	0.0	4048
8640 min Winter	1.031	0.0	4760
10080 min Winter	0.906	0.0	5456

The Charles Parker Building
 Midland Road
 Northants NN10 8DN



Date 14/11/2022 21:41
 File Central Catchment Model...

Designed by Bryan Hoadley
 Checked by

Micro Drainage Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	1.000
Region	England and Wales	Cv (Winter)	1.000
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.439	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.150

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From: To:	(ha)	From: To:	(ha)	From: To:	(ha)
0	4 0.050	4	8 0.050	8	12 0.050

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:41 File Central Catchment Model...	Designed by Bryan Hoadley Checked by	
Micro Drainage	Source Control 2020.1	

Model Details

Storage is Online Cover Level (m) 79.000

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.03600	Width (m)	33.1
Membrane Percolation (mm/hr)	1000	Length (m)	33.1
Max Percolation (l/s)	304.3	Slope (1:X)	200.0
Safety Factor	10.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	78.470	Cap Volume Depth (m)	0.400

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 719 minutes.

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
15 min Summer	77.706	0.256	2.6	100.2	Flood Risk
30 min Summer	77.747	0.297	2.6	132.4	Flood Risk
60 min Summer	77.787	0.337	2.6	163.6	Flood Risk
120 min Summer	77.823	0.373	2.6	191.8	Flood Risk
180 min Summer	77.841	0.391	2.6	205.5	Flood Risk
240 min Summer	77.850	0.400	2.6	213.0	Flood Risk
360 min Summer	77.859	0.409	2.6	219.6	Flood Risk
480 min Summer	77.861	0.411	2.6	221.5	Flood Risk
600 min Summer	77.860	0.410	2.6	220.3	Flood Risk
720 min Summer	77.857	0.407	2.6	217.8	Flood Risk
960 min Summer	77.850	0.400	2.6	212.9	Flood Risk
1440 min Summer	77.836	0.386	2.6	202.0	Flood Risk
2160 min Summer	77.814	0.364	2.6	184.2	Flood Risk
2880 min Summer	77.791	0.341	2.6	166.7	Flood Risk
4320 min Summer	77.751	0.301	2.6	135.8	Flood Risk
5760 min Summer	77.720	0.270	2.6	111.0	Flood Risk
7200 min Summer	77.697	0.247	2.5	93.7	O K
8640 min Summer	77.680	0.230	2.3	81.0	O K
10080 min Summer	77.665	0.215	2.2	70.6	O K
15 min Winter	77.706	0.256	2.6	100.2	Flood Risk

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
15 min Summer	142.716	0.0	26
30 min Summer	92.222	0.0	41
60 min Summer	56.713	0.0	70
120 min Summer	33.722	0.0	128
180 min Summer	24.576	0.0	188
240 min Summer	19.534	0.0	246
360 min Summer	14.061	0.0	364
480 min Summer	11.142	0.0	482
600 min Summer	9.297	0.0	600
720 min Summer	8.015	0.0	650
960 min Summer	6.338	0.0	764
1440 min Summer	4.546	0.0	1014
2160 min Summer	3.257	0.0	1416
2880 min Summer	2.568	0.0	1820
4320 min Summer	1.836	0.0	2596
5760 min Summer	1.445	0.0	3336
7200 min Summer	1.200	0.0	4040
8640 min Summer	1.031	0.0	4760
10080 min Summer	0.906	0.0	5456
15 min Winter	142.716	0.0	26

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	77.747	0.297	2.6	132.5	Flood Risk
60 min Winter	77.787	0.337	2.6	163.6	Flood Risk
120 min Winter	77.823	0.373	2.6	191.9	Flood Risk
180 min Winter	77.841	0.391	2.6	205.6	Flood Risk
240 min Winter	77.851	0.401	2.6	213.2	Flood Risk
360 min Winter	77.859	0.409	2.6	219.9	Flood Risk
480 min Winter	77.862	0.412	2.6	222.0	Flood Risk
600 min Winter	77.861	0.411	2.6	221.0	Flood Risk
720 min Winter	77.857	0.407	2.6	218.3	Flood Risk
960 min Winter	77.848	0.398	2.6	211.0	Flood Risk
1440 min Winter	77.830	0.380	2.6	196.7	Flood Risk
2160 min Winter	77.798	0.348	2.6	172.3	Flood Risk
2880 min Winter	77.768	0.318	2.6	148.4	Flood Risk
4320 min Winter	77.717	0.267	2.6	108.6	Flood Risk
5760 min Winter	77.685	0.235	2.4	84.3	O K
7200 min Winter	77.660	0.210	2.1	67.3	O K
8640 min Winter	77.639	0.189	1.9	54.7	O K
10080 min Winter	77.622	0.172	1.8	45.1	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	92.222	0.0	40
60 min Winter	56.713	0.0	68
120 min Winter	33.722	0.0	126
180 min Winter	24.576	0.0	184
240 min Winter	19.534	0.0	242
360 min Winter	14.061	0.0	356
480 min Winter	11.142	0.0	470
600 min Winter	9.297	0.0	578
720 min Winter	8.015	0.0	684
960 min Winter	6.338	0.0	778
1440 min Winter	4.546	0.0	1076
2160 min Winter	3.257	0.0	1516
2880 min Winter	2.568	0.0	1936
4320 min Winter	1.836	0.0	2684
5760 min Winter	1.445	0.0	3408
7200 min Winter	1.200	0.0	4176
8640 min Winter	1.031	0.0	4848
10080 min Winter	0.906	0.0	5552

The Charles Parker Building
 Midland Road
 Northants NN10 8DN



Date 14/11/2022 21:46
 File Eastern Catchment Model...

Designed by Bryan Hoadley
 Checked by

Micro Drainage Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	1.000
Region	England and Wales	Cv (Winter)	1.000
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.439	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.324

Time (mins)	Area	Time (mins)	Area	Time (mins)	Area
From:	To:	From:	To:	From:	To:
	(ha)		(ha)		(ha)
0	4	0.108	4	8	0.108
				8	12
					0.108

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:46 File Eastern Catchment Model...	Designed by Bryan Hoadley Checked by	
Micro Drainage	Source Control 2020.1	

Model Details

Storage is Online Cover Level (m) 78.000

Porous Car Park Structure

Infiltration Coefficient Base (m/hr)	0.03600	Width (m)	51.0
Membrane Percolation (mm/hr)	1000	Length (m)	51.0
Max Percolation (l/s)	722.5	Slope (1:X)	200.0
Safety Factor	10.0	Depression Storage (mm)	5
Porosity	0.30	Evaporation (mm/day)	3
Invert Level (m)	77.450	Cap Volume Depth (m)	0.420

Summary of Results for 100 year Return Period (+40%)

Half Drain Time : 653 minutes.


Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
15 min Summer	88.382	0.382	0.1	2.5	O K
30 min Summer	88.490	0.490	0.1	3.1	O K
60 min Summer	88.591	0.591	0.1	3.8	O K
120 min Summer	88.680	0.680	0.1	4.4	O K
180 min Summer	88.719	0.719	0.1	4.6	O K
240 min Summer	88.738	0.738	0.1	4.7	O K
360 min Summer	88.747	0.747	0.1	4.8	O K
480 min Summer	88.741	0.741	0.1	4.8	O K
600 min Summer	88.732	0.732	0.1	4.7	O K
720 min Summer	88.721	0.721	0.1	4.6	O K
960 min Summer	88.700	0.700	0.1	4.5	O K
1440 min Summer	88.656	0.656	0.1	4.2	O K
2160 min Summer	88.594	0.594	0.1	3.8	O K
2880 min Summer	88.541	0.541	0.1	3.5	O K
4320 min Summer	88.450	0.450	0.1	2.9	O K
5760 min Summer	88.375	0.375	0.1	2.4	O K
7200 min Summer	88.313	0.313	0.1	2.0	O K
8640 min Summer	88.261	0.261	0.0	1.7	O K
10080 min Summer	88.217	0.217	0.0	1.4	O K
15 min Winter	88.382	0.382	0.1	2.5	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
15 min Summer	142.716	0.0	19
30 min Summer	92.222	0.0	34
60 min Summer	56.713	0.0	64
120 min Summer	33.722	0.0	122
180 min Summer	24.576	0.0	182
240 min Summer	19.534	0.0	242
360 min Summer	14.061	0.0	360
480 min Summer	11.142	0.0	468
600 min Summer	9.297	0.0	518
720 min Summer	8.015	0.0	576
960 min Summer	6.338	0.0	702
1440 min Summer	4.546	0.0	980
2160 min Summer	3.257	0.0	1388
2880 min Summer	2.568	0.0	1792
4320 min Summer	1.836	0.0	2596
5760 min Summer	1.445	0.0	3352
7200 min Summer	1.200	0.0	4112
8640 min Summer	1.031	0.0	4848
10080 min Summer	0.906	0.0	5552
15 min Winter	142.716	0.0	19

Summary of Results for 100 year Return Period (+40%)

Storm Event	Max Level (m)	Max Depth (m)	Max Infiltration (l/s)	Max Volume (m ³)	Status
30 min Winter	88.490	0.490	0.1	3.1	O K
60 min Winter	88.592	0.592	0.1	3.8	O K
120 min Winter	88.681	0.681	0.1	4.4	O K
180 min Winter	88.721	0.721	0.1	4.6	O K
240 min Winter	88.741	0.741	0.1	4.8	O K
360 min Winter	88.752	0.752	0.1	4.8	O K
480 min Winter	88.749	0.749	0.1	4.8	O K
600 min Winter	88.738	0.738	0.1	4.7	O K
720 min Winter	88.724	0.724	0.1	4.6	O K
960 min Winter	88.700	0.700	0.1	4.5	O K
1440 min Winter	88.645	0.645	0.1	4.1	O K
2160 min Winter	88.564	0.564	0.1	3.6	O K
2880 min Winter	88.493	0.493	0.1	3.2	O K
4320 min Winter	88.374	0.374	0.1	2.4	O K
5760 min Winter	88.281	0.281	0.0	1.8	O K
7200 min Winter	88.207	0.207	0.0	1.3	O K
8640 min Winter	88.147	0.147	0.0	0.9	O K
10080 min Winter	88.101	0.101	0.0	0.6	O K

Storm Event	Rain (mm/hr)	Flooded Volume (m ³)	Time-Peak (mins)
30 min Winter	92.222	0.0	33
60 min Winter	56.713	0.0	62
120 min Winter	33.722	0.0	120
180 min Winter	24.576	0.0	178
240 min Winter	19.534	0.0	236
360 min Winter	14.061	0.0	350
480 min Winter	11.142	0.0	458
600 min Winter	9.297	0.0	560
720 min Winter	8.015	0.0	590
960 min Winter	6.338	0.0	734
1440 min Winter	4.546	0.0	1040
2160 min Winter	3.257	0.0	1492
2880 min Winter	2.568	0.0	1928
4320 min Winter	1.836	0.0	2728
5760 min Winter	1.445	0.0	3520
7200 min Winter	1.200	0.0	4256
8640 min Winter	1.031	0.0	5008
10080 min Winter	0.906	0.0	5648

Rolton Group		Page 3
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:34 File Plot Soakaway Calculati...	Designed by Bryan Hoadley Checked by	
Micro Drainage		Source Control 2020.1


Rainfall Details

Rainfall Model	FSR	Winter Storms	Yes
Return Period (years)	100	Cv (Summer)	1.000
Region	England and Wales	Cv (Winter)	1.000
M5-60 (mm)	20.000	Shortest Storm (mins)	15
Ratio R	0.439	Longest Storm (mins)	10080
Summer Storms	Yes	Climate Change %	+40

Time Area Diagram

Total Area (ha) 0.007

Time (mins)		Area
From:	To:	(ha)
0	4	0.007

Rolton Group		Page 4
The Charles Parker Building Midland Road Northants NN10 8DN		
Date 14/11/2022 21:34 File Plot Soakaway Calculati...	Designed by Bryan Hoadley Checked by	
Micro Drainage	Source Control 2020.1	

Model Details

Storage is Online Cover Level (m) 90.000

House Soakaway Structure

Infiltration Coefficient Base (m/hr) 0.03600	Pit Width (m) 2.600
Infiltration Coefficient Side (m/hr) 0.03600	Number Required 1
Safety Factor 2.0	Cap Volume Depth (m) 0.000
Porosity 0.95	Cap Infiltration Depth (m) 0.000
Invert Level (m) 88.000	

APPENDIX G - MAINTENANCE SCHEDULE

A maintenance company will be appointed to ensure that regular inspection of the drainage systems are carried out, the inspections are logged and any remedial work necessary at the time of inspection is completed to ensure continued satisfactory operation of the designed system.

PLANNED PREVENTATIVE MAINTENANCE

As a minimum the appointed maintenance company, should complete the following scope of works during the planned bi-annual preventative maintenance inspection for the following Surface Water features:

- Swales
- Permeable Paving
- Attenuation/Infiltration Tank
- Pond/Detention Basins
- Soakaways

SWALES

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY
Regular Maintenance	Remove litter including leaf litter and debris from swale surface, access chambers and pre-treatment devices	Monthly (or as required)
	Inspect swale surface, inlet/outlet pipework and control systems for blockages, clogging, standing water and structural damage	Monthly
	Inspect pre-treatment systems, inlets and perforated pipework for silt accumulation, and establish appropriate silt removal frequencies	Six monthly
	Remove sediment from pre-treatment devices	Six monthly, or as required
Occasional Maintenance	Remove or control tree roots where they are encroaching the sides of the swale, using recommended methods (eg NJUG, 2007 or BS 3998:2010)	As required
	At locations with high pollution loads, remove surface geotextile and replace, and wash or replace overlying filter medium	Five yearly, or as required
	Clear perforated pipework of blockages	As required

Prepared By:	Andrew Leadbetter	Date:	10.11.22	Verified By:	Bryan Hoadley	Date:	14.11.22
--------------	-------------------	-------	----------	--------------	---------------	-------	----------

PERMEABLE PAVING

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY
Regular Maintenance	Brushing and vacuuming (standard cosmetic sweep over whole surface)	Once a year, after autumn leaf fall, or reduced frequency as required, based on site-specific observations of clogging or manufacturers recommendations – pay particular attention to areas where water runs onto pervious surface from adjacent impermeable areas as this area is most likely to collect the most sediment
Occasional Maintenance	Stabilise and mow contributing and adjacent areas	As required
	Removal of weeds or management using glyphosate applied directly into the weeds by an applicator rather than spraying	As required – once per year on less frequently used pavements
Remedial Actions	Remediate any landscaping which, through vegetation maintenance or soil slip, has been raised to within 50mm of the level of the paving	As required
	Remedial work to any depressions, rutting and cracked or broken blocks considered detrimental to the structural performance or a hazard to users, and replace lost jointing material	As required
	Rehabilitation of surface and upper substructure by remedial sweeping	Every 10 to 15 years or as required
Monitoring	Initial inspection	Monthly for 3 months after installation
	Inspect for evidence of poor operation and/or weed growth – if required, take remedial action	Three-monthly, 48h after large storms in first six months
	Inspect silt accumulation rates and establish appropriate brushing frequencies	Annually
	Monitor inspection chambers	Annually

Prepared By:	Andrew Leadbetter	Date:	10.11.22	Verified By:	Bryan Hoadley	Date:	14.11.22
--------------	-------------------	-------	----------	--------------	---------------	-------	----------

ATTENUATION/INFILTRATION TANKS

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY
Regular Maintenance	Inspect and identify any areas that are not operating correctly. If required, take remedial action	Monthly for 3 months, then annually
	Remove debris from the catchment surface (where it may cause risks to performance)	Monthly
	For systems where rainfall infiltrates into the tank from above, check surface of filter for blockage by sediment, algae or other matter; remove and replace surface infiltration medium as necessary.	Annually
Remedial Action	Repair/rehabilitate inlets, outlet, overflows and vents	As required
Monitoring	Inspect/check all inlets, outlets, vents and overflows to ensure that they are in good condition and operating as designed	Annually
	Survey inside of tank for sediment build-up and remove if necessary	Every 5 years or as required

Prepared By:	Andrew Leadbetter	Date:	10.11.22	Verified By:	Bryan Hoadley	Date:	14.11.22
--------------	-------------------	-------	----------	--------------	---------------	-------	----------

INFILTRATION/DETENTION BASINS

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY
Regular Maintenance	Remove litter and debris	Monthly
	Cut grass – for spillways and access routes	Monthly (during growing season), or as required
	Cut grass – meadow grass in and around basin	Half yearly (spring – before nesting season, and autumn)
	Manage other vegetation and remove nuisance plants	Monthly (at start, then as required)
	Inspect inlets, outlets and overflows for blockages, and clear if required.	Monthly
	Inspect banksides, structures, pipework etc for evidence of physical damage	Monthly
	Inspect inlets and facility surface for silt accumulation. Establish appropriate silt removal frequencies.	Monthly (for first year), then annually or as required
	Check any penstocks and other mechanical devices	Annually
	Tidy all dead growth before start of growing season	Annually
	Remove sediment from inlets, outlet and forebay	Annually (or as required)
	Manage wetland plants in outlet pool – where provided	Annually (or as required)
	Occasional Maintenance	Reseed areas of poor vegetation growth
Prune and trim any trees and remove cuttings		Every 2 years, or as required
Remove sediment from inlets, outlets, forebay and main basin when required		Every 5 years, or as required (likely to be minimal requirements where effective upstream source control is provided)
Remedial Actions	Repair erosion or other damage by reseedling or re-turfing	As required
	Realignment of rip-rap	As required
	Repair/rehabilitation of inlets, outlets and overflows	As required
	Relevel uneven surfaces and reinstate design levels	As required

Prepared By:	Andrew Leadbetter	Date:	10.11.22	Verified By:	Bryan Hoadley	Date:	14.11.22
--------------	-------------------	-------	----------	--------------	---------------	-------	----------

SOAKAWAYS

MAINTENANCE SCHEDULE	REQUIRED ACTION	TYPICAL FREQUENCY
Regular Maintenance	Inspect for sediment and debris in pre-treatment components and floor of inspection tube or chamber and inside of concrete manhole rings	Annually
	Trimming any roots that may be causing blockages	Annually (or as required)
Occasional Maintenance	Remove sediment and debris from pre-treatment components and floor of inspection tube or chamber and inside of concrete manhole rings	As required, based on inspections
Remedial Actions	Reconstruct soakaway and/or replace or clean void fill, if performance deteriorates or failure occurs	As required
	Replacement of clogged geotextile (will require reconstruction of soakaway)	As required
Monitoring	Inspect silt traps and note rate of sediment accumulation	Monthly in the first year and then annually
	Check soakaway to ensure emptying is occurring	Annually

Prepared By:	Andrew Leadbetter	Date:	10.11.22	Verified By:	Bryan Hoadley	Date:	14.11.22
--------------	-------------------	-------	----------	--------------	---------------	-------	----------

APPENDIX H - LLFA CORRESPONDENCE REGARDING SW FLOODING FLOW ROUTE

Bryan Hoadley

From: Richard Atkins - Development and Flood Risk Officer
<[REDACTED]>
Sent: 02 February 2023 08:36
To: Bryan Hoadley
Subject: RE: Land South of Saffron Walden - Site Off Thaxted Road (Site 1) - Drainage and Flood Risk

Caution: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender.

Hi Bryan

Yes that approach would be acceptable

Regards

Richard


From: Bryan Hoadley <[REDACTED]>
Sent: 31 January 2023 10:13
To: Richard Atkins - Development and Flood Risk Officer <[REDACTED]>
Cc: Andrew Chisem <[REDACTED]>
Subject: RE: Land South of Saffron Walden - Site Off Thaxted Road (Site 1) - Drainage and Flood Risk

CAUTION: This is an external email.

Good morning Richard,


Thanks so much for coming back to me so quickly.

Apologies I didn't mention that in the email but yes, we would look to form a designed basin etc to the area to the south of the access junction (see below subject to detailed design and review) if this proposal was to go ahead to replace the natural low area would lose to the north of the road where water currently leaves the site boundary.

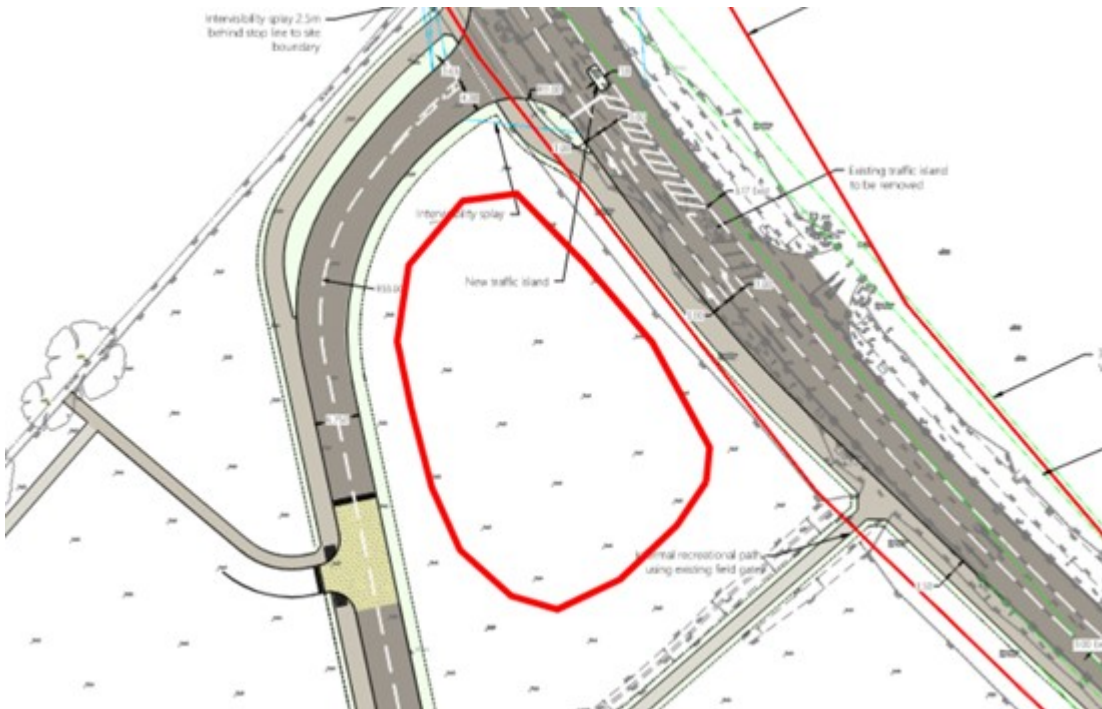

If we were to proceed with this, forming a basin as above and suggesting the surface water flooding flow route would be as per my previous email, would this be an acceptable approach to you? Obviously the points you provided regarding treatment etc would still be covered by any approach we take.

Kind regards

 **Bryan Hoadley**
Roltion Group | Senior Engineer
Direct [Redacted]
Web [Redacted]

From: Richard Atkins - Development and Flood Risk Officer <[Redacted]>
Sent: 31 January 2023 08:53
To: Bryan Hoadley <[Redacted]>
Subject: RE: Land South of Saffron Walden - Site Off Thaxted Road (Site 1) - Drainage and Flood Risk

Caution: This email originated from outside of the organisation. Do not click links or open attachments unless you recognise the sender.

Hi Bryan

Thank you for the information on the re-aligned access road.

I consider that the realignment would reduce the ability of the north west corner to retain water which I raised in my e-mail of 26/01/23, and I would suggest that you look at designing a formal infiltration basin or swale at this location, alongside the carriageway.

Regards

Richard

From: Bryan Hoadley <[REDACTED]>
Sent: 30 January 2023 14:51
To: Richard Atkins - Development and Flood Risk Officer [REDACTED]
Cc: Andrew Chisem <[REDACTED]>
Subject: Land South of Saffron Walden - Site Off Thaxted Road (Site 1) - Drainage and Flood Risk


CAUTION: This is an external email.

Good afternoon Richard,


I hope you are keeping well.

We have been informed that Essex County Highways are proposing an alternative site access to the proposed development and we are undertaking a high level review of the consequences of this, please see attached potential alternative arrangement.

Our previous drainage strategy (layout attached again for your ease) suggested that the surface water flooding flow route would be maintained from the south eastern boundary through to the northernmost corner of the site so as to not impede the existing flows, which, looking at the extract of the topo survey below does something along the lines of the flow arrows shown. Water builds up in the northernmost corner of the site until it overflows a small raised area along the boundary, and then flows onto the highway and along the road.

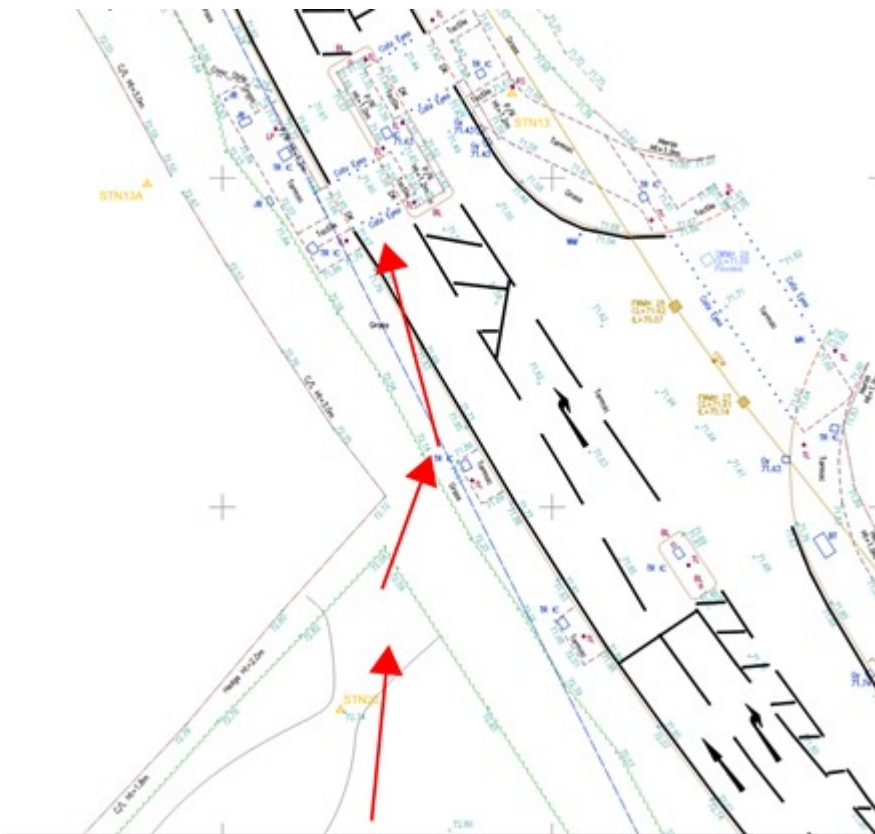

As a result of the potential new road alignment at the entrance, we would not have adequate space to the north of the road (along the boundary) to retain the existing ground levels and situation. Rather, any flood water would likely flow onto our entrance road, adjacent to Thaxted Road, and then flow onto Thaxted Road instead, see below for indicative flow arrows.

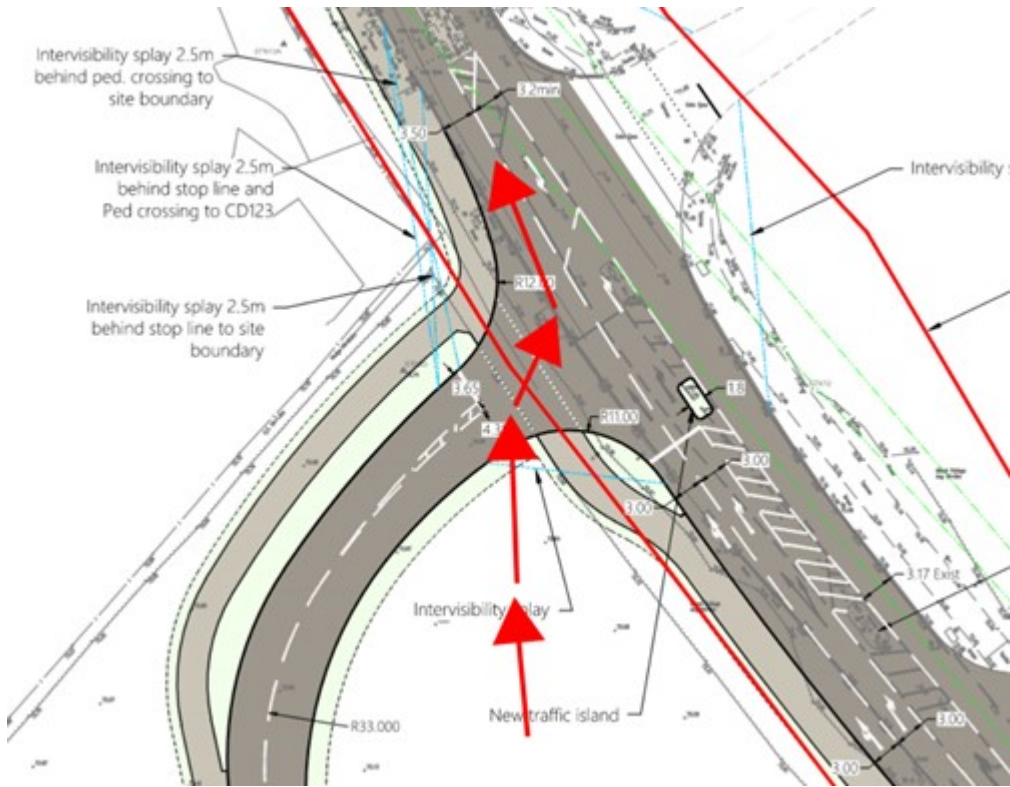


Could you please review this and let us know any thoughts you have on this potential change with relation to the surface water flooding or if you would accept what has been described above if this was to be adopted going forwards? Alternatively if you would like to have a call/teams meeting to discuss this please let us know and this can be arranged.

Kind regards

 **Bryan Hoadley**
Rolton Group | Senior Engineer

Direct + [redacted]
 Web [redacted]



Visit [redacted] for regular updates on company news and opinion pieces, follow us on Twitter at [@RoltonGroup](#) or on LinkedIn at [redacted]. This e-mail transmission is subject to the terms of the Rolton Group e-mail disclaimer. [redacted]

Visit [redacted] for regular updates on company news and opinion pieces, follow us on Twitter at [@RoltonGroup](#) or on LinkedIn at [redacted]. This e-mail transmission is subject to the terms of the Rolton Group e-mail disclaimer. [redacted]

IMPORTANT INFORMATION

THIS PAGE CONTAINS IMPORTANT INFORMATION ABOUT THE RIGHTS TO USE THIS DOCUMENT. IF YOU DO NOT ACCEPT THE FOLLOWING CONDITIONS FOR THE USE AND RELIANCE OF THIS DOCUMENT PLEASE RETURN IT TO THE AUTHOR OR TO THE MANAGING DIRECTOR OF ROLTON GROUP LTD BY RECORDED DELIVERY AND WITH COVERING LETTER.

DEFINITIONS

The Client: Kier Ventures

The Development: Land West of Thaxted Road, Saffron Walden

CONFIDENTIALITY

Rolton Group Ltd will keep confidential and not disclose to any person or use any confidential information or any technical operational administrative business information relating to the Client the Development or otherwise without the Client's prior written authority.

COPYRIGHT

All design rights and copyright and intellectual Property in this document and the referenced documents herein ("the Report") shall remain vested in Rolton Group Ltd and Rolton Group Ltd grants to the Client a royalty-free, non-exclusive licence to use and to reproduce the Report in full but not in part for all purposes relating to the Development including (without limitation) the construction completion reconstruction modification alteration maintenance reinstatement repair use letting sale promotion and advertisement thereof. Such licence shall not include a licence to reproduce the designs contained in the Report and shall not include a license for the Report to be modified in any way. The licence shall include the right without the consent of Rolton Group Ltd to assign the licence or grant a sub-licence to any person whatsoever provided that Rolton Group shall not be liable for any such use by the Client or any assignee or licensee for any purposes other than that for which the same were provided by Rolton Group.

INFORMATION PROVIDED BY OTHERS

Where copies of any documents information reports investigations findings and/or details of any preliminary works carried out in respect of the Development ("Other Documents") have been provided to Rolton Group Ltd by any party not limited to the Client then Rolton Group Ltd

has made full regard to the Other Documents when considering the findings designs and recommendations made by Rolton Group Ltd in the Report.

Unless specifically stated to be otherwise Rolton Group have relied on the Other Documents for the findings designs and recommendations in the Report and any errors or omissions in the Other Documents shall operate to exclude or limit the Rolton Group Ltd liability for any findings designs and recommendations in the Report unless such error or omission should reasonably have been identified by a properly qualified and competent consultant or person experienced in the provision of like services as those provided by Rolton Group Ltd for a Development of similar type size scope and complexity.

THIRD PARTY RIGHTS

By acceptance of this Report the Client confirms and Rolton Group Ltd agree that any contracts or agreements between Rolton Group Ltd and the Client shall not be enforceable under the Contracts (Rights of Third Parties) Act 1999 by any person not a party to them.

FREEDOM OF INFORMATION

Authorised or unauthorised copies of this document may come into the possession of organisations that are designated under the Freedom of Information Act 2000 ("the Act"). Such organisations that are designated in the Act are requested by Rolton Group to respect the above statements relating to confidentiality and copyright. It is possible that the disclosure of the information in the Report may be in breach of certain exceptions of the Act such as Part II Section 41, 42, 43. Rolton Group has invested and imparted substantial skill economic resources and labour in producing the Report and any disclosure shall prejudice the commercial interests of the Rolton Group Ltd. Where there are breaches of the exemption requirements of the Act by the disclosure of information in this Report then Rolton Group Ltd will pursue for legal recourse including for but not limited to recovery of losses and damages.

Rolton Group Limited, Registered in England No. 1547400.