

Appendix 5 ASHP data sheet

[Blank page]

CAHV-R450YA-HPB

Ecodan Air Source Heat Pump

The Mitsubishi Electric Ecodan **CAHV air source heat pump** uses low GWP R454C refrigerant, offering a robust, low carbon system for the provision of sanitary hot water and space heating. This innovative heat pump solution can operate as a single system or form part of a multiple unit system, making it suitable for most commercial applications.

The multiple unit system has the ability to cascade available units to both on and off mode to meet the load from a building. As an example of this unique modulation, a 16 unit system allows 0.5kW increments of capacity, from 7.8kW all the way up to 640kW*. With cascade and rotation built in as standard, the Ecodan CAHV system is perfectly suited to commercial applications including schools and hospitals.



*At nominal conditions A7W35

Key Features & Benefits:

- Low GWP R454C refrigerant and reduced embodied carbon helps achieve CSR targets
- Achieves 70°C outlet temperature down to -20°C ambient temperature for continuous heating provision
- Multiple unit cascade control from 7.8kW to 640kW capacity provides design flexibility for a wide range of commercial applications
- Water flow temperatures from 24°C to 70°C without boost heaters results in cost and energy savings
- Advanced heat exchange design combined with the properties of R454C refrigerant enables a shorter defrost time
- Low frequency compressor control improves energy efficiency and product operation
- Ability to rotate units based on accumulated run hours offers extended product life
- Requires only water and electrical connections, for ease of installation
- Hermetically-sealed monobloc design, requiring low maintenance



Commercial Heating Product Information

CAHV-R450YA-HPB Ecodan Air Source Heat Pump



MODEL		CAHV-R450YA-HPB	
Power source		3-phase 4-wire 380-400-415V 50/60 Hz	
Capacity(EN14511) ^{*1}		40	
	Power input	kW	14.03
	Current input	A	23.7-22.5-21.7
	COP (kW/kW)		2.85
	SCOP Low/Medium		3.57/3.24
Capacity ^{*2}		33.4	
	Power input	kW	16.6
	Current input	A	28.0-26.6-25.7
	COP (kW/kW)		2.01
Maximum current input		44.0-41.8-40.3	
Water pressure drop ^{*1}		10.2 kPa (1.47 psi)	
Temperature range ^{*5}	Outlet water temperature	24~70°C	
	Outdoor temperature	-25~43°C	
Circulating water volume range ^{*5}		25 l/min-250 l/min	
Sound pressure level (measured 1m below the unit in an anechoic room) ^{*1,4}		64	
Sound pressure level (measured 1m below the unit in an anechoic room) ^{*3,4}		72	
Water pipe diameter and type	Inlet	38.1 (1 1/2"), housing type joint	
	Outlet	38.1 (1 1/2"), housing type joint	
External finish		Acrylic painted steel sheet <Munsell 5Y 8/1 or similar>	
External dimensions H × W × D		1710 × 1750 × 740	
Net weight		359 (791)	
Design pressure	R454C	3.85	
	Water	1.0	
Heat exchanger	Water-side	Copper brazed stainless steel sheet	
	Air-side	Plate fins and copper tubes	
Compressor	Type	Inverter scroll hermetic compressor	
	Manufacturer	MITSUBISHI ELECTRIC CORPORATION	
	Starting method	Inverter	
	Motor output	12.1	
	Lubricant	FVC32EA	
Fan	Air flow rate	2500 × 2	
	External static pressure	10 Pa (1mm H ₂ O)	
	Type and quantity	Propeller fan × 2	
	Control and driving mechanism	Inverter control, direct driven by motor	
	Motor output	0.92 × 2	
HIC (Heat inter-changer) circuit		Copper pipe	
Protection devices	High pressure	High-pressure sensor and switch set at 3.85 MPa (643 psi)	
	Inverter circuit	Overheat and overcurrent protection	
	Compressor	Overheat protection	
	Fan motor	Thermal switch	
Defrosting method		Auto-defrost mode (Reversed refrigerant cycle)	
Refrigerant	Type and factory charge	R454C, 9.0 kg	
	Flow and temperature control	LEV and HIC circuit	

Notes:


*1 Under normal heating conditions at the outdoor temperature of 7°CDB/6°CWB, the outlet water temperature of 45°C, and the inlet water temperature of 40°C.

*2 Under normal heating conditions at the outdoor temperature of -5°CDB/-6°CWB and the outlet water temperature of 55°C.

*3 Under normal heating conditions at the outdoor temperature of 7°CDB/6°CWB when the unit is set to the "Capacity Priority" mode through the dry NC-contact.

*4 The sound pressure level is a value measured in an anechoic room in accordance with the conventional method in JRA4060.

*5

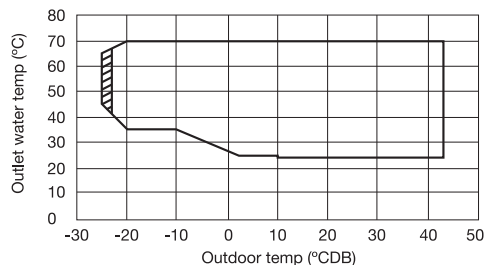


*6 4.0 - 15.0 m³/h under the following conditions:


- When the outdoor temperature is below 0°C,
- When the outlet water temperature is 30°C or below AND the outdoor temperature is 6°C or below.



CAHV-R450YA-HPB DIMENSIONS

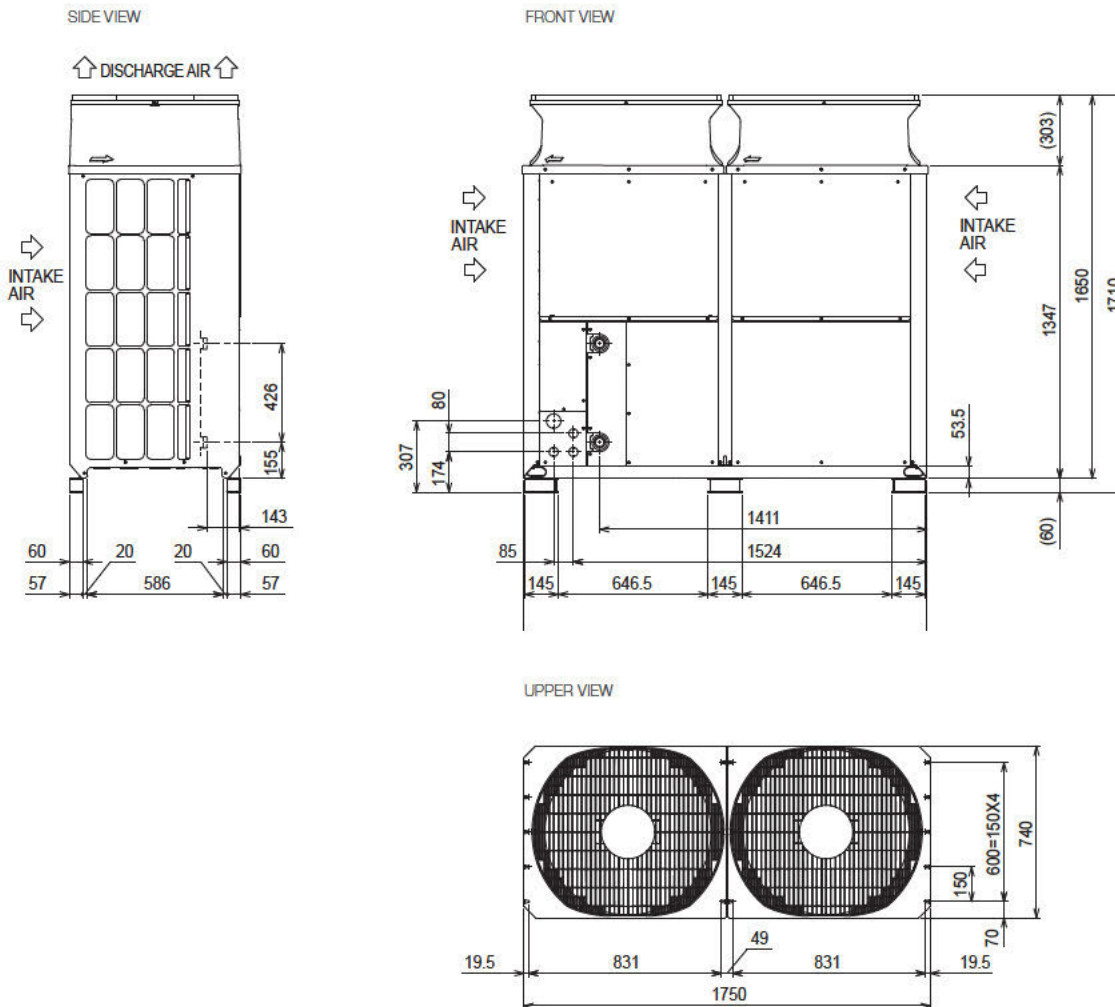

Telephone: 01707 282880
email: air.conditioning@meuk.mee.com



UNITED KINGDOM Mitsubishi Electric Europe Living Environment Systems Division, Travellers Lane, Hatfield, Hertfordshire, AL10 8XB, England. Telephone: 01707 282880 Fax: 01707 278881
IRELAND Mitsubishi Electric Europe, Westgate Business Park, Ballymount, Dublin 24, Ireland. Telephone: (01) 419 8800 Fax: (01) 419 8890 International code: (003531)

Country of origin: United Kingdom - Italy - Turkey - Japan - Thailand - Malaysia. ©Mitsubishi Electric Europe 2022. Mitsubishi and Mitsubishi Electric are trademarks of Mitsubishi Electric Europe B.V. The company reserves the right to make any variation in technical specification to the equipment described, or to withdraw or replace products without prior notification or public announcement. Mitsubishi Electric is constantly developing and improving its products. All descriptions, illustrations, drawings and specifications in this publication present only general particulars and shall not form part of any contract. All goods are supplied subject to the Company's General Conditions of Sale, a copy of which is available on request. Third-party product and brand names may be trademarks or registered trademarks of their respective owners.

Note: Refer to 'Installation Manual' and 'Instruction Book' for further 'Technical Information'. The fuse rating is for guidance only and please refer to the relevant databook for detailed specification. It is the responsibility of a qualified electrician/electrical engineer to select the correct cable size and fuse rating based on current regulation and site specific conditions. Mitsubishi Electric's air conditioning equipment and heat pump systems contain a fluorinated greenhouse gas, R410A (GWP:2088), R32 (GWP:675), R407C (GWP:1774), R134a (GWP:1430), R613A (GWP:631), R454B (GWP:466), R1234ze (GWP:7) or R1234yf (GWP:4). *These GWP values are based on Regulation (EU) No 517/2014 from IPCC 4th edition. In case of Regulation (EU) No.626/2011 from IPCC 3rd edition, these are as follows: R410A (GWP:1975), R32 (GWP:550), R407C (GWP:1650) or R134a (GWP:1300).

Effective as of November 2022





Architectural & Environmental Consultants

Noise | Vibration | Air Quality

This report has been prepared by Cass Allen Associates Ltd in accordance with the CDM regulations with all reasonable skill, care and diligence, and taking account of the resources devoted to it by agreement with the client. Information reported herein is based on the interpretation of data collected and has been accepted in good faith as being accurate and valid at the time of collection. This report is for the exclusive use of the client named above; no warranties or guarantees are expressed or should be inferred by any third parties. This report may not be relied upon by other parties without written consent from Cass Allen Associates Ltd. Cass Allen Associates Ltd disclaims any responsibility to the client and others in respect of any matters outside the agreed scope of work.



If you have any queries
with this report, please
[click here](#) to send us an
email and we will call you
back to discuss