


Orkney - Dounreay HVAC Link
<i>CFD Unit Name¹:</i>

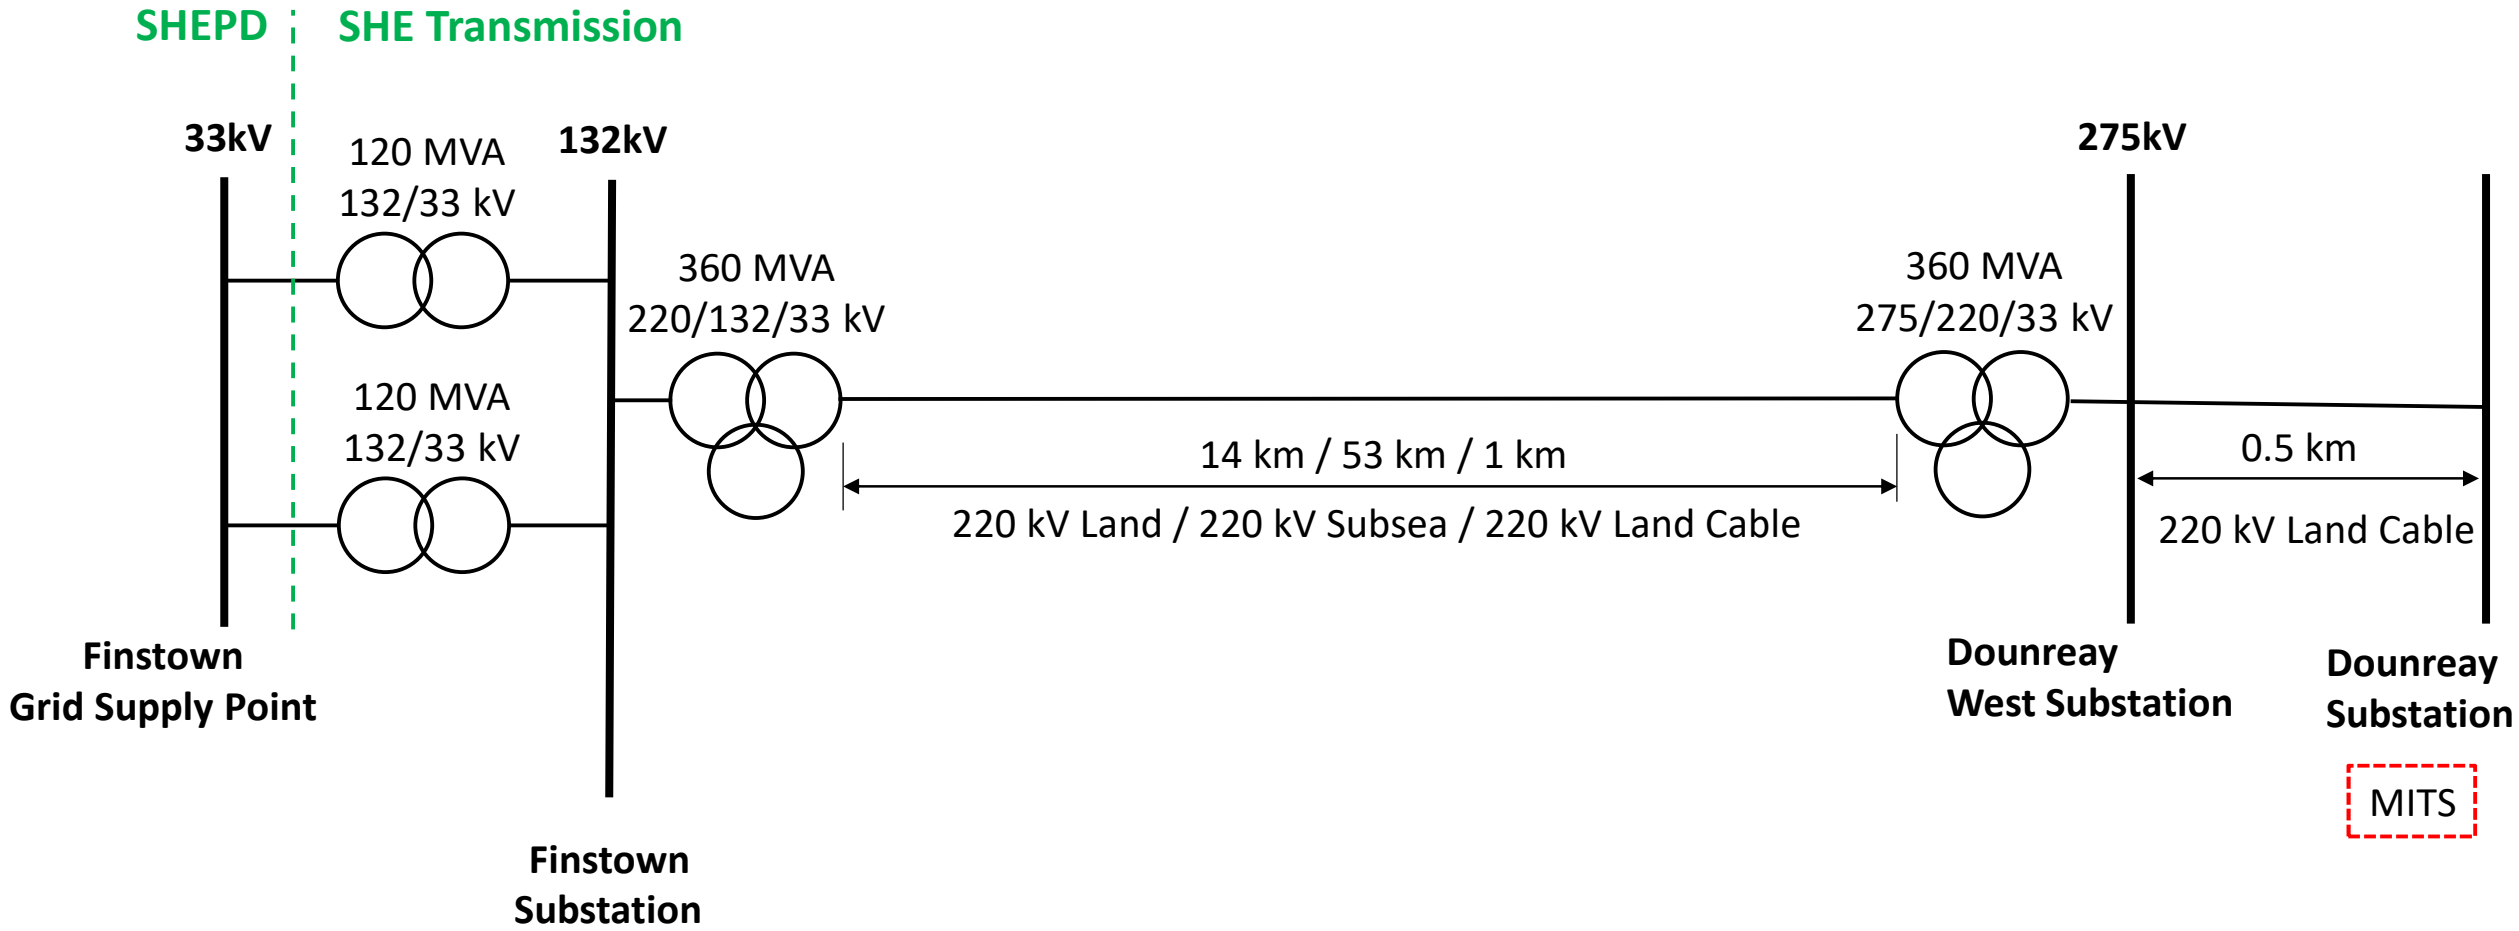

¹Please use the same CFD Unit Name as provided on the CFD application form.

Note: Exact switchgear and bus-bar arrangements simplified.